Sembcorp Myingyan Power Company Limited
Registration No. 103598974
Myanmar Centre Tower 1, 20th Floor, Unit 01/03
192 Kaba Aye Pagoda Road,
Bahan Township, Yangon, Myanmar
Tel: (95) 1-9345233 Fax: (95) 1-9345229
www.sembcorp.com

Our Ref: SMPC/MM/2026-035

28th April 2026

To:

Assistant Director
Department of Environmental Conservation
Ministry of Natural Resources and Environmental Conservation
Nyaung - U district
Nyaung - U.

SUBJECT: MYINGYAN IPP – Submission of 18th Environmental Management Plan and Greenhouse Gas Report for (October 2025 – March 2026)

Dear Sir,

1. On 23 April 2015, Sembcorp Utilities Pte. Ltd. ("**Sembcorp**"), a wholly owned subsidiary of Sembcorp Industries Limited, a company listed on the main board of the Singapore Exchange, was awarded a Notice of Award by the Myanmar Electric Power Enterprise (" **MEPE**"), a division under the Ministry of Electricity and Energy ("**MOEE**") (formerly known as Ministry of Electric Power) to develop and operate a 225-megawatt gas-fired power plant in central Myanmar under a 22-year power purchase agreement ("**Project**").
2. A Power Purchase Agreement (the "**PPA**") was signed on 29 March 2016 between the then MEPE and Sembcorp Myingyan Power Company Limited (the "**Company**"); the Company notes that Electric Power Generation Enterprise ("**EPGE**") has assumed all rights and contractual obligations of the then MEPE, including the PPA.
3. The Project is funded by multilateral development banks such as International Finance Corporation ("**IFC**") and Asian Development Bank ("**ADB**"), as well as several international commercial lenders and as such, an **Environmental and Social Impact Assessment ("ESIA")** was submitted in order to achieve **Environmental Compliance Certificate (ECC).**
4. In accordance with Clause 4 of the Approval Letter on ESIA released from Ministry of Natural Resources and Environmental Conservation (MONREC) dated 17th March 2017, we are pleased to submit our Air Quality Monitoring Report and Environmental Quality Monitoring Report. In accordance with the Clause 108 of Environmental Impact Assessment Procedure issued by MONREC, this data is taken on 6 months, and the attached report contains data for the period of October 2025 to March 2026.

Sembcorp Myingyan Power Company Limited
Registration No. 103598974
Myanmar Centre Tower 1, 20th Floor, Unit 01/03
192 Kaba Aye Pagoda Road,
Bahan Township, Yangon, Myanmar
Tel: (95) 1-9345233 Fax: (95) 1-9345229
www.sembcorp.com

5. Additionally, in accordance with Clause 109 of the Environmental Impact Assessment Procedure issued by (MONREC), the Company is pleased to submit its Environmental and Social Monitoring Plan (ESMP) checklists.

6. Should you have any queries, please do not hesitate to contact Mr. Zaw Moe Aung at zaw.moeaung@sembcorp.com or Mr. Aung Lwin Oo at aung.lwinoo@sembcorp.com. If you require any assistance from us, please do let us know. Thank you for your continued support on this matter.

Yours sincerely,



Yazar Myo Thein Managing
Director

Enclosures:

1. Stack Emission Monitoring (CEMS)Report
2. CMB Water Quality Monitoring Report
3. Air Quality Monitoring Report
4. Water Quality Monitoring Report
5. Soil Quality Monitoring Report
6. ESMP - Air Quality Management Checklist
7. ESMP - Emergency Preparedness & Response Management Monitoring Checklist
8. ESMP - Noise & Vibration Monitoring Checklist
9. ESMP - Occupational Health and Safety Control Measure Implementation & Monitoring Checklist
10. ESMP - Surface Water Management Monitoring Checklist
11. ESMP - Waste Management Monitoring Checklist
12. CSR activities

Sembcorp Myingyan Power Co., Ltd.

Stack Emission Report

Continuous Emission Monitoring System

Table of Contents

List of Tables ii

1. Introduction 2

2. Methodology 2

3. Sampling Location 3

4. Emission Monitoring Results 3

5. Appendix 4

6. Annex 1 - NO_x 5

7. Annex 2 - SO_2 29

8. Annex 3 - PM 53

List of Tables

Table 2.1 Emission Limits for Combustion Turbine.....1

Table 2.2 Equipment Used for Stack Emission Monitoring.....2

Table 3.1 Sampling Location 2

Table 4.1 Percentage of Operating Hours in Compliance (NO_x) 3

Table 4.2 Average hourly readings for the plant in the year 3

1. Introduction

Pursuant to paragraph 3(d) of the letter from MONREC dated 17th March 2017 (Ref: EIA/1/2 (478/2017)), we hereby submit this annual environmental monitoring report (Stack and Greenhouse Gas emission) for Sembcorp Myingyan Power Company Limited.

2. Methodology

The environmental monitoring of the emission concentration is done continuously through the Continuous Emission Monitoring System (CEMS). NO_x, SO_2, O_2 and PM are monitored, but only NO_x has emission limit for Natural Gas Fired Gas Turbine of ≥50MW.

Table 2.1 Emission Limits for Myingyan IPP


Combustion Technology / Fuel	Particulate Matter (PM)	Sulphur Dioxide (SO_2)	Nitrogen Oxides (NO_x)	Dry Gas, Excess O2 Content (%)
Natural Gas (all turbine types of Unit ≥ 50MW)	N/A	N/A	25ppm	15%

Source: National Environmental Quality Emission Guidelines

Pertaining to National Environmental Quality (Emission) Guidelines Chapter 1, Paragraph 7, the specified guideline should be achieved, without dilution, at least 95% of the time that a project is operating, to be calculated as a proportion of annual operating hours.

For the control of NOx, the gas turbines are equipped with dry low NOx burners. The bypass stacks are 30 meters high above ground, and the main stacks are 40 meters high above ground.

Table 2.2 Equipment Used for Stack Emission Monitoring

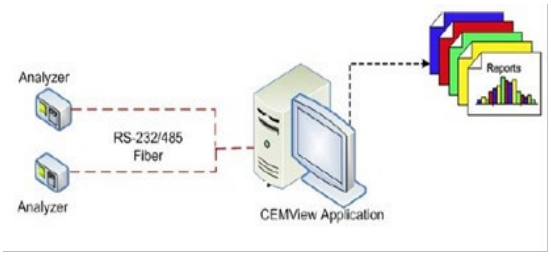Yokogawa NDIR Type Infrared Gas Analyzer O_2, SO_2 and NOx	
Durag, Opacity Analyzer Total Suspended Particulates, PM_{10} (TSP)	
Nexus, CEMView Data Acquisition and Reporting System for Continuous Emission Monitoring	

3. Sampling Locations

Continuous sampling during combined cycle operation is from the HRSG main stacks and from the HRSG bypass stacks during simple cycle operation.

Table 3.1 Sampling Location

Input Parameter	HRSG Main Stacks	HRSG Bypass Stacks	Remarks
Operation Mode	Combined Cycle	Simple Cycle	-
Number of Stacks	2	2	2 Gas Turbine Units, each has 1 main stack and 1 bypass stack
Stack Height (m above ground)	40	30	

4. Emission Monitoring Result

Pertaining to National Environmental Quality (Emission) Guidelines Chapter 1, Paragraph 7, the specified guideline shall be achieved, without dilution, at least 95% of the time that a project is operating, to be calculated as a proportion of annual operating hours. Myingyan IPP achieved 99.6%, which is above the guideline of at least 95%.

Table 4.1 Percentage of Operating Hours in Compliance (NO_x)

	Apr-25	May-25	Jun-25	Jul-25	Aug-25	Sept-25	Oct-25	Nov-25	Dec-25	Jan-26	Feb-26	Mar-26	YTD Average
% of Operating Hours In Compliance	99.6	100.0	99.7	99.7	100.0	98.9	99.4	99.7	100.0	99.8	99.4	99.0	99.6

The Carbon Dioxide emission for the year 2025 is 649,698.22 MT which is equivalent to a carbon intensity of 0.378 kg-CO_2/kWh-electricity.

Please refer to Annex 1 to 3 for the hourly CEMS readings of NOx, SO_2 and PM (Total Suspended Particulates) at GT1 and GT2. The average hourly readings for the plant in the year are:

Table 4.2 Average hourly readings for the plant in the year

	Average
NO_x (ppm)	17.18
SO_2 (ppm)	0.25
PM(mg/Nm^3)	11.69

Appendix

CEMS Cabinet (Identical for the 2 units)	
Analyzer Inside CEMS Cabinet (Identical for the 2 units)	

Annex-1

Unit 1 NO_x (ppmv) - April 2025

Time	1-Apr	2-Apr	3-Apr	4-Apr	5-Apr	6-Apr	7-Apr	8-Apr	9-Apr	10-Apr	11-Apr	12-Apr	13-Apr	14-Apr	15-Apr	Remarks
00:00 - 00:59	0.0	12.4	12.6	12.8	12.7	12.4	12.4	10.7	11.0	11.5	11.6	11.2	10.3	9.7	11.0	Compliant
01:00 - 01:59	0.0	12.4	12.6	12.6	12.7	12.4	12.5	10.7	11.0	11.5	11.6	11.2	10.2	9.7	11.0	Compliant
02:00 - 02:59	0.0	12.4	12.7	12.6	12.7	12.2	12.5	10.7	11.1	11.5	11.5	11.2	10.3	9.7	11.0	Compliant
03:00 - 03:59	0.0	12.6	12.7	12.6	12.7	12.2	12.6	10.8	11.1	11.6	11.5	11.2	10.3	10.0	11.0	Compliant
04:00 - 04:59	0.0	12.6	12.7	12.6	12.7	12.2	12.6	10.8	11.2	11.6	11.5	11.2	10.3	9.9	11.1	Compliant
05:00 - 05:59	0.0	12.6	12.8	12.6	12.8	12.2	12.7	10.8	11.3	11.6	11.6	11.2	10.4	9.8	11.0	Compliant
06:00 - 06:59	0.0	12.6	12.8	12.7	12.7	12.3	12.8	10.8	11.3	11.7	11.6	11.2	10.4	9.6	11.0	Compliant
07:00 - 07:59	0.0	12.6	12.8	12.7	12.7	12.4	12.8	10.7	11.3	11.7	11.7	11.2	10.4	9.7	11.1	Compliant
08:00 - 08:59	0.0	12.6	12.7	12.7	12.7	12.3	12.7	10.8	11.2	11.7	11.7	11.1	10.4	9.7	11.0	Compliant
09:00 - 09:59	0.0	12.6	12.6	12.6	12.6	12.1	6.4	10.7	11.3	11.6	11.6	11.0	10.2	4.5	10.9	Compliant
10:00 - 10:59	0.0	12.6	12.6	12.6	12.5	12.1	1.5	10.7	11.2	11.6	11.4	10.8	9.9	1.9	10.8	Compliant
11:00 - 11:59	0.0	12.7	12.6	12.7	12.7	12.1	8.6	10.8	11.2	11.6	11.3	10.9	9.8	9.0	10.6	Compliant
12:00 - 12:59	0.0	12.8	12.8	12.9	12.8	12.1	11.5	11.1	11.2	11.6	11.4	10.9	9.8	12.1	10.4	Compliant
13:00 - 13:59	0.0	13.0	13.1	13.0	13.0	12.1	11.7	11.4	11.3	11.6	11.5	10.9	9.8	12.4	10.5	Compliant
14:00 - 14:59	0.0	13.1	13.3	13.2	13.1	12.1	11.7	11.6	11.3	11.7	11.4	11.0	10.0	12.1	10.7	Compliant
15:00 - 15:59	0.0	13.3	13.5	13.3	13.1	12.1	11.6	11.6	11.3	11.8	11.4	11.2	10.1	11.5	10.8	Compliant
16:00 - 16:59	0.0	13.7	13.6	13.3	13.2	12.2	11.4	11.6	11.3	11.8	11.3	11.2	10.1	11.1	10.7	Compliant
17:00 - 17:59	0.0	13.6	13.8	13.3	13.2	12.2	11.2	11.5	11.4	11.9	11.2	11.1	10.2	11.1	10.8	Compliant
18:00 - 18:59	0.0	13.4	13.8	13.3	13.4	12.0	11.1	11.2	11.5	11.8	11.2	11.0	10.4	11.3	10.7	Compliant
19:00 - 19:59	0.0	13.1	13.5	13.4	13.3	12.0	10.8	11.1	11.5	11.7	11.3	10.9	10.6	11.1	10.6	Compliant
20:00 - 20:59	0.0	13.0	13.3	13.1	12.9	12.1	10.6	11.0	11.5	11.7	11.2	10.8	10.3	11.4	10.7	Compliant
21:00 - 21:59	0.0	12.7	13.1	12.9	12.5	12.3	10.6	11.0	11.5	11.6	11.3	10.6	9.8	11.2	10.5	Compliant
22:00 - 22:59	0.0	12.6	13.0	12.8	12.4	12.3	10.7	11.0	11.5	11.6	11.3	10.5	9.7	11.0	10.5	Compliant
23:00 - 23:59	11.5	12.6	12.8	12.7	12.4	12.4	10.7	11.0	11.5	11.6	11.2	10.4	9.7	11.1	10.4	Compliant

Time	16-Apr	17-Apr	18-Apr	19-Apr	20-Apr	21-Apr	22-Apr	23-Apr	24-Apr	25-Apr	26-Apr	27-Apr	28-Apr	29-Apr	30-Apr	Remarks
00:00 - 00:59	10.5	10.3	10.2	10.1	13.6	13.4	11.7	11.9	11.9	12.2	12.1	12.1	11.8	12.8	12.9	Compliant
01:00 - 01:59	10.3	10.6	10.1	10.2	13.5	13.5	11.6	11.7	11.8	12.1	12.1	12.1	11.8	12.7	13.0	Compliant
02:00 - 02:59	10.3	10.5	10.1	10.3	13.5	13.5	11.6	11.7	11.8	12.0	12.0	12.0	11.9	12.7	12.8	Compliant
03:00 - 03:59	10.4	10.5	10.2	10.2	13.5	13.5	11.6	11.7	11.7	12.0	12.0	11.9	11.8	12.8	12.8	Compliant
04:00 - 04:59	10.3	10.3	10.2	10.2	13.7	13.5	11.7	11.7	11.7	12.0	12.1	12.0	11.8	12.9	12.7	Compliant
05:00 - 05:59	10.3	10.1	10.2	10.3	13.8	13.5	11.7	11.8	11.7	12.1	12.2	12.1	11.8	12.9	12.6	Compliant
06:00 - 06:59	10.2	10.4	9.9	10.2	13.9	13.5	11.7	11.9	11.8	12.4	12.2	12.2	11.8	12.8	12.7	Compliant
07:00 - 07:59	10.4	10.7	10.1	10.3	14.1	13.4	11.7	12.1	11.9	12.4	12.2	12.3	11.8	12.9	12.7	Compliant
08:00 - 08:59	10.4	10.7	10.1	10.3	13.9	13.4	11.6	12.1	12.1	12.3	12.2	12.3	11.9	12.9	12.6	Compliant
09:00 - 09:59	10.3	10.5	9.9	10.2	13.9	2.5	11.5	12.1	11.9	12.2	12.0	12.2	11.9	12.9	12.5	Compliant
10:00 - 10:59	10.1	10.4	9.8	10.1	13.6	4.5	11.4	11.8	11.8	12.0	11.9	12.0	2.1	12.7	12.5	Compliant
11:00 - 11:59	10.0	10.2	9.9	9.6	13.5	12.7	11.5	11.8	12.1	12.1	12.0	12.1	11.8	12.5	12.4	Compliant
12:00 - 12:59	9.9	10.2	10.0	5.3	13.5	12.7	11.9	12.1	12.7	12.5	12.3	12.3	13.3	12.3	12.3	Compliant
13:00 - 13:59	10.3	10.3	10.4	0.2	13.7	12.7	12.2	12.5	13.3	13.0	12.6	12.6	13.4	12.5	12.1	Compliant
14:00 - 14:59	10.4	10.3	10.6	1.6	13.9	12.6	12.6	12.8	13.7	13.4	12.9	12.8	13.5	12.5	12.0	Compliant
15:00 - 15:59	10.4	10.3	10.8	0.5	13.9	12.6	13.0	12.9	13.9	13.5	13.1	12.9	13.7	12.5	11.9	Compliant
16:00 - 16:59	10.5	10.4	10.9	5.3	13.9	12.4	13.3	12.9	14.1	13.6	13.4	12.8	13.8	12.4	11.9	Compliant
17:00 - 17:59	10.3	10.3	11.0	14.4	13.9	12.2	13.5	12.9	14.1	13.6	13.5	12.8	13.8	12.3	11.9	Compliant
18:00 - 18:59	10.2	10.4	10.9	14.6	13.8	12.2	13.4	12.7	13.9	13.3	13.4	12.8	13.8	12.2	12.2	Compliant
19:00 - 19:59	10.2	10.4	10.7	14.3	13.8	12.2	13.2	12.7	13.6	13.0	13.2	12.6	13.6	12.1	12.5	Compliant
20:00 - 20:59	10.1	10.4	10.5	14.0	13.6	12.0	12.8	12.5	13.2	12.7	13.0	12.4	13.3	12.0	12.4	Compliant
21:00 - 21:59	10.1	10.3	10.5	13.8	13.6	11.8	12.5	12.3	12.8	12.4	12.7	12.2	13.1	12.0	12.4	Compliant
22:00 - 22:59	10.0	10.2	10.4	13.6	13.5	11.8	12.1	12.2	12.6	12.3	12.3	12.0	13.0	12.1	12.4	Compliant
23:00 - 23:59	10.0	10.0	10.1	13.5	13.4	11.7	12.0	12.1	12.3	12.2	12.1	11.8	12.9	12.6	12.3	Compliant

Unit 1 NO_x (ppmv) - May 2025

Time	1-May	2-May	3-May	4-May	5-May	6-May	7-May	8-May	9-May	10-May	11-May	12-May	13-May	14-May	15-May	Remarks
00:00 - 00:59	12.3	11.8	11.7	11.3	10.9	11.7	12.1	12.2	12.1	12.6	0.0	11.0	11.2	10.9	10.3	Compliant
01:00 - 01:59	12.3	12.0	11.7	11.3	11.0	11.8	12.1	12.2	12.1	12.6	0.0	11.1	11.1	11.1	10.4	Compliant
02:00 - 02:59	12.4	12.0	11.7	11.5	11.1	11.8	12.0	12.1	12.1	12.5	0.0	11.3	11.1	11.2	10.7	Compliant
03:00 - 03:59	12.3	11.9	11.7	11.7	11.1	11.8	12.0	12.1	12.0	12.6	0.0	11.4	11.0	11.1	10.7	Compliant
04:00 - 04:59	12.2	12.0	11.7	11.5	11.0	11.9	12.0	12.1	12.0	12.6	0.0	11.5	11.2	11.0	10.8	Compliant
05:00 - 05:59	12.1	12.0	11.6	11.7	11.1	11.8	12.1	12.2	11.9	12.5	0.0	11.3	11.2	10.9	11.0	Compliant
06:00 - 06:59	12.0	12.1	11.7	11.7	11.3	11.9	12.0	12.3	11.9	12.4	0.0	11.3	11.2	11.0	10.9	Compliant
07:00 - 07:59	12.2	12.0	11.5	11.7	11.3	11.9	12.0	12.3	11.7	12.1	0.0	11.4	11.1	11.0	10.8	Compliant
08:00 - 08:59	12.2	12.0	11.6	11.7	11.2	11.8	12.0	12.1	11.7	12.0	0.0	11.3	11.0	10.8	10.7	Compliant
09:00 - 09:59	12.1	12.0	11.6	11.6	11.0	11.7	11.9	11.8	11.5	12.0	0.0	11.4	10.9	10.8	10.6	Compliant
10:00 - 10:59	12.0	12.0	11.5	11.3	10.9	11.7	11.8	11.8	11.6	12.1	0.0	11.3	10.7	10.7	10.5	Compliant
11:00 - 11:59	11.9	12.0	11.4	11.1	1.9	11.7	11.9	12.0	11.8	12.3	0.0	0.3	10.3	10.4	10.2	Compliant
12:00 - 12:59	11.8	11.9	11.3	11.1	11.3	11.9	12.1	12.2	12.1	12.1	0.0	6.4	10.4	10.3	10.2	Compliant
13:00 - 13:59	11.9	11.8	11.3	11.2	12.8	12.2	12.3	12.6	12.4	13.4	0.0	12.6	10.5	10.3	10.3	Compliant
14:00 - 14:59	11.9	11.7	11.5	11.3	12.7	12.5	12.6	12.9	12.9	0.0	0.0	12.3	10.7	10.6	10.4	Compliant
15:00 - 15:59	12.0	11.7	11.5	11.3	12.5	12.6	12.7	13.1	13.2	0.0	0.0	11.9	10.8	10.6	10.6	Compliant
16:00 - 16:59	12.1	11.8	11.5	11.3	12.5	12.7	12.8	13.1	13.3	0.0	0.0	11.7	10.9	10.5	10.7	Compliant
17:00 - 17:59	12.1	11.7	11.6	11.2	12.3	12.7	12.9	13.1	13.4	0.0	0.0	11.6	10.9	10.5	10.8	Compliant
18:00 - 18:59	12.0	11.7	11.4	11.2	12.3	12.6	12.9	13.1	13.2	0.0	0.0	11.5	10.9	10.6	10.7	Compliant
19:00 - 19:59	12.0	11.7	11.4	11.1	12.1	12.6	12.8	13.0	13.1	0.0	0.0	11.5	11.1	10.9	11.0	Compliant
20:00 - 20:59	11.9	11.7	11.3	11.0	12.0	12.5	12.7	12.8	13.0	0.0	0.0	11.3	11.2	10.7	11.1	Compliant
21:00 - 21:59	11.8	11.7	11.3	11.0	11.9	12.2	12.6	12.6	12.9	0.0	0.0	11.2	11.0	10.5	11.0	Compliant
22:00 - 22:59	11.8	11.8	11.4	10.9	11.9	12.1	12.5	12.4	12.8	0.0	10.1	11.1	11.1	10.3	10.8	Compliant
23:00 - 23:59	11.8	11.8	11.4	10.9	11.8	12.1	12.2	12.2	12.7	0.0	10.9	11.1	10.8	10.1	10.7	Compliant

Time	16-May	17-May	18-May	19-May	20-May	21-May	22-May	23-May	24-May	25-May	26-May	27-May	28-May	29-May	30-May	31-May	Remarks
00:00 - 00:59	10.5	10.6	10.6	10.0	11.2	10.5	10.7	10.9	11.3	11.0	11.1	10.4	10.3	10.6	11.0	10.4	Compliant
01:00 - 01:59	10.5	10.9	10.5	10.0	10.9	11.0	10.9	10.9	11.1	11.0	10.9	10.4	10.3	10.6	11.0	10.3	Compliant
02:00 - 02:59	10.7	10.7	10.5	9.9	10.9	11.1	11.1	10.9	10.9	11.0	11.0	10.5	10.4	10.6	11.2	10.3	Compliant
03:00 - 03:59	10.7	10.5	10.3	9.8	10.8	11.0	10.9	11.0	10.8	10.9	10.9	10.5	10.2	10.8	11.2	10.3	Compliant
04:00 - 04:59	10.6	10.5	10.2	9.8	10.8	10.9	11.0	11.2	11.0	10.8	11.0	10.4	10.3	10.9	11.2	10.3	Compliant
05:00 - 05:59	10.7	10.6	10.3	9.9	11.0	10.8	11.4	11.4	11.2	10.9	11.1	10.5	10.1	11.0	11.3	10.4	Compliant
06:00 - 06:59	10.6	10.7	10.3	9.8	11.0	10.8	11.5	11.0	11.3	11.0	11.0	10.6	10.4	11.1	11.3	10.4	Compliant
07:00 - 07:59	10.7	10.7	10.0	9.7	11.2	10.8	11.5	10.8	11.2	11.2	11.1	10.4	10.4	11.0	11.3	10.3	Compliant
08:00 - 08:59	10.7	10.7	10.1	9.5	11.1	10.7	11.2	10.9	10.9	11.4	11.3	10.6	10.4	11.0	11.2	10.2	Compliant
09:00 - 09:59	10.6	10.6	10.0	9.4	10.9	10.6	11.0	10.7	10.8	11.4	11.3	10.7	10.3	11.1	11.0	10.2	Compliant
10:00 - 10:59	10.5	10.4	9.9	9.5	10.7	10.4	10.8	10.5	10.7	11.5	11.1	10.7	10.2	11.0	11.0	10.1	Compliant
11:00 - 11:59	10.3	9.9	9.6	9.2	10.5	10.3	10.7	10.4	10.5	11.4	2.1	10.7	10.1	11.0	11.0	10.0	Compliant
12:00 - 12:59	10.2	9.9	9.4	0.7	10.5	10.4	10.6	10.4	10.4	11.1	11.9	10.5	9.5	11.0	11.1	9.8	Compliant
13:00 - 13:59	10.1	9.9	9.5	7.1	10.8	10.7	10.9	10.6	10.7	10.6	11.7	10.4	7.7	10.9	10.9	9.8	Compliant
14:00 - 14:59	10.1	9.9	9.9	12.4	11.2	11.0	11.4	10.6	11.0	10.4	11.0	10.3	7.7	11.0	10.9	10.2	Compliant
15:00 - 15:59	10.2	10.2	10.1	12.1	11.3	10.9	11.5	10.6	11.2	10.5	10.7	10.2	7.8	10.8	11.1	10.1	Compliant
16:00 - 16:59	10.2	10.8	9.9	11.8	11.3	11.0	11.5	10.8	11.5	10.8	10.5	10.2	8.5	10.5	11.2	9.8	Compliant
17:00 - 17:59	10.3	10.9	9.7	11.5	11.3	11.1	11.2	11.1	11.6	10.7	10.5	10.4	9.1	10.7	11.3	10.0	Compliant
18:00 - 18:59	10.2	11.0	9.6	11.3	11.4	11.1	11.1	11.2	11.5	10.7	10.4	10.3	9.2	10.8	11.0	10.0	Compliant
19:00 - 19:59	10.2	11.0	9.6	11.1	11.3	11.1	11.1	11.1	11.4	11.2	10.1	10.1	9.7	11.0	10.8	10.1	Compliant
20:00 - 20:59	10.1	10.8	10.0	10.9	11.4	11.0	11.5	11.0	11.2	11.0	10.3	9.9	9.9	11.0	10.7	10.1	Compliant
21:00 - 21:59	10.3	10.4	10.1	11.1	11.5	10.9	11.5	11.2	11.2	11.1	10.4	10.1	10.1	11.0	10.7	10.2	Compliant
22:00 - 22:59	10.5	10.4	10.2	11.5	11.0	10.8	11.1	11.5	11.1	11.2	10.4	10.2	10.3	11.0	10.5	10.0	Compliant
23:00 - 23:59	10.6	10.6	10.1	11.4	10.6	10.6	10.9	11.4	11.0	11.2	10.4	10.3	10.5	10.9	10.4	10.0	Compliant

Unit 1 NO_x (ppmv) - June 2025

Time	1-Jun	2-Jun	3-Jun	4-Jun	5-Jun	6-Jun	7-Jun	8-Jun	9-Jun	10-Jun	11-Jun	12-Jun	13-Jun	14-Jun	15-Jun	Remarks
00:00 - 00:59	10.1	9.8	10.7	10.7	10.9	10.9	10.7	9.9	10.4	20.1	19.8	19.5	19.1	19.8	19.3	Compliant
01:00 - 01:59	10.1	10.0	10.6	10.8	11.1	11.0	10.8	10.1	10.4	20.2	19.9	19.7	20.2	19.7	19.4	Compliant
02:00 - 02:59	10.1	10.0	10.6	10.8	11.0	11.0	10.6	10.0	10.6	20.2	20.0	19.8	0.0	19.7	19.4	Compliant
03:00 - 03:59	10.1	10.1	10.5	10.7	11.0	11.1	10.6	10.0	10.5	20.3	20.4	19.9	0.0	19.8	19.5	Compliant
04:00 - 04:59	10.1	10.1	10.7	10.8	11.0	11.1	10.6	10.3	10.6	20.4	20.3	20.1	0.0	19.9	19.4	Compliant
05:00 - 05:59	10.2	10.2	10.6	10.7	11.0	11.1	10.9	10.6	10.5	20.8	20.7	20.5	0.0	19.7	19.4	Compliant
06:00 - 06:59	10.3	10.1	10.7	10.8	11.1	11.1	10.9	10.6	10.5	20.5	20.0	20.1	13.5	19.7	19.3	Compliant
07:00 - 07:59	10.2	10.1	10.5	10.8	11.1	11.1	10.9	10.5	10.2	20.5	19.9	19.9	19.3	19.5	19.3	Compliant
08:00 - 08:59	10.1	10.1	10.4	10.6	11.0	11.0	10.7	10.3	10.2	20.2	20.1	20.0	19.8	19.5	19.4	Compliant
09:00 - 09:59	10.1	10.1	10.4	10.4	10.8	10.8	10.3	10.2	9.9	20.0	20.1	19.8	19.7	19.4	19.4	Compliant
10:00 - 10:59	9.8	0.7	10.3	10.2	10.7	10.6	10.3	10.0	9.7	19.6	20.1	19.6	19.6	19.5	19.4	Compliant
11:00 - 11:59	9.8	9.3	10.2	10.0	10.7	10.3	10.3	9.7	0.6	19.6	20.0	19.5	19.5	19.4	19.3	Compliant
12:00 - 12:59	9.7	12.2	10.1	10.0	10.6	10.4	10.2	9.5	7.2	19.3	19.8	19.7	19.5	19.4	19.3	Compliant
13:00 - 13:59	9.6	11.5	10.2	10.3	10.8	10.9	10.3	10.0	12.9	19.6	20.3	19.8	19.5	19.2	19.3	Compliant
14:00 - 14:59	9.7	11.0	10.2	10.4	10.8	11.1	10.4	10.2	14.9	19.6	20.2	20.0	19.4	19.1	19.8	Compliant
15:00 - 15:59	9.5	10.9	10.4	10.3	11.1	11.0	10.5	10.5	20.0	19.5	20.3	0.0	19.4	19.1	19.6	Compliant
16:00 - 16:59	9.5	10.7	10.8	10.7	11.0	10.9	10.4	10.2	19.8	19.9	20.2	0.0	19.7	19.0	19.3	Compliant
17:00 - 17:59	9.8	10.6	10.7	11.1	11.0	10.9	11.0	9.9	20.0	19.9	19.9	0.0	19.5	19.1	19.3	Compliant
18:00 - 18:59	9.8	10.6	10.8	11.5	10.9	10.8	11.1	9.8	19.6	19.7	20.0	0.0	19.5	19.4	19.5	Compliant
19:00 - 19:59	9.8	10.7	10.6	11.4	11.0	10.4	10.4	10.1	20.0	20.1	20.2	0.0	19.7	19.5	19.5	Compliant
20:00 - 20:59	9.8	10.7	10.7	11.3	11.1	10.6	10.2	10.7	20.1	20.1	20.1	0.0	19.8	19.2	19.4	Compliant
21:00 - 21:59	9.7	10.5	10.5	11.2	11.0	10.6	10.2	10.6	19.9	20.1	19.9	0.0	19.7	19.0	19.2	Compliant
22:00 - 22:59	9.8	10.6	10.6	11.0	11.0	10.6	10.2	10.6	19.9	19.8	19.7	8.1	19.7	19.2	19.2	Compliant
23:00 - 23:59	9.8	10.6	10.6	10.9	10.9	10.5	9.9	10.5	20.1	19.7	19.5	15.7	19.7	19.3	19.3	Compliant

Time	16-Jun	17-Jun	18-Jun	19-Jun	20-Jun	21-Jun	22-Jun	23-Jun	24-Jun	25-Jun	26-Jun	27-Jun	28-Jun	29-Jun	30-Jun	Remarks
00:00 - 00:59	19.4	18.6	18.6	18.6	18.4	18.2	18.3	18.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
01:00 - 01:59	19.4	18.6	18.7	18.7	18.4	18.4	18.2	18.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
02:00 - 02:59	19.5	18.6	18.7	18.8	18.5	18.4	18.3	18.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
03:00 - 03:59	19.4	18.7	18.6	18.8	18.5	18.4	18.4	18.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
04:00 - 04:59	19.4	18.7	18.6	18.9	18.6	18.4	18.3	18.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
05:00 - 05:59	19.4	18.8	18.7	18.8	18.7	18.5	18.4	18.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
06:00 - 06:59	19.4	18.8	18.6	18.6	18.6	18.5	18.4	18.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
07:00 - 07:59	19.4	18.9	18.6	18.7	18.7	18.6	18.4	18.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
08:00 - 08:59	19.1	18.8	18.7	18.7	18.6	18.6	18.5	18.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
09:00 - 09:59	19.4	18.8	18.7	18.4	18.5	18.6	18.4	18.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
10:00 - 10:59	17.6	18.7	18.6	18.7	18.5	18.5	18.4	18.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
11:00 - 11:59	18.3	18.6	18.7	18.4	18.3	18.1	18.2	17.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
12:00 - 12:59	18.2	18.6	18.6	18.0	18.0	18.3	18.1	17.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
13:00 - 13:59	18.2	18.5	18.5	17.7	17.8	18.2	17.9	17.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
14:00 - 14:59	18.3	18.5	18.5	17.5	17.5	18.2	17.7	17.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
15:00 - 15:59	18.2	17.3	18.3	17.6	17.4	18.2	17.7	17.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
16:00 - 16:59	18.3	0.0	18.1	17.4	17.2	18.1	17.5	17.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
17:00 - 17:59	18.3	10.8	18.0	17.4	16.9	18.4	17.5	17.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
18:00 - 18:59	18.5	17.4	18.1	17.4	16.9	18.4	17.6	17.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
19:00 - 19:59	18.5	17.8	18.2	17.4	16.9	18.2	17.7	17.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
20:00 - 20:59	18.5	18.3	18.2	17.8	17.2	18.2	17.8	17.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
21:00 - 21:59	18.6	18.4	18.3	18.0	17.7	18.4	18.0	17.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
22:00 - 22:59	18.6	18.4	18.5	18.3	18.0	18.5	18.2	17.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
23:00 - 23:59	18.6	18.5	18.6	18.4	18.1	18.5	18.3	17.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant

Remark: Plant shutdown from 23:29hr on 23 Jun 25 to 14:06 hr on 02 Jul 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 1 NO_x (ppmv) - July 2025

Time	1-Jul	2-Jul	3-Jul	4-Jul	5-Jul	6-Jul	7-Jul	8-Jul	9-Jul	10-Jul	11-Jul	12-Jul	13-Jul	14-Jul	15-Jul	Remarks
00:00 - 00:59	0.0	0.0	0.0	18.2	18.2	18.2	18.1	17.9	18.0	17.5	6.3	18.0	20.7	18.5	20.0	Compliant
01:00 - 01:59	0.0	0.0	0.0	20.0	18.3	18.3	18.2	18.0	18.0	17.7	5.8	18.2	17.6	20.5	17.5	Compliant
02:00 - 02:59	0.0	0.0	0.0	17.7	18.4	18.3	18.1	18.0	17.9	17.7	6.5	19.7	19.3	18.0	18.0	Compliant
03:00 - 03:59	0.0	0.0	0.0	19.6	18.4	18.3	18.1	18.0	17.9	17.6	9.5	19.8	21.3	17.8	18.9	Compliant
04:00 - 04:59	0.0	0.0	0.0	19.2	18.4	18.3	18.1	18.1	17.9	17.6	15.1	21.6	17.2	19.2	17.5	Compliant
05:00 - 05:59	0.0	0.0	0.0	19.3	18.3	18.4	18.1	18.2	17.8	17.8	17.5	20.2	20.0	19.6	18.8	Compliant
06:00 - 06:59	0.0	0.0	0.0	17.6	18.3	18.3	18.0	18.2	17.9	17.8	18.0	21.2	18.9	20.7	19.7	Compliant
07:00 - 07:59	0.0	0.0	0.0	21.1	18.2	18.3	18.0	18.0	17.8	17.8	18.2	21.0	20.1	21.6	17.9	Compliant
08:00 - 08:59	0.0	0.0	19.6	18.2	18.2	18.2	18.0	17.7	17.6	17.8	18.3	17.9	21.6	17.7	18.5	Compliant
09:00 - 09:59	0.0	0.0	19.8	21.0	18.1	18.1	17.9	17.9	17.6	17.4	18.3	19.5	17.8	17.6	18.0	Compliant
10:00 - 10:59	0.0	0.0	19.6	19.0	18.0	18.0	17.9	17.7	17.6	17.4	17.9	21.0	20.2	18.7	20.6	Compliant
11:00 - 11:59	0.0	0.0	19.8	20.2	17.9	17.8	16.2	17.5	17.5	17.3	18.0	17.7	17.7	20.4	17.6	Compliant
12:00 - 12:59	0.0	0.0	18.7	18.8	17.7	17.6	17.5	17.2	17.4	17.2	17.9	18.8	18.9	21.2	20.3	Compliant
13:00 - 13:59	0.0	0.0	20.4	17.2	17.5	17.4	17.4	17.0	17.3	16.9	17.6	17.8	18.1	20.4	21.3	Compliant
14:00 - 14:59	0.0	0.0	20.2	15.2	17.4	17.3	17.3	16.9	17.2	16.6	17.5	21.3	20.0	19.5	21.3	Compliant
15:00 - 15:59	0.0	0.0	19.1	17.2	17.4	17.3	17.3	17.2	17.1	16.6	20.1	17.9	18.6	18.1	20.8	Compliant
16:00 - 16:59	0.0	0.0	20.6	17.3	17.5	17.3	17.2	17.9	17.0	16.4	17.5	21.7	19.5	20.4	19.8	Compliant
17:00 - 17:59	0.0	0.0	21.2	17.3	17.3	17.2	17.2	17.9	16.8	16.2	21.2	20.8	20.4	21.4	20.6	Compliant
18:00 - 18:59	0.0	0.0	19.2	17.3	17.5	17.3	17.3	17.8	16.9	16.2	21.5	18.2	18.8	21.5	17.4	Compliant
19:00 - 19:59	0.0	0.0	21.1	17.3	17.5	17.6	17.4	17.9	17.0	16.3	21.3	18.7	21.8	20.4	19.6	Compliant
20:00 - 20:59	0.0	0.0	20.9	17.7	17.6	17.9	17.5	18.0	17.1	16.3	17.6	17.7	17.5	17.5	17.6	Compliant
21:00 - 21:59	0.0	0.0	20.5	17.7	17.6	18.1	17.5	18.0	17.3	16.3	21.2	21.3	18.5	20.4	21.2	Compliant
22:00 - 22:59	0.0	0.0	21.3	17.9	17.7	18.0	17.6	18.1	17.4	13.3	18.9	19.0	17.6	18.0	20.2	Compliant
23:00 - 23:59	0.0	0.0	21.2	18.1	17.9	18.0	17.7	18.2	17.4	16.7	19.5	20.1	21.1	18.6	17.6	Compliant

Time	16-Jul	17-Jul	18-Jul	19-Jul	20-Jul	21-Jul	22-Jul	23-Jul	24-Jul	25-Jul	26-Jul	27-Jul	28-Jul	29-Jul	30-Jul	31-Jul	Remarks
00:00 - 00:59	20.7	18.5	18.7	21.4	21.4	17.9	18.8	21.0	19.4	17.8	17.7	20.1	21.4	17.7	18.2	18.0	Compliant
01:00 - 01:59	20.3	19.0	19.5	20.3	17.8	21.5	21.0	17.6	20.4	20.0	19.6	17.6	20.4	20.3	18.2	20.9	Compliant
02:00 - 02:59	17.9	21.3	19.0	20.7	17.5	18.0	20.1	19.1	18.6	18.0	21.0	19.9	21.2	19.8	17.8	18.6	Compliant
03:00 - 03:59	18.8	20.9	18.3	17.6	17.9	20.6	21.2	18.8	19.4	18.6	20.9	18.2	17.7	20.5	17.7	20.9	Compliant
04:00 - 04:59	17.4	18.5	20.5	18.1	18.7	18.6	21.1	18.7	21.6	20.9	20.4	21.2	17.8	19.1	21.5	18.5	Compliant
05:00 - 05:59	21.1	19.0	20.1	17.9	19.1	18.7	20.1	17.6	20.6	17.6	19.7	20.2	21.5	17.5	21.3	21.4	Compliant
06:00 - 06:59	18.3	21.3	21.0	20.5	21.4	17.9	17.5	18.0	17.9	19.1	21.3	21.0	18.8	21.4	21.6	21.1	Compliant
07:00 - 07:59	18.9	17.8	19.9	21.4	19.7	20.3	20.9	21.5	21.0	21.6	17.7	17.7	18.4	20.0	19.1	18.3	Compliant
08:00 - 08:59	21.3	20.3	18.0	18.8	21.4	21.4	17.5	21.3	18.8	17.9	20.5	20.3	21.6	18.6	19.9	19.7	Compliant
09:00 - 09:59	20.4	20.9	20.6	18.1	18.5	18.3	19.7	17.7	18.9	18.3	21.1	20.6	21.3	20.7	19.1	19.8	Compliant
10:00 - 10:59	19.2	18.0	19.2	18.4	21.4	19.8	21.4	17.9	17.7	20.5	20.3	17.5	21.1	21.7	17.7	20.7	Compliant
11:00 - 11:59	17.9	17.5	18.3	17.6	18.4	19.9	17.8	20.0	18.3	21.1	21.1	17.8	21.1	18.4	20.8	17.7	Compliant
12:00 - 12:59	19.4	21.0	19.7	18.3	21.4	18.0	20.7	17.4	17.6	20.0	20.6	20.2	18.5	19.2	21.6	18.0	Compliant
13:00 - 13:59	21.3	18.2	20.2	19.8	18.5	21.2	21.7	20.1	21.4	17.4	19.0	20.7	19.0	17.5	20.4	18.4	Compliant
14:00 - 14:59	20.2	18.3	20.1	17.5	19.0	21.5	19.6	21.3	17.7	18.1	20.0	17.6	20.1	17.4	21.1	19.5	Compliant
15:00 - 15:59	20.8	17.6	21.6	18.9	20.2	18.9	18.1	19.5	21.0	18.2	17.8	19.2	21.6	19.5	18.0	21.3	Compliant
16:00 - 16:59	21.1	18.7	21.2	18.5	19.1	21.6	18.4	21.2	19.3	17.6	21.0	21.5	19.2	18.5	19.2	19.9	Compliant
17:00 - 17:59	17.4	17.5	21.6	19.3	19.8	17.8	19.6	17.8	18.5	21.1	18.7	21.2	17.7	17.6	19.0	21.6	Compliant
18:00 - 18:59	21.5	17.7	19.6	21.5	20.0	21.2	18.8	20.2	21.5	21.1	19.4	19.9	17.7	19.0	18.1	20.5	Compliant
19:00 - 19:59	17.5	17.8	20.9	19.9	17.5	21.5	18.2	21.5	20.9	21.3	20.7	20.7	18.0	18.4	21.5	21.0	Compliant
20:00 - 20:59	18.5	18.0	18.2	21.0	19.9	21.3	20.0	19.5	19.1	21.4	21.0	18.0	20.4	20.1	17.7	18.5	Compliant
21:00 - 21:59	21.2	17.6	21.1	18.2	21.4	20.8	18.9	21.6	20.5	19.6	21.4	18.2	20.7	21.1	21.1	21.3	Compliant
22:00 - 22:59	20.8	17.5	18.8	17.5	17.9	19.4	21.5	17.5	19.9	18.5	19.7	19.6	18.0	17.6	21.5	20.6	Compliant
23:00 - 23:59	19.1	19.9	17.5	19.5	18.3	17.8	18.6	18.1	20.2	19.2	20.1	19.1	19.5	17.9	19.5	17.6	Compliant

Remark: Plant shutdown from 23:29hr on 23 Jun 25 to 02 Jul 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 1 NO_x (ppmv) - August 2025

Time	1-Aug	2-Aug	3-Aug	4-Aug	5-Aug	6-Aug	7-Aug	8-Aug	9-Aug	10-Aug	11-Aug	12-Aug	13-Aug	14-Aug	15-Aug	Remarks
00:00 - 00:59	18.1	17.6	17.4	16.8	17.1	17.5	18.2	17.4	17.4	17.4	17.0	17.6	17.7	17.8	18.0	Compliant
01:00 - 01:59	19.0	17.7	17.5	16.9	17.2	17.6	18.2	17.5	17.6	17.5	17.1	17.8	17.8	18.0	18.1	Compliant
02:00 - 02:59	17.7	17.6	17.5	17.1	17.3	17.8	18.2	17.6	17.6	17.6	16.8	18.0	17.9	18.1	18.2	Compliant
03:00 - 03:59	0.6	18.6	17.5	17.2	17.3	17.9	18.1	17.7	17.6	17.7	17.1	18.1	18.0	18.3	18.3	Compliant
04:00 - 04:59	0.8	17.7	17.6	17.2	17.3	17.9	18.0	17.7	17.7	17.7	17.3	18.3	18.2	18.4	18.4	Compliant
05:00 - 05:59	17.9	19.5	17.7	17.3	17.4	18.0	18.0	17.7	17.8	17.8	17.5	18.3	18.2	18.4	18.5	Compliant
06:00 - 06:59	18.0	18.3	17.7	17.3	17.5	17.9	18.0	17.7	17.9	17.8	17.6	18.3	18.3	18.4	18.5	Compliant
07:00 - 07:59	19.1	19.0	17.8	17.4	17.5	17.9	18.0	17.7	17.8	17.8	17.6	18.3	18.3	18.3	18.5	Compliant
08:00 - 08:59	19.0	18.9	17.5	17.5	17.4	17.7	18.0	17.8	17.7	17.8	17.6	18.3	18.3	18.4	18.4	Compliant
09:00 - 09:59	19.0	19.1	17.4	17.5	17.1	17.6	17.8	17.7	17.6	17.7	17.5	18.2	18.2	18.3	18.4	Compliant
10:00 - 10:59	18.0	17.8	17.3	17.1	17.1	17.5	17.7	17.6	17.3	17.3	17.2	18.1	18.0	18.1	18.2	Compliant
11:00 - 11:59	19.2	16.8	16.8	17.0	17.1	17.3	17.6	17.5	17.1	17.2	17.3	18.0	17.7	17.8	18.2	Compliant
12:00 - 12:59	18.0	17.0	16.5	16.9	16.9	17.2	17.1	17.5	16.9	17.1	16.8	17.7	17.6	17.7	18.0	Compliant
13:00 - 13:59	17.4	17.2	16.3	16.8	16.7	17.1	17.3	17.2	16.3	16.9	17.0	17.5	17.1	17.6	17.8	Compliant
14:00 - 14:59	18.7	16.6	16.2	16.5	16.6	17.2	17.1	17.1	16.3	16.6	17.0	17.2	17.1	17.4	17.4	Compliant
15:00 - 15:59	17.4	16.4	16.3	16.3	16.4	17.3	17.0	17.0	16.1	16.5	16.9	16.9	17.0	17.3	17.3	Compliant
16:00 - 16:59	18.1	16.3	16.3	16.2	16.4	17.5	17.0	17.0	16.0	16.3	16.9	16.8	16.9	17.3	16.9	Compliant
17:00 - 17:59	17.5	16.3	16.4	16.3	16.3	17.6	17.0	17.0	16.2	16.3	17.0	16.7	16.9	17.2	16.8	Compliant
18:00 - 18:59	18.8	16.5	16.4	16.3	17.0	17.7	17.1	16.8	16.4	16.3	17.0	16.7	17.0	17.2	17.0	Compliant
19:00 - 19:59	17.6	16.6	16.3	16.4	17.2	17.8	17.2	16.8	16.7	16.1	17.0	16.9	16.9	17.3	17.3	Compliant
20:00 - 20:59	19.2	16.6	16.3	16.5	17.3	17.9	17.2	16.7	16.8	16.3	17.2	17.1	17.0	17.4	17.6	Compliant
21:00 - 21:59	17.7	16.9	16.4	16.6	17.3	18.0	17.2	17.1	16.9	16.2	17.3	17.3	17.2	17.5	18.0	Compliant
22:00 - 22:59	18.3	17.1	16.5	16.8	17.3	18.1	17.2	17.2	17.0	16.3	17.4	17.4	17.4	17.7	18.3	Compliant
23:00 - 23:59	17.9	17.3	16.6	17.0	17.4	18.1	17.3	17.3	17.2	16.9	17.5	17.6	17.6	17.9	18.5	Compliant

Time	16-Aug	17-Aug	18-Aug	19-Aug	20-Aug	21-Aug	22-Aug	23-Aug	24-Aug	25-Aug	26-Aug	27-Aug	28-Aug	29-Aug	30-Aug	31-Aug	Remarks
00:00 - 00:59	18.7	18.5	18.7	18.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
01:00 - 01:59	18.9	18.5	18.8	18.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
02:00 - 02:59	19.0	18.6	18.9	18.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
03:00 - 03:59	19.1	18.9	18.9	18.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
04:00 - 04:59	19.2	19.0	18.7	18.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
05:00 - 05:59	19.1	19.1	18.8	18.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
06:00 - 06:59	19.1	19.1	18.7	18.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
07:00 - 07:59	19.2	19.0	18.9	18.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
08:00 - 08:59	19.2	18.8	18.6	18.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
09:00 - 09:59	19.3	18.7	18.6	18.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
10:00 - 10:59	19.3	18.6	17.8	18.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
11:00 - 11:59	19.2	18.5	17.8	18.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
12:00 - 12:59	19.1	18.2	17.7	18.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
13:00 - 13:59	19.0	18.0	17.7	18.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
14:00 - 14:59	18.9	17.8	17.5	18.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
15:00 - 15:59	18.8	17.5	17.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
16:00 - 16:59	18.6	17.6	17.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
17:00 - 17:59	18.5	17.6	17.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
18:00 - 18:59	18.5	17.7	17.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
19:00 - 19:59	18.5	17.9	18.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
20:00 - 20:59	18.6	18.2	18.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
21:00 - 21:59	18.4	18.3	18.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
22:00 - 22:59	18.6	18.5	18.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
23:00 - 23:59	18.6	18.6	18.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant

Remark: Plant shutdown from 14:00 hr on 19 Aug 25 to 22:06hr on 17 Sep 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 1 NO_x (ppmv) - September 2025

Time	1-Sep	2-Sep	3-Sep	4-Sep	5-Sep	6-Sep	7-Sep	8-Sep	9-Sep	10-Sep	11-Sep	12-Sep	13-Sep	14-Sep	15-Sep	Remarks
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown

Time	16-Sep	17-Sep	18-Sep	19-Sep	20-Sep	21-Sep	22-Sep	23-Sep	24-Sep	25-Sep	26-Sep	27-Sep	28-Sep	29-Sep	30-Sep	Remarks
00:00 - 00:59	0.0	0.0	0.0	17.4	17.8	17.3	16.8	17.2	16.9	17.2	16.9	17.0	16.8	16.7	16.9	Compliant
01:00 - 01:59	0.0	0.0	0.0	17.7	18.7	17.3	16.9	17.3	17.2	17.3	16.9	17.0	17.2	16.7	16.8	Compliant
02:00 - 02:59	0.0	0.0	0.0	19.1	20.8	17.4	16.9	17.3	17.3	17.3	17.0	17.0	17.2	16.8	17.1	Compliant
03:00 - 03:59	0.0	0.0	0.0	20.9	19.9	17.4	16.9	17.4	17.2	17.3	17.0	16.9	17.3	16.7	17.1	Compliant
04:00 - 04:59	0.0	0.0	0.0	18.5	17.6	17.4	17.0	17.4	17.2	17.3	17.0	16.8	17.3	16.8	17.1	Compliant
05:00 - 05:59	0.0	0.0	0.0	20.9	21.4	17.4	17.0	17.4	17.3	17.1	17.0	16.8	17.2	16.8	17.0	Compliant
06:00 - 06:59	0.0	0.0	0.0	19.2	17.8	17.5	16.9	17.4	17.2	17.1	17.0	16.9	17.2	16.9	17.1	Compliant
07:00 - 07:59	0.0	0.0	0.0	18.2	17.6	17.5	16.9	17.4	17.1	17.2	17.0	16.9	17.2	16.8	17.0	Compliant
08:00 - 08:59	0.0	0.0	0.0	17.7	19.4	17.5	16.9	17.4	17.1	17.2	16.9	16.7	17.1	16.7	17.1	Compliant
09:00 - 09:59	0.0	0.0	0.0	20.8	15.8	17.3	16.8	17.2	17.0	17.1	16.7	16.6	17.1	16.6	17.0	Compliant
10:00 - 10:59	0.0	0.0	0.0	20.4	16.2	17.1	16.6	17.1	17.0	17.1	16.5	16.6	16.9	16.0	16.9	Compliant
11:00 - 11:59	0.0	0.0	0.0	19.2	16.9	16.9	16.6	17.1	17.1	17.0	16.4	16.3	16.8	16.3	16.9	Compliant
12:00 - 12:59	0.0	0.0	0.0	18.3	16.6	16.6	17.0	16.9	17.1	16.8	16.2	16.2	16.7	16.4	16.8	Compliant
13:00 - 13:59	0.0	0.0	35.9	18.7	16.4	16.4	16.9	16.7	16.9	16.7	16.3	16.1	16.6	16.3	16.7	Low Load
14:00 - 14:59	0.0	0.0	19.6	16.9	16.2	16.1	16.7	16.4	16.9	16.5	16.3	16.1	16.5	16.3	16.7	Compliant
15:00 - 15:59	0.0	0.0	19.3	18.9	16.0	15.9	16.5	16.3	16.7	16.5	16.3	16.4	16.4	16.3	16.8	Compliant
16:00 - 16:59	0.0	0.0	19.0	18.1	15.9	15.8	16.4	15.8	16.8	16.2	16.2	16.3	16.3	16.3	16.8	Compliant
17:00 - 17:59	0.0	0.0	20.2	17.5	16.0	16.2	16.4	16.1	16.9	16.5	16.4	16.8	16.3	16.3	16.9	Compliant
18:00 - 18:59	0.0	0.0	20.6	18.4	16.1	16.4	16.5	16.2	16.8	16.6	16.5	16.9	16.3	16.6	16.9	Compliant
19:00 - 19:59	0.0	0.0	21.2	18.7	16.1	16.4	16.8	16.3	16.9	16.7	16.8	17.0	16.4	16.7	16.7	Compliant
20:00 - 20:59	0.0	0.0	17.7	17.8	16.3	16.5	16.9	16.5	16.8	16.9	16.8	17.0	16.4	16.7	16.7	Compliant
21:00 - 21:59	0.0	0.0	17.7	21.2	16.7	16.6	16.8	16.7	16.8	16.9	17.0	17.1	16.5	16.8	16.9	Compliant
22:00 - 22:59	0.0	0.0	19.1	19.6	16.9	16.6	16.9	16.8	16.9	16.9	17.1	17.0	16.5	16.9	16.9	Compliant
23:00 - 23:59	0.0	0.0	17.4	21.5	17.1	16.7	17.1	16.9	17.0	16.9	17.1	16.8	16.6	17.0	16.9	Compliant

Remark: Plant shutdown from 14:00 hr on 19 Aug 25 to 17 Sep 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 1 NO_x (ppmv) - October 2025

Time	1-Oct	2-Oct	3-Oct	4-Oct	5-Oct	6-Oct	7-Oct	8-Oct	9-Oct	10-Oct	11-Oct	12-Oct	13-Oct	14-Oct	15-Oct	Remarks
00:00 - 00:59	16.9	16.6	16.6	16.6	16.5	16.4	17.1	16.8	16.8	16.7	16.9	16.7	16.8	17.0	16.6	Compliant
01:00 - 01:59	16.9	16.4	16.6	16.3	16.5	16.4	17.1	16.8	16.8	16.6	16.9	16.9	16.9	17.1	16.8	Compliant
02:00 - 02:59	16.9	16.8	16.6	16.4	16.6	16.3	17.1	16.8	16.9	17.0	17.0	16.9	16.3	17.0	16.9	Compliant
03:00 - 03:59	16.9	16.7	16.6	16.6	16.7	16.6	17.1	16.9	17.1	17.0	17.0	16.3	16.8	17.0	16.9	Compliant
04:00 - 04:59	16.9	16.7	16.6	16.7	16.7	16.6	17.1	16.9	17.1	17.0	17.0	16.8	16.8	17.0	16.9	Compliant
05:00 - 05:59	16.8	16.6	16.5	16.7	16.7	16.5	17.1	17.0	17.1	17.0	16.3	16.8	16.9	17.1	17.0	Compliant
06:00 - 06:59	16.7	16.6	16.6	16.7	16.6	16.6	17.0	16.7	17.1	16.7	16.7	16.8	16.9	17.0	16.9	Compliant
07:00 - 07:59	16.7	16.6	16.5	16.8	16.6	16.5	17.1	17.0	17.0	17.0	16.8	16.9	17.0	16.9	16.8	Compliant
08:00 - 08:59	16.7	16.4	16.5	16.6	16.6	16.4	16.9	16.8	16.9	16.5	16.8	16.8	16.6	16.8	16.7	Compliant
09:00 - 09:59	16.6	16.3	16.4	16.6	16.5	16.4	16.9	16.8	16.9	16.6	16.8	16.3	16.6	16.6	16.7	Compliant
10:00 - 10:59	16.5	16.0	16.2	16.6	16.5	16.2	16.7	16.6	16.7	16.8	16.6	16.4	16.7	16.7	16.7	Compliant
11:00 - 11:59	16.4	15.9	16.1	16.4	16.2	16.1	16.5	16.4	16.7	16.8	16.4	16.2	16.6	16.5	16.6	Compliant
12:00 - 12:59	16.4	15.7	16.0	16.3	16.0	16.5	16.4	16.3	16.6	16.7	16.2	15.7	16.5	15.4	16.4	Compliant
13:00 - 13:59	16.4	16.0	16.1	16.2	15.9	16.6	16.4	16.3	16.2	16.7	16.5	15.7	16.4	14.7	16.3	Compliant
14:00 - 14:59	16.4	16.3	16.0	16.1	15.8	16.6	16.2	16.2	16.2	16.6	16.4	15.8	16.4	15.0	16.3	Compliant
15:00 - 15:59	16.5	16.0	15.9	16.1	15.7	16.5	16.1	16.2	16.4	16.6	15.4	15.9	16.7	12.7	16.6	Compliant
16:00 - 16:59	16.6	16.1	16.0	16.1	16.0	16.7	16.1	16.2	16.4	16.6	15.8	15.8	16.8	9.9	16.8	Compliant
17:00 - 17:59	16.5	16.1	16.1	16.4	16.0	16.6	16.3	16.3	16.6	16.6	15.9	15.9	16.7	11.0	16.9	Compliant
18:00 - 18:59	16.4	16.3	16.3	16.4	16.1	16.9	16.4	16.4	16.7	16.7	16.3	15.6	16.7	13.0	17.0	Compliant
19:00 - 19:59	16.5	16.1	16.4	16.4	16.2	16.9	16.5	16.4	16.7	16.6	16.5	15.8	16.8	14.2	16.8	Compliant
20:00 - 20:59	16.6	16.1	16.4	16.5	16.2	17.0	16.5	16.4	16.8	16.6	16.6	16.1	16.9	15.1	16.8	Compliant
21:00 - 21:59	16.6	16.2	16.4	16.6	16.4	16.9	16.6	16.6	16.3	16.9	16.8	16.3	16.9	15.7	17.0	Compliant
22:00 - 22:59	16.8	16.3	16.6	16.6	16.4	16.9	16.6	16.7	16.6	16.6	16.3	16.5	16.9	16.2	17.0	Compliant
23:00 - 23:59	16.7	16.5	16.6	16.5	16.4	17.0	16.8	16.6	16.8	16.9	16.8	16.7	17.0	16.4	17.1	Compliant

Time	16-Oct	17-Oct	18-Oct	19-Oct	20-Oct	21-Oct	22-Oct	23-Oct	24-Oct	25-Oct	26-Oct	27-Oct	28-Oct	29-Oct	30-Oct	31-Oct	Remarks
00:00 - 00:59	17.2	17.1	17.0	16.7	16.3	16.6	16.5	16.5	16.2	16.2	16.0	16.5	17.4	17.3	17.1	17.2	Compliant
01:00 - 01:59	17.1	17.2	17.0	16.7	16.4	16.8	16.6	16.5	16.3	16.4	16.2	16.0	17.5	17.4	17.3	17.3	Compliant
02:00 - 02:59	17.2	17.1	17.0	16.8	16.4	16.7	16.6	16.6	16.3	16.5	16.3	16.1	17.5	17.4	17.4	17.4	Compliant
03:00 - 03:59	17.2	17.2	17.0	16.8	16.4	16.8	16.7	16.4	16.6	16.6	16.4	16.3	17.6	17.5	17.4	17.5	Compliant
04:00 - 04:59	17.2	17.2	17.0	16.9	16.4	16.8	16.6	16.2	16.2	16.7	16.2	16.5	17.7	17.5	17.4	17.6	Compliant
05:00 - 05:59	17.2	17.2	17.0	16.9	16.3	16.9	16.8	16.1	16.5	16.7	16.4	16.6	17.7	17.6	17.5	17.6	Compliant
06:00 - 06:59	17.2	17.3	16.9	16.9	16.2	16.9	16.8	16.0	16.6	16.8	16.5	16.1	17.8	17.6	17.5	17.7	Compliant
07:00 - 07:59	17.2	17.2	16.9	16.9	16.1	16.8	16.8	16.2	16.6	16.2	16.6	16.4	17.8	17.5	17.5	17.6	Compliant
08:00 - 08:59	17.1	17.1	16.8	16.8	16.0	16.8	16.6	16.3	16.4	16.3	16.6	16.4	17.7	17.4	17.4	17.5	Compliant
09:00 - 09:59	17.1	17.0	16.5	16.7	16.0	16.6	16.7	16.1	16.4	16.2	16.6	16.5	17.6	17.3	17.4	17.4	Compliant
10:00 - 10:59	16.9	16.9	16.1	16.5	15.9	16.5	16.4	16.0	16.0	15.9	16.6	16.5	17.3	17.0	17.1	17.2	Compliant
11:00 - 11:59	16.9	16.7	16.2	16.4	16.0	16.3	16.2	16.0	16.1	15.9	15.1	15.5	16.8	16.7	16.6	17.0	Compliant
12:00 - 12:59	16.9	16.6	16.2	16.2	15.9	16.2	16.2	15.8	16.0	15.6	15.3	15.7	16.7	16.5	16.6	16.8	Compliant
13:00 - 13:59	16.7	16.9	16.1	16.0	15.8	16.0	16.0	15.6	15.5	15.2	15.0	15.8	16.3	16.3	16.4	16.6	Compliant
14:00 - 14:59	16.5	16.9	16.1	16.0	15.8	15.8	15.8	15.1	14.9	15.2	15.0	15.9	16.2	16.2	16.3	16.1	Compliant
15:00 - 15:59	16.4	16.8	15.9	15.7	15.8	15.8	15.8	15.4	14.7	15.1	15.2	15.9	16.2	16.1	16.1	16.1	Compliant
16:00 - 16:59	16.6	16.8	16.0	15.7	15.8	15.7	15.7	15.5	14.9	14.6	15.3	16.1	16.1	15.9	16.2	16.2	Compliant
17:00 - 17:59	16.7	16.7	16.2	15.8	15.8	15.7	15.7	15.8	15.2	14.3	15.3	16.2	16.2	16.0	16.4	16.4	Compliant
18:00 - 18:59	16.6	16.8	16.3	15.9	16.1	15.8	15.7	15.6	15.1	14.9	15.4	16.4	16.5	16.1	16.4	16.5	Compliant
19:00 - 19:59	16.8	16.8	16.4	16.0	16.1	15.8	16.2	15.8	15.5	15.3	15.4	16.6	16.7	16.4	16.5	16.6	Compliant
20:00 - 20:59	16.9	16.8	16.5	15.9	16.3	15.9	15.9	15.9	15.8	15.3	15.5	16.8	16.9	16.5	16.6	16.7	Compliant
21:00 - 21:59	17.0	16.9	16.6	16.3	16.3	16.0	16.2	16.2	15.7	15.5	15.8	17.0	17.1	16.7	16.8	16.9	Compliant
22:00 - 22:59	17.0	16.9	16.6	16.2	16.5	16.3	16.3	16.2	16.0	15.9	16.1	17.1	17.2	16.9	16.8	17.0	Compliant
23:00 - 23:59	17.1	16.9	16.6	16.3	16.6	16.5	16.4	16.2	16.1	15.8	16.3	17.2	17.2	17.1	16.8	17.1	Compliant

Unit 1 NO_x (ppmv) - November 2025

Time	1-Nov	2-Nov	3-Nov	4-Nov	5-Nov	6-Nov	7-Nov	8-Nov	9-Nov	10-Nov	11-Nov	12-Nov	13-Nov	14-Nov	15-Nov	Remarks
00:00 - 00:59	17.2	17.1	16.8	17.5	16.7	16.9	16.4	17.6	18.3	18.3	17.9	0.0	0.0	0.0	14.5	Compliant
01:00 - 01:59	17.4	17.3	17.0	17.4	16.9	17.1	16.9	18.1	17.9	18.4	17.5	0.0	0.0	0.0	14.5	Compliant
02:00 - 02:59	17.4	17.4	17.2	17.5	17.1	17.3	17.2	18.4	17.0	18.3	17.4	0.0	0.0	0.0	14.7	Compliant
03:00 - 03:59	17.5	17.4	17.5	17.7	17.1	17.4	16.7	18.5	17.7	17.9	17.6	0.0	0.0	0.0	14.9	Compliant
04:00 - 04:59	17.5	17.1	17.3	17.7	17.3	17.5	17.1	18.6	18.1	17.4	15.3	0.0	0.0	6.8	14.8	Compliant
05:00 - 05:59	17.5	17.2	17.4	17.8	17.4	17.4	17.3	18.7	18.3	18.0	0.0	0.0	0.0	42.0	14.8	Compliant
06:00 - 06:59	16.8	17.4	17.4	17.9	17.5	17.7	17.2	18.8	18.5	18.3	0.0	0.0	0.0	16.2	14.9	Compliant
07:00 - 07:59	16.5	17.4	17.5	17.8	17.0	16.5	17.3	18.4	18.4	18.4	0.0	0.0	0.0	15.8	15.0	Compliant
08:00 - 08:59	17.0	17.3	17.6	17.2	17.2	16.6	17.5	18.6	18.5	18.5	0.0	0.0	0.0	14.8	14.7	Compliant
09:00 - 09:59	16.9	17.2	11.3	0.1	17.1	16.8	17.4	17.0	18.4	18.5	0.0	0.0	0.0	14.3	14.5	Compliant
10:00 - 10:59	16.3	16.8	10.9	3.4	17.0	16.8	17.3	16.0	18.3	18.1	0.0	0.0	0.0	13.7	14.3	Compliant
11:00 - 11:59	16.8	16.6	15.4	12.7	16.6	16.6	17.3	17.4	18.1	16.0	0.0	0.0	0.0	13.2	12.1	Compliant
12:00 - 12:59	16.6	16.5	16.5	16.0	16.5	16.7	17.3	17.7	14.9	16.7	0.0	0.0	0.0	13.1	11.2	Compliant
13:00 - 13:59	16.9	16.5	16.7	17.0	16.5	16.7	17.3	17.8	0.1	16.8	0.0	0.0	0.0	13.0	11.2	Compliant
14:00 - 14:59	17.1	16.6	16.8	16.9	16.5	16.0	15.4	17.7	7.2	16.3	0.0	0.0	0.0	13.1	11.1	Compliant
15:00 - 15:59	16.9	7.8	17.1	17.0	16.5	16.1	15.0	17.7	15.0	13.9	0.0	0.0	0.0	13.1	11.0	Compliant
16:00 - 16:59	16.5	12.9	17.4	16.9	16.6	16.1	16.3	17.4	16.5	15.6	0.0	0.0	0.0	13.1	11.1	Compliant
17:00 - 17:59	16.5	15.9	17.2	16.7	16.4	16.0	16.7	17.4	17.1	16.2	0.0	0.0	0.0	13.4	9.1	Compliant
18:00 - 18:59	17.0	16.7	17.5	16.5	16.9	16.4	16.9	17.6	17.5	16.8	0.0	0.0	0.0	13.5	10.7	Compliant
19:00 - 19:59	17.0	17.2	17.7	16.8	16.8	16.4	17.2	16.8	17.3	17.1	0.0	0.0	0.0	13.5	10.6	Compliant
20:00 - 20:59	16.9	16.0	17.1	16.9	16.5	16.3	17.3	15.9	17.5	16.6	0.0	0.0	0.0	13.6	10.7	Compliant
21:00 - 21:59	17.1	16.3	17.5	17.1	16.8	16.6	17.4	17.3	17.5	16.7	0.0	0.0	0.0	13.7	10.8	Compliant
22:00 - 22:59	17.3	16.9	17.6	16.6	17.0	16.9	17.3	17.8	17.8	17.2	0.0	0.0	0.0	14.0	12.0	Compliant
23:00 - 23:59	17.1	17.2	17.7	16.8	16.9	15.7	16.7	18.1	17.7	17.9	0.0	0.0	0.0	14.2	12.1	Compliant

Time	16-Nov	17-Nov	18-Nov	19-Nov	20-Nov	21-Nov	22-Nov	23-Nov	24-Nov	25-Nov	26-Nov	27-Nov	28-Nov	29-Nov	30-Nov	Remarks
00:00 - 00:59	12.8	14.5	14.7	16.1	16.7	17.7	18.1	18.3	18.3	18.5	18.2	18.6	18.4	19.9	18.8	Compliant
01:00 - 01:59	13.6	14.6	14.8	16.2	16.8	17.9	18.2	18.3	18.5	18.6	18.3	18.6	18.6	19.9	19.5	Compliant
02:00 - 02:59	13.6	14.9	14.9	16.3	17.0	18.0	18.3	18.5	18.6	18.7	18.4	18.8	18.8	20.1	19.8	Compliant
03:00 - 03:59	13.8	14.9	14.9	16.4	17.0	18.1	18.4	18.6	18.8	18.8	18.5	18.8	18.7	20.2	19.6	Compliant
04:00 - 04:59	14.0	15.1	14.9	16.4	17.1	18.2	18.5	18.6	18.8	18.8	18.5	18.9	18.8	20.2	19.5	Compliant
05:00 - 05:59	13.6	15.2	15.0	16.5	17.2	18.2	18.5	18.6	18.8	18.8	18.6	18.9	18.7	20.2	19.8	Compliant
06:00 - 06:59	13.3	15.4	15.0	16.7	17.2	18.3	18.6	18.6	18.9	18.9	18.6	18.8	18.9	19.9	19.5	Compliant
07:00 - 07:59	13.3	15.3	15.1	16.6	17.3	18.2	18.5	18.6	18.9	18.9	18.6	19.2	18.8	20.0	19.4	Compliant
08:00 - 08:59	13.7	15.1	15.5	16.5	17.2	18.1	18.4	18.7	18.9	18.8	18.6	18.8	18.7	18.6	19.5	Compliant
09:00 - 09:59	13.7	15.0	15.7	16.5	17.2	18.0	18.2	18.7	18.3	18.7	18.5	18.7	18.6	18.1	19.1	Compliant
10:00 - 10:59	13.5	14.9	15.7	16.4	17.0	17.8	18.0	18.4	18.3	18.5	18.3	18.4	18.3	18.0	17.5	Compliant
11:00 - 11:59	13.6	14.8	15.5	16.4	16.9	17.6	17.8	18.1	18.1	18.2	18.0	18.0	17.9	17.7	17.1	Compliant
12:00 - 12:59	13.6	3.1	15.5	16.1	16.8	17.2	17.6	17.6	17.7	17.5	17.8	17.7	17.4	17.3	16.8	Compliant
13:00 - 13:59	13.8	14.0	15.5	16.1	16.7	17.1	17.0	17.4	17.2	16.8	17.6	17.4	17.0	16.6	16.4	Compliant
14:00 - 14:59	13.9	12.9	15.5	16.1	16.5	16.9	16.7	17.1	16.9	0.0	17.4	16.9	16.5	16.4	16.2	Compliant
15:00 - 15:59	14.0	12.7	15.5	16.1	16.4	16.7	16.5	16.8	16.9	0.0	17.3	17.1	16.5	16.4	16.1	Compliant
16:00 - 16:59	14.0	12.7	15.5	16.1	16.4	16.6	16.6	16.7	16.8	0.0	17.3	16.8	16.5	16.5	16.2	Compliant
17:00 - 17:59	14.1	12.7	15.5	16.1	16.4	16.7	16.6	16.7	16.9	0.0	17.4	16.8	16.6	16.6	16.3	Compliant
18:00 - 18:59	14.3	13.5	15.6	16.1	16.5	16.9	16.7	16.9	17.0	6.0	17.5	17.1	16.9	16.9	16.6	Compliant
19:00 - 19:59	14.3	14.0	15.7	16.1	16.8	17.1	17.0	17.2	17.2	13.9	17.6	17.4	17.1	17.1	16.8	Compliant
20:00 - 20:59	14.5	14.2	15.8	16.1	17.0	17.3	17.1	17.5	17.4	16.4	17.9	17.6	17.4	17.3	17.0	Compliant
21:00 - 21:59	14.6	14.4	15.8	16.3	17.2	17.5	17.5	17.7	17.6	17.1	18.1	17.8	17.6	17.3	17.2	Compliant
22:00 - 22:59	14.6	14.5	16.0	16.5	17.5	17.8	17.9	18.0	18.0	17.7	18.2	18.1	19.1	18.4	17.5	Compliant
23:00 - 23:59	14.7	14.7	16.1	16.6	17.6	18.0	18.1	18.1	18.3	18.0	18.5	18.3	20.0	18.9	17.6	Compliant

Remark: GT#11 Borosopic Inspection from 11 Nov 25 to14 Nov 25.

Unit 1 NO_x (ppmv) - December 2025

Time	1-Dec	2-Dec	3-Dec	4-Dec	5-Dec	6-Dec	7-Dec	8-Dec	9-Dec	10-Dec	11-Dec	12-Dec	13-Dec	14-Dec	15-Dec	Remarks
00:00 - 00:59	18.0	17.3	17.9	17.9	18.1	17.9	18.0	17.8	18.2	17.8	18.1	18.1	17.7	17.7	17.6	Compliant
01:00 - 01:59	18.4	17.6	18.0	18.0	18.2	18.1	18.1	18.0	18.9	18.5	19.4	18.4	17.9	17.7	17.7	Compliant
02:00 - 02:59	18.0	17.8	18.1	18.1	18.3	18.2	18.2	19.1	18.4	18.9	19.6	18.2	18.0	17.8	18.1	Compliant
03:00 - 03:59	18.4	18.3	18.2	18.2	18.3	18.3	18.3	18.3	18.7	18.5	18.9	18.9	18.0	17.9	18.0	Compliant
04:00 - 04:59	18.6	18.4	18.2	18.2	18.4	18.3	18.3	18.5	19.0	18.6	18.4	18.1	18.1	18.0	17.9	Compliant
05:00 - 05:59	18.7	18.4	18.2	18.2	18.4	18.2	18.3	18.3	19.1	18.8	18.3	18.2	18.2	17.9	18.0	Compliant
06:00 - 06:59	19.0	18.8	18.4	18.2	18.4	18.3	18.3	18.3	19.3	18.5	18.8	18.6	18.3	17.9	18.5	Compliant
07:00 - 07:59	19.5	19.2	18.6	18.2	18.4	18.4	18.6	18.5	19.3	19.0	18.4	18.4	18.8	18.0	18.2	Compliant
08:00 - 08:59	18.6	18.2	18.3	18.3	18.4	18.3	18.5	18.0	18.1	18.4	17.9	18.3	17.9	17.8	17.6	Compliant
09:00 - 09:59	18.0	17.9	18.2	18.1	18.4	18.1	18.1	17.9	17.9	18.0	18.2	17.9	17.8	17.7	17.6	Compliant
10:00 - 10:59	17.5	17.7	18.0	17.9	18.1	17.9	17.9	17.6	17.8	17.8	17.6	17.8	17.7	17.7	17.4	Compliant
11:00 - 11:59	17.5	17.5	17.7	17.7	17.8	17.7	17.6	17.5	17.5	17.6	17.5	17.6	17.4	17.4	17.0	Compliant
12:00 - 12:59	17.1	17.4	17.5	17.4	17.5	17.4	17.3	17.2	17.3	17.3	17.3	17.4	17.3	17.3	17.3	Compliant
13:00 - 13:59	16.5	17.1	17.0	17.2	17.2	17.2	17.1	17.0	17.0	17.1	17.3	17.2	16.9	17.1	17.1	Compliant
14:00 - 14:59	16.4	16.9	17.0	17.1	16.8	17.0	16.6	16.8	16.5	17.0	16.7	17.0	16.7	16.9	16.8	Compliant
15:00 - 15:59	16.2	16.7	16.8	17.0	17.0	16.9	16.8	16.8	16.7	16.8	16.4	16.9	16.4	16.8	16.5	Compliant
16:00 - 16:59	15.8	16.6	16.6	16.9	16.9	16.9	16.8	16.7	16.7	16.8	16.6	16.9	16.7	16.7	16.7	Compliant
17:00 - 17:59	15.7	16.7	16.7	17.0	17.1	16.9	16.9	16.8	16.8	16.9	16.8	16.9	16.8	16.8	16.8	Compliant
18:00 - 18:59	15.8	16.9	17.1	17.3	17.2	17.1	17.0	17.1	17.0	17.1	16.9	17.1	17.0	17.1	17.0	Compliant
19:00 - 19:59	16.0	17.1	17.1	17.4	17.4	17.3	17.1	17.1	17.0	17.0	17.0	17.1	17.1	16.9	17.2	Compliant
20:00 - 20:59	16.6	17.2	17.3	17.5	17.5	17.5	17.2	17.3	17.1	17.2	17.2	17.1	17.2	17.0	17.3	Compliant
21:00 - 21:59	16.7	17.3	17.5	17.6	17.6	17.6	17.3	17.5	17.3	17.4	17.5	17.3	17.3	17.2	17.4	Compliant
22:00 - 22:59	17.1	17.4	17.6	17.7	17.8	17.7	17.5	17.7	17.4	17.5	17.5	17.4	17.4	17.4	17.6	Compliant
23:00 - 23:59	17.3	17.6	17.8	17.9	17.9	17.9	17.6	17.9	17.7	18.1	17.6	17.5	17.6	17.5	17.7	Compliant

Time	16-Dec	17-Dec	18-Dec	19-Dec	20-Dec	21-Dec	22-Dec	23-Dec	24-Dec	25-Dec	26-Dec	27-Dec	28-Dec	29-Dec	30-Dec	31-Dec	Remarks
00:00 - 00:59	17.9	17.9	17.9	19.3	18.0	18.4	17.6	17.6	17.4	17.3	18.0	17.2	17.1	17.1	17.7	17.9	Compliant
01:00 - 01:59	18.0	18.0	18.0	19.1	18.7	18.0	17.6	17.6	17.5	17.5	17.4	17.2	17.1	17.2	17.8	17.9	Compliant
02:00 - 02:59	18.0	18.0	18.1	19.5	18.4	19.1	17.7	17.7	17.8	17.4	17.4	17.2	17.2	17.3	18.0	18.1	Compliant
03:00 - 03:59	18.2	18.1	18.1	18.7	18.8	18.8	17.9	18.3	18.0	17.5	17.5	17.3	17.6	17.5	18.3	18.1	Compliant
04:00 - 04:59	18.1	18.1	18.1	18.4	19.4	18.5	18.2	17.8	17.6	17.6	17.6	17.5	18.4	17.6	18.1	18.2	Compliant
05:00 - 05:59	18.1	18.2	18.1	18.6	18.9	18.9	18.0	17.7	17.7	17.6	17.7	17.8	18.2	17.8	18.1	18.2	Compliant
06:00 - 06:59	18.2	18.2	18.1	19.0	18.9	18.9	18.0	17.7	17.6	17.6	17.8	17.7	18.2	18.2	18.6	18.4	Compliant
07:00 - 07:59	18.1	18.6	17.9	19.7	19.2	19.5	17.9	17.6	17.6	17.6	18.1	18.8	18.6	18.9	18.6	18.8	Compliant
08:00 - 08:59	17.9	18.1	17.8	18.1	17.7	18.7	17.7	17.5	17.4	17.5	17.2	17.4	17.1	17.6	17.9	18.2	Compliant
09:00 - 09:59	17.8	18.0	17.7	17.9	17.7	17.8	17.9	17.4	17.5	17.5	17.4	17.2	17.2	17.2	17.9	17.9	Compliant
10:00 - 10:59	17.7	17.9	17.6	17.7	17.7	17.7	17.8	17.4	17.3	17.4	17.2	17.0	17.2	17.1	17.8	17.8	Compliant
11:00 - 11:59	18.1	17.7	17.5	17.5	17.5	17.5	17.3	17.1	17.1	17.3	17.1	16.7	16.9	17.0	17.7	17.7	Compliant
12:00 - 12:59	17.3	17.5	17.3	17.3	17.3	17.3	17.2	16.9	17.0	17.1	16.9	16.6	16.8	16.8	17.5	17.6	Compliant
13:00 - 13:59	17.1	17.3	17.1	16.8	16.9	17.0	17.0	16.6	16.7	16.8	16.7	16.1	16.6	16.7	17.2	17.4	Compliant
14:00 - 14:59	16.9	17.1	16.9	16.5	16.4	16.7	16.7	16.4	16.4	16.6	16.3	15.9	16.3	14.5	17.1	17.3	Compliant
15:00 - 15:59	16.7	16.9	16.8	16.4	16.3	16.6	16.6	16.3	16.2	16.6	16.1	15.9	16.2	16.8	17.0	17.0	Compliant
16:00 - 16:59	16.8	16.8	16.7	16.3	16.4	16.6	16.5	16.2	16.1	16.4	15.9	16.0	16.1	16.7	17.0	17.0	Compliant
17:00 - 17:59	16.9	16.9	16.7	16.3	16.6	16.8	16.6	16.3	16.3	16.5	16.1	16.2	16.2	16.7	17.0	17.1	Compliant
18:00 - 18:59	17.0	16.9	16.9	16.5	16.6	16.9	16.8	16.5	16.4	16.7	16.4	16.3	16.2	16.8	17.1	17.1	Compliant
19:00 - 19:59	17.2	16.9	17.1	16.8	16.8	16.9	16.9	16.7	16.5	16.8	16.6	16.3	16.2	16.8	17.3	17.3	Compliant
20:00 - 20:59	17.2	17.1	17.2	16.9	16.7	17.1	17.0	16.7	16.8	16.8	16.6	16.3	16.4	17.0	17.4	17.3	Compliant
21:00 - 21:59	17.3	17.3	17.3	17.0	17.0	17.1	17.1	16.8	17.0	16.9	16.7	16.5	16.6	17.2	17.6	17.5	Compliant
22:00 - 22:59	17.4	17.5	17.4	17.2	17.3	17.2	17.1	17.0	17.1	17.0	17.0	16.9	16.9	17.4	17.7	17.7	Compliant
23:00 - 23:59	17.7	17.7	17.7	17.7	17.7	17.5	17.4	17.2	17.2	17.4	17.2	17.0	17.1	17.5	17.8	17.8	Compliant

Unit 1 NOx (ppmv) - January 2026

Time	1-Jan	2-Jan	3-Jan	4-Jan	5-Jan	6-Jan	7-Jan	8-Jan	9-Jan	10-Jan	11-Jan	12-Jan	13-Jan	14-Jan	15-Jan	Remarks
00:00 - 00:59	17.9	17.8	17.7	17.1	17.4	17.3	18.2	17.2	17.2	16.8	17.0	17.0	17.5	17.1	17.1	Compliant
01:00 - 01:59	17.9	17.9	17.8	17.3	18.6	17.6	17.6	18.0	17.4	17.0	17.5	17.1	17.6	17.2	17.2	Compliant
02:00 - 02:59	18.0	17.9	17.8	17.8	19.5	17.6	18.3	18.9	18.2	17.2	17.3	17.2	17.7	17.4	17.3	Compliant
03:00 - 03:59	18.0	17.9	17.8	18.4	19.0	18.0	18.7	17.9	18.7	17.7	17.3	17.3	17.9	17.4	17.4	Compliant
04:00 - 04:59	18.0	18.0	17.9	18.8	19.1	18.1	18.3	18.0	18.6	17.7	17.8	17.3	17.9	17.5	17.4	Compliant
05:00 - 05:59	18.0	18.0	17.8	18.2	18.9	18.3	18.2	17.7	18.4	17.6	18.2	17.4	17.6	17.5	17.5	Compliant
06:00 - 06:59	18.0	17.9	17.9	19.1	19.0	18.8	18.5	18.3	18.5	17.5	18.0	17.3	18.1	17.5	17.6	Compliant
07:00 - 07:59	18.0	17.9	18.0	19.0	19.1	19.0	18.8	18.9	18.7	18.2	18.3	17.4	18.1	17.4	17.7	Compliant
08:00 - 08:59	17.8	17.8	18.0	18.3	18.0	17.9	18.2	17.8	18.4	17.4	17.6	17.3	17.6	17.4	17.5	Compliant
09:00 - 09:59	17.6	17.8	17.6	17.7	17.3	17.4	17.7	17.4	17.1	17.3	17.1	17.3	17.3	17.5	17.5	Compliant
10:00 - 10:59	17.8	17.7	17.8	17.5	15.6	17.3	17.3	17.2	17.0	17.2	17.1	17.3	17.0	17.3	17.1	Compliant
11:00 - 11:59	17.6	17.6	17.6	17.4	17.0	17.1	17.2	17.1	16.9	17.0	17.0	17.2	17.0	17.1	17.3	Compliant
12:00 - 12:59	17.5	17.5	17.5	17.3	16.8	16.9	17.0	17.0	16.7	16.8	16.8	16.9	16.8	16.8	17.3	Compliant
13:00 - 13:59	17.3	17.3	17.3	17.1	16.7	16.7	16.8	16.8	16.6	16.6	16.6	17.0	16.6	16.8	17.1	Compliant
14:00 - 14:59	17.1	17.1	17.0	16.9	16.5	16.3	16.6	16.8	16.2	16.3	16.4	16.7	16.3	16.6	16.8	Compliant
15:00 - 15:59	16.8	16.9	16.7	16.5	16.3	16.1	16.4	16.5	16.0	16.1	16.2	16.6	16.1	16.4	16.6	Compliant
16:00 - 16:59	16.8	16.9	16.4	16.8	16.3	16.1	16.3	16.4	16.0	16.1	16.1	16.5	16.3	16.3	16.5	Compliant
17:00 - 17:59	16.9	16.9	16.4	17.0	16.4	16.0	16.2	16.5	16.0	16.2	16.1	16.5	16.4	16.4	16.4	Compliant
18:00 - 18:59	17.1	17.0	16.4	17.1	16.5	16.1	16.4	16.5	16.1	16.3	16.2	16.7	16.6	16.3	16.5	Compliant
19:00 - 19:59	17.2	17.1	16.7	17.2	16.6	16.2	16.4	16.5	16.2	16.4	16.3	16.9	16.6	16.4	16.6	Compliant
20:00 - 20:59	17.2	17.3	16.8	17.2	16.6	16.3	16.5	16.5	16.3	16.4	16.4	17.0	16.6	16.5	16.6	Compliant
21:00 - 21:59	17.4	17.5	16.9	17.4	16.8	16.4	16.7	16.6	16.5	16.5	16.5	17.0	16.7	16.7	16.8	Compliant
22:00 - 22:59	17.6	17.6	16.9	17.4	17.2	16.9	16.9	16.9	16.7	16.8	16.7	17.1	16.8	16.9	17.1	Compliant
23:00 - 23:59	17.7	17.6	17.1	17.4	17.2	17.2	17.0	17.1	16.8	16.9	17.3	17.4	17.1	17.0	17.2	Compliant

Time	16-Jan	17-Jan	18-Jan	19-Jan	20-Jan	21-Jan	22-Jan	23-Jan	24-Jan	25-Jan	26-Jan	27-Jan	28-Jan	29-Jan	30-Jan	31-Jan	Remarks
00:00 - 00:59	17.3	17.3	17.1	17.0	17.2	17.3	17.2	17.3	17.3	17.0	17.1	17.2	17.1	17.1	17.0	0.0	Compliant
01:00 - 01:59	17.4	17.4	17.1	17.1	17.3	17.3	17.4	17.4	17.4	17.2	17.1	17.3	17.2	17.2	17.0	0.0	Compliant
02:00 - 02:59	17.5	17.4	17.2	17.2	17.4	17.4	17.5	17.5	17.5	17.3	17.2	17.3	17.4	17.3	17.2	0.0	Compliant
03:00 - 03:59	17.8	17.5	17.2	17.2	17.5	17.5	17.6	17.5	17.6	17.3	17.3	17.4	17.3	17.2	17.3	0.0	Compliant
04:00 - 04:59	17.6	17.6	17.4	17.4	17.5	17.5	17.6	17.6	17.5	17.4	17.4	17.4	18.2	17.2	17.2	0.0	Compliant
05:00 - 05:59	17.7	17.5	17.9	17.6	17.6	18.2	17.6	17.6	17.9	17.5	17.5	17.5	17.9	17.8	18.0	0.0	Compliant
06:00 - 06:59	17.6	17.5	18.3	17.6	18.0	17.7	17.6	18.0	17.6	17.8	17.5	17.5	18.3	17.4	0.0	0.0	Compliant
07:00 - 07:59	17.5	17.4	18.7	17.5	17.6	17.8	17.7	17.6	17.6	17.9	17.5	17.5	18.2	17.5	0.0	0.0	Compliant
08:00 - 08:59	17.5	17.5	17.6	17.3	17.6	17.5	17.5	17.5	17.4	17.5	17.3	17.5	18.5	17.8	0.0	0.0	Compliant
09:00 - 09:59	17.4	17.9	17.1	17.1	17.5	17.6	17.4	17.4	17.4	17.3	17.3	17.4	17.6	17.4	0.0	0.0	Compliant
10:00 - 10:59	17.3	16.9	17.0	16.7	17.6	17.2	17.3	17.1	17.4	17.0	17.3	17.2	17.4	17.3	0.0	0.0	Compliant
11:00 - 11:59	17.3	17.1	16.9	16.9	17.3	17.3	17.2	17.2	17.3	16.9	16.7	0.0	17.3	17.2	0.0	0.0	Compliant
12:00 - 12:59	17.6	16.9	16.7	16.8	17.1	17.3	17.2	17.1	17.0	16.9	16.8	0.0	17.0	17.0	0.0	0.0	Compliant
13:00 - 13:59	17.1	16.6	16.6	16.6	16.9	17.0	17.0	16.9	16.7	16.7	16.8	0.0	16.7	16.7	0.0	0.0	Compliant
14:00 - 14:59	16.9	16.5	16.3	16.3	16.8	16.8	16.7	16.8	16.5	16.6	16.6	9.1	16.6	16.3	0.0	0.0	Compliant
15:00 - 15:59	16.7	16.2	16.1	16.3	16.6	16.5	16.5	16.6	16.3	16.2	16.4	13.1	16.3	16.2	0.0	0.0	Compliant
16:00 - 16:59	16.7	16.1	16.0	16.2	16.4	16.4	16.5	16.5	16.1	16.2	16.3	15.7	16.1	16.1	0.0	0.0	Compliant
17:00 - 17:59	16.6	16.2	16.2	16.3	16.5	16.4	16.5	16.6	16.1	16.2	16.4	15.7	16.1	15.8	0.0	0.0	Compliant
18:00 - 18:59	16.7	16.3	16.3	16.5	16.8	16.5	16.5	16.8	16.3	16.3	16.5	16.4	16.2	16.0	0.0	0.0	Compliant
19:00 - 19:59	16.9	16.5	16.5	16.6	16.8	16.6	16.5	16.8	16.4	16.4	16.5	16.6	16.4	16.3	0.0	0.0	Compliant
20:00 - 20:59	17.0	16.6	16.6	16.7	16.8	16.7	16.6	16.7	16.4	16.5	16.6	16.6	16.5	16.4	0.0	0.0	Compliant
21:00 - 21:59	16.9	16.6	16.7	16.8	16.9	16.7	16.7	16.8	16.5	16.6	16.7	16.7	16.6	16.6	0.0	0.0	Compliant
22:00 - 22:59	17.1	16.8	16.8	17.1	17.1	16.9	17.0	17.1	16.7	16.9	16.8	16.8	16.8	16.8	0.0	0.0	Compliant
23:00 - 23:59	17.2	17.1	17.1	17.2	17.2	17.1	17.2	17.2	16.9	17.0	17.1	17.0	17.0	17.0	0.0	0.0	Compliant

Remark: Plant shutdown from 30 Jan 26 to 01 Feb 26 due to Steel Mill-Thapyaywa Line Maintenance

Unit 1 NOx (ppmv) - February 2026

Time	1-Feb	2-Feb	3-Feb	4-Feb	5-Feb	6-Feb	7-Feb	8-Feb	9-Feb	10-Feb	11-Feb	12-Feb	13-Feb	14-Feb	Remarks
00:00 - 00:59	0.0	0.0	18.3	17.8	17.1	16.8	16.7	16.4	16.4	16.4	16.6	16.1	16.5	16.3	Compliant
01:00 - 01:59	0.0	0.0	18.3	17.9	17.2	16.9	16.7	16.5	16.5	16.6	16.8	16.4	16.6	16.5	Compliant
02:00 - 02:59	0.0	0.0	18.3	18.0	17.2	17.0	16.9	16.7	16.7	16.6	17.0	17.0	18.0	16.4	Compliant
03:00 - 03:59	0.0	0.0	18.4	18.0	17.3	17.1	17.0	16.8	16.7	16.8	17.0	17.9	19.0	16.4	Compliant
04:00 - 04:59	0.0	0.0	18.5	18.1	17.4	17.1	17.1	16.8	16.8	16.8	17.2	17.9	18.8	16.6	Compliant
05:00 - 05:59	0.0	0.0	18.5	18.2	17.4	17.7	17.1	16.9	16.9	16.9	17.2	18.5	18.9	16.6	Compliant
06:00 - 06:59	0.0	0.0	18.6	18.2	17.4	17.4	17.2	17.4	17.0	16.9	17.3	18.2	18.8	16.5	Compliant
07:00 - 07:59	0.0	0.0	18.5	18.1	17.4	17.2	17.3	18.3	17.0	16.9	17.4	18.4	18.9	16.6	Compliant
08:00 - 08:59	0.0	0.0	18.4	18.0	17.4	17.2	17.0	17.2	16.9	16.8	17.1	17.6	18.8	16.6	Compliant
09:00 - 09:59	0.0	0.0	18.1	17.9	17.3	17.2	16.9	16.8	16.7	16.8	17.0	17.0	17.2	16.7	Compliant
10:00 - 10:59	0.0	30.1	18.0	17.7	17.0	17.1	16.7	16.7	16.6	16.6	16.8	16.9	17.2	16.7	Low Load
11:00 - 11:59	0.0	16.4	16.8	17.4	16.8	16.8	16.4	16.5	16.5	16.4	16.6	16.7	17.2	16.5	Compliant
12:00 - 12:59	0.0	18.4	-841.5	17.2	16.5	16.6	16.2	16.4	13.9	16.3	16.5	16.8	16.8	16.4	Compliant
13:00 - 13:59	0.0	18.0	9.7	16.9	16.4	16.4	16.0	16.2	16.3	16.2	16.2	16.5	16.4	16.3	Compliant
14:00 - 14:59	0.0	17.5	13.2	13.8	16.2	16.2	15.8	16.0	16.0	16.1	15.9	16.1	16.1	16.1	Compliant
15:00 - 15:59	0.0	17.3	16.4	16.1	15.9	15.9	15.6	15.8	15.9	16.0	15.6	5.6	15.8	16.0	Compliant
16:00 - 16:59	0.0	17.4	16.3	16.4	15.8	15.8	15.5	15.8	15.7	15.9	14.8	5.1	15.4	15.9	Compliant
17:00 - 17:59	0.0	17.6	16.4	16.5	15.9	15.7	15.5	15.8	15.6	15.8	14.7	11.2	15.2	15.9	Compliant
18:00 - 18:59	0.0	17.6	16.8	16.5	16.0	15.9	15.5	15.8	15.7	15.9	14.9	14.8	15.3	15.9	Compliant
19:00 - 19:59	0.0	17.7	17.4	16.7	16.1	16.1	15.7	15.9	15.8	16.0	15.3	15.6	15.4	16.1	Compliant
20:00 - 20:59	0.0	17.5	17.5	16.4	16.3	15.9	15.8	16.0	16.0	16.1	15.4	15.8	15.7	16.2	Compliant
21:00 - 21:59	0.0	17.9	17.5	16.8	16.4	16.2	15.9	15.8	16.1	15.9	15.6	15.7	15.8	16.2	Compliant
22:00 - 22:59	0.0	18.0	17.6	17.0	16.5	16.5	16.1	16.2	16.3	16.3	15.7	16.1	15.9	16.2	Compliant
23:00 - 23:59	0.0	18.2	17.8	17.0	16.7	16.6	16.3	16.3	16.4	16.5	16.0	16.3	16.1	16.2	Compliant

Time	15-Feb	16-Feb	17-Feb	18-Feb	19-Feb	20-Feb	21-Feb	22-Feb	23-Feb	24-Feb	25-Feb	26-Feb	27-Feb	28-Feb	Remarks
00:00 - 00:59	15.9	16.0	16.0	15.6	14.6	14.7	16.4	16.4	16.4	16.0	16.1	16.8	16.4	15.8	Compliant
01:00 - 01:59	15.8	16.0	15.9	15.5	14.8	14.9	16.5	16.5	16.4	16.1	16.2	16.8	16.4	15.9	Compliant
02:00 - 02:59	15.8	16.0	16.1	15.6	14.6	15.0	16.6	16.7	16.6	16.3	16.2	16.8	16.6	15.9	Compliant
03:00 - 03:59	15.9	16.0	16.2	15.7	14.7	15.1	16.7	16.8	16.7	16.2	16.4	16.9	16.6	16.0	Compliant
04:00 - 04:59	16.4	16.3	16.4	15.7	14.8	15.2	16.8	16.7	16.7	16.2	16.4	17.0	16.7	15.9	Compliant
05:00 - 05:59	16.8	16.6	16.4	15.8	14.6	15.2	16.4	16.8	16.5	16.2	16.2	17.1	16.3	15.9	Compliant
06:00 - 06:59	16.4	16.4	16.4	15.9	14.8	15.2	16.8	17.0	16.8	16.3	16.6	17.1	16.6	15.8	Compliant
07:00 - 07:59	16.5	16.4	16.3	15.9	14.9	15.3	17.0	17.0	16.8	16.3	16.6	17.2	16.7	15.8	Compliant
08:00 - 08:59	16.3	16.2	16.4	15.8	14.9	15.3	17.0	16.8	16.8	16.3	16.5	17.1	16.5	15.9	Compliant
09:00 - 09:59	16.3	16.2	16.5	15.7	14.9	15.3	16.8	16.7	16.7	16.5	16.3	17.0	16.5	16.2	Compliant
10:00 - 10:59	16.3	16.2	16.7	15.6	14.8	15.1	16.6	16.6	15.6	16.5	16.3	16.8	16.5	16.2	Compliant
11:00 - 11:59	16.2	16.2	16.4	15.4	14.8	14.9	16.5	16.6	16.3	16.3	16.3	16.7	16.4	16.0	Compliant
12:00 - 12:59	16.0	16.0	16.3	15.5	14.6	14.9	16.4	16.6	7.4	16.2	16.4	16.6	16.2	15.8	Compliant
13:00 - 13:59	15.7	15.9	0.0	15.3	14.4	14.9	16.2	16.2	5.0	15.9	16.3	16.5	15.9	15.7	Compliant
14:00 - 14:59	15.6	15.8	12.7	14.5	14.2	15.2	16.1	16.1	5.6	15.5	16.3	16.2	15.7	15.5	Compliant
15:00 - 15:59	15.4	15.7	15.2	16.3	14.0	15.2	16.1	16.2	6.8	15.3	16.1	16.0	15.5	15.1	Compliant
16:00 - 16:59	15.2	15.3	14.8	0.0	13.7	14.9	15.7	15.9	14.9	15.1	16.2	16.0	15.4	14.9	Compliant
17:00 - 17:59	15.2	15.3	14.8	0.0	13.6	14.9	15.5	15.7	14.8	15.1	16.1	15.8	15.2	14.9	Compliant
18:00 - 18:59	15.4	15.6	15.0	0.0	13.6	15.0	15.8	15.8	15.0	15.2	16.2	15.9	15.4	15.1	Compliant
19:00 - 19:59	15.5	15.7	15.1	0.0	13.9	15.3	15.9	15.5	15.3	15.3	16.3	16.0	15.4	15.2	Compliant
20:00 - 20:59	15.6	15.7	15.1	0.0	14.2	15.7	15.9	15.5	15.6	15.3	16.4	16.1	15.5	15.2	Compliant
21:00 - 21:59	15.7	15.8	15.2	0.0	14.3	15.9	16.0	15.7	15.6	15.3	16.4	16.2	15.6	15.5	Compliant
22:00 - 22:59	15.8	15.9	15.4	4.5	14.6	16.2	16.0	16.0	15.7	15.5	16.5	16.3	15.7	15.6	Compliant
23:00 - 23:59	15.8	16.0	15.5	10.7	14.6	16.3	16.2	16.3	15.8	15.7	16.7	16.5	15.7	15.5	Compliant

Remark: Plant shutdown from 30 Jan 26 to 01 Feb 26 due to Steel Mill-Thapyaywa Line Maintenance

Unit 1 NOx (ppmv) - March 2026

Time	1-Mar	2-Mar	3-Mar	4-Mar	5-Mar	6-Mar	7-Mar	8-Mar	9-Mar	10-Mar	11-Mar	12-Mar	13-Mar	14-Mar	15-Mar	Remarks
00:00 - 00:59	15.6	3.4	14.8	16.8	16.0	15.1	15.4	14.8	16.4	16.5	16.8	16.8	17.6	16.5	16.4	Compliant
01:00 - 01:59	15.6	3.4	15.0	16.9	16.1	15.3	15.6	15.0	16.8	16.9	17.0	17.2	17.8	16.6	16.6	Compliant
02:00 - 02:59	15.6	3.5	15.2	17.0	16.3	15.4	15.7	15.2	17.0	18.1	17.3	17.5	17.9	16.7	16.7	Compliant
03:00 - 03:59	15.7	3.4	15.3	17.0	16.3	15.5	15.8	15.4	17.2	17.4	17.5	17.5	18.0	17.0	16.8	Compliant
04:00 - 04:59	15.7	6.2	15.3	17.1	16.4	15.7	15.9	15.3	17.3	17.5	17.7	17.3	18.1	17.1	16.8	Compliant
05:00 - 05:59	15.5	13.2	15.0	17.1	16.1	15.8	15.8	15.4	17.1	17.6	17.6	17.3	17.8	17.3	16.6	Compliant
06:00 - 06:59	15.8	15.1	15.4	17.2	16.4	15.8	16.2	15.6	17.5	17.8	18.0	17.3	18.0	17.4	17.1	Compliant
07:00 - 07:59	15.9	15.2	15.4	17.1	16.4	15.9	16.2	11.7	18.6	17.9	18.2	17.5	18.0	17.5	17.3	Compliant
08:00 - 08:59	15.9	15.3	15.4	17.1	16.3	15.8	16.1	8.1	17.8	17.7	18.2	17.6	17.9	17.5	17.3	Compliant
09:00 - 09:59	15.9	15.3	15.4	17.1	16.2	15.8	16.0	7.5	17.5	17.5	17.4	17.4	17.9	17.4	17.3	Compliant
10:00 - 10:59	15.8	15.3	15.2	17.0	16.2	15.7	15.8	7.0	17.1	17.5	16.5	17.3	17.9	17.3	17.1	Compliant
11:00 - 11:59	15.7	15.2	14.8	16.8	16.1	15.7	15.3	6.9	16.9	17.6	15.5	17.1	17.7	16.9	16.9	Compliant
12:00 - 12:59	15.3	14.7	16.1	16.6	16.1	15.6	14.8	7.4	16.6	17.0	13.6	16.9	17.5	16.4	16.6	Compliant
13:00 - 13:59	15.1	14.3	15.9	16.3	15.9	15.4	14.5	6.7	16.4	16.3	11.0	16.7	17.2	16.0	16.2	Compliant
14:00 - 14:59	15.0	14.1	15.8	15.9	15.8	15.1	14.1	4.8	14.4	16.0	11.5	16.5	16.8	15.5	15.9	Compliant
15:00 - 15:59	14.8	13.9	15.6	15.7	16.2	14.9	14.0	3.8	14.9	15.6	9.9	16.1	16.4	15.0	15.6	Compliant
16:00 - 16:59	14.6	13.9	15.7	15.5	14.9	14.8	14.0	3.3	4.7	15.1	2.8	15.9	15.6	14.5	15.4	Compliant
17:00 - 17:59	14.4	13.9	15.5	15.2	14.7	14.7	13.8	3.2	3.6	14.7	2.9	15.9	15.3	14.2	14.9	Compliant
18:00 - 18:59	14.6	13.9	15.7	15.3	14.7	14.8	13.8	3.4	3.7	14.7	6.6	16.0	15.4	14.2	14.6	Compliant
19:00 - 19:59	14.8	14.1	15.9	15.4	14.6	14.8	13.9	3.0	6.7	14.9	10.0	16.1	15.5	14.3	14.7	Compliant
20:00 - 20:59	14.8	14.3	16.0	15.4	14.6	15.0	14.1	10.8	10.9	15.1	12.5	16.3	15.6	14.9	14.7	Compliant
21:00 - 21:59	15.0	14.3	16.1	15.5	14.9	15.0	14.2	13.3	13.7	15.4	14.1	16.5	15.8	15.5	14.9	Compliant
22:00 - 22:59	15.3	14.6	16.5	15.7	14.9	15.1	14.4	14.8	14.1	15.7	15.3	17.0	16.1	15.9	15.2	Compliant
23:00 - 23:59	15.2	14.6	16.7	15.9	15.0	15.3	14.7	15.6	15.7	16.2	16.3	17.5	16.3	16.2	15.6	Compliant

Time	16-Mar	17-Mar	18-Mar	19-Mar	20-Mar	21-Mar	22-Mar	23-Mar	24-Mar	25-Mar	26-Mar	27-Mar	28-Mar	29-Mar	30-Mar	31-Mar	Remarks
00:00 - 00:59	16.4	16.2	16.4	15.2	16.2	18.6	19.0	17.8	16.8	16.3	16.0	15.3	15.1	15.7	15.1	15.5	Compliant
01:00 - 01:59	17.1	16.7	16.5	15.3	16.4	18.5	19.1	17.9	17.0	16.4	16.2	15.5	15.3	16.1	7.7	15.8	Compliant
02:00 - 02:59	17.3	16.8	16.7	15.7	16.4	18.6	19.1	18.3	17.1	16.5	16.6	15.7	15.6	16.4	5.7	15.8	Compliant
03:00 - 03:59	17.2	16.8	16.8	15.8	16.5	18.7	19.2	18.5	17.2	16.8	16.8	15.9	15.7	16.6	6.1	16.1	Compliant
04:00 - 04:59	17.3	16.9	16.8	16.0	16.7	18.9	19.4	18.6	17.4	17.0	16.8	16.0	15.9	16.9	6.0	16.2	Compliant
05:00 - 05:59	17.4	16.7	16.9	16.0	16.8	18.7	19.7	18.6	17.4	16.8	16.9	15.9	15.9	16.7	10.8	16.1	Compliant
06:00 - 06:59	17.5	17.0	16.9	16.5	16.9	19.0	19.5	19.1	17.6	17.1	17.0	16.4	16.3	17.1	15.6	16.5	Compliant
07:00 - 07:59	17.5	17.0	16.9	16.9	16.8	19.4	19.5	19.1	17.6	17.2	16.9	16.7	16.3	17.2	16.2	16.6	Compliant
08:00 - 08:59	17.5	17.0	17.0	17.0	16.9	19.1	19.0	18.9	17.5	17.1	16.8	17.0	16.6	17.0	16.5	16.5	Compliant
09:00 - 09:59	17.4	17.4	17.1	17.1	17.1	18.9	18.6	18.8	17.3	17.1	16.8	17.0	16.6	16.9	16.7	16.5	Compliant
10:00 - 10:59	17.2	17.2	16.9	17.1	17.1	18.6	18.1	17.2	17.1	16.8	16.5	16.8	16.5	17.5	16.6	15.7	Compliant
11:00 - 11:59	17.0	17.0	16.7	16.9	16.9	18.5	17.8	17.2	16.9	16.5	16.2	16.7	16.3	16.8	16.4	8.0	Compliant
12:00 - 12:59	16.8	16.7	16.5	16.6	16.6	18.3	17.5	16.7	16.4	16.1	15.9	16.4	15.9	16.4	16.1	6.5	Compliant
13:00 - 13:59	16.5	16.5	16.0	16.2	16.2	18.1	17.1	16.4	16.0	15.6	15.6	16.2	15.7	16.2	16.0	6.5	Compliant
14:00 - 14:59	15.5	16.3	15.6	15.9	15.8	18.0	16.6	16.2	15.6	15.3	12.3	15.1	14.9	15.8	15.5	79.8	Compliant
15:00 - 15:59	15.5	16.3	15.0	15.6	12.9	17.8	16.4	15.8	15.4	15.1	8.1	14.6	13.6	15.6	15.3	10.7	Compliant
16:00 - 16:59	15.3	16.2	14.3	15.2	7.0	17.7	16.2	15.5	15.2	15.0	14.4	14.5	13.2	15.4	15.1	15.6	Compliant
17:00 - 17:59	15.3	15.9	14.1	14.9	17.0	17.8	16.1	15.3	15.1	14.7	17.7	14.4	13.2	15.2	14.8	15.9	Compliant
18:00 - 18:59	15.2	15.7	14.3	15.0	-156.0	17.9	16.2	15.2	15.1	14.5	16.0	14.3	13.1	15.5	14.6	16.1	Compliant
19:00 - 19:59	15.4	15.8	14.3	14.9	9.8	18.0	16.3	15.3	15.4	14.7	15.9	14.2	13.4	15.3	14.5	16.1	Compliant
20:00 - 20:59	15.6	15.8	14.2	14.9	12.1	18.0	16.7	15.5	15.5	14.7	16.2	14.2	13.6	15.2	14.7	16.3	Compliant
21:00 - 21:59	15.9	16.0	14.5	15.6	15.9	18.1	17.1	15.9	15.6	15.1	15.1	14.7	14.2	15.1	14.8	16.6	Compliant
22:00 - 22:59	16.0	16.2	14.9	15.7	16.4	18.1	17.3	16.2	16.0	15.4	14.8	14.9	14.8	15.3	15.0	17.1	Compliant
23:00 - 23:59	16.0	16.4	15.0	16.0	17.4	18.2	17.5	16.4	16.2	15.6	15.1	14.9	15.1	15.1	15.1	17.6	Compliant

Unit 2 NO_x (ppmv) - April 2025

Time	1-Apr	2-Apr	3-Apr	4-Apr	5-Apr	6-Apr	7-Apr	8-Apr	9-Apr	10-Apr	11-Apr	12-Apr	13-Apr	14-Apr	15-Apr	Remarks
00:00 - 00:59	0.0	15.2	13.5	12.3	13.2	13.4	12.8	16.5	16.3	16.2	16.0	16.6	16.1	16.2	18.8	Compliant
01:00 - 01:59	0.0	15.3	13.5	12.5	13.4	13.4	12.5	16.7	16.2	16.1	16.1	16.7	16.2	16.6	18.8	Compliant
02:00 - 02:59	0.0	15.7	13.7	12.8	13.4	13.4	12.5	16.8	16.3	16.3	16.1	16.6	16.3	16.9	18.8	Compliant
03:00 - 03:59	0.0	16.0	13.8	13.0	13.4	13.3	12.6	16.7	16.3	16.2	16.2	16.7	16.4	16.9	18.8	Compliant
04:00 - 04:59	0.0	15.8	13.7	12.9	13.3	13.1	12.8	16.6	16.1	15.9	16.2	16.8	16.5	17.0	18.7	Compliant
05:00 - 05:59	0.0	15.9	13.9	12.6	13.7	13.3	13.0	16.9	16.2	15.8	16.3	16.9	16.6	17.0	18.8	Compliant
06:00 - 06:59	0.0	15.7	14.2	13.1	13.7	13.3	13.1	16.9	16.3	16.0	16.5	16.9	16.6	16.9	18.8	Compliant
07:00 - 07:59	0.0	15.6	14.1	12.5	13.8	13.5	13.2	17.1	16.4	16.0	16.4	16.8	16.6	16.8	18.7	Compliant
08:00 - 08:59	0.0	15.3	13.9	12.1	13.5	13.5	13.3	16.9	16.2	16.0	16.4	16.5	16.3	16.7	18.5	Compliant
09:00 - 09:59	0.0	14.9	13.4	12.1	13.2	13.4	15.7	16.8	16.3	15.7	16.2	16.2	16.0	17.9	18.2	Compliant
10:00 - 10:59	0.0	14.6	13.0	11.9	12.9	13.1	17.1	16.5	16.4	15.8	15.9	16.1	15.7	17.7	18.0	Compliant
11:00 - 11:59	0.0	14.1	12.6	11.7	12.5	12.8	16.6	16.0	16.2	15.6	15.6	15.9	15.4	17.3	17.7	Compliant
12:00 - 12:59	23.2	13.6	12.0	11.3	12.2	12.7	15.5	15.7	15.9	15.5	15.4	15.7	15.3	17.3	17.5	Compliant
13:00 - 13:59	25.3	13.1	11.7	11.0	11.7	12.4	14.5	15.3	15.7	15.1	15.3	15.4	14.8	17.5	17.3	Low Load
14:00 - 14:59	36.9	12.8	11.3	10.8	11.4	12.2	14.2	15.1	15.4	15.0	15.3	15.2	14.6	17.3	17.2	Low Load
15:00 - 15:59	39.5	12.3	10.7	11.1	11.4	12.1	14.3	15.1	15.4	15.0	14.9	15.1	14.1	17.1	16.6	Low Load
16:00 - 16:59	37.8	12.1	10.4	11.6	11.2	12.0	15.5	15.1	15.3	15.0	15.5	14.9	14.3	16.9	16.9	Low Load
17:00 - 17:59	24.4	12.2	10.3	11.6	11.0	12.1	15.7	15.2	15.2	15.0	15.5	14.9	14.3	16.9	17.7	Compliant
18:00 - 18:59	43.6	12.4	10.5	11.7	11.8	12.1	15.7	15.4	15.4	15.0	15.6	15.0	15.0	17.1	18.0	Low Load
19:00 - 19:59	30.9	12.8	10.5	12.0	12.4	12.1	16.0	15.5	15.6	15.1	15.7	15.2	15.2	17.9	18.1	Low Load
20:00 - 20:59	11.8	13.1	10.6	12.5	12.7	12.2	16.0	15.7	15.8	15.2	16.0	15.4	15.5	18.3	18.2	Compliant
21:00 - 21:59	14.2	13.4	10.8	12.7	13.1	12.5	16.3	16.1	15.8	15.5	16.1	15.6	15.9	18.5	18.2	Compliant
22:00 - 22:59	15.1	13.5	11.0	13.0	13.3	12.6	16.4	16.2	16.0	15.6	16.3	15.8	16.1	18.6	18.4	Compliant
23:00 - 23:59	15.1	13.6	11.7	13.1	13.3	12.8	16.5	16.2	16.0	15.8	16.5	15.8	16.1	18.7	18.5	Compliant

Time	16-Apr	17-Apr	18-Apr	19-Apr	20-Apr	21-Apr	22-Apr	23-Apr	24-Apr	25-Apr	26-Apr	27-Apr	28-Apr	29-Apr	30-Apr	Remarks
00:00 - 00:59	18.5	17.6	17.6	17.3	17.3	16.6	17.3	17.1	16.9	16.9	16.9	16.9	16.9	18.1	19.0	Compliant
01:00 - 01:59	18.6	17.8	17.7	17.4	17.5	16.8	17.4	17.3	17.0	17.1	17.1	17.2	17.3	18.4	19.1	Compliant
02:00 - 02:59	18.6	17.9	17.7	17.5	17.5	16.9	17.7	17.3	17.3	17.4	17.3	17.4	17.3	18.6	19.2	Compliant
03:00 - 03:59	18.5	18.0	17.8	17.6	17.7	17.0	17.9	17.5	17.5	17.6	17.5	17.5	17.5	18.7	19.2	Compliant
04:00 - 04:59	18.5	17.9	17.9	17.6	17.7	17.0	18.1	17.6	17.5	17.7	17.6	17.6	17.7	18.8	19.2	Compliant
05:00 - 05:59	18.5	17.9	18.0	17.7	17.6	17.3	18.1	17.7	17.4	17.9	17.7	17.7	17.8	18.8	19.3	Compliant
06:00 - 06:59	18.5	18.1	18.0	17.7	17.6	17.4	18.1	17.8	17.7	17.9	17.8	17.8	17.9	18.9	19.3	Compliant
07:00 - 07:59	18.6	18.1	17.8	17.6	17.7	17.4	18.0	17.8	17.8	17.9	17.8	17.6	17.8	18.7	19.3	Compliant
08:00 - 08:59	18.4	18.0	17.6	17.4	17.6	17.2	17.7	17.7	17.6	17.7	17.5	17.6	17.7	18.5	19.1	Compliant
09:00 - 09:59	18.1	17.8	17.4	17.2	17.3	17.9	17.5	17.4	17.0	17.4	17.2	17.4	17.6	18.4	18.7	Compliant
10:00 - 10:59	17.8	17.6	17.1	16.9	17.0	17.7	17.1	17.0	16.5	16.8	16.9	17.1	17.5	18.2	18.6	Compliant
11:00 - 11:59	17.4	17.2	16.8	16.4	16.7	17.2	16.8	16.6	16.0	16.2	16.5	16.8	16.9	17.8	18.4	Compliant
12:00 - 12:59	17.0	16.8	16.5	16.0	16.4	16.8	16.5	16.3	15.5	15.7	16.1	16.5	16.4	17.9	18.2	Compliant
13:00 - 13:59	16.9	16.6	16.1	16.1	16.1	16.4	16.1	16.1	15.1	15.4	15.8	16.2	16.1	17.7	17.9	Compliant
14:00 - 14:59	16.7	16.4	15.9	15.5	16.0	16.3	15.5	15.8	14.8	15.1	15.5	16.0	15.6	17.5	17.8	Compliant
15:00 - 15:59	16.4	16.2	15.7	15.2	15.9	16.1	15.4	15.6	14.5	14.9	15.1	15.8	15.4	17.4	17.6	Compliant
16:00 - 16:59	16.2	15.7	15.7	15.0	15.7	15.8	15.1	15.3	14.3	14.8	14.8	15.7	15.1	17.4	17.6	Compliant
17:00 - 17:59	16.2	16.1	15.6	15.2	15.7	15.9	15.2	15.1	14.3	14.8	14.7	15.6	14.9	17.4	18.1	Compliant
18:00 - 18:59	16.3	16.2	15.8	15.4	15.6	16.0	15.5	15.3	14.7	15.2	15.0	15.6	15.0	17.4	18.2	Compliant
19:00 - 19:59	16.6	16.5	16.2	15.8	15.8	16.3	15.9	15.6	15.0	15.6	15.3	15.9	15.3	17.5	18.4	Compliant
20:00 - 20:59	16.6	16.8	16.5	16.3	16.0	16.6	16.0	15.8	15.4	15.8	15.7	16.1	16.0	17.6	18.8	Compliant
21:00 - 21:59	16.7	17.1	16.7	16.6	16.1	16.8	16.3	16.1	16.0	16.0	15.9	16.4	16.8	17.8	19.0	Compliant
22:00 - 22:59	16.9	17.4	16.9	16.8	16.3	17.1	16.7	16.4	16.4	16.3	16.2	16.6	17.4	18.1	19.2	Compliant
23:00 - 23:59	17.2	17.6	17.1	17.1	16.4	17.4	16.9	16.7	16.7	16.6	16.4	16.8	17.9	18.9	19.3	Compliant

Unit 2 NO_x (ppmv) - May 2025

Time	1-May	2-May	3-May	4-May	5-May	6-May	7-May	8-May	9-May	10-May	11-May	12-May	13-May	14-May	15-May	Remarks
00:00 - 00:59	19.2	18.7	18.8	18.0	18.1	17.7	17.8	17.3	17.4	17.5	17.5	19.0	18.4	18.5	18.3	Compliant
01:00 - 01:59	19.2	18.7	18.9	18.3	18.3	17.7	17.8	17.6	17.8	17.6	17.8	19.3	18.5	18.6	18.4	Compliant
02:00 - 02:59	19.2	18.8	18.9	18.4	18.4	17.8	17.9	17.7	17.9	17.7	18.0	19.5	18.7	18.7	18.5	Compliant
03:00 - 03:59	19.1	18.9	18.9	18.4	18.3	17.9	17.9	17.9	18.2	17.8	18.1	19.6	18.9	18.6	18.6	Compliant
04:00 - 04:59	19.1	18.9	18.9	18.4	18.5	18.1	18.2	18.0	18.3	18.0	18.2	19.6	19.0	18.6	18.7	Compliant
05:00 - 05:59	19.2	18.9	18.9	18.6	18.7	18.3	18.3	18.1	18.4	18.4	18.5	19.6	19.0	18.7	18.8	Compliant
06:00 - 06:59	19.2	18.9	18.9	18.6	18.5	18.4	18.5	18.1	18.4	18.5	18.7	19.6	18.9	18.7	18.8	Compliant
07:00 - 07:59	19.2	19.0	18.7	18.7	18.5	18.3	18.6	18.2	18.2	18.3	18.7	19.6	18.8	18.7	18.7	Compliant
08:00 - 08:59	19.1	18.9	18.6	18.4	18.3	18.0	18.3	17.9	18.0	17.9	18.5	19.4	18.6	18.7	18.5	Compliant
09:00 - 09:59	18.9	19.0	18.3	18.1	18.0	17.7	18.0	17.6	17.8	17.7	18.3	19.0	18.4	18.4	18.3	Compliant
10:00 - 10:59	18.8	19.0	18.1	17.9	18.0	17.5	17.8	17.4	17.7	17.5	18.0	18.7	17.8	18.2	18.0	Compliant
11:00 - 11:59	18.2	18.9	17.9	17.6	17.5	17.2	17.4	17.1	17.2	17.2	17.7	18.4	17.7	17.9	17.6	Compliant
12:00 - 12:59	18.1	18.8	17.3	17.4	16.6	16.9	16.6	16.8	16.4	11.2	17.2	18.0	17.3	17.6	17.0	Compliant
13:00 - 13:59	17.8	18.6	17.4	17.2	16.7	16.7	16.6	16.5	16.3	10.4	16.8	17.7	17.1	17.3	16.9	Compliant
14:00 - 14:59	17.7	18.5	17.2	17.0	16.6	16.5	16.4	16.3	16.0	11.0	16.5	17.3	16.8	17.0	17.1	Compliant
15:00 - 15:59	17.8	18.3	17.1	16.9	16.4	16.4	16.2	16.0	16.0	11.0	16.2	17.1	16.6	16.9	16.8	Compliant
16:00 - 16:59	17.8	18.3	17.0	16.9	16.4	16.4	16.2	15.8	15.9	10.1	16.0	17.2	16.6	16.8	17.0	Compliant
17:00 - 17:59	17.9	18.2	17.0	16.9	16.4	16.4	16.2	16.0	16.0	14.3	16.4	17.3	17.0	16.7	17.4	Compliant
18:00 - 18:59	18.0	18.2	17.2	17.1	16.5	16.5	16.3	16.3	16.1	15.3	16.6	17.5	17.2	17.1	17.7	Compliant
19:00 - 19:59	18.2	18.3	17.3	17.3	16.7	16.8	16.5	16.4	16.3	16.2	16.8	17.6	17.5	17.5	18.3	Compliant
20:00 - 20:59	18.3	18.5	17.6	17.4	16.9	17.0	16.8	16.6	16.7	16.4	17.0	17.7	17.7	17.7	18.5	Compliant
21:00 - 21:59	18.5	18.7	17.6	17.6	17.0	17.2	17.0	16.8	16.9	16.7	17.3	17.8	17.9	17.8	18.6	Compliant
22:00 - 22:59	18.7	18.6	17.8	17.8	17.3	17.4	17.1	17.0	17.1	16.8	17.8	18.0	18.1	18.0	18.8	Compliant
23:00 - 23:59	18.7	18.8	17.9	17.9	17.5	17.5	17.2	17.3	17.3	17.1	18.6	18.3	18.3	18.2	18.9	Compliant

Time	16-May	17-May	18-May	19-May	20-May	21-May	22-May	23-May	24-May	25-May	26-May	27-May	28-May	29-May	30-May	31-May	Remarks
00:00 - 00:59	19.0	18.6	19.4	18.8	19.1	19.1	19.0	19.4	19.3	19.7	20.4	18.6	18.7	18.4	18.1	18.4	Compliant
01:00 - 01:59	19.2	18.7	19.5	18.8	19.1	19.4	19.3	19.5	19.4	19.8	20.4	18.6	18.6	18.5	18.1	18.4	Compliant
02:00 - 02:59	19.4	18.8	19.4	18.9	19.2	19.5	19.3	19.6	19.5	19.9	20.3	18.6	18.6	18.6	18.1	18.2	Compliant
03:00 - 03:59	19.4	18.8	19.6	18.9	19.3	19.5	19.2	19.6	19.6	20.0	20.4	18.7	18.6	18.5	18.2	18.2	Compliant
04:00 - 04:59	19.2	18.8	19.4	18.8	19.3	19.5	19.3	19.6	19.7	20.1	20.3	18.7	18.4	18.5	18.2	18.2	Compliant
05:00 - 05:59	19.1	18.9	19.4	18.9	19.4	19.6	19.4	19.7	19.9	20.0	20.3	18.6	18.1	18.4	18.2	18.1	Compliant
06:00 - 06:59	19.1	18.9	19.4	18.9	19.3	19.6	19.4	19.8	20.0	19.9	20.3	18.7	18.1	18.4	18.1	18.2	Compliant
07:00 - 07:59	19.0	18.9	19.3	18.8	19.2	19.4	19.6	19.8	20.0	20.0	20.2	18.7	18.0	18.4	18.0	18.1	Compliant
08:00 - 08:59	18.9	18.8	19.1	18.7	19.0	19.2	19.3	19.5	19.8	20.1	20.2	18.7	17.9	18.4	18.0	18.0	Compliant
09:00 - 09:59	18.6	18.5	18.9	18.4	18.6	18.9	19.0	19.2	19.6	20.2	20.3	18.7	17.8	18.3	17.9	17.9	Compliant
10:00 - 10:59	18.4	18.2	18.7	18.2	18.3	18.8	18.8	19.0	19.4	20.1	20.1	18.7	17.7	18.3	17.9	17.8	Compliant
11:00 - 11:59	18.1	17.9	18.5	18.3	17.9	18.5	18.6	18.7	19.0	20.0	18.6	18.6	17.5	18.4	17.8	17.8	Compliant
12:00 - 12:59	17.8	17.6	18.1	17.9	17.5	18.1	18.2	18.4	18.5	20.0	18.5	18.4	17.5	18.3	17.7	17.7	Compliant
13:00 - 13:59	17.5	16.9	18.1	17.6	17.2	17.7	17.9	18.2	18.2	19.6	18.2	18.3	17.5	18.4	17.5	17.7	Compliant
14:00 - 14:59	17.4	17.1	18.3	17.1	17.0	17.3	17.9	17.6	18.1	19.2	17.9	18.2	17.5	18.2	17.5	17.9	Compliant
15:00 - 15:59	17.2	17.8	18.1	17.3	16.9	17.3	17.8	17.6	18.4	19.3	17.9	17.7	17.5	17.6	17.7	17.6	Compliant
16:00 - 16:59	17.2	18.4	18.0	17.5	16.8	17.5	17.7	17.5	18.5	19.2	17.9	18.1	17.5	17.6	17.9	17.5	Compliant
17:00 - 17:59	17.4	18.5	17.9	17.6	16.8	17.9	17.8	17.6	18.8	19.4	18.1	18.4	17.5	17.7	18.1	17.7	Compliant
18:00 - 18:59	17.6	18.8	18.0	17.7	16.9	18.1	18.0	17.7	18.9	19.6	18.1	18.5	17.7	17.8	18.2	17.8	Compliant
19:00 - 19:59	17.6	19.1	18.1	18.2	17.3	18.3	18.4	18.0	19.0	19.8	18.1	18.5	17.8	17.7	18.2	18.0	Compliant
20:00 - 20:59	17.9	19.2	18.4	18.5	18.4	18.5	18.9	18.4	19.1	20.0	18.4	18.5	17.9	17.8	18.4	18.1	Compliant
21:00 - 21:59	18.2	19.3	18.6	18.8	18.3	18.6	19.2	18.6	19.2	20.1	18.6	18.5	18.2	18.0	18.3	18.1	Compliant
22:00 - 22:59	18.5	19.4	18.7	19.2	18.5	18.8	19.6	18.9	19.4	20.3	18.7	18.6	18.2	17.9	18.3	18.2	Compliant
23:00 - 23:59	18.7	19.5	18.8	19.1	18.8	18.8	19.4	19.0	19.4	20.4	18.7	18.7	18.2	18.0	18.4	18.3	Compliant

Unit 2 NO_x (ppmv) - June 2025

Time	1-Jun	2-Jun	3-Jun	4-Jun	5-Jun	6-Jun	7-Jun	8-Jun	9-Jun	10-Jun	11-Jun	12-Jun	13-Jun	14-Jun	15-Jun	Remarks
00:00 - 00:59	18.3	18.7	18.6	19.4	19.9	19.3	19.2	19.5	20.1	21.4	21.7	21.6	17.8	15.5	15.2	Compliant
01:00 - 01:59	18.4	18.8	18.8	19.4	20.1	19.5	19.2	19.7	20.0	17.5	19.2	17.5	24.4	15.5	15.2	Compliant
02:00 - 02:59	18.4	19.1	18.7	19.5	20.0	19.7	19.4	19.8	20.1	21.2	20.6	21.6	60.5	15.5	15.2	Low Load
03:00 - 03:59	18.5	19.1	18.8	19.4	20.0	19.7	19.4	19.9	20.2	20.7	21.7	17.4	26.8	15.6	15.3	Low Load
04:00 - 04:59	18.3	18.9	19.1	19.7	20.1	19.7	19.6	20.0	20.1	20.9	19.0	17.5	12.3	15.4	15.2	Compliant
05:00 - 05:59	18.3	18.9	19.2	19.2	19.8	19.9	19.7	20.0	20.1	22.1	17.7	17.8	20.2	15.4	15.2	Compliant
06:00 - 06:59	18.4	19.0	18.9	19.4	19.8	19.9	19.8	20.1	20.1	19.1	17.3	20.3	24.1	15.3	15.1	Compliant
07:00 - 07:59	18.4	19.0	19.0	19.4	19.9	19.7	19.7	19.9	20.1	20.7	21.5	19.4	43.1	15.1	15.1	Low Load
08:00 - 08:59	18.4	19.2	18.9	19.1	19.3	19.5	19.2	19.7	20.8	17.4	20.9	19.5	18.4	15.1	15.0	Compliant
09:00 - 09:59	18.2	18.9	18.4	19.2	19.3	19.2	19.2	19.4	20.8	19.8	18.4	19.8	17.3	15.1	15.1	Compliant
10:00 - 10:59	18.0	19.0	18.2	18.6	18.7	18.8	18.9	19.1	20.8	18.1	18.8	19.7	16.5	15.2	15.0	Compliant
11:00 - 11:59	17.8	18.9	18.2	18.2	18.6	18.6	18.5	18.7	20.3	18.5	20.5	21.7	16.0	15.2	14.9	Compliant
12:00 - 12:59	17.8	18.7	17.7	18.2	18.4	18.0	18.2	18.6	17.5	20.2	19.1	21.4	15.6	15.0	14.9	Compliant
13:00 - 13:59	17.7	18.2	17.6	17.7	18.2	17.7	18.0	18.6	22.6	17.2	21.3	20.4	15.5	14.9	14.8	Compliant
14:00 - 14:59	17.6	18.1	17.3	17.7	18.1	17.6	17.9	18.7	18.5	21.5	21.5	21.3	15.4	14.9	15.2	Compliant
15:00 - 15:59	17.4	18.4	17.8	17.6	17.9	17.5	17.9	18.7	21.2	19.3	17.9	20.4	15.4	14.8	15.1	Compliant
16:00 - 16:59	17.5	18.2	18.2	17.6	17.9	17.4	18.0	18.6	17.7	17.2	21.2	21.3	15.6	14.7	14.9	Compliant
17:00 - 17:59	17.7	18.4	18.4	18.2	18.0	17.4	18.1	18.5	17.0	21.6	17.9	20.4	15.5	14.9	15.1	Compliant
18:00 - 18:59	17.7	18.5	18.4	18.9	18.2	17.6	18.2	18.9	20.2	17.9	21.4	21.3	15.4	15.1	15.2	Compliant
19:00 - 19:59	18.1	18.4	18.6	19.4	18.6	18.0	18.6	19.0	18.3	21.9	17.4	10.1	15.4	15.1	15.2	Compliant
20:00 - 20:59	18.0	18.3	18.8	19.3	18.8	18.3	18.9	19.2	18.7	17.4	17.4	17.1	15.5	15.1	15.2	Compliant
21:00 - 21:59	18.4	18.6	18.8	19.5	19.0	18.5	18.9	19.5	20.8	20.3	17.5	21.6	15.6	15.1	15.2	Compliant
22:00 - 22:59	18.6	18.5	18.9	19.7	19.2	18.7	19.1	19.8	17.5	21.2	19.8	17.4	15.6	15.2	15.3	Compliant
23:00 - 23:59	18.4	18.7	19.2	19.9	19.3	18.9	19.2	20.0	21.4	17.9	17.6	17.5	15.6	15.1	15.3	Compliant

Time	16-Jun	17-Jun	18-Jun	19-Jun	20-Jun	21-Jun	22-Jun	23-Jun	24-Jun	25-Jun	26-Jun	27-Jun	28-Jun	29-Jun	30-Jun	Remarks
00:00 - 00:59	15.3	19.2	19.2	19.2	19.3	19.3	19.3	19.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
01:00 - 01:59	15.3	19.1	19.2	19.2	19.3	19.4	19.3	19.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
02:00 - 02:59	15.3	19.1	19.2	19.3	19.3	19.3	19.3	19.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
03:00 - 03:59	15.2	19.1	19.1	19.2	19.2	19.3	19.3	19.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
04:00 - 04:59	15.2	19.1	19.0	19.2	19.2	19.2	19.3	19.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
05:00 - 05:59	15.2	19.1	19.0	19.2	19.2	19.3	19.3	19.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
06:00 - 06:59	15.1	19.1	19.0	19.2	19.2	19.3	19.3	19.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
07:00 - 07:59	14.9	19.2	19.1	19.2	19.1	19.2	19.2	19.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
08:00 - 08:59	14.7	19.0	19.0	19.1	19.1	19.2	19.2	19.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
09:00 - 09:59	14.5	19.0	19.0	18.8	19.0	19.1	19.1	19.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
10:00 - 10:59	18.8	19.0	19.0	18.9	19.0	19.1	19.0	18.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
11:00 - 11:59	18.9	19.0	19.0	18.8	18.8	18.6	18.9	18.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
12:00 - 12:59	18.7	19.0	18.9	18.5	18.6	18.8	18.8	18.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
13:00 - 13:59	18.7	18.9	18.8	18.3	18.5	18.8	18.7	18.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
14:00 - 14:59	18.7	18.8	18.8	18.3	18.4	18.9	18.5	18.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
15:00 - 15:59	18.8	18.7	18.7	18.3	18.4	19.0	18.5	18.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
16:00 - 16:59	18.9	18.7	18.7	18.5	18.4	18.9	18.5	18.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
17:00 - 17:59	18.9	18.8	18.7	18.5	18.4	19.1	18.6	18.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
18:00 - 18:59	19.0	18.7	18.8	18.6	18.5	19.2	18.8	18.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
19:00 - 19:59	19.0	18.8	18.9	18.7	18.5	19.1	18.9	19.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
20:00 - 20:59	19.1	19.1	19.1	19.0	18.7	19.1	19.1	19.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
21:00 - 21:59	19.1	19.2	19.1	19.1	19.0	19.3	19.2	19.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
22:00 - 22:59	19.2	19.2	19.2	19.3	19.2	19.4	19.3	19.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
23:00 - 23:59	19.2	19.2	19.2	19.3	19.3	19.4	19.4	18.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant

Remark: Plant shutdown from 23:29hr on 23 Jun 25 to 02 Jul 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 2 NO_x (ppmv) - July 2025

Time	1-Jul	2-Jul	3-Jul	4-Jul	5-Jul	6-Jul	7-Jul	8-Jul	9-Jul	10-Jul	11-Jul	12-Jul	13-Jul	14-Jul	15-Jul	Remarks
00:00 - 00:59	0.0	0.0	30.9	19.3	19.3	19.4	19.4	19.0	19.3	19.1	18.7	19.3	19.5	19.4	19.2	Low Load
01:00 - 01:59	0.0	0.0	27.6	19.2	19.3	19.3	19.4	19.1	19.3	19.2	18.6	19.2	19.5	19.4	19.2	Low Load
02:00 - 02:59	0.0	0.0	24.9	19.2	19.2	19.3	19.2	18.9	19.2	19.2	18.6	19.2	19.5	19.4	19.2	Compliant
03:00 - 03:59	0.0	0.0	24.1	19.1	19.2	19.4	19.0	18.9	19.1	19.1	18.4	19.2	19.4	19.3	19.2	Compliant
04:00 - 04:59	0.0	0.0	23.6	19.0	19.2	19.3	18.9	18.7	19.0	18.9	18.5	18.9	19.3	19.1	19.1	Compliant
05:00 - 05:59	0.0	0.0	24.4	18.9	19.2	19.3	18.9	18.8	19.1	18.8	18.6	18.9	19.2	19.0	19.1	Compliant
06:00 - 06:59	0.0	0.0	14.2	18.9	19.2	19.3	19.0	18.9	19.1	18.9	18.7	18.9	19.2	19.1	19.1	Compliant
07:00 - 07:59	0.0	0.0	13.3	18.9	19.1	19.1	18.9	18.8	19.1	19.0	18.8	18.9	19.0	18.9	19.1	Compliant
08:00 - 08:59	0.0	0.0	18.9	18.9	19.1	19.0	18.9	18.3	18.9	18.8	18.7	18.9	19.0	18.9	19.0	Compliant
09:00 - 09:59	0.0	0.0	18.9	19.0	18.9	19.0	18.8	18.6	18.7	18.4	18.7	18.9	18.6	18.9	19.0	Compliant
10:00 - 10:59	0.0	0.0	18.8	19.0	18.8	18.8	18.9	18.7	18.8	18.6	18.6	18.7	18.8	18.9	19.1	Compliant
11:00 - 11:59	0.0	0.0	18.8	18.9	18.9	18.8	19.0	18.7	18.9	18.7	18.5	18.8	18.8	18.9	18.6	Compliant
12:00 - 12:59	0.0	0.0	18.8	18.7	18.8	18.7	18.5	18.4	18.9	18.6	18.7	18.7	18.7	18.8	19.0	Compliant
13:00 - 13:59	0.0	0.0	18.6	18.6	18.8	18.7	18.4	18.3	18.8	18.4	18.5	18.8	18.7	18.7	19.3	Compliant
14:00 - 14:59	0.0	0.0	18.6	18.7	18.7	18.5	18.4	18.4	18.7	18.5	18.4	18.7	18.6	18.7	19.7	Compliant
15:00 - 15:59	0.0	0.0	18.5	18.7	18.7	18.6	18.4	18.6	18.6	18.4	18.4	18.8	18.5	18.8	19.7	Compliant
16:00 - 16:59	0.0	0.0	18.6	18.8	18.9	18.6	18.4	19.0	18.6	18.4	18.4	19.1	18.6	18.8	19.2	Compliant
17:00 - 17:59	0.0	0.0	18.8	18.7	18.8	18.7	18.3	19.2	18.6	18.4	18.8	19.2	18.8	18.8	19.4	Compliant
18:00 - 18:59	0.0	0.0	19.0	18.8	18.8	18.6	18.5	19.2	18.6	18.4	19.2	19.3	18.9	18.9	19.2	Compliant
19:00 - 19:59	0.0	0.0	19.0	18.7	18.9	19.0	18.5	19.0	18.7	18.4	19.3	19.3	19.0	19.0	19.0	Compliant
20:00 - 20:59	0.0	0.0	19.1	18.9	19.0	19.3	18.7	19.0	18.9	18.4	19.3	19.3	19.2	19.0	18.9	Compliant
21:00 - 21:59	0.0	0.0	19.3	19.1	19.2	19.4	18.8	19.1	19.0	18.6	19.3	19.4	19.3	19.1	18.9	Compliant
22:00 - 22:59	0.0	43.6	19.3	19.2	19.3	19.4	18.9	19.3	19.1	18.7	19.2	19.5	19.4	19.1	19.0	Low Load
23:00 - 23:59	0.0	34.7	19.3	19.3	19.4	19.3	18.8	19.3	19.1	18.7	19.3	19.5	19.4	19.1	19.1	Low Load

Time	16-Jul	17-Jul	18-Jul	19-Jul	20-Jul	21-Jul	22-Jul	23-Jul	24-Jul	25-Jul	26-Jul	27-Jul	28-Jul	29-Jul	30-Jul	31-Jul	Remarks
00:00 - 00:59	19.1	19.0	19.4	19.0	19.1	19.2	19.0	18.8	18.9	18.7	18.9	18.8	19.2	18.9	18.8	18.7	Compliant
01:00 - 01:59	19.2	19.0	19.3	19.0	19.1	19.2	18.9	18.9	18.9	18.7	18.8	18.8	19.2	18.8	18.7	18.7	Compliant
02:00 - 02:59	19.2	18.9	19.3	19.0	19.1	19.2	19.0	18.8	18.8	18.7	18.9	18.7	19.2	18.7	18.8	18.8	Compliant
03:00 - 03:59	18.9	18.9	19.2	19.0	19.1	19.1	19.0	18.8	18.9	18.6	18.9	18.7	19.1	18.7	18.7	18.6	Compliant
04:00 - 04:59	18.6	18.9	18.9	19.0	19.1	19.1	18.8	18.8	18.8	18.6	18.7	18.6	18.9	18.6	18.6	18.3	Compliant
05:00 - 05:59	18.7	18.9	18.9	18.9	19.2	19.0	18.7	18.8	18.9	18.5	18.7	18.6	18.8	18.7	18.5	18.2	Compliant
06:00 - 06:59	18.8	18.9	19.0	18.7	19.1	19.0	18.8	18.6	18.9	18.5	18.6	18.5	18.9	18.7	18.6	18.4	Compliant
07:00 - 07:59	18.8	18.9	18.9	18.6	19.0	19.0	18.8	18.7	19.0	18.6	18.7	18.5	18.9	18.7	18.6	18.4	Compliant
08:00 - 08:59	18.7	18.9	18.8	18.5	18.9	18.9	18.6	18.6	18.8	18.5	18.5	18.5	18.8	18.6	18.3	18.3	Compliant
09:00 - 09:59	18.7	18.9	18.6	18.6	18.8	18.8	18.6	18.7	18.7	18.4	18.4	18.7	18.7	18.5	18.3	18.3	Compliant
10:00 - 10:59	18.8	18.9	18.5	18.5	18.8	18.3	18.5	18.6	18.6	18.5	18.4	18.7	18.7	18.4	18.2	18.3	Compliant
11:00 - 11:59	19.0	18.4	18.6	18.2	18.8	18.4	18.5	18.6	18.5	18.6	18.4	18.7	18.5	18.6	18.2	18.2	Compliant
12:00 - 12:59	19.0	18.6	18.8	18.5	18.7	18.0	18.6	18.1	18.7	18.3	18.5	18.3	18.4	18.7	18.2	18.1	Compliant
13:00 - 13:59	19.0	18.6	18.5	18.7	18.7	18.3	18.4	18.4	18.5	18.4	18.3	18.3	18.2	18.2	18.0	17.5	Compliant
14:00 - 14:59	18.9	18.6	18.5	18.6	18.7	18.5	18.5	18.3	18.4	18.6	18.3	18.6	18.1	18.4	18.2	17.8	Compliant
15:00 - 15:59	18.8	18.6	18.5	18.6	18.8	18.4	18.4	18.5	18.4	18.7	18.4	18.6	18.2	18.2	18.3	17.7	Compliant
16:00 - 16:59	18.8	18.6	18.5	18.5	18.5	18.3	18.1	18.8	18.5	19.0	18.4	18.6	18.4	18.2	18.0	17.9	Compliant
17:00 - 17:59	18.8	18.7	18.8	18.4	18.5	18.3	18.1	18.7	18.6	18.8	18.4	18.7	18.5	18.1	18.0	17.8	Compliant
18:00 - 18:59	18.9	18.8	18.9	18.4	18.6	18.4	18.3	18.8	18.6	18.8	18.4	18.6	18.6	18.3	18.0	17.9	Compliant
19:00 - 19:59	19.0	19.0	18.9	18.4	18.7	18.4	18.4	18.8	18.6	18.7	18.4	18.7	18.7	18.4	18.0	18.0	Compliant
20:00 - 20:59	18.9	19.3	18.9	18.5	18.9	18.5	18.5	18.8	18.7	18.7	18.6	18.9	18.7	18.5	18.2	18.1	Compliant
21:00 - 21:59	19.0	19.3	19.0	18.7	19.0	18.7	18.6	18.9	18.8	18.8	18.7	18.9	18.7	18.7	18.4	18.1	Compliant
22:00 - 22:59	19.0	19.4	19.1	18.8	19.1	18.8	18.6	18.9	18.8	18.9	18.8	19.1	18.8	18.7	18.6	18.4	Compliant
23:00 - 23:59	19.0	19.4	19.0	18.9	19.2	18.9	18.8	19.0	18.8	19.0	18.9	19.2	18.8	18.8	18.7	18.5	Compliant

Remark: Plant shutdown from 23:29hr on 23 Jun 25 to 02 Jul 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 2 NO_x (ppmv) - August 2025

Time	1-Aug	2-Aug	3-Aug	4-Aug	5-Aug	6-Aug	7-Aug	8-Aug	9-Aug	10-Aug	11-Aug	12-Aug	13-Aug	14-Aug	15-Aug	Remarks
00:00 - 00:59	18.6	18.7	18.7	18.3	18.8	18.9	19.1	18.9	18.9	19.0	19.0	18.7	18.7	18.7	18.6	Compliant
01:00 - 01:59	18.7	18.7	18.7	18.3	18.8	18.8	19.1	18.9	19.0	18.9	18.9	18.8	18.8	18.8	18.6	Compliant
02:00 - 02:59	18.6	18.7	18.7	18.3	18.8	18.9	19.1	18.9	19.0	18.8	18.9	18.8	18.8	18.8	18.7	Compliant
03:00 - 03:59	18.4	18.7	18.7	18.3	18.7	18.9	19.0	18.9	18.9	18.8	18.8	18.9	18.8	18.7	18.7	Compliant
04:00 - 04:59	18.3	18.6	18.7	18.2	18.5	18.8	19.0	18.8	18.5	18.5	18.6	18.8	18.6	18.5	18.6	Compliant
05:00 - 05:59	18.3	18.6	18.6	18.0	18.4	18.8	18.9	18.7	18.5	18.5	18.5	18.7	18.5	18.6	18.5	Compliant
06:00 - 06:59	18.4	18.6	18.6	18.1	18.5	18.8	18.8	18.6	18.5	18.5	18.5	18.6	18.5	18.6	18.4	Compliant
07:00 - 07:59	18.4	18.5	18.6	18.1	18.6	18.9	18.9	18.6	18.5	18.6	18.5	18.6	18.6	18.6	18.5	Compliant
08:00 - 08:59	18.4	18.4	18.5	18.1	18.6	18.8	18.8	18.6	18.5	18.6	18.4	18.7	18.5	18.4	18.5	Compliant
09:00 - 09:59	18.3	18.4	17.9	18.1	18.6	18.8	18.7	18.6	18.5	18.6	18.4	18.6	18.5	18.4	18.4	Compliant
10:00 - 10:59	18.3	18.2	18.4	18.2	18.1	18.7	18.8	18.7	18.3	18.5	18.5	18.5	18.5	18.4	18.3	Compliant
11:00 - 11:59	18.3	18.2	18.2	18.2	18.2	18.6	18.7	18.7	18.1	18.5	18.5	18.5	18.4	18.3	18.3	Compliant
12:00 - 12:59	18.3	18.1	18.1	18.3	18.2	18.6	18.2	18.7	18.1	18.4	18.2	18.4	18.3	18.3	18.3	Compliant
13:00 - 13:59	18.2	18.0	18.1	18.2	18.1	18.7	18.4	18.6	17.7	18.3	17.8	18.3	17.9	18.2	18.2	Compliant
14:00 - 14:59	18.1	17.9	18.0	18.2	18.2	18.8	18.4	18.6	18.0	18.3	18.1	18.1	18.0	18.3	18.1	Compliant
15:00 - 15:59	18.3	17.9	17.9	18.1	18.1	19.0	18.4	18.6	18.1	18.3	18.2	18.1	18.1	18.2	17.6	Compliant
16:00 - 16:59	18.3	17.9	18.0	18.1	18.1	19.1	18.5	18.6	18.1	18.1	18.2	18.2	18.1	18.2	17.8	Compliant
17:00 - 17:59	18.3	17.8	18.0	18.1	18.1	19.0	18.5	18.5	18.2	18.1	18.4	18.1	18.1	18.1	17.8	Compliant
18:00 - 18:59	18.4	17.9	17.9	18.1	18.7	18.9	18.6	18.5	18.4	18.2	18.3	18.0	18.1	18.0	18.0	Compliant
19:00 - 19:59	18.4	18.0	17.8	18.1	18.8	18.7	18.8	18.5	18.5	18.3	18.5	18.3	18.1	18.0	18.4	Compliant
20:00 - 20:59	18.2	18.0	18.1	18.3	18.8	18.8	18.9	18.3	18.6	18.5	18.6	18.4	18.3	18.2	18.6	Compliant
21:00 - 21:59	18.4	18.1	18.1	18.4	18.8	18.9	18.9	18.6	18.8	18.7	18.6	18.5	18.4	18.3	18.8	Compliant
22:00 - 22:59	18.6	18.4	18.2	18.6	18.8	19.0	18.9	19.0	18.8	18.7	18.7	18.7	18.6	18.5	18.8	Compliant
23:00 - 23:59	18.7	18.5	18.2	18.7	18.9	19.1	18.9	18.9	19.0	18.9	18.7	18.8	18.6	18.6	18.9	Compliant

Time	16-Aug	17-Aug	18-Aug	19-Aug	20-Aug	21-Aug	22-Aug	23-Aug	24-Aug	25-Aug	26-Aug	27-Aug	28-Aug	29-Aug	30-Aug	31-Aug	Remarks
00:00 - 00:59	18.9	18.9	18.9	18.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
01:00 - 01:59	19.0	18.9	18.9	18.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
02:00 - 02:59	19.0	18.9	18.9	18.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
03:00 - 03:59	18.8	18.9	18.6	18.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
04:00 - 04:59	18.8	18.8	18.4	18.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
05:00 - 05:59	18.9	18.8	18.4	18.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
06:00 - 06:59	18.5	18.8	18.5	18.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
07:00 - 07:59	18.6	18.8	18.7	18.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
08:00 - 08:59	18.5	18.7	18.3	18.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
09:00 - 09:59	18.7	18.7	18.3	18.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
10:00 - 10:59	18.7	18.6	18.1	18.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
11:00 - 11:59	18.7	18.5	18.1	18.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
12:00 - 12:59	18.6	18.4	18.1	18.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
13:00 - 13:59	18.5	18.3	18.0	18.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
14:00 - 14:59	18.4	18.3	18.0	16.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
15:00 - 15:59	18.5	18.0	17.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
16:00 - 16:59	18.4	18.2	18.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
17:00 - 17:59	18.5	18.2	18.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
18:00 - 18:59	18.5	18.2	18.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
19:00 - 19:59	18.5	18.6	18.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
20:00 - 20:59	18.8	18.8	18.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
21:00 - 21:59	18.8	18.9	18.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
22:00 - 22:59	18.9	19.0	18.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant
23:00 - 23:59	19.0	18.9	18.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Compliant

Remark: Plant shutdown from 14:00 hr on 19 Aug 25 to17 Sep 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 2 NO_x (ppmv) - September 2025

Time	1-Sep	2-Sep	3-Sep	4-Sep	5-Sep	6-Sep	7-Sep	8-Sep	9-Sep	10-Sep	11-Sep	12-Sep	13-Sep	14-Sep	15-Sep	Remarks
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Shutdown

Time	16-Sep	17-Sep	18-Sep	19-Sep	20-Sep	21-Sep	22-Sep	23-Sep	24-Sep	25-Sep	26-Sep	27-Sep	28-Sep	29-Sep	30-Sep	Remarks
00:00 - 00:59	0.0	0.0	0.0	19.0	19.1	18.9	19.6	19.3	18.3	16.3	16.0	16.2	16.0	16.2	18.6	Compliant
01:00 - 01:59	0.0	0.0	43.4	19.0	19.1	18.9	19.7	19.3	18.3	16.3	16.1	16.2	16.1	16.3	18.2	Low Load
02:00 - 02:59	0.0	0.0	51.8	19.0	19.1	19.0	19.6	19.2	18.3	16.3	16.1	16.2	16.3	16.3	18.6	Low Load
03:00 - 03:59	0.0	0.0	38.4	19.0	19.1	19.1	19.6	19.2	18.1	16.2	16.1	15.9	16.2	16.2	18.7	Low Load
04:00 - 04:59	0.0	0.0	27.6	19.0	19.1	19.1	19.6	18.9	18.0	16.1	15.9	16.0	15.9	16.2	18.6	Low Load
05:00 - 05:59	0.0	0.0	28.0	19.0	19.2	19.1	19.6	18.8	17.9	16.0	15.9	16.0	15.9	16.2	18.6	Low Load
06:00 - 06:59	0.0	0.0	26.6	18.9	18.9	19.1	19.4	19.0	17.9	15.9	15.8	16.0	15.9	16.2	18.8	Low Load
07:00 - 07:59	0.0	0.0	23.3	18.9	18.9	19.1	19.3	18.9	17.7	15.9	15.7	16.0	15.9	16.1	18.7	Compliant
08:00 - 08:59	0.0	0.0	21.6	18.9	18.9	19.1	19.4	18.8	17.5	15.8	15.7	15.9	16.0	16.0	18.5	Compliant
09:00 - 09:59	0.0	0.0	12.4	18.9	18.9	19.0	19.4	18.7	17.4	15.8	15.7	15.8	15.9	15.8	18.5	Compliant
10:00 - 10:59	0.0	0.0	7.8	18.8	18.9	19.0	19.3	18.7	17.3	15.8	15.6	15.8	15.7	15.8	18.4	Compliant
11:00 - 11:59	0.0	0.0	19.1	18.5	18.9	19.1	18.9	18.6	17.4	15.8	15.6	15.8	15.8	17.3	18.3	Compliant
12:00 - 12:59	0.0	0.0	18.9	18.5	18.9	19.0	18.8	18.7	17.3	15.7	15.4	15.7	15.8	17.8	18.2	Compliant
13:00 - 13:59	0.0	0.0	19.1	18.7	18.8	19.0	18.9	18.5	17.1	15.6	15.3	15.5	15.6	17.5	18.1	Compliant
14:00 - 14:59	0.0	0.0	18.9	18.7	18.8	18.9	19.0	18.5	16.9	15.4	15.6	15.5	15.5	15.2	18.0	Compliant
15:00 - 15:59	0.0	0.0	18.8	18.8	18.8	18.9	18.8	18.3	17.1	15.6	15.6	15.8	15.6	0.0	18.1	Compliant
16:00 - 16:59	0.0	0.0	19.0	18.4	18.8	18.7	18.9	18.0	16.9	15.7	15.5	15.9	15.6	5.4	18.5	Compliant
17:00 - 17:59	0.0	0.0	19.1	18.7	18.9	19.0	18.7	17.8	16.8	15.4	15.8	15.9	15.7	15.8	18.4	Compliant
18:00 - 18:59	0.0	0.0	19.1	18.9	19.0	19.4	18.9	18.2	16.6	15.8	16.0	16.0	15.7	18.2	18.4	Compliant
19:00 - 19:59	0.0	0.0	19.1	18.9	19.0	19.4	19.2	18.2	16.3	16.0	16.0	16.0	15.9	18.3	18.5	Compliant
20:00 - 20:59	0.0	0.0	19.1	18.9	19.2	19.5	19.3	18.3	16.0	16.0	15.9	16.0	16.0	18.3	18.5	Compliant
21:00 - 21:59	0.0	0.0	19.0	19.0	19.0	19.5	19.2	18.3	16.0	16.1	16.0	16.0	16.1	18.5	18.6	Compliant
22:00 - 22:59	0.0	0.0	19.0	19.0	19.0	19.5	19.2	18.3	16.0	16.1	16.0	16.0	16.1	18.5	18.7	Compliant
23:00 - 23:59	0.0	0.0	19.0	19.1	18.9	19.6	19.2	18.3	16.1	16.0	16.1	16.1	16.1	18.6	18.8	Compliant

Remark: Plant shutdown from 14:00 hr on 19 Aug 25 to17 Sep 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 2 NO_x (ppmv) - October 2025

Time	1-Oct	2-Oct	3-Oct	4-Oct	5-Oct	6-Oct	7-Oct	8-Oct	9-Oct	10-Oct	11-Oct	12-Oct	13-Oct	14-Oct	15-Oct	Remarks
00:00 - 00:59	18.7	18.6	18.7	18.8	18.7	18.7	18.6	18.5	18.3	18.4	18.6	18.5	18.4	18.5	18.2	Compliant
01:00 - 01:59	18.8	18.2	18.7	18.7	18.7	18.8	18.6	18.4	18.2	18.6	18.6	18.5	18.4	18.4	18.2	Compliant
02:00 - 02:59	18.7	18.4	18.8	18.0	18.7	18.2	18.7	18.4	18.2	18.6	18.6	18.5	18.4	18.4	18.3	Compliant
03:00 - 03:59	18.7	18.1	18.7	18.3	18.7	18.3	18.7	18.4	18.1	18.5	18.5	18.5	18.3	18.4	18.3	Compliant
04:00 - 04:59	18.6	18.2	18.7	18.4	18.7	18.4	18.5	18.4	18.2	18.2	18.6	18.5	18.3	18.4	18.1	Compliant
05:00 - 05:59	18.6	18.2	18.6	18.4	18.7	18.4	18.4	18.4	18.3	18.2	18.5	18.4	18.3	18.1	18.1	Compliant
06:00 - 06:59	18.5	18.3	18.4	18.4	18.7	18.4	18.5	18.3	18.2	18.2	18.6	18.4	18.3	18.2	18.2	Compliant
07:00 - 07:59	18.5	18.3	18.4	18.5	18.6	18.4	18.3	17.8	18.3	18.2	18.6	18.3	18.4	18.1	18.1	Compliant
08:00 - 08:59	18.4	18.3	18.3	18.4	18.5	18.3	18.3	17.9	18.1	18.2	18.4	18.2	18.4	18.0	18.0	Compliant
09:00 - 09:59	18.3	18.1	18.1	18.6	18.5	18.3	18.1	17.8	18.1	17.8	18.2	17.6	18.3	18.1	17.8	Compliant
10:00 - 10:59	18.2	18.1	18.1	18.6	18.3	18.2	18.0	17.7	18.0	18.1	18.1	17.6	18.2	17.7	17.7	Compliant
11:00 - 11:59	18.1	17.9	18.2	18.5	18.2	18.1	17.9	17.6	17.9	18.2	17.9	17.6	18.2	17.9	17.6	Compliant
12:00 - 12:59	18.2	17.9	18.1	18.4	18.0	18.0	17.7	17.5	17.8	18.1	17.6	17.6	18.1	17.1	17.6	Compliant
13:00 - 13:59	18.1	18.0	18.0	18.2	17.8	17.9	17.7	17.3	17.7	18.0	17.7	17.5	18.0	16.2	17.7	Compliant
14:00 - 14:59	18.0	18.0	18.0	18.2	17.6	17.9	17.6	17.5	17.7	17.9	17.8	17.5	17.8	15.8	17.8	Compliant
15:00 - 15:59	18.4	18.0	18.0	18.1	17.6	17.9	17.6	17.5	17.9	18.0	17.8	17.5	18.1	15.8	17.9	Compliant
16:00 - 16:59	18.4	18.0	18.0	18.1	17.9	18.2	17.6	17.5	18.0	18.1	17.8	17.5	18.2	17.1	18.0	Compliant
17:00 - 17:59	18.4	18.1	18.0	18.2	18.0	18.2	17.6	17.5	18.0	18.1	17.8	17.6	18.1	17.5	18.1	Compliant
18:00 - 18:59	18.6	18.2	18.2	18.3	18.1	18.4	17.7	17.7	18.1	18.3	18.0	17.8	18.2	17.9	18.1	Compliant
19:00 - 19:59	18.5	18.4	18.4	18.4	18.3	18.4	17.9	17.8	18.2	18.3	18.3	17.9	18.3	18.0	18.2	Compliant
20:00 - 20:59	18.6	18.5	18.5	18.5	18.2	18.5	18.0	17.9	18.3	18.5	18.3	18.0	18.3	18.1	18.4	Compliant
21:00 - 21:59	18.7	18.5	18.6	18.5	18.4	18.5	18.1	18.0	18.4	18.5	18.4	18.2	18.3	18.1	18.5	Compliant
22:00 - 22:59	18.8	18.6	18.7	18.7	18.5	18.4	18.3	18.0	18.5	18.5	18.5	18.2	18.4	18.2	18.5	Compliant
23:00 - 23:59	18.7	18.7	18.8	18.7	18.6	18.6	18.5	18.2	18.4	18.5	18.5	18.4	18.4	18.3	18.6	Compliant

Time	16-Oct	17-Oct	18-Oct	19-Oct	20-Oct	21-Oct	22-Oct	23-Oct	24-Oct	25-Oct	26-Oct	27-Oct	28-Oct	29-Oct	30-Oct	31-Oct	Remarks
00:00 - 00:59	18.6	18.6	18.8	18.2	18.6	18.6	18.5	18.3	18.5	18.0	18.4	18.3	18.6	17.8	18.3	18.3	Compliant
01:00 - 01:59	18.6	18.6	18.8	18.3	18.6	18.6	18.6	18.4	18.5	18.2	18.4	18.4	18.6	17.8	18.4	18.3	Compliant
02:00 - 02:59	18.5	18.6	18.8	18.3	18.7	18.5	18.6	18.4	18.6	18.2	18.4	18.4	18.7	17.9	18.4	18.3	Compliant
03:00 - 03:59	18.5	18.5	18.7	18.3	18.7	18.4	18.5	18.2	18.6	18.2	18.5	18.4	18.7	17.9	18.4	18.4	Compliant
04:00 - 04:59	18.4	18.3	18.7	18.3	18.7	18.4	18.5	18.2	18.5	18.1	18.4	18.4	18.6	17.9	18.4	18.5	Compliant
05:00 - 05:59	18.4	18.3	18.7	18.3	18.6	18.5	18.5	18.3	18.4	18.2	18.3	18.3	18.6	17.7	18.4	18.4	Compliant
06:00 - 06:59	18.4	18.3	18.7	18.3	18.6	18.5	18.5	18.4	18.5	18.3	18.4	18.5	18.6	17.7	18.5	18.2	Compliant
07:00 - 07:59	18.4	18.3	18.6	18.3	18.5	18.3	18.4	18.3	18.3	18.1	18.1	18.3	18.6	17.5	18.3	18.1	Compliant
08:00 - 08:59	18.3	18.1	18.5	18.1	18.3	18.2	18.2	18.0	18.0	17.9	17.9	18.1	18.4	17.6	18.2	18.0	Compliant
09:00 - 09:59	18.3	18.0	18.4	18.0	18.3	18.1	18.1	17.9	17.9	17.8	17.9	17.9	18.3	17.5	18.0	17.9	Compliant
10:00 - 10:59	17.6	18.0	17.9	18.0	17.4	17.9	18.0	17.8	18.0	17.7	17.9	17.8	18.1	17.4	18.0	18.0	Compliant
11:00 - 11:59	17.9	18.0	17.9	17.9	17.7	17.7	17.6	17.9	17.6	17.7	17.3	17.9	17.9	17.3	17.9	17.8	Compliant
12:00 - 12:59	17.8	18.1	17.9	17.7	17.7	17.6	17.9	17.8	17.9	17.5	17.4	17.8	17.2	17.2	17.3	17.7	Compliant
13:00 - 13:59	17.8	18.3	17.8	17.6	17.6	17.4	17.8	17.6	17.6	17.4	17.3	17.8	17.4	17.1	17.5	17.6	Compliant
14:00 - 14:59	17.8	18.5	17.6	17.7	17.6	17.2	17.7	17.5	17.2	17.3	17.3	17.5	17.4	17.3	17.6	17.4	Compliant
15:00 - 15:59	17.8	18.3	17.5	17.7	17.6	17.2	17.7	17.6	17.2	17.4	17.3	17.5	17.5	17.5	17.5	17.4	Compliant
16:00 - 16:59	17.8	18.3	17.5	17.8	17.7	17.5	17.6	17.5	17.3	17.4	17.3	17.6	17.3	17.5	17.5	17.7	Compliant
17:00 - 17:59	18.0	18.3	17.6	17.9	17.8	17.6	17.8	17.8	17.3	17.4	17.4	17.7	17.4	17.5	17.6	17.9	Compliant
18:00 - 18:59	18.3	18.4	17.7	18.0	17.9	17.8	18.0	17.9	17.5	17.6	17.5	17.8	17.5	17.7	17.6	18.0	Compliant
19:00 - 19:59	18.2	18.5	17.7	18.2	18.0	17.9	18.1	18.1	17.7	17.7	17.7	18.1	17.6	17.9	17.9	18.2	Compliant
20:00 - 20:59	18.3	18.6	17.8	18.3	18.1	18.1	18.1	18.1	17.8	17.9	17.8	18.2	17.7	18.0	18.0	18.3	Compliant
21:00 - 21:59	18.3	18.7	18.0	18.4	18.2	18.2	18.2	18.2	17.8	18.1	18.0	18.2	17.7	18.1	17.9	18.4	Compliant
22:00 - 22:59	18.4	18.7	18.1	18.5	18.3	18.3	18.2	18.4	18.0	18.2	18.2	18.3	17.7	18.2	18.1	18.5	Compliant
23:00 - 23:59	18.5	18.8	18.2	18.4	18.4	18.5	18.3	18.4	18.0	18.3	18.2	18.4	17.7	18.3	18.2	18.5	Compliant

Unit 2 NO_x (ppmv) - November 2025

Time	1-Nov	2-Nov	3-Nov	4-Nov	5-Nov	6-Nov	7-Nov	8-Nov	9-Nov	10-Nov	11-Nov	12-Nov	13-Nov	14-Nov	15-Nov	Remarks
00:00 - 00:59	18.6	18.4	18.7	18.9	18.5	18.0	18.3	0.0	0.0	0.0	17.7	18.3	17.9	17.8	17.5	Compliant
01:00 - 01:59	18.6	18.3	18.6	18.9	18.4	18.1	18.3	0.0	0.0	0.0	22.9	18.4	17.9	17.8	17.5	Compliant
02:00 - 02:59	18.7	18.3	18.6	18.9	18.5	18.1	18.4	0.0	0.0	0.0	16.2	18.4	17.9	17.9	17.6	Compliant
03:00 - 03:59	18.7	18.3	18.7	18.9	18.5	17.9	18.3	0.0	0.0	0.0	10.6	18.4	18.0	17.9	17.7	Compliant
04:00 - 04:59	18.7	18.1	18.7	18.9	18.2	17.9	18.2	0.0	0.0	0.0	12.4	18.3	18.0	18.0	17.7	Compliant
05:00 - 05:59	18.7	18.1	18.6	18.8	18.2	17.9	18.2	0.0	0.0	0.0	18.7	18.3	18.1	18.0	17.7	Compliant
06:00 - 06:59	18.7	18.1	18.6	18.9	18.2	18.0	18.2	0.0	0.0	0.0	18.6	18.4	18.1	18.1	17.8	Compliant
07:00 - 07:59	18.6	18.2	18.6	18.9	18.2	18.0	18.3	0.0	0.0	0.0	18.6	18.3	18.0	18.1	17.7	Compliant
08:00 - 08:59	18.5	18.2	18.5	18.8	17.9	17.8	18.2	0.0	0.0	0.0	18.4	18.2	18.0	17.9	17.6	Compliant
09:00 - 09:59	18.4	18.0	18.5	18.7	17.8	17.6	18.2	0.0	0.0	0.0	18.3	18.0	17.9	17.7	17.6	Compliant
10:00 - 10:59	18.3	17.9	18.4	18.5	17.7	17.5	18.1	0.0	0.0	0.0	18.0	17.8	18.0	17.7	17.8	Compliant
11:00 - 11:59	18.3	17.8	18.3	18.5	17.8	17.5	17.9	0.0	0.0	0.0	17.8	18.0	17.9	17.8	17.6	Compliant
12:00 - 12:59	18.3	17.7	18.2	18.5	17.3	17.4	17.8	0.0	0.0	0.0	17.6	18.4	17.7	17.6	17.1	Compliant
13:00 - 13:59	18.3	17.7	18.2	18.6	17.3	17.4	17.7	0.0	0.0	0.0	17.5	18.0	17.5	17.4	17.2	Compliant
14:00 - 14:59	18.4	17.9	18.2	18.5	17.4	17.5	17.7	0.0	0.0	0.0	17.4	17.7	17.4	17.3	17.1	Compliant
15:00 - 15:59	18.2	17.9	18.5	18.4	17.4	17.3	17.8	0.0	0.0	0.0	17.2	17.5	17.2	17.1	17.2	Compliant
16:00 - 16:59	18.3	18.0	18.6	18.2	17.4	17.3	17.8	0.0	0.0	0.0	17.2	17.4	17.3	17.2	17.3	Compliant
17:00 - 17:59	17.9	18.1	18.4	18.2	17.5	17.5	17.8	0.0	0.0	0.0	17.6	17.5	17.2	17.3	17.1	Compliant
18:00 - 18:59	17.9	18.4	18.4	18.3	17.1	17.7	18.0	0.0	0.0	0.0	17.7	17.8	17.5	17.6	17.3	Compliant
19:00 - 19:59	18.0	18.5	18.6	18.3	17.5	17.9	18.0	0.0	0.0	0.0	17.9	17.9	17.5	17.6	17.6	Compliant
20:00 - 20:59	18.3	18.4	18.7	18.4	17.6	17.9	18.1	0.0	0.0	0.0	17.9	17.6	17.3	17.3	17.5	Compliant
21:00 - 21:59	18.3	18.4	18.9	18.5	17.7	18.0	18.3	0.0	0.0	16.8	18.0	17.3	17.4	17.3	17.6	Compliant
22:00 - 22:59	18.3	18.5	19.0	18.5	17.9	18.1	17.8	0.0	0.0	26.6	18.0	17.9	17.5	17.3	17.6	Low Load
23:00 - 23:59	18.3	18.6	19.0	18.6	17.9	18.2	9.0	0.0	0.0	0.0	18.2	18.0	17.7	17.5	17.8	Compliant

Time	16-Nov	17-Nov	18-Nov	19-Nov	20-Nov	21-Nov	22-Nov	23-Nov	24-Nov	25-Nov	26-Nov	27-Nov	28-Nov	29-Nov	30-Nov	Remarks
00:00 - 00:59	17.8	17.9	18.5	18.3	18.7	18.9	18.7	18.4	18.2	18.1	18.6	18.3	18.1	17.4	17.8	Compliant
01:00 - 01:59	17.9	18.0	18.4	18.4	18.8	18.9	18.8	18.3	18.3	18.2	18.7	18.3	18.1	17.4	17.8	Compliant
02:00 - 02:59	17.8	17.9	18.3	18.5	18.8	18.9	18.9	18.3	18.3	18.3	18.6	18.4	18.2	17.4	17.6	Compliant
03:00 - 03:59	17.9	17.9	18.4	18.4	18.7	18.9	18.5	18.3	18.4	18.2	18.6	18.4	18.0	17.5	17.8	Compliant
04:00 - 04:59	17.9	17.9	18.2	18.1	18.5	18.8	18.5	18.2	18.4	18.2	18.6	18.4	18.1	17.4	18.0	Compliant
05:00 - 05:59	18.0	18.0	18.3	18.2	18.6	18.7	18.5	18.4	18.4	18.2	18.6	18.4	18.0	17.3	18.0	Compliant
06:00 - 06:59	18.0	18.0	18.2	18.3	18.5	18.6	18.5	18.5	18.5	18.2	18.6	18.4	18.0	17.4	18.0	Compliant
07:00 - 07:59	18.0	18.1	18.3	18.1	18.4	18.7	18.5	18.4	18.6	18.3	18.6	18.5	18.0	17.5	18.0	Compliant
08:00 - 08:59	17.8	18.0	18.2	17.9	18.7	18.8	18.4	18.3	18.5	18.2	18.3	18.4	18.1	17.6	17.7	Compliant
09:00 - 09:59	17.8	17.8	18.1	18.0	18.6	18.7	18.5	18.2	17.9	18.0	18.2	18.2	17.9	17.5	17.5	Compliant
10:00 - 10:59	17.6	17.9	18.0	18.1	18.4	18.5	18.4	18.5	17.8	17.8	18.2	18.0	17.7	17.3	17.5	Compliant
11:00 - 11:59	17.7	17.8	18.2	18.1	18.4	18.4	18.4	18.3	18.0	17.8	18.1	17.5	17.4	17.2	17.5	Compliant
12:00 - 12:59	17.6	18.2	18.2	17.8	18.2	18.0	18.3	17.9	17.9	17.4	17.9	17.3	17.1	16.9	17.4	Compliant
13:00 - 13:59	17.6	17.9	18.0	17.9	18.2	18.0	17.8	17.9	17.6	24.2	17.6	17.0	16.7	16.8	17.1	Compliant
14:00 - 14:59	17.5	18.3	18.0	18.0	18.1	18.1	17.8	17.7	17.5	0.1	17.5	16.5	16.5	16.3	17.0	Compliant
15:00 - 15:59	17.6	18.2	18.1	18.1	18.1	18.1	17.7	17.7	17.6	3.9	17.4	16.8	16.5	16.8	17.0	Compliant
16:00 - 16:59	17.6	18.2	17.9	18.1	18.1	18.1	17.8	17.7	17.5	12.4	17.6	16.7	16.5	16.9	17.1	Compliant
17:00 - 17:59	17.7	18.2	18.0	18.1	18.1	18.2	17.8	17.6	17.6	14.3	17.6	16.8	16.8	17.0	17.1	Compliant
18:00 - 18:59	17.6	18.4	18.3	18.2	18.3	18.4	18.1	17.7	17.7	18.0	17.9	17.2	17.1	17.4	17.4	Compliant
19:00 - 19:59	17.6	18.4	18.4	18.3	18.5	18.6	18.2	17.7	17.7	18.3	17.9	17.5	17.3	17.5	17.5	Compliant
20:00 - 20:59	17.7	18.5	18.5	18.4	18.6	18.5	18.2	18.0	17.6	18.2	18.0	17.6	17.4	17.8	17.7	Compliant
21:00 - 21:59	17.9	18.7	18.5	18.5	18.8	18.5	18.4	18.1	17.7	18.5	18.2	17.7	17.4	17.8	17.8	Compliant
22:00 - 22:59	17.9	18.7	18.4	18.6	18.9	18.7	18.4	18.1	17.7	18.5	18.2	17.8	17.4	17.9	18.0	Compliant
23:00 - 23:59	17.9	18.5	18.6	18.7	18.9	18.7	18.5	18.2	17.8	18.5	18.2	17.9	17.4	17.8	18.1	Compliant

RemaRemark: GT#12 Borosopic Inspection from 07 Nov 25 to 11 Nov 25.

Unit 2 NO_x (ppmv) - December 2025

Time	1-Dec	2-Dec	3-Dec	4-Dec	5-Dec	6-Dec	7-Dec	8-Dec	9-Dec	10-Dec	11-Dec	12-Dec	13-Dec	14-Dec	15-Dec	
00:00 - 00:59	18.1	17.8	17.4	17.4	17.6	17.6	17.7	17.7	17.8	17.7	17.7	17.7	17.4	17.6	17.7	Compliant
01:00 - 01:59	18.0	17.8	17.4	17.5	17.8	17.8	17.8	17.8	17.9	17.9	17.7	17.7	17.6	17.6	17.7	Compliant
02:00 - 02:59	18.1	17.8	17.3	17.5	17.8	17.7	17.8	17.6	17.9	17.8	17.5	17.7	17.7	17.7	17.8	Compliant
03:00 - 03:59	18.2	17.9	17.3	17.5	17.8	17.9	17.9	17.8	17.9	17.8	17.7	17.8	17.8	17.8	17.8	Compliant
04:00 - 04:59	18.3	17.9	17.3	17.5	17.8	17.9	17.9	17.9	17.9	17.9	17.9	17.7	17.8	17.8	17.7	Compliant
05:00 - 05:59	18.2	17.8	17.3	17.5	17.8	17.9	17.9	17.8	17.9	17.8	17.9	17.8	17.7	17.7	17.8	Compliant
06:00 - 06:59	18.1	17.8	17.3	17.6	17.9	17.8	18.0	17.9	17.9	17.8	17.9	17.8	17.9	17.8	17.8	Compliant
07:00 - 07:59	18.1	17.7	17.4	17.6	17.9	17.9	17.9	17.9	18.0	17.8	17.8	17.8	17.9	17.7	17.8	Compliant
08:00 - 08:59	18.1	17.7	17.3	17.4	17.7	17.9	17.7	17.6	18.0	17.7	17.8	17.7	17.7	17.4	17.7	Compliant
09:00 - 09:59	17.7	17.5	17.1	17.3	17.5	17.5	17.5	17.4	17.7	17.7	17.5	17.5	17.6	17.0	17.5	Compliant
10:00 - 10:59	17.4	17.4	17.1	17.2	17.3	17.3	17.3	17.3	17.5	17.3	17.3	17.2	17.3	16.8	17.1	Compliant
11:00 - 11:59	17.1	17.4	17.1	17.1	17.4	17.2	17.2	17.0	17.1	17.2	17.1	17.0	17.1	16.7	16.8	Compliant
12:00 - 12:59	17.1	17.3	17.0	17.2	17.4	17.1	17.1	16.9	17.1	17.1	16.9	16.9	17.0	16.7	16.9	Compliant
13:00 - 13:59	17.0	17.1	16.9	17.1	17.2	17.0	16.9	16.7	16.8	16.8	16.9	16.9	16.9	16.6	16.8	Compliant
14:00 - 14:59	16.9	17.0	16.8	17.0	17.1	16.8	16.9	16.7	16.8	16.8	16.8	16.9	16.6	16.4	16.7	Compliant
15:00 - 15:59	16.4	16.9	16.2	17.0	16.5	16.7	16.5	16.8	16.5	16.7	16.2	16.8	16.3	16.4	16.1	Compliant
16:00 - 16:59	16.7	16.8	16.4	16.9	17.1	16.7	16.8	17.0	16.8	16.7	16.5	16.9	16.5	16.4	17.4	Compliant
17:00 - 17:59	16.9	16.9	16.5	16.8	17.2	16.8	16.9	17.0	16.8	16.8	16.7	16.9	16.7	16.7	1.8	Compliant
18:00 - 18:59	17.2	17.0	16.7	17.1	17.2	17.1	17.0	17.2	17.0	17.0	16.9	17.1	16.8	16.8	17.0	Compliant
19:00 - 19:59	17.3	17.1	16.8	17.2	17.3	17.2	17.2	17.2	17.1	17.2	17.0	17.0	16.9	16.9	17.1	Compliant
20:00 - 20:59	17.4	17.1	17.0	17.3	17.4	17.4	17.2	17.4	17.4	17.3	17.1	17.2	17.0	17.1	17.2	Compliant
21:00 - 21:59	17.4	17.2	16.9	17.4	17.4	17.4	17.3	17.5	17.3	17.3	17.3	17.2	17.2	17.3	17.4	Compliant
22:00 - 22:59	17.7	17.2	17.1	17.4	17.5	17.5	17.4	17.7	17.4	17.5	17.3	17.3	17.4	17.5	17.5	Compliant
23:00 - 23:59	17.8	17.3	17.3	17.4	17.6	17.6	17.4	17.7	17.6	17.6	17.4	17.4	17.5	17.6	17.8	Compliant

Time	16-Dec	17-Dec	18-Dec	19-Dec	20-Dec	21-Dec	22-Dec	23-Dec	24-Dec	25-Dec	26-Dec	27-Dec	28-Dec	29-Dec	30-Dec	31-Dec	Remarks
00:00 - 00:59	17.9	17.9	17.5	17.6	17.7	17.8	17.7	17.8	18.0	17.7	17.9	17.5	17.9	17.8	18.1	18.1	Compliant
01:00 - 01:59	17.9	18.0	17.4	17.9	17.7	17.7	17.7	17.8	18.0	17.8	17.8	17.8	17.9	17.8	18.2	18.2	Compliant
02:00 - 02:59	18.1	18.0	17.4	17.8	17.9	17.7	17.7	17.9	18.0	17.7	17.9	17.7	17.9	17.8	18.3	18.3	Compliant
03:00 - 03:59	18.0	18.0	17.4	17.8	17.6	17.7	17.8	17.6	17.8	17.9	17.9	17.9	17.8	18.0	18.4	18.2	Compliant
04:00 - 04:59	18.2	17.8	17.5	17.7	17.6	17.9	17.9	18.0	18.1	17.9	18.0	17.9	18.0	18.1	18.3	18.2	Compliant
05:00 - 05:59	18.0	18.2	17.3	18.0	18.0	17.7	18.1	18.0	17.9	17.9	18.0	17.8	17.7	18.1	18.2	18.3	Compliant
06:00 - 06:59	18.4	18.1	17.6	18.0	17.9	18.0	18.1	18.1	18.1	18.0	18.0	17.9	18.3	18.2	18.5	18.4	Compliant
07:00 - 07:59	18.2	18.1	17.5	18.1	17.5	18.1	17.8	18.1	17.9	18.1	18.1	18.1	18.1	18.2	18.4	18.2	Compliant
08:00 - 08:59	17.8	17.9	16.8	17.9	17.5	17.8	17.5	18.0	17.6	17.9	17.7	18.0	17.7	18.1	18.1	18.1	Compliant
09:00 - 09:59	17.6	17.8	17.0	17.6	17.6	17.6	17.5	17.7	17.4	18.0	17.8	17.5	17.6	17.8	17.6	18.0	Compliant
10:00 - 10:59	17.5	17.5	17.0	17.4	17.4	17.6	17.3	17.5	17.2	17.8	17.6	17.6	17.5	17.8	17.8	17.7	Compliant
11:00 - 11:59	17.7	17.4	16.9	17.3	17.1	17.4	17.4	17.3	17.2	17.5	17.2	17.2	17.3	17.5	17.5	17.5	Compliant
12:00 - 12:59	17.4	17.0	16.7	17.5	17.2	17.6	17.5	17.4	17.3	17.6	17.0	17.3	17.2	17.3	17.3	17.6	Compliant
13:00 - 13:59	17.2	16.8	16.5	17.1	17.0	17.2	17.2	17.1	17.1	17.3	16.9	16.8	17.0	17.0	16.8	17.2	Compliant
14:00 - 14:59	17.3	16.8	16.5	17.0	16.7	17.0	17.0	17.1	16.8	17.3	16.8	16.8	16.9	17.3	17.0	17.2	Compliant
15:00 - 15:59	17.1	16.7	16.4	16.9	16.6	16.7	17.0	17.2	16.6	17.3	16.6	17.1	16.9	17.4	16.9	17.1	Compliant
16:00 - 16:59	17.3	16.4	16.4	16.9	16.6	16.8	16.8	17.0	16.6	17.3	16.5	17.1	16.9	17.3	17.0	17.3	Compliant
17:00 - 17:59	17.0	16.5	16.7	16.7	16.9	17.0	17.0	16.9	16.8	17.2	16.6	16.9	16.8	17.0	17.1	17.2	Compliant
18:00 - 18:59	17.3	16.7	17.1	16.9	16.9	17.0	17.2	17.2	17.0	17.3	17.1	17.3	16.9	17.5	17.3	17.4	Compliant
19:00 - 19:59	17.4	16.9	17.4	17.2	17.0	17.2	17.4	17.3	17.2	17.5	17.3	17.5	17.2	17.5	17.5	17.6	Compliant
20:00 - 20:59	17.4	17.1	17.6	17.5	17.1	17.6	17.5	17.5	17.5	17.8	17.5	17.5	17.3	17.7	17.7	17.6	Compliant
21:00 - 21:59	17.5	17.2	17.7	17.4	17.3	17.5	17.6	17.6	17.7	17.8	17.6	17.5	17.5	17.8	17.8	17.9	Compliant
22:00 - 22:59	17.7	17.3	17.7	17.6	17.5	17.7	17.7	17.7	17.7	17.8	17.9	18.0	17.8	17.9	17.9	18.1	Compliant
23:00 - 23:59	17.9	17.4	17.7	17.7	17.8	17.7	17.9	17.8	17.7	17.8	17.8	18.0	17.8	18.0	17.9	18.0	Compliant

Unit 2 NOx (ppmv) - January 2026

Time	1-Jan	2-Jan	3-Jan	4-Jan	5-Jan	6-Jan	7-Jan	8-Jan	9-Jan	10-Jan	11-Jan	12-Jan	13-Jan	14-Jan	15-Jan	Remarks
00:00 - 00:59	18.2	18.1	17.9	17.1	17.9	18.0	17.9	17.9	18.1	18.1	18.2	18.3	17.8	15.0	18.5	Compliant
01:00 - 01:59	17.9	18.1	18.2	17.2	17.7	17.8	18.0	17.7	18.1	18.2	18.4	18.5	18.1	14.9	18.5	Compliant
02:00 - 02:59	18.4	18.2	17.9	17.5	18.0	17.9	18.1	17.8	18.0	18.2	18.2	18.5	18.1	15.0	18.0	Compliant
03:00 - 03:59	18.5	18.3	18.0	17.7	18.3	17.8	17.9	17.9	17.9	18.2	18.4	18.6	18.2	15.1	17.5	Compliant
04:00 - 04:59	18.3	18.3	18.2	17.7	18.2	18.0	18.3	18.1	18.1	18.3	18.2	18.6	18.3	15.1	17.5	Compliant
05:00 - 05:59	18.5	18.3	17.9	18.0	18.6	18.1	18.2	18.2	18.3	18.4	18.6	18.6	18.4	15.1	17.1	Compliant
06:00 - 06:59	18.1	18.5	18.2	17.9	18.6	18.2	18.3	18.3	18.4	18.4	18.7	18.6	18.5	15.1	16.9	Compliant
07:00 - 07:59	18.5	18.5	18.3	18.1	18.5	18.3	18.4	18.2	18.3	18.0	18.7	18.7	18.5	14.8	16.6	Compliant
08:00 - 08:59	18.3	18.2	18.3	18.1	18.1	18.3	18.3	17.9	18.1	18.4	18.4	18.7	18.0	15.1	16.3	Compliant
09:00 - 09:59	17.7	18.1	17.6	17.8	17.4	17.8	18.0	18.0	18.0	18.2	18.2	18.6	17.5	15.0	16.1	Compliant
10:00 - 10:59	17.8	18.0	17.7	17.5	17.7	17.9	17.5	17.7	17.1	18.1	17.8	18.4	17.5	15.0	15.8	Compliant
11:00 - 11:59	17.6	17.8	17.4	18.3	18.6	17.9	17.7	17.7	18.6	17.9	17.8	18.2	17.1	14.7	15.5	Compliant
12:00 - 12:59	17.3	17.7	17.4	17.3	17.5	17.5	17.4	17.5	17.2	17.7	17.9	18.1	16.9	14.4	15.3	Compliant
13:00 - 13:59	17.1	17.3	17.3	17.4	17.1	17.2	17.2	17.3	17.0	3.5	17.7	18.0	16.6	14.1	17.2	Compliant
14:00 - 14:59	17.2	17.4	17.5	17.4	6.0	17.2	17.1	17.3	17.1	2.1	17.6	16.8	16.3	15.1	17.2	Compliant
15:00 - 15:59	17.1	17.2	17.5	16.9	6.7	17.0	16.8	17.2	17.0	14.5	17.6	17.0	14.4	15.1	17.0	Compliant
16:00 - 16:59	17.1	17.1	16.7	17.0	16.8	16.7	16.9	17.1	17.1	16.9	17.3	17.0	13.6	14.8	16.7	Compliant
17:00 - 17:59	17.2	17.2	16.7	17.2	17.1	17.2	16.9	17.2	17.2	17.0	17.4	16.9	13.8	15.1	17.2	Compliant
18:00 - 18:59	17.3	17.4	16.5	17.5	17.4	17.5	17.2	17.2	17.5	17.5	17.5	17.4	14.0	15.0	17.5	Compliant
19:00 - 19:59	17.5	17.6	16.8	17.9	17.6	17.6	17.3	17.6	17.9	17.8	17.8	17.4	14.2	15.0	19.5	Compliant
20:00 - 20:59	17.6	17.8	17.0	17.8	17.7	17.8	17.4	17.6	17.9	17.8	17.8	17.3	14.4	14.9	20.2	Compliant
21:00 - 21:59	17.7	18.0	17.2	18.0	17.9	17.9	17.5	17.7	17.9	18.0	18.0	17.5	14.5	15.0	20.4	Compliant
22:00 - 22:59	17.9	17.6	17.3	17.9	18.0	18.1	17.8	18.0	18.1	18.3	18.3	17.5	14.7	15.1	20.7	Compliant
23:00 - 23:59	17.9	18.0	17.4	17.7	17.9	18.1	17.8	17.9	18.1	18.3	18.3	18.0	15.0	15.3	20.8	Compliant

Time	16-Jan	17-Jan	18-Jan	19-Jan	20-Jan	21-Jan	22-Jan	23-Jan	24-Jan	25-Jan	26-Jan	27-Jan	28-Jan	29-Jan	30-Jan	31-Jan	Remarks
00:00 - 00:59	20.9	21.6	20.9	21.6	23.4	20.7	20.4	20.7	20.6	20.2	20.5	21.5	22.2	21.5	21.6	0.0	Compliant
01:00 - 01:59	21.0	21.5	21.7	22.0	23.4	20.5	20.6	20.6	20.7	20.7	20.3	21.6	21.9	21.9	21.4	0.0	Compliant
02:00 - 02:59	20.8	21.4	22.1	21.8	23.5	20.8	20.9	20.7	20.6	20.4	20.4	21.5	22.0	21.8	21.5	0.0	Compliant
03:00 - 03:59	21.1	21.3	22.3	21.6	24.1	20.8	20.7	20.6	20.8	20.9	20.6	21.5	22.0	21.7	21.8	0.0	Compliant
04:00 - 04:59	21.3	21.3	22.8	22.1	23.6	20.5	20.7	20.8	20.6	20.4	20.5	21.7	22.0	21.9	21.7	0.0	Compliant
05:00 - 05:59	21.4	21.4	23.3	21.3	23.5	21.2	20.7	20.4	20.7	21.0	20.4	21.7	22.1	21.7	23.6	0.0	Compliant
06:00 - 06:59	21.2	21.6	23.6	22.0	23.9	21.3	21.1	21.0	20.8	21.0	20.6	21.4	22.0	22.4	0.0	0.0	Compliant
07:00 - 07:59	21.4	21.6	23.7	21.7	24.3	21.3	21.4	20.9	20.6	20.8	20.8	21.8	22.4	22.2	0.0	0.0	Compliant
08:00 - 08:59	21.0	21.3	23.3	21.9	23.8	21.2	20.8	20.5	20.5	20.6	20.5	21.6	22.2	21.8	0.0	0.0	Compliant
09:00 - 09:59	21.1	21.0	22.6	20.9	22.6	20.6	20.6	20.4	20.6	20.4	20.6	21.5	22.1	21.6	0.0	0.0	Compliant
10:00 - 10:59	20.7	20.6	22.3	20.7	21.8	20.5	20.6	20.4	20.7	20.4	20.6	22.1	22.2	21.6	0.0	0.0	Compliant
11:00 - 11:59	20.9	20.9	22.1	20.3	21.2	20.4	20.7	20.1	20.7	20.0	20.5	48.4	22.0	21.6	0.0	0.0	Low Load
12:00 - 12:59	20.7	20.9	22.1	20.6	21.0	20.7	20.7	20.4	20.5	20.3	21.2	52.6	21.5	21.4	0.0	0.0	Low Load
13:00 - 13:59	20.8	20.5	21.6	20.1	20.3	20.3	20.2	20.2	20.1	20.0	21.2	52.1	21.0	21.0	0.0	0.0	Low Load
14:00 - 14:59	9.0	20.2	21.1	23.6	20.4	20.0	19.8	20.0	20.0	19.8	21.1	22.2	20.7	20.6	0.0	0.0	Compliant
15:00 - 15:59	0.1	19.8	20.8	23.8	20.4	19.7	19.7	19.8	19.7	19.5	21.0	20.9	20.8	20.4	0.0	0.0	Compliant
16:00 - 16:59	19.6	20.0	21.1	22.5	20.2	19.7	19.9	19.7	19.6	19.6	20.9	21.1	20.7	20.6	0.0	0.0	Compliant
17:00 - 17:59	18.6	20.2	21.0	22.6	20.5	19.7	20.1	19.9	19.8	19.7	21.0	20.5	20.6	19.9	0.0	0.0	Compliant
18:00 - 18:59	20.9	20.1	20.7	22.4	20.6	20.0	20.2	20.2	19.9	20.0	21.2	21.1	20.7	20.4	0.0	0.0	Compliant
19:00 - 19:59	21.7	20.4	21.1	22.9	20.4	20.3	20.4	20.3	20.3	20.3	21.4	21.7	21.1	21.0	0.0	0.0	Compliant
20:00 - 20:59	21.8	20.6	20.9	22.7	21.2	20.6	20.4	20.4	20.1	20.3	21.5	21.6	21.1	21.3	0.0	0.0	Compliant
21:00 - 21:59	21.7	20.9	21.1	23.2	21.2	20.1	20.3	20.5	20.4	20.4	21.4	21.7	21.4	21.5	0.0	0.0	Compliant
22:00 - 22:59	21.8	21.1	22.2	23.4	20.7	20.3	20.4	20.5	20.0	20.6	21.5	21.8	21.7	21.4	0.0	0.0	Compliant
23:00 - 23:59	21.6	21.4	22.0	23.5	20.6	20.4	20.5	20.5	20.4	20.4	21.6	22.1	21.6	21.6	0.0	0.0	Compliant

Remark: Plant shutdown from 30 Jan 26 to 01 Feb 26 due to Steel Mill-Thapyaywa Line Maintenance

Unit 2 NOx (ppmv) - February 2026

Time	1-Feb	2-Feb	3-Feb	4-Feb	5-Feb	6-Feb	7-Feb	8-Feb	9-Feb	10-Feb	11-Feb	12-Feb	13-Feb	14-Feb	Remarks
00:00 - 00:59	0.0	0.0	21.7	22.0	22.1	21.6	21.4	21.3	21.4	21.1	21.5	20.5	20.6	20.9	Compliant
01:00 - 01:59	0.0	0.0	21.7	22.6	22.2	21.3	21.6	21.9	21.3	21.8	21.6	20.6	20.8	20.6	Compliant
02:00 - 02:59	0.0	0.0	21.7	22.3	22.3	21.9	21.6	21.4	21.8	21.8	21.4	20.6	20.8	20.8	Compliant
03:00 - 03:59	0.0	0.0	21.6	22.0	22.3	21.6	21.8	22.7	21.6	21.3	21.9	21.1	21.3	21.1	Compliant
04:00 - 04:59	0.0	0.0	21.1	22.1	22.2	21.9	21.7	21.8	21.0	21.5	21.7	20.3	20.9	21.0	Compliant
05:00 - 05:59	0.0	0.0	21.8	21.5	22.1	21.9	21.8	22.3	21.6	21.5	22.2	20.7	21.0	20.7	Compliant
06:00 - 06:59	0.0	2.0	21.7	22.0	22.1	21.9	21.7	21.2	21.6	21.4	21.6	20.6	21.2	20.6	Compliant
07:00 - 07:59	0.0	2.0	21.6	21.6	21.8	21.4	21.6	22.0	21.8	21.4	21.6	20.4	21.3	20.6	Compliant
08:00 - 08:59	0.0	60.6	21.5	21.7	22.1	21.8	21.4	21.5	21.6	21.8	21.2	20.5	20.9	20.7	Low Load
09:00 - 09:59	0.0	17.1	21.5	21.5	22.1	21.8	21.4	21.8	20.9	21.7	21.2	20.4	20.8	20.7	Compliant
10:00 - 10:59	0.0	22.3	21.4	21.6	21.8	22.1	21.1	22.1	21.7	21.5	21.1	20.4	20.9	20.9	Compliant
11:00 - 11:59	0.0	21.8	21.0	21.6	21.6	21.8	21.3	21.5	21.4	21.2	21.0	20.3	21.0	20.6	Compliant
12:00 - 12:59	0.0	21.6	21.0	21.1	21.1	21.4	20.6	21.2	20.8	20.8	20.6	20.4	20.8	20.6	Compliant
13:00 - 13:59	0.0	21.4	20.5	20.7	20.8	21.1	20.6	21.0	20.6	20.5	20.1	19.9	20.3	20.4	Compliant
14:00 - 14:59	0.0	21.4	20.1	21.1	20.7	20.6	20.2	20.5	20.5	20.1	19.9	16.7	20.1	20.1	Compliant
15:00 - 15:59	0.0	21.2	20.6	21.0	20.8	20.5	20.2	20.5	20.5	20.1	19.8	68.4	19.6	19.9	Low Load
16:00 - 16:59	0.0	20.9	20.3	21.0	20.5	20.3	20.3	20.4	20.5	19.9	19.9	56.0	19.2	19.8	Low Load
17:00 - 17:59	0.0	20.9	20.6	21.4	20.5	20.4	20.3	20.4	20.4	19.7	19.8	20.0	19.4	19.9	Compliant
18:00 - 18:59	0.0	21.1	20.9	21.5	20.9	20.6	20.3	20.6	20.4	19.9	19.5	19.5	19.2	19.8	Compliant
19:00 - 19:59	0.0	21.4	21.2	21.8	21.1	21.1	20.8	21.7	21.1	20.4	20.2	20.2	19.6	20.2	Compliant
20:00 - 20:59	0.0	21.1	21.6	21.3	21.6	21.6	21.3	21.4	21.0	20.9	20.7	20.4	20.0	20.5	Compliant
21:00 - 21:59	0.0	21.5	22.4	21.8	21.6	21.0	21.4	20.7	21.4	20.6	20.5	20.0	20.4	20.7	Compliant
22:00 - 22:59	0.0	21.7	23.0	22.1	21.8	21.6	21.0	21.5	21.3	21.9	20.6	20.4	20.7	20.3	Compliant
23:00 - 23:59	0.0	21.8	22.7	22.0	21.5	21.6	22.5	21.6	21.7	21.5	20.2	20.5	20.8	20.7	Compliant

Time	15-Feb	16-Feb	17-Feb	18-Feb	19-Feb	20-Feb	21-Feb	22-Feb	23-Feb	24-Feb	25-Feb	26-Feb	27-Feb	28-Feb	Remarks
00:00 - 00:59	20.6	20.6	20.7	20.9	21.2	20.6	21.2	21.0	20.8	22.2	24.1	24.6	15.8	16.1	Compliant
01:00 - 01:59	20.5	20.9	20.5	20.8	21.0	20.8	21.1	21.1	20.8	22.3	24.3	24.3	15.6	15.4	Compliant
02:00 - 02:59	20.5	20.9	20.8	20.8	21.2	20.9	21.3	21.4	20.9	22.5	24.1	24.5	16.1	15.5	Compliant
03:00 - 03:59	20.7	20.9	21.1	21.0	21.1	21.1	21.2	21.6	20.9	22.7	24.1	24.5	15.8	15.4	Compliant
04:00 - 04:59	20.9	20.7	20.8	21.1	21.3	21.2	21.1	21.4	21.2	22.8	24.1	24.7	15.7	15.6	Compliant
05:00 - 05:59	20.9	20.7	20.9	21.0	20.9	21.1	21.5	21.5	21.0	22.6	24.1	24.9	16.1	15.5	Compliant
06:00 - 06:59	20.8	20.8	21.1	21.0	21.2	21.2	21.4	21.5	21.2	23.0	23.6	24.6	15.6	15.3	Compliant
07:00 - 07:59	20.9	20.8	21.0	21.0	21.2	21.5	21.5	21.3	21.5	22.5	24.5	24.2	15.6	15.9	Compliant
08:00 - 08:59	20.8	20.8	20.8	21.0	21.0	21.5	21.4	21.5	21.4	22.5	24.7	23.3	15.9	16.5	Compliant
09:00 - 09:59	20.8	20.8	20.9	20.8	20.7	21.1	21.0	21.7	21.1	22.5	24.0	23.1	15.6	16.4	Compliant
10:00 - 10:59	20.7	20.6	21.0	20.7	20.6	21.0	21.0	21.9	21.2	22.8	23.6	15.8	16.0	16.8	Compliant
11:00 - 11:59	20.3	20.7	20.9	20.5	20.7	20.8	20.7	21.4	21.2	22.4	23.6	15.7	15.7	17.6	Compliant
12:00 - 12:59	20.1	20.5	20.7	20.4	20.4	20.7	20.4	21.0	24.2	21.7	23.7	15.7	15.6	17.8	Compliant
13:00 - 13:59	19.7	20.1	20.4	20.1	19.9	20.3	20.0	20.5	0.0	21.3	23.4	16.2	15.9	18.0	Compliant
14:00 - 14:59	19.4	19.9	19.9	19.7	19.4	19.6	19.7	19.7	45.8	21.0	23.5	15.8	15.7	18.0	Low Load
15:00 - 15:59	19.0	19.7	19.6	0.0	19.5	19.7	19.5	19.2	22.9	20.9	23.3	16.2	16.0	17.9	Compliant
16:00 - 16:59	19.1	19.2	19.2	0.0	19.4	19.4	19.3	19.1	22.2	20.9	23.2	15.7	16.1	18.2	Compliant
17:00 - 17:59	19.1	19.5	19.4	18.5	19.5	19.8	19.1	19.2	22.6	22.1	23.4	16.0	16.2	18.1	Compliant
18:00 - 18:59	19.5	19.7	19.5	0.0	19.7	19.7	19.5	19.4	22.7	22.3	23.5	15.7	15.8	17.7	Compliant
19:00 - 19:59	19.9	20.2	20.4	51.7	20.1	20.5	19.7	19.9	22.1	22.7	23.9	16.1	16.3	17.9	Low Load
20:00 - 20:59	20.0	20.2	20.5	56.3	20.5	20.9	20.2	20.2	22.6	23.0	24.0	15.7	15.6	17.9	Low Load
21:00 - 21:59	20.4	20.4	20.5	47.6	20.9	21.1	20.4	20.2	22.7	23.4	24.1	16.0	16.1	18.0	Low Load
22:00 - 22:59	20.3	20.7	20.5	21.9	21.1	21.1	20.5	20.5	22.5	23.5	24.3	16.0	16.0	18.0	Compliant
23:00 - 23:59	20.3	20.8	20.8	21.0	21.1	21.3	20.8	20.8	22.4	23.6	24.5	15.9	16.2	17.6	Compliant

Remark: Plant shutdown from 30 Jan 26 to 01 Feb 26 due to Steel Mill-Thapyaywa Line Maintenance

Unit 2 NOx (ppmv) - March 2026

Time	1-Mar	2-Mar	3-Mar	4-Mar	5-Mar	6-Mar	7-Mar	8-Mar	9-Mar	10-Mar	11-Mar	12-Mar	13-Mar	14-Mar	15-Mar	Remarks
00:00 - 00:59	15.9	0.0	14.6	15.1	15.3	15.4	15.6	15.3	14.6	14.6	14.9	15.0	15.0	15.2	15.2	Compliant
01:00 - 01:59	15.9	0.0	14.3	15.0	15.0	15.4	15.8	15.8	14.7	15.4	15.6	15.0	15.3	15.1	15.4	Compliant
02:00 - 02:59	15.9	1.3	14.4	14.7	15.1	15.1	16.0	15.9	14.7	14.8	15.2	15.1	15.4	15.1	15.1	Compliant
03:00 - 03:59	16.5	1.2	14.4	14.8	14.7	15.4	15.5	15.8	14.4	14.9	15.3	15.0	15.3	14.9	15.7	Compliant
04:00 - 04:59	15.8	15.2	14.6	15.0	15.0	16.4	15.5	15.5	14.8	14.8	14.8	15.0	15.4	15.3	15.2	Compliant
05:00 - 05:59	16.0	15.0	14.2	14.7	15.1	15.1	15.7	15.1	14.7	15.2	14.7	15.0	15.1	14.9	15.5	Compliant
06:00 - 06:59	15.3	14.5	14.6	14.8	14.8	15.7	16.0	15.1	14.4	14.5	14.8	15.0	15.4	15.5	15.2	Compliant
07:00 - 07:59	15.2	14.7	14.7	14.8	14.4	15.2	15.2	18.3	14.5	14.8	14.6	14.8	15.2	15.0	15.3	Compliant
08:00 - 08:59	15.3	14.4	14.6	14.8	14.8	15.3	15.4	-0.1	14.3	14.7	15.2	15.0	15.1	15.3	15.2	Compliant
09:00 - 09:59	15.0	14.7	15.0	14.6	14.8	15.6	15.7	-0.1	14.5	14.9	15.2	15.2	15.1	15.3	14.9	Compliant
10:00 - 10:59	15.5	14.8	14.9	14.8	14.8	15.6	15.7	0.1	14.5	15.1	14.8	15.2	15.0	15.3	15.3	Compliant
11:00 - 11:59	15.2	14.9	15.0	15.3	15.1	7.0	15.2	0.0	14.7	15.4	14.8	15.2	14.8	15.2	14.9	Compliant
12:00 - 12:59	15.4	14.6	14.6	15.0	7.9	4.7	15.0	-0.1	14.5	15.0	14.6	15.2	15.1	15.2	15.0	Compliant
13:00 - 13:59	15.3	14.5	15.0	14.7	5.2	7.4	16.0	0.0	14.9	14.9	14.6	15.0	14.9	15.2	14.7	Compliant
14:00 - 14:59	15.3	14.7	14.5	14.8	7.1	15.1	15.0	0.0	22.2	17.0	14.8	15.1	14.8	15.1	15.1	Compliant
15:00 - 15:59	15.2	15.1	10.1	14.7	5.2	13.2	15.4	0.0	177.9	15.3	14.9	15.2	14.9	14.9	15.0	Low Load
16:00 - 16:59	15.1	14.7	5.5	14.6	7.5	8.1	15.2	0.0	237.2	14.6	14.7	14.9	14.8	15.0	15.2	Low Load
17:00 - 17:59	15.5	14.7	5.0	15.0	15.8	7.0	15.3	268.0	262.7	14.7	14.6	15.0	15.0	14.8	15.1	Low Load
18:00 - 18:59	15.6	14.9	10.8	14.7	15.4	16.0	15.2	249.5	264.5	15.4	15.0	15.3	15.0	15.0	14.8	Low Load
19:00 - 19:59	15.3	14.5	15.1	15.0	15.5	15.6	15.5	14.9	210.6	15.3	14.7	15.3	14.9	15.1	14.8	Low Load
20:00 - 20:59	15.2	14.9	15.0	14.7	15.3	15.7	15.7	14.9	15.0	14.9	14.6	15.2	15.2	15.3	15.4	Compliant
21:00 - 21:59	15.5	14.9	14.8	15.0	15.8	15.8	15.5	14.9	14.9	14.7	15.0	15.1	15.0	15.2	15.0	Compliant
22:00 - 22:59	15.2	14.9	15.3	15.5	15.5	15.5	15.3	14.7	14.9	15.0	15.1	15.2	15.0	15.1	15.2	Compliant
23:00 - 23:59	15.6	14.6	15.0	14.8	16.2	15.9	15.9	14.7	15.0	15.3	15.0	15.4	15.5	15.3	15.0	Compliant

Time	16-Mar	17-Mar	18-Mar	19-Mar	20-Mar	21-Mar	22-Mar	23-Mar	24-Mar	25-Mar	26-Mar	27-Mar	28-Mar	29-Mar	30-Mar	31-Mar	Remarks
00:00 - 00:59	15.3	14.7	14.9	14.8	14.7	15.1	14.3	15.2	14.7	14.5	14.3	15.2	15.6	15.3	15.9	16.1	Compliant
01:00 - 01:59	15.2	15.0	15.0	14.9	14.8	15.4	15.3	14.5	14.5	15.1	14.5	15.5	15.4	15.1	15.8	15.1	Compliant
02:00 - 02:59	15.3	15.1	14.9	15.1	15.0	14.6	15.0	14.8	14.5	14.9	15.2	16.0	15.9	15.2	15.8	15.6	Compliant
03:00 - 03:59	15.3	15.0	14.8	14.3	14.5	15.3	15.0	14.4	14.5	15.7	14.2	15.2	16.3	16.3	16.0	15.7	Compliant
04:00 - 04:59	14.8	15.0	14.6	14.7	14.4	15.0	14.7	14.9	14.9	15.0	14.8	15.3	15.5	15.9	15.7	15.3	Compliant
05:00 - 05:59	15.1	14.4	14.5	14.4	14.4	15.0	15.4	14.3	14.8	14.6	15.4	15.0	15.1	15.1	15.7	15.4	Compliant
06:00 - 06:59	15.1	14.7	14.5	14.7	14.2	15.3	14.7	15.1	14.2	14.8	14.4	15.1	15.5	15.2	15.8	15.4	Compliant
07:00 - 07:59	15.0	14.7	14.6	14.9	14.4	15.0	15.3	14.7	14.8	15.0	14.9	15.7	15.5	15.0	16.7	15.9	Compliant
08:00 - 08:59	14.8	14.8	14.9	14.8	14.6	14.4	14.4	15.4	14.3	14.4	15.3	14.9	15.3	15.2	15.8	15.5	Compliant
09:00 - 09:59	15.3	14.3	15.0	14.9	14.7	14.4	15.3	14.5	14.5	15.1	14.6	15.8	15.4	15.3	15.3	15.8	Compliant
10:00 - 10:59	15.1	15.0	15.1	14.4	15.0	14.4	15.1	14.3	14.7	14.9	16.1	16.0	15.4	15.5	15.1	64.8	Low Load
11:00 - 11:59	15.0	15.2	15.0	14.9	15.1	14.4	14.5	14.5	15.7	14.4	15.3	15.2	15.0	15.5	14.9	287.2	Low Load
12:00 - 12:59	15.0	15.0	15.1	15.1	15.2	14.4	14.4	15.1	14.8	14.6	15.7	15.3	15.8	15.4	15.7	280.9	Low Load
13:00 - 13:59	14.7	15.1	14.5	15.1	15.0	14.7	14.6	14.5	15.0	14.4	15.2	15.7	15.0	15.2	15.2	279.7	Low Load
14:00 - 14:59	14.8	14.8	15.0	14.5	14.7	14.2	15.1	14.7	14.7	14.8	16.3	15.5	15.2	15.8	15.6	235.0	Low Load
15:00 - 15:59	14.8	14.8	15.1	14.7	16.1	14.6	14.5	14.6	15.0	15.5	0.2	15.4	15.2	16.0	16.1	14.9	Compliant
16:00 - 16:59	15.0	14.9	14.5	14.5	186.1	14.2	15.2	14.4	15.1	15.1	0.0	15.6	16.0	15.9	16.0	14.9	Low Load
17:00 - 17:59	14.6	14.6	14.3	14.6	183.6	14.4	15.0	14.2	15.2	15.2	0.0	15.5	15.6	15.9	15.8	14.9	Low Load
18:00 - 18:59	14.6	14.9	14.8	14.3	266.4	14.4	14.5	14.8	14.7	15.0	0.0	15.6	15.5	15.3	15.7	14.8	Low Load
19:00 - 19:59	15.0	14.7	14.8	15.0	201.5	15.1	15.1	14.9	14.5	14.7	0.0	15.1	15.4	15.9	15.4	15.3	Low Load
20:00 - 20:59	15.0	14.8	14.8	14.6	14.7	15.2	14.8	14.6	15.3	14.6	0.0	15.5	15.6	16.2	15.2	14.8	Compliant
21:00 - 21:59	15.2	15.1	14.8	14.6	15.0	14.8	14.8	14.6	14.6	14.8	17.7	16.1	15.9	15.5	15.8	14.8	Compliant
22:00 - 22:59	15.0	15.0	15.2	14.6	14.9	14.7	15.0	14.4	14.8	14.8	15.4	15.5	15.8	16.0	14.9	14.7	Compliant
23:00 - 23:59	15.3	14.8	14.6	14.7	14.8	15.0	15.0	14.5	14.9	14.9	15.4	15.6	15.4	16.1	15.6	15.0	Compliant

Annex-2

Unit 1 SO2 (ppmv) - April 2025

Time	1-Apr	2-Apr	3-Apr	4-Apr	5-Apr	6-Apr	7-Apr	8-Apr	9-Apr	10-Apr	11-Apr	12-Apr	13-Apr	14-Apr	15-Apr
00:00 - 00:59	0.0	0.2	0.2	0.7	0.7	0.8	1.4	0.5	0.7	0.5	0.5	0.7	1.5	1.6	2.3
01:00 - 01:59	0.0	0.1	0.2	0.6	0.6	0.8	1.3	0.5	0.7	0.4	0.5	0.6	1.5	1.7	2.3
02:00 - 02:59	0.0	0.1	0.2	0.6	0.6	0.9	1.2	0.4	0.6	0.4	0.5	0.6	1.5	1.6	2.2
03:00 - 03:59	0.0	0.1	0.2	0.5	0.5	0.9	1.1	0.4	0.5	0.4	0.5	0.6	1.4	1.4	2.2
04:00 - 04:59	0.0	0.1	0.1	0.5	0.5	0.9	1.1	0.4	0.5	0.3	0.5	0.6	1.3	1.4	2.1
05:00 - 05:59	0.0	0.1	0.1	0.4	0.5	0.9	1.0	0.4	0.5	0.3	0.5	0.6	1.3	1.4	2.0
06:00 - 06:59	0.0	0.1	0.1	0.3	0.5	0.9	0.9	0.3	0.4	0.2	0.4	0.6	1.3	1.5	2.0
07:00 - 07:59	0.0	0.1	0.1	0.2	0.5	0.9	0.9	0.3	0.4	0.2	0.4	0.6	1.2	1.5	1.9
08:00 - 08:59	0.0	0.1	0.1	0.2	0.5	0.9	0.9	0.4	0.3	0.3	0.3	0.6	1.2	1.5	2.0
09:00 - 09:59	0.0	0.1	0.2	0.3	0.7	1.1	0.9	0.4	0.4	0.3	0.4	0.8	1.4	1.5	2.2
10:00 - 10:59	0.0	0.1	0.3	0.4	0.8	1.2	0.6	0.7	0.4	0.4	0.5	0.9	1.7	1.4	2.5
11:00 - 11:59	0.0	0.1	0.5	0.6	1.0	1.3	0.4	0.9	0.5	0.5	0.7	1.1	2.0	1.8	3.1
12:00 - 12:59	0.0	0.1	0.7	0.7	1.2	1.5	0.6	1.2	0.6	0.6	0.9	1.3	2.4	2.3	3.5
13:00 - 13:59	0.0	0.2	1.0	0.9	1.5	1.7	0.9	1.4	0.7	0.7	1.0	1.5	2.6	2.2	3.9
14:00 - 14:59	0.0	0.3	1.1	1.1	1.7	1.9	1.2	1.5	0.8	0.8	1.0	1.6	2.8	2.3	3.9
15:00 - 15:59	0.0	0.5	1.2	1.2	1.8	2.0	1.4	1.6	0.8	0.9	1.0	1.8	2.9	2.8	3.7
16:00 - 16:59	0.0	0.6	1.3	1.3	1.9	2.2	1.3	1.5	0.9	1.0	1.1	1.8	3.0	3.2	3.9
17:00 - 17:59	0.0	0.7	1.3	1.4	1.9	2.2	1.2	1.5	0.9	0.9	1.1	1.9	3.0	3.3	3.3
18:00 - 18:59	0.0	0.7	1.4	1.4	1.7	2.2	1.1	1.4	0.9	0.9	1.0	1.9	2.9	3.3	2.8
19:00 - 19:59	0.0	0.7	1.3	1.3	1.2	2.1	1.1	1.3	0.9	0.9	0.9	1.8	2.2	3.0	2.7
20:00 - 20:59	0.0	0.6	1.1	1.2	1.1	2.1	1.0	1.2	0.8	0.8	0.8	1.7	1.9	2.5	2.7
21:00 - 21:59	0.0	0.5	0.9	1.1	1.0	2.0	0.8	1.1	0.7	0.7	0.7	1.6	1.8	2.3	2.6
22:00 - 22:59	0.0	0.3	0.7	0.9	0.9	1.8	0.7	0.9	0.6	0.6	0.7	1.5	1.8	2.2	2.7
23:00 - 23:59	0.0	0.2	0.7	0.8	0.8	1.6	0.6	0.8	0.5	0.6	0.7	1.5	1.7	2.2	2.8

Time	16-Apr	17-Apr	18-Apr	19-Apr	20-Apr	21-Apr	22-Apr	23-Apr	24-Apr	25-Apr	26-Apr	27-Apr	28-Apr	29-Apr	30-Apr
00:00 - 00:59	2.8	3.4	3.1	3.3	0.1	0.2	1.2	1.6	1.3	1.2	0.9	0.8	0.9	0.1	0.1
01:00 - 01:59	2.8	2.7	3.0	3.1	0.1	0.1	1.1	1.5	1.2	1.1	0.9	0.8	0.8	0.1	0.1
02:00 - 02:59	2.9	2.5	2.9	2.9	0.1	0.1	1.0	1.4	1.1	1.0	0.8	0.7	0.8	0.1	0.1
03:00 - 03:59	2.9	2.5	2.8	2.9	0.1	0.1	1.0	1.3	1.0	0.9	0.8	0.7	0.7	0.1	0.1
04:00 - 04:59	2.9	2.4	2.7	2.9	0.1	0.1	0.9	1.2	0.9	0.7	0.7	0.7	0.6	0.1	0.1
05:00 - 05:59	2.9	2.5	2.7	2.8	0.1	0.1	0.8	1.1	0.8	0.6	0.6	0.6	0.6	0.1	0.1
06:00 - 06:59	2.9	2.7	2.7	2.7	0.1	0.1	0.8	0.9	0.7	0.4	0.5	0.5	0.5	0.1	0.1
07:00 - 07:59	2.9	2.6	2.8	2.6	0.1	0.1	0.7	0.8	0.6	0.4	0.5	0.4	0.4	0.1	0.1
08:00 - 08:59	2.9	2.6	2.8	2.7	0.1	0.1	0.9	0.8	0.6	0.4	0.5	0.4	0.4	0.1	0.1
09:00 - 09:59	3.0	2.6	3.0	2.8	0.1	0.4	1.0	0.8	0.6	0.5	0.5	0.5	0.5	0.1	0.1
10:00 - 10:59	3.4	2.8	3.3	3.1	0.1	0.8	1.3	1.0	0.8	0.6	0.7	0.6	0.6	0.1	0.1
11:00 - 11:59	3.9	3.2	3.7	3.2	0.1	0.6	1.6	1.2	1.0	0.7	0.9	0.8	0.3	0.1	0.2
12:00 - 12:59	4.4	3.7	4.1	7.6	0.3	0.9	1.9	1.6	1.3	1.0	1.1	1.0	0.5	0.2	0.4
13:00 - 13:59	4.8	4.0	4.3	0.8	0.5	1.2	2.1	1.8	1.5	1.2	1.3	1.3	0.8	0.3	0.6
14:00 - 14:59	5.0	4.2	4.4	0.8	0.6	1.4	2.1	1.9	1.6	1.4	1.4	1.4	1.1	0.5	0.8
15:00 - 15:59	5.1	4.3	4.4	0.6	0.7	1.6	2.2	2.0	1.7	1.4	1.4	1.4	1.3	0.6	0.9
16:00 - 16:59	5.0	4.3	4.4	0.3	0.7	1.7	2.2	2.0	1.7	1.5	1.4	1.5	1.4	0.7	1.0
17:00 - 17:59	5.0	4.4	4.4	0.1	0.8	1.7	2.2	2.0	1.7	1.5	1.5	1.5	1.4	0.6	0.9
18:00 - 18:59	5.0	4.3	4.4	0.1	0.7	1.7	2.2	2.0	1.7	1.5	1.5	1.5	1.3	0.5	0.7
19:00 - 19:59	4.9	4.1	4.4	0.1	0.6	1.6	2.1	1.9	1.6	1.4	1.4	1.4	1.3	0.5	0.4
20:00 - 20:59	4.7	3.8	4.2	0.1	0.6	1.5	1.9	1.8	1.5	1.3	1.3	1.3	1.2	0.4	0.3
21:00 - 21:59	4.4	3.6	3.7	0.1	0.5	1.5	1.8	1.7	1.5	1.2	1.1	1.2	0.7	0.3	0.1
22:00 - 22:59	4.2	3.4	3.5	0.1	0.3	1.4	1.7	1.6	1.4	1.1	1.0	1.1	0.2	0.2	0.1
23:00 - 23:59	3.9	3.3	3.4	0.1	0.3	1.3	1.7	1.5	1.3	1.0	0.9	1.0	0.1	0.1	0.1

Unit 1 SO2 (ppmv) - May 2025

Time	1-May	2-May	3-May	4-May	5-May	6-May	7-May	8-May	9-May	10-May	11-May	12-May	13-May	14-May	15-May
00:00 - 00:59	0.1	0.4	0.5	1.0	1.2	1.0	1.1	0.9	1.0	0.8	1.1	0.1	1.0	1.2	2.1
01:00 - 01:59	0.1	0.3	0.5	0.9	1.1	0.8	0.9	0.8	0.9	0.8	1.1	0.1	0.9	1.1	1.9
02:00 - 02:59	0.2	0.2	0.5	0.7	1.0	0.7	0.8	0.7	0.8	0.7	1.1	0.1	0.9	1.0	1.7
03:00 - 03:59	0.1	0.2	0.5	0.5	1.0	0.6	0.7	0.7	0.7	0.7	1.1	0.1	0.9	0.9	1.6
04:00 - 04:59	0.1	0.1	0.5	0.4	0.9	0.5	0.6	0.7	0.7	0.6	1.0	0.1	0.9	0.9	1.5
05:00 - 05:59	0.1	0.1	0.5	0.4	0.9	0.5	0.6	0.6	0.6	0.5	0.9	0.1	0.9	1.0	1.3
06:00 - 06:59	0.1	0.1	0.5	0.4	0.7	0.4	0.5	0.5	0.6	0.5	0.9	0.1	1.0	1.0	1.3
07:00 - 07:59	0.1	0.1	0.4	0.5	0.8	0.5	0.5	0.4	0.5	0.5	0.9	0.1	1.2	1.1	1.4
08:00 - 08:59	0.2	0.1	0.5	0.5	0.9	0.5	0.6	0.5	0.6	0.6	1.0	0.1	1.3	1.2	1.5
09:00 - 09:59	0.2	0.1	0.6	0.6	1.0	0.6	0.7	0.7	0.8	0.7	1.1	0.1	1.4	1.4	1.7
10:00 - 10:59	0.3	0.1	0.7	0.8	1.2	0.8	1.0	0.9	1.0	0.8	1.4	0.3	1.6	1.6	1.9
11:00 - 11:59	0.5	0.2	0.9	1.1	0.6	1.1	1.3	1.2	1.2	1.1	1.7	0.6	2.0	1.8	2.2
12:00 - 12:59	0.7	0.2	1.1	1.5	0.8	1.4	1.6	1.5	1.5	1.8	2.0	1.0	2.4	2.2	2.5
13:00 - 13:59	0.9	0.3	1.4	1.7	1.2	1.7	1.9	1.8	1.7	4.0	2.3	1.1	2.7	2.5	2.7
14:00 - 14:59	1.0	0.5	1.5	1.9	1.5	1.9	1.9	1.9	1.7	3.0	2.5	1.4	3.0	2.8	2.9
15:00 - 15:59	1.0	0.6	1.6	1.9	1.7	1.9	1.9	1.8	1.8	2.8	2.5	1.7	3.1	2.9	3.1
16:00 - 16:59	0.9	0.6	1.6	1.8	1.8	1.9	2.0	1.8	1.8	2.6	2.4	2.0	3.1	3.1	3.1
17:00 - 17:59	0.8	0.7	1.6	1.8	1.8	1.8	1.9	1.8	1.7	2.6	2.4	2.0	3.1	3.2	2.9
18:00 - 18:59	0.7	0.7	1.7	1.7	1.7	1.7	1.8	1.8	1.7	2.6	2.4	1.9	2.9	3.1	2.5
19:00 - 19:59	0.6	0.7	1.6	1.6	1.7	1.6	1.8	1.7	1.5	2.3	2.1	1.5	2.4	2.7	2.1
20:00 - 20:59	0.6	0.6	1.6	1.5	1.6	1.5	1.6	1.4	1.4	1.9	1.9	1.3	1.9	2.5	1.7
21:00 - 21:59	0.6	0.6	1.4	1.5	1.4	1.3	1.4	1.2	1.2	1.6	1.6	1.1	1.6	2.3	1.5
22:00 - 22:59	0.5	0.5	1.2	1.3	1.3	1.3	1.2	1.1	1.1	1.4	1.8	1.0	1.4	2.1	1.5
23:00 - 23:59	0.5	0.5	1.0	1.3	1.1	1.2	1.0	1.0	0.9	1.2	0.7	1.0	1.3	2.1	1.5

Time	16-May	17-May	18-May	19-May	20-May	21-May	22-May	23-May	24-May	25-May	26-May	27-May	28-May	29-May	30-May	31-May
00:00 - 00:59	1.5	1.5	1.5	1.8	0.9	1.4	1.6	1.0	1.4	1.3	0.8	1.6	1.9	1.7	1.7	1.7
01:00 - 01:59	1.5	1.4	1.4	1.9	0.9	1.2	1.4	1.1	1.4	1.2	0.9	1.6	1.9	1.7	1.6	1.7
02:00 - 02:59	1.5	1.3	1.4	1.9	0.9	0.9	1.2	1.1	1.4	1.2	0.9	1.5	1.9	1.7	1.6	1.7
03:00 - 03:59	1.5	1.4	1.5	2.0	0.9	0.9	1.2	1.0	1.5	1.2	1.0	1.5	1.9	1.7	1.6	1.7
04:00 - 04:59	1.5	1.4	1.4	2.0	0.9	1.0	1.1	0.9	1.4	1.2	1.0	1.5	1.9	1.8	1.6	1.7
05:00 - 05:59	1.5	1.3	1.4	2.0	0.9	1.0	0.9	0.8	1.3	1.3	0.9	1.5	1.9	1.7	1.6	1.7
06:00 - 06:59	1.4	1.2	1.5	2.0	0.8	0.9	0.7	0.9	1.1	1.1	1.0	1.5	1.9	1.7	1.6	1.7
07:00 - 07:59	1.4	1.2	1.5	2.0	0.8	1.0	0.8	1.0	1.2	0.9	1.0	1.5	1.9	1.7	1.6	1.7
08:00 - 08:59	1.4	1.2	1.5	2.1	0.9	1.1	0.9	1.1	1.3	0.8	0.9	1.5	1.8	1.6	1.7	1.8
09:00 - 09:59	1.6	1.4	1.7	2.3	1.1	1.2	1.2	1.2	1.4	0.7	0.8	1.5	1.8	1.7	1.9	1.9
10:00 - 10:59	1.8	1.6	2.0	2.5	1.4	1.6	1.4	1.4	1.6	0.7	0.8	1.5	1.9	1.7	2.0	2.1
11:00 - 11:59	2.0	2.0	2.3	2.7	1.9	2.0	1.8	1.8	2.0	0.8	0.5	1.6	2.0	1.7	2.1	2.3
12:00 - 12:59	2.2	2.3	2.6	0.5	2.4	2.4	2.3	2.3	2.4	1.1	0.5	1.7	2.4	1.8	2.2	2.6
13:00 - 13:59	2.5	2.6	2.9	1.2	2.8	2.8	2.7	2.6	2.8	1.5	1.0	1.9	2.6	1.9	2.2	2.7
14:00 - 14:59	2.7	2.9	2.7	1.6	3.0	2.9	2.9	2.9	2.9	1.9	1.5	2.1	2.6	2.1	2.2	2.7
15:00 - 15:59	2.9	3.0	2.5	2.1	3.1	2.9	2.8	3.2	2.9	2.1	1.9	2.3	2.7	2.2	2.2	2.7
16:00 - 16:59	3.0	2.5	2.6	2.6	3.3	3.0	2.6	3.2	2.5	2.0	2.1	2.2	2.7	2.2	2.1	2.7
17:00 - 17:59	2.9	2.1	2.7	2.8	3.2	3.0	2.5	3.3	2.1	2.1	2.1	2.2	2.5	2.2	2.0	2.6
18:00 - 18:59	2.7	1.7	2.7	2.9	3.1	2.8	2.5	3.1	1.7	2.0	2.1	2.2	2.4	2.1	1.8	2.4
19:00 - 19:59	2.5	1.4	2.7	2.8	2.9	2.6	2.2	3.0	1.5	1.6	2.2	2.2	2.2	2.1	1.7	2.3
20:00 - 20:59	2.3	1.3	2.3	2.8	2.4	2.3	1.6	2.9	1.3	1.3	2.0	2.2	2.1	2.0	1.7	2.2
21:00 - 21:59	2.0	1.3	2.0	2.3	1.8	2.1	1.2	2.3	1.2	1.1	1.8	2.0	2.0	1.8	1.7	2.1
22:00 - 22:59	1.8	1.4	1.8	1.4	1.6	2.0	1.1	1.8	1.2	0.9	1.7	1.9	1.8	1.7	1.7	2.1
23:00 - 23:59	1.6	1.5	1.8	1.0	1.4	1.8	1.1	1.5	1.3	0.8	1.6	1.8	1.7	1.7	1.7	2.0

Unit 1 SO2 (ppmv) - June 2025

Time	1-Jun	2-Jun	3-Jun	4-Jun	5-Jun	6-Jun	7-Jun	8-Jun	9-Jun	10-Jun	11-Jun	12-Jun	13-Jun	14-Jun	15-Jun
00:00 - 00:59	2.0	2.1	1.4	1.3	1.2	1.4	1.7	2.3	1.7	0.1	0.1	0.1	0.1	0.1	0.1
01:00 - 01:59	2.0	2.0	1.4	1.4	1.3	1.3	1.7	2.1	1.7	0.1	0.1	0.1	0.1	0.1	0.1
02:00 - 02:59	2.0	1.9	1.4	1.4	1.2	1.2	1.6	2.1	1.6	0.1	0.1	0.1	0.1	0.1	0.1
03:00 - 03:59	2.0	1.8	1.4	1.4	1.2	1.1	1.6	2.0	1.6	0.1	0.1	0.1	0.1	0.1	0.1
04:00 - 04:59	1.9	1.8	1.4	1.4	1.1	1.0	1.6	1.7	1.7	0.1	0.1	0.1	0.1	0.1	0.1
05:00 - 05:59	1.9	1.8	1.4	1.3	1.1	1.0	1.4	1.6	1.7	0.1	0.1	0.1	0.1	0.1	0.1
06:00 - 06:59	1.9	1.8	1.4	1.3	1.1	1.0	1.3	1.6	1.8	0.1	0.1	0.1	0.1	0.1	0.1
07:00 - 07:59	1.9	1.9	1.5	1.4	1.2	1.1	1.3	1.6	1.9	0.1	0.1	0.1	0.1	0.1	0.1
08:00 - 08:59	2.0	1.9	1.6	1.5	1.3	1.2	1.4	1.7	2.0	0.1	0.1	0.1	0.1	0.1	0.1
09:00 - 09:59	2.1	1.9	1.7	1.7	1.5	1.4	1.6	1.9	2.2	0.1	0.1	0.1	0.1	0.1	0.1
10:00 - 10:59	2.3	0.4	2.0	1.9	1.7	1.6	1.8	2.1	2.5	0.1	0.1	0.1	0.1	0.1	0.1
11:00 - 11:59	2.6	0.7	2.2	2.2	1.8	2.0	2.2	2.5	0.5	0.1	0.1	0.1	0.1	0.1	0.1
12:00 - 12:59	2.8	0.9	2.4	2.5	2.1	2.4	2.6	2.9	1.4	0.1	0.1	0.1	0.1	0.1	0.1
13:00 - 13:59	2.9	1.4	2.6	2.7	2.4	2.6	2.9	3.1	1.8	0.1	0.1	0.1	0.1	0.1	0.1
14:00 - 14:59	2.9	1.6	2.8	2.8	2.7	2.7	3.1	3.2	1.5	0.1	0.1	0.2	0.1	0.1	0.1
15:00 - 15:59	3.0	1.8	2.6	2.8	2.6	2.8	3.3	3.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
16:00 - 16:59	3.1	1.9	2.0	2.8	2.6	3.0	3.4	3.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
17:00 - 17:59	3.1	1.8	1.7	2.6	2.5	2.9	3.1	3.2	0.1	0.1	0.1	0.1	0.1	0.1	0.1
18:00 - 18:59	2.9	1.9	1.5	1.9	2.4	2.9	2.7	3.2	0.1	0.1	0.1	0.1	0.1	0.1	0.1
19:00 - 19:59	2.8	1.8	1.4	1.6	2.3	2.9	2.7	3.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1
20:00 - 20:59	2.7	1.8	1.4	1.4	2.2	2.8	2.7	2.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1
21:00 - 21:59	2.5	1.7	1.4	1.2	2.0	2.6	2.6	2.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
22:00 - 22:59	2.4	1.6	1.3	1.2	1.7	2.3	2.4	1.8	0.1	0.1	0.1	0.1	0.1	0.1	0.1
23:00 - 23:59	2.2	1.5	1.3	1.2	1.5	2.0	2.3	1.7	0.1	0.1	0.1	0.1	0.1	0.1	0.1

Time	16-Jun	17-Jun	18-Jun	19-Jun	20-Jun	21-Jun	22-Jun	23-Jun	24-Jun	25-Jun	26-Jun	27-Jun	28-Jun	29-Jun	30-Jun
00:00 - 00:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.1	2.5	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Remark: Plant shutdown from 23:29hr on 23 Jun 25 to 02 Jul 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 1 SO2 (ppmv) - July 2025

Time	1-Jul	2-Jul	3-Jul	4-Jul	5-Jul	6-Jul	7-Jul	8-Jul	9-Jul	10-Jul	11-Jul	12-Jul	13-Jul	14-Jul	15-Jul
00:00 - 00:59	0.0	0.0	0.0	0.8	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
01:00 - 01:59	0.0	0.0	0.0	0.8	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
02:00 - 02:59	0.0	0.0	0.0	0.9	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
03:00 - 03:59	0.0	0.0	0.0	0.9	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
04:00 - 04:59	0.0	0.0	0.0	0.9	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
05:00 - 05:59	0.0	0.0	0.0	0.9	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
06:00 - 06:59	0.0	0.0	0.0	0.9	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1	0.1	0.1
07:00 - 07:59	0.0	0.0	0.0	0.9	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1	0.1	0.1
08:00 - 08:59	0.0	0.0	0.2	0.9	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
09:00 - 09:59	0.0	0.0	0.5	0.8	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1	0.1	0.1
10:00 - 10:59	0.0	0.0	0.8	0.8	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
11:00 - 11:59	0.0	0.0	0.7	0.7	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1	0.1	0.1
12:00 - 12:59	0.0	0.0	0.7	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
13:00 - 13:59	0.0	0.0	0.7	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
14:00 - 14:59	0.0	0.0	0.8	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
15:00 - 15:59	0.0	0.0	0.7	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
16:00 - 16:59	0.0	0.0	0.7	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
17:00 - 17:59	0.0	0.0	0.7	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
18:00 - 18:59	0.0	0.0	0.7	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
19:00 - 19:59	0.0	0.0	0.8	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
20:00 - 20:59	0.0	0.0	0.8	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
21:00 - 21:59	0.0	0.0	0.7	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
22:00 - 22:59	0.0	0.0	0.7	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
23:00 - 23:59	0.0	0.0	0.7	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1

Time	16-Jul	17-Jul	18-Jul	19-Jul	20-Jul	21-Jul	22-Jul	23-Jul	24-Jul	25-Jul	26-Jul	27-Jul	28-Jul	29-Jul	30-Jul	31-Jul
00:00 - 00:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
01:00 - 01:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
02:00 - 02:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
03:00 - 03:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
04:00 - 04:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
05:00 - 05:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
06:00 - 06:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
07:00 - 07:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
08:00 - 08:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
09:00 - 09:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
10:00 - 10:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
11:00 - 11:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
12:00 - 12:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
13:00 - 13:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
14:00 - 14:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
15:00 - 15:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
16:00 - 16:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
17:00 - 17:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
18:00 - 18:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
19:00 - 19:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
20:00 - 20:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
21:00 - 21:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
22:00 - 22:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
23:00 - 23:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1

Remark: Plant shutdown from 23:29hr on 23 Jun 25 to 02 Jul 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 1 SO2 (ppmv) - August 2025

Time	1-Aug	2-Aug	3-Aug	4-Aug	5-Aug	6-Aug	7-Aug	8-Aug	9-Aug	10-Aug	11-Aug	12-Aug	13-Aug	14-Aug	15-Aug
00:00 - 00:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
01:00 - 01:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
02:00 - 02:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
03:00 - 03:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
04:00 - 04:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
05:00 - 05:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
06:00 - 06:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
07:00 - 07:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
08:00 - 08:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
09:00 - 09:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
10:00 - 10:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
11:00 - 11:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
12:00 - 12:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
13:00 - 13:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
14:00 - 14:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
15:00 - 15:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
16:00 - 16:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
17:00 - 17:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
18:00 - 18:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
19:00 - 19:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
20:00 - 20:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
21:00 - 21:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
22:00 - 22:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
23:00 - 23:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1

Time	16-Aug	17-Aug	18-Aug	19-Aug	20-Aug	21-Aug	22-Aug	23-Aug	24-Aug	25-Aug	26-Aug	27-Aug	28-Aug	29-Aug	30-Aug	31-Aug
00:00 - 00:59	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Remark: Plant shutdown from 14:00 hr on 19 Aug 25 to17 Sep 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 1 SO2 (ppmv) - September 2025

Time	1-Sep	2-Sep	3-Sep	4-Sep	5-Sep	6-Sep	7-Sep	8-Sep	9-Sep	10-Sep	11-Sep	12-Sep	13-Sep	14-Sep	15-Sep
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Time	16-Sep	17-Sep	18-Sep	19-Sep	20-Sep	21-Sep	22-Sep	23-Sep	24-Sep	25-Sep	26-Sep	27-Sep	28-Sep	29-Sep	30-Sep
00:00 - 00:59	0.0	0.0	0.0	1.5	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
01:00 - 01:59	0.0	0.0	0.0	1.5	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
02:00 - 02:59	0.0	0.0	0.0	1.5	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
03:00 - 03:59	0.0	0.0	0.0	1.5	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
04:00 - 04:59	0.0	0.0	0.0	1.5	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
05:00 - 05:59	0.0	0.0	0.0	1.5	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
06:00 - 06:59	0.0	0.0	0.0	1.5	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
07:00 - 07:59	0.0	0.0	0.0	1.5	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
08:00 - 08:59	0.0	0.0	0.0	1.5	1.4	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
09:00 - 09:59	0.0	0.0	0.0	1.5	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
10:00 - 10:59	0.0	0.0	0.0	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
11:00 - 11:59	0.0	0.0	0.0	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
12:00 - 12:59	0.0	0.0	0.0	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
13:00 - 13:59	0.0	0.0	2.9	1.4	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
14:00 - 14:59	0.0	0.0	2.2	1.4	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.5	0.0
15:00 - 15:59	0.0	0.0	1.5	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
16:00 - 16:59	0.0	0.0	1.7	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
17:00 - 17:59	0.0	0.0	1.6	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
18:00 - 18:59	0.0	0.0	1.5	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
19:00 - 19:59	0.0	0.0	1.5	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
20:00 - 20:59	0.0	0.0	1.5	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
21:00 - 21:59	0.0	0.0	1.5	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
22:00 - 22:59	0.0	0.0	1.5	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
23:00 - 23:59	0.0	0.0	1.5	1.5	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0

Remark: Plant shutdown from 14:00 hr on 19 Aug 25 to17 Sep 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 1 SO2 (ppmv) - October 2025

Time	1-Oct	2-Oct	3-Oct	4-Oct	5-Oct	6-Oct	7-Oct	8-Oct	9-Oct	10-Oct	11-Oct	12-Oct	13-Oct	14-Oct	15-Oct
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.0	0.1	0.0	0.1
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.1	0.1	0.0	0.1
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.1
12:00 - 12:59	0.0	0.0	0.1	0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
13:00 - 13:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
14:00 - 14:59	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1
15:00 - 15:59	0.0	0.0	0.1	0.0	0.1	0.1	0.1	0.0	0.1	0.1	0.1	0.1	0.0	0.1	0.1
16:00 - 16:59	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.0	0.1	0.0	0.1	0.1
17:00 - 17:59	0.0	0.0	0.0	0.1	0.0	0.1	0.1	0.1	0.0	0.1	0.1	0.1	0.0	0.1	0.1
18:00 - 18:59	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.1	0.0	0.1	0.1
19:00 - 19:59	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.1
20:00 - 20:59	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.1
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.1
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.1
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.1

Time	16-Oct	17-Oct	18-Oct	19-Oct	20-Oct	21-Oct	22-Oct	23-Oct	24-Oct	25-Oct	26-Oct	27-Oct	28-Oct	29-Oct	30-Oct	31-Oct
00:00 - 00:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.0
01:00 - 01:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.0
02:00 - 02:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0
03:00 - 03:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.0
04:00 - 04:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0
05:00 - 05:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.0
06:00 - 06:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.0
07:00 - 07:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0
08:00 - 08:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.0
09:00 - 09:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.0
10:00 - 10:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
11:00 - 11:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
12:00 - 12:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
13:00 - 13:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
14:00 - 14:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
15:00 - 15:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
16:00 - 16:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
17:00 - 17:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
18:00 - 18:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
19:00 - 19:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
20:00 - 20:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1	0.1
21:00 - 21:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.1	0.0
22:00 - 22:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.0	0.0
23:00 - 23:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.0	0.0

Unit 1 SO2 (ppmv) - November 2025

Time	1-Nov	2-Nov	3-Nov	4-Nov	5-Nov	6-Nov	7-Nov	8-Nov	9-Nov	10-Nov	11-Nov	12-Nov	13-Nov	14-Nov	15-Nov
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.2	5.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	1.4	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.7	0.1	0.1	0.0	0.0	0.0	0.1
13:00 - 13:59	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	5.7	0.1	0.1	0.0	0.0	0.0	0.1
14:00 - 14:59	0.1	0.1	0.0	0.0	0.0	0.1	0.0	0.0	0.3	0.1	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.1	0.4	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.1	0.1	0.0	0.0	0.0	0.1	0.0	0.1	0.0	0.1	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Time	16-Nov	17-Nov	18-Nov	19-Nov	20-Nov	21-Nov	22-Nov	23-Nov	24-Nov	25-Nov	26-Nov	27-Nov	28-Nov	29-Nov	30-Nov
00:00 - 00:59	0.0	0.0	0.0	0.1	0.1	0.0	0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.2	0.2
01:00 - 01:59	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.2	0.2
02:00 - 02:59	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.2	0.2
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.2	0.2
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1	0.1
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.1	0.1
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.1	0.1
08:00 - 08:59	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.0	0.1	0.0
09:00 - 09:59	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.1	0.0
10:00 - 10:59	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.0	0.0
11:00 - 11:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
12:00 - 12:59	0.0	0.3	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
13:00 - 13:59	0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	4.1	0.1	0.1	0.1	0.1	0.1
14:00 - 14:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.2	0.1
15:00 - 15:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.1	0.1	0.3	0.3	0.1
16:00 - 16:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.1	0.1	0.3	0.3	0.1
17:00 - 17:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.1	0.2	0.2	0.2	0.1
18:00 - 18:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	1.2	0.1	0.2	0.2	0.2	0.1
19:00 - 19:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.1	0.1
20:00 - 20:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.1	0.0
21:00 - 21:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.2	0.1	0.1
22:00 - 22:59	0.0	0.0	0.1	0.1	0.1	0.1	0.0	0.1	0.1	0.1	0.0	0.0	0.2	0.1	0.1
23:00 - 23:59	0.0	0.0	0.1	0.1	0.0	0.1	0.0	0.1	0.1	0.0	0.0	0.0	0.2	0.2	0.0

Remark: GT#11 Borosopic Inspection from 12 Nov 25 to14 Nov 25.

Unit 1 SO2 (ppmv) - December 2025

Time	1-Dec	2-Dec	3-Dec	4-Dec	5-Dec	6-Dec	7-Dec	8-Dec	9-Dec	10-Dec	11-Dec	12-Dec	13-Dec	14-Dec	15-Dec
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.1	0.1	0.0	0.0
11:00 - 11:59	0.1	0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
12:00 - 12:59	0.1	0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
13:00 - 13:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
14:00 - 14:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
15:00 - 15:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
16:00 - 16:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
17:00 - 17:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.1
18:00 - 18:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
19:00 - 19:59	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1	0.1	0.0	0.1	0.1	0.1	0.1	0.1
20:00 - 20:59	0.0	0.1	0.1	0.1	0.1	0.0	0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1
21:00 - 21:59	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.0	0.1	0.1
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0

Time	16-Dec	17-Dec	18-Dec	19-Dec	20-Dec	21-Dec	22-Dec	23-Dec	24-Dec	25-Dec	26-Dec	27-Dec	28-Dec	29-Dec	30-Dec	31-Dec
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.3	0.1	0.1	0.0	0.1	0.1	0.1	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0
12:00 - 12:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0
13:00 - 13:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
14:00 - 14:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.0
15:00 - 15:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.0
16:00 - 16:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.1	0.1	0.1	0.0	0.0	0.0
17:00 - 17:59	0.1	0.1	0.0	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.1	0.1	0.1	0.0	0.1	0.0
18:00 - 18:59	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0
19:00 - 19:59	0.1	0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
20:00 - 20:59	0.1	0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Unit 1 SO2 (ppmv) - January 2026

Time	1-Jan	2-Jan	3-Jan	4-Jan	5-Jan	6-Jan	7-Jan	8-Jan	9-Jan	10-Jan	11-Jan	12-Jan	13-Jan	14-Jan	15-Jan
00:00 - 00:59	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
11:00 - 11:59	0.1	0.0	0.1	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
12:00 - 12:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1	0.1	0.1
13:00 - 13:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
14:00 - 14:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1	0.1	0.1
15:00 - 15:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.1	0.1	0.1
16:00 - 16:59	0.1	0.1	0.1	0.0	0.1	0.1	0.1	0.0	0.1	0.1	0.0	0.1	0.1	0.1	0.1
17:00 - 17:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1
18:00 - 18:59	0.1	0.1	0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.1
19:00 - 19:59	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.1
20:00 - 20:59	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
23:00 - 23:59	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1

Time	16-Jan	17-Jan	18-Jan	19-Jan	20-Jan	21-Jan	22-Jan	23-Jan	24-Jan	25-Jan	26-Jan	27-Jan	28-Jan	29-Jan	30-Jan	31-Jan
00:00 - 00:59	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.1	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.1	0.1	0.1	0.0	0.1	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.1	0.1	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.1	0.1	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.1	0.0	0.1	0.1	0.1	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.1	0.0	0.0	0.0
11:00 - 11:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0
12:00 - 12:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0
13:00 - 13:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0
14:00 - 14:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0
15:00 - 15:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0
16:00 - 16:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0
17:00 - 17:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0
18:00 - 18:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0
19:00 - 19:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0
20:00 - 20:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0
21:00 - 21:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0
22:00 - 22:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0

Remark: Plant shutdown from 30 Jan 26 to 01 Feb 26 due to Steel Mill-Thapyaywa Line Maintenance

Unit 1 SO2 (ppmv) - Febuary 2026

Time	1-Feb	2-Feb	3-Feb	4-Feb	5-Feb	6-Feb	7-Feb	8-Feb	9-Feb	10-Feb	11-Feb	12-Feb	13-Feb	14-Feb
00:00 - 00:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
01:00 - 01:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
02:00 - 02:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
03:00 - 03:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
04:00 - 04:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
05:00 - 05:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
06:00 - 06:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
07:00 - 07:59	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
08:00 - 08:59	0.0	0.4	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
09:00 - 09:59	0.0	0.3	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1
10:00 - 10:59	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1
11:00 - 11:59	0.0	0.1	1.6	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
12:00 - 12:59	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
13:00 - 13:59	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
14:00 - 14:59	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
15:00 - 15:59	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
16:00 - 16:59	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.3	0.1	0.1
17:00 - 17:59	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
18:00 - 18:59	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
19:00 - 19:59	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
20:00 - 20:59	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
21:00 - 21:59	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
22:00 - 22:59	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
23:00 - 23:59	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1

Time	15-Feb	16-Feb	17-Feb	18-Feb	19-Feb	20-Feb	21-Feb	22-Feb	23-Feb	24-Feb	25-Feb	26-Feb	27-Feb	28-Feb
00:00 - 00:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.5	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.1	0.1	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.1	0.0
14:00 - 14:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.0
15:00 - 15:59	0.1	0.1	0.1	1.2	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0
16:00 - 16:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.0	0.0	0.0	0.0
17:00 - 17:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.1	0.1	0.1	0.7	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0

Remark: Plant shutdown from 30 Jan 26 to 01 Feb 26 due to Steel Mill-Thapyaywa Line Maintenance

Unit 1 SO2 (ppmv) - March 2026

Time	1-Mar	2-Mar	3-Mar	4-Mar	5-Mar	6-Mar	7-Mar	8-Mar	9-Mar	10-Mar	11-Mar	12-Mar	13-Mar	14-Mar	15-Mar
00:00 - 00:59	0.0	0.1	0.0	0.0	0.1	0.1	0.1	0.1	0.2	0.1	0.1	0.1	0.0	0.0	0.0
01:00 - 01:59	0.0	0.1	0.0	0.0	0.1	0.1	0.1	0.1	0.2	0.1	0.1	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.1	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0
03:00 - 03:59	0.0	0.1	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.1	0.1	0.1	1.3	0.1	0.1	0.1	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0
12:00 - 12:59	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1
13:00 - 13:59	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1
14:00 - 14:59	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
15:00 - 15:59	0.0	0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
16:00 - 16:59	0.0	0.1	0.0	0.1	0.1	0.1	0.1	0.6	0.1	0.1	0.1	0.1	0.1	0.1	0.1
17:00 - 17:59	0.0	0.1	0.0	0.1	0.1	0.1	0.1	1.0	0.4	0.1	0.1	0.1	0.1	0.1	0.1
18:00 - 18:59	0.0	0.1	0.0	0.1	0.1	0.1	0.1	1.1	0.6	0.1	0.1	0.1	0.1	0.1	0.1
19:00 - 19:59	0.0	0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1
20:00 - 20:59	0.0	0.1	0.0	0.1	0.1	0.1	0.1	0.3	0.1	0.1	0.1	0.1	0.0	0.0	0.1
21:00 - 21:59	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.4	0.1	0.1	0.1	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.4	0.1	0.1	0.1	0.0	0.0	0.0	0.0
23:00 - 23:59	0.3	0.0	0.0	0.1	0.1	0.1	0.1	0.3	0.1	0.1	0.1	0.0	0.0	0.0	0.0

Time	16-Mar	17-Mar	18-Mar	19-Mar	20-Mar	21-Mar	22-Mar	23-Mar	24-Mar	25-Mar	26-Mar	27-Mar	28-Mar	29-Mar	30-Mar	31-Mar
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.6	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.0	0.1
13:00 - 13:59	0.1	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1	0.0	0.1	0.1	0.1	0.0	0.0	0.1
14:00 - 14:59	0.1	0.0	0.0	0.1	0.1	0.0	0.1	0.0	0.1	0.1	4.0	0.0	0.1	0.1	0.1	0.1
15:00 - 15:59	0.1	0.0	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.1	0.2	0.1	0.1	0.0	0.0	0.1
16:00 - 16:59	0.0	0.0	0.1	0.1	2.4	0.0	0.1	0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.0	0.1
17:00 - 17:59	0.0	0.0	0.1	0.1	0.1	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
18:00 - 18:59	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.1	0.0	0.1	0.1	0.1	0.0	0.1	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.1	0.1	0.0	0.1	0.1	0.0	0.0	0.1
20:00 - 20:59	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Unit 2 SO2 - April 2025

Time	1-Apr	2-Apr	3-Apr	4-Apr	5-Apr	6-Apr	7-Apr	8-Apr	9-Apr	10-Apr	11-Apr	12-Apr	13-Apr	14-Apr	15-Apr
00:00 - 00:59	0.0	0.2	0.7	0.6	0.6	0.6	0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.2	0.7	0.4	0.6	0.6	0.7	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.2	0.6	0.4	0.6	0.6	0.7	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.1	0.6	0.5	0.6	0.6	0.7	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.1	0.6	0.5	0.6	0.6	0.7	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.1	0.6	0.6	0.5	0.6	0.7	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.2	0.5	0.6	0.5	0.6	0.7	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.2	0.4	0.6	0.5	0.5	0.6	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.2	0.4	0.6	0.4	0.5	0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.2	0.4	0.5	0.4	0.5	0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.1	0.3	0.3	0.3	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.2	0.3	0.2	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.1	0.2	0.1	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.1	0.1	0.1	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.1	0.1	0.2	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.1	0.0	0.1	0.2	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.1	0.1	0.1	0.3	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	5.4	0.2	0.1	0.2	0.3	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.3	0.2	0.3	0.4	0.5	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.2	0.3	0.4	0.4	0.5	0.5	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.4	0.6	0.5	0.6	0.5	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.5	0.8	0.5	0.6	0.5	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.1	0.5	0.8	0.5	0.6	0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.2	0.6	0.7	0.6	0.7	0.6	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0

Time	16-Apr	17-Apr	18-Apr	19-Apr	20-Apr	21-Apr	22-Apr	23-Apr	24-Apr	25-Apr	26-Apr	27-Apr	28-Apr	29-Apr	30-Apr
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0

Unit 2 SO2 - May 2025

Time	1-May	2-May	3-May	4-May	5-May	6-May	7-May	8-May	9-May	10-May	11-May	12-May	13-May	14-May	15-May
00:00 - 00:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	1.8	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	5.6	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Time	16-May	17-May	18-May	19-May	20-May	21-May	22-May	23-May	24-May	25-May	26-May	27-May	28-May	29-May	30-May	31-May
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Unit 2 SO2 - June 2025

Time	1-Jun	2-Jun	3-Jun	4-Jun	5-Jun	6-Jun	7-Jun	8-Jun	9-Jun	10-Jun	11-Jun	12-Jun	13-Jun	14-Jun	15-Jun
00:00 - 00:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2
01:00 - 01:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5.3	0.0	0.2
02:00 - 02:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	20.1	0.0	0.2
03:00 - 03:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.0	0.2
04:00 - 04:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.3
05:00 - 05:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3
06:00 - 06:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3
07:00 - 07:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	15.7	0.0	0.3
08:00 - 08:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3
09:00 - 09:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3
10:00 - 10:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.4
11:00 - 11:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.4
12:00 - 12:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.4
13:00 - 13:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.4
14:00 - 14:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.4
15:00 - 15:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.6	0.0	0.2	0.4
16:00 - 16:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.6	0.0	0.2	0.4
17:00 - 17:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.5	0.0	0.2	0.4
18:00 - 18:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	16.8	0.0	0.2	0.4
19:00 - 19:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.4
20:00 - 20:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.4
21:00 - 21:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.4
22:00 - 22:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.4
23:00 - 23:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.4

Time	16-Jun	17-Jun	18-Jun	19-Jun	20-Jun	21-Jun	22-Jun	23-Jun	24-Jun	25-Jun	26-Jun	27-Jun	28-Jun	29-Jun	30-Jun
00:00 - 00:59	0.4	0.0	0.0	0.0	0.2	0.4	0.5	0.7	10.6	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.5	0.0	0.0	0.0	0.2	0.4	0.5	0.7	0.4	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.5	0.0	0.0	0.0	0.3	0.4	0.5	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.5	0.0	0.0	0.1	0.3	0.4	0.5	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.5	0.0	0.0	0.1	0.3	0.4	0.6	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.5	0.0	0.0	0.1	0.3	0.5	0.6	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.5	0.0	0.0	0.1	0.3	0.5	0.6	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.4	0.0	0.0	0.1	0.3	0.5	0.6	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.5	0.0	0.0	0.1	0.3	0.5	0.6	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.5	0.0	0.0	0.1	0.4	0.5	0.6	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.1	0.4	0.5	0.6	0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.2	0.4	0.6	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.2	0.5	0.6	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.3	0.4	0.6	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	0.3	0.5	0.6	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.0	0.1	0.3	0.5	0.6	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.3	0.5	0.5	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.0	0.0	0.3	0.5	0.6	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.3	0.5	0.5	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.2	0.4	0.5	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.2	0.4	0.5	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.2	0.4	0.5	0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.2	0.4	0.5	0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.2	0.4	0.5	0.6	3.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Remark: Plant shutdown from 23:29hr on 23 Jun 25 to 02 Jul 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 2 SO2 - July 2025

Time	1-Jul	2-Jul	3-Jul	4-Jul	5-Jul	6-Jul	7-Jul	8-Jul	9-Jul	10-Jul	11-Jul	12-Jul	13-Jul	14-Jul	15-Jul
00:00 - 00:59	0.0	0.0	0.0	0.2	0.3	0.3	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.2	0.3	0.3	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.2	0.3	0.3	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.2	0.3	0.3	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.2	0.3	0.3	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.3	0.3	0.3	0.4	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.8	0.3	0.3	0.3	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.3	0.3	0.3	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.1	0.2	0.3	0.3	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.2	0.2	0.3	0.3	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.2	0.2	0.3	0.4	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.2	0.3	0.3	0.4	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.3	0.3	0.3	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
13:00 - 13:59	0.0	0.0	0.3	0.3	0.3	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.6
14:00 - 14:59	0.0	0.0	0.3	0.3	0.3	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.8
15:00 - 15:59	0.0	0.0	0.3	0.3	0.3	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0
16:00 - 16:59	0.0	0.0	0.3	0.3	0.4	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.4
17:00 - 17:59	0.0	0.0	0.3	0.3	0.4	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.3	0.3	0.3	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.2	0.3	0.3	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.2	0.3	0.3	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.2	0.3	0.3	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.1	0.2	0.3	0.3	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.2	0.3	0.3	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Time	16-Jul	17-Jul	18-Jul	19-Jul	20-Jul	21-Jul	22-Jul	23-Jul	24-Jul	25-Jul	26-Jul	27-Jul	28-Jul	29-Jul	30-Jul	31-Jul
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Remark: Plant shutdown from 23:29hr on 23 Jun 25 to 02 Jul 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 2 SO2 - August 2025

Time	1-Aug	2-Aug	3-Aug	4-Aug	5-Aug	6-Aug	7-Aug	8-Aug	9-Aug	10-Aug	11-Aug	12-Aug	13-Aug	14-Aug	15-Aug
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Time	16-Aug	17-Aug	18-Aug	19-Aug	20-Aug	21-Aug	22-Aug	23-Aug	24-Aug	25-Aug	26-Aug	27-Aug	28-Aug	29-Aug	30-Aug	31-Aug
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	8.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Remark: Plant shutdown from 14:00 hr on 19 Aug 25 to17 Sep 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 2 SO2 - September 2025

Time	1-Sep	2-Sep	3-Sep	4-Sep	5-Sep	6-Sep	7-Sep	8-Sep	9-Sep	10-Sep	11-Sep	12-Sep	13-Sep	14-Sep	15-Sep
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Time	16-Sep	17-Sep	18-Sep	19-Sep	20-Sep	21-Sep	22-Sep	23-Sep	24-Sep	25-Sep	26-Sep	27-Sep	28-Sep	29-Sep	30-Sep
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	1.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.2	0.0
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	11.9	0.0
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Remark: Plant shutdown from 14:00 hr on 19 Aug 25 to17 Sep 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 2 SO2 - October 2025

Time	1-Oct	2-Oct	3-Oct	4-Oct	5-Oct	6-Oct	7-Oct	8-Oct	9-Oct	10-Oct	11-Oct	12-Oct	13-Oct	14-Oct	15-Oct
00:00 - 00:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Time	16-Oct	17-Oct	18-Oct	19-Oct	20-Oct	21-Oct	22-Oct	23-Oct	24-Oct	25-Oct	26-Oct	27-Oct	28-Oct	29-Oct	30-Oct	31-Oct
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Unit 2 SO2 - November 2025

Time	1-Nov	2-Nov	3-Nov	4-Nov	5-Nov	6-Nov	7-Nov	8-Nov	9-Nov	10-Nov	11-Nov	12-Nov	13-Nov	14-Nov	15-Nov
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.7	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.7	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.7	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.5	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.4	0.0	0.0	1.6	0.0	0.0	0.0	0.0	0.0

Time	16-Nov	17-Nov	18-Nov	19-Nov	20-Nov	21-Nov	22-Nov	23-Nov	24-Nov	25-Nov	26-Nov	27-Nov	28-Nov	29-Nov	30-Nov
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Remark: GT#12 Borosopic Inspection from 07 Nov 25 to 11 Nov 25.

Unit 2 SO2 - December 2025

Time	1-Dec	2-Dec	3-Dec	4-Dec	5-Dec	6-Dec	7-Dec	8-Dec	9-Dec	10-Dec	11-Dec	12-Dec	13-Dec	14-Dec	15-Dec
00:00 - 00:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
18:00 - 18:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.00	0.00	0.00	0.00	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Time	16-Dec	17-Dec	18-Dec	19-Dec	20-Dec	21-Dec	22-Dec	23-Dec	24-Dec	25-Dec	26-Dec	27-Dec	28-Dec	29-Dec	30-Dec	31-Dec
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Unit 2 SO2 - January 2026

Time	1-Jan	2-Jan	3-Jan	4-Jan	5-Jan	6-Jan	7-Jan	8-Jan	9-Jan	10-Jan	11-Jan	12-Jan	13-Jan	14-Jan	15-Jan
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.1	0.0
15:00 - 15:59	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.0
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Time	16-Jan	17-Jan	18-Jan	19-Jan	20-Jan	21-Jan	22-Jan	23-Jan	24-Jan	25-Jan	26-Jan	27-Jan	28-Jan	29-Jan	30-Jan	31-Jan
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.0	0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Remark: Plant shutdown from 30 Jan 26 to 01 Feb 26 due to Steel Mill-Thapyaywa Line Maintenance

Unit 2 SO2 (ppmv) - Febuary 2026

Time	1-Feb	2-Feb	3-Feb	4-Feb	5-Feb	6-Feb	7-Feb	8-Feb	9-Feb	10-Feb	11-Feb	12-Feb	13-Feb	14-Feb
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	1.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	1.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	1.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Time	15-Feb	16-Feb	17-Feb	18-Feb	19-Feb	20-Feb	21-Feb	22-Feb	23-Feb	24-Feb	25-Feb	26-Feb	27-Feb	28-Feb
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.4	0.0	0.0	19.2	0.0	0.0
12:00 - 12:59	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.3	0.0	0.0	24.4	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.0	0.0	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4.9	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
20:00 - 20:59	0.0	0.0	0.0	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1

Remark: Plant shutdown from 30 Jan 26 to 01 Feb 26 due to Steel Mill-Thapyaywa Line Maintenance

Unit 2 SO2 - March 2026

Time	1-Mar	2-Mar	3-Mar	4-Mar	5-Mar	6-Mar	7-Mar	8-Mar	9-Mar	10-Mar	11-Mar	12-Mar	13-Mar	14-Mar	15-Mar
00:00 - 00:59	0.1	0.2	0.1	0.1	0.1	0.0	0.4	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.1	0.2	0.1	0.1	0.1	0.0	0.4	0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.1	0.2	0.1	0.1	0.1	0.0	0.4	0.5	0.0	0.1	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.1	0.1	0.1	0.1	0.1	0.0	0.4	0.5	0.0	0.2	0.1	0.0	0.0	0.0	0.0
04:00 - 04:59	0.1	0.1	0.1	0.1	0.1	0.0	0.4	0.5	0.0	0.2	0.1	0.0	0.0	0.0	0.0
05:00 - 05:59	0.1	0.1	0.1	0.1	0.1	0.0	0.3	0.5	0.0	0.2	0.1	0.0	0.0	0.0	0.0
06:00 - 06:59	0.1	0.1	0.1	0.1	0.1	0.0	0.3	0.4	0.0	0.2	0.1	0.0	0.0	0.0	0.0
07:00 - 07:59	0.1	0.1	0.1	0.1	0.1	0.0	0.3	0.5	0.0	0.2	0.1	0.0	0.0	0.0	0.0
08:00 - 08:59	0.1	0.1	0.1	0.1	0.1	0.0	0.4	0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.1	0.1	0.1	0.1	0.2	0.0	0.3	0.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.1	0.1	0.1	0.1	0.2	0.0	0.4	0.8	0.0	0.0	0.2	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.1	0.1	0.1	0.2	0.0	0.4	0.0	0.0	0.0	0.5	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.1	0.0	0.1	0.1	0.0	0.3	0.0	0.0	0.0	0.4	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.1	0.0	0.2	0.0	1.9	0.3	0.0	0.0	0.0	0.2	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.1	0.0	0.2	8.2	97.3	0.3	0.0	0.0	0.0	0.3	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.1	0.0	0.2	0.0	0.0	0.4	0.0	0.0	0.0	0.3	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.1	0.0	0.2	0.0	11.7	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.1	1.4	0.2	0.0	0.1	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.1	10.2	0.2	0.0	0.2	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.1	0.1	0.1	0.2	0.0	0.4	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.1	0.1	0.1	0.2	0.0	0.4	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.1	0.1	0.2	0.2	0.0	0.4	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.1	0.1	0.2	0.2	0.0	0.4	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.1	0.1	0.1	0.1	0.0	0.5	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Time	16-Mar	17-Mar	18-Mar	19-Mar	20-Mar	21-Mar	22-Mar	23-Mar	24-Mar	25-Mar	26-Mar	27-Mar	28-Mar	29-Mar	30-Mar	31-Mar
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.1	0.1	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.1	0.1	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.1	0.1	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.2	0.1	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0

Annex-3

Unit 1 PM (ppmv) - April 2025

Time	1-Apr	2-Apr	3-Apr	4-Apr	5-Apr	6-Apr	7-Apr	8-Apr	9-Apr	10-Apr	11-Apr	12-Apr	13-Apr	14-Apr	15-Apr
00:00 - 00:59	0.0	5.5	5.5	5.6	5.0	6.0	5.4	5.6	4.8	5.6	5.3	5.7	5.4	5.4	8.2
01:00 - 01:59	0.0	5.5	5.6	5.7	5.3	5.9	5.6	5.8	5.2	5.5	5.4	5.8	5.3	5.7	5.8
02:00 - 02:59	0.0	5.5	5.7	5.6	5.2	6.0	5.5	5.7	5.4	5.6	5.5	5.7	5.5	5.7	4.6
03:00 - 03:59	0.0	5.7	5.6	5.3	5.3	5.8	5.5	5.3	5.4	5.7	5.5	5.8	5.6	5.9	5.6
04:00 - 04:59	0.0	5.8	5.6	5.6	5.6	5.6	5.8	5.4	5.5	5.6	5.5	5.9	5.6	5.4	6.5
05:00 - 05:59	0.0	5.7	5.3	5.6	5.7	5.2	5.6	5.4	5.6	5.7	5.6	5.8	5.5	5.4	6.4
06:00 - 06:59	0.0	5.8	5.2	5.5	5.7	5.4	5.6	5.6	5.5	5.8	5.9	6.0	5.6	5.4	6.5
07:00 - 07:59	0.0	5.8	5.3	5.6	5.7	5.6	5.7	5.5	5.7	5.7	5.9	6.1	5.7	5.6	6.9
08:00 - 08:59	0.0	5.9	5.3	5.7	5.7	5.7	5.8	5.6	5.5	5.5	5.9	6.0	5.8	5.8	6.8
09:00 - 09:59	0.0	5.8	5.3	5.4	5.7	5.7	5.8	5.8	5.2	5.6	5.9	5.9	5.6	5.9	6.6
10:00 - 10:59	0.0	5.6	5.5	5.3	5.6	5.5	5.6	5.5	5.6	5.0	5.7	5.7	5.4	5.6	6.2
11:00 - 11:59	0.0	5.5	5.4	5.5	5.7	5.7	5.8	5.3	5.5	5.2	5.4	5.7	5.3	5.6	5.9
12:00 - 12:59	0.0	5.6	5.6	5.4	5.4	5.6	5.6	5.5	5.5	5.7	5.4	5.7	5.5	4.8	6.1
13:00 - 13:59	0.0	5.6	5.7	5.5	5.3	5.7	5.7	5.6	5.4	5.2	5.3	5.6	5.5	5.5	5.7
14:00 - 14:59	0.0	5.6	5.3	5.6	5.1	5.6	5.8	5.4	5.7	5.2	5.4	5.2	5.4	6.0	5.7
15:00 - 15:59	0.0	5.3	5.2	5.4	5.3	5.5	5.7	5.4	5.5	5.2	5.3	5.2	5.2	5.6	5.7
16:00 - 16:59	0.0	5.1	5.4	5.3	5.2	5.1	5.8	5.3	5.6	5.4	5.5	5.2	5.1	4.9	6.4
17:00 - 17:59	0.0	5.0	5.3	5.1	5.0	5.4	5.8	5.3	5.2	5.4	5.3	5.3	5.0	5.3	5.8
18:00 - 18:59	0.0	5.3	5.1	4.9	6.1	5.5	5.7	5.4	5.0	5.5	5.0	5.2	5.9	5.4	5.8
19:00 - 19:59	0.0	5.2	4.8	5.3	6.2	5.0	5.5	5.1	5.3	5.2	4.9	5.5	5.7	8.2	5.3
20:00 - 20:59	0.0	5.1	5.1	5.4	6.1	5.3	5.6	4.9	5.5	5.2	5.1	5.6	5.1	61.4	6.3
21:00 - 21:59	0.0	5.3	5.4	5.0	6.0	5.2	5.7	4.7	5.6	5.1	5.2	5.6	5.4	4.0	48.6
22:00 - 22:59	0.0	5.6	5.6	4.9	6.2	5.6	5.8	4.9	5.7	5.3	5.3	5.4	5.1	38.7	7.0
23:00 - 23:59	0.0	5.5	5.7	5.2	6.1	5.5	5.8	5.0	5.7	5.3	5.5	5.3	5.5	65.0	6.1

Time	16-Apr	17-Apr	18-Apr	19-Apr	20-Apr	21-Apr	22-Apr	23-Apr	24-Apr	25-Apr	26-Apr	27-Apr	28-Apr	29-Apr	30-Apr
00:00 - 00:59	5.5	6.0	6.0	6.0	6.6	5.7	5.9	5.9	5.7	5.6	5.6	5.6	5.2	5.3	7.7
01:00 - 01:59	6.1	6.0	6.1	5.8	25.4	5.8	5.8	5.8	5.6	5.6	5.7	5.7	5.2	4.8	39.4
02:00 - 02:59	6.4	5.8	6.0	5.9	5.7	5.8	5.7	5.8	5.8	5.7	5.6	5.7	5.4	5.0	6.8
03:00 - 03:59	5.9	4.8	5.8	5.9	5.8	5.9	5.3	5.6	5.8	5.7	5.7	5.7	5.4	5.4	6.5
04:00 - 04:59	5.7	5.6	5.9	6.1	6.0	5.8	5.3	5.8	5.8	5.9	5.8	5.7	5.5	5.5	6.0
05:00 - 05:59	5.5	7.1	6.1	6.1	5.6	6.0	5.7	5.9	5.8	5.9	5.7	5.7	5.4	5.3	5.4
06:00 - 06:59	5.8	7.1	5.8	5.9	7.4	5.9	6.0	5.9	5.9	6.0	5.6	5.5	5.4	5.3	19.9
07:00 - 07:59	6.1	6.3	5.9	6.0	6.4	6.1	6.1	6.0	6.0	6.0	5.7	5.7	5.3	5.6	5.9
08:00 - 08:59	5.9	6.0	5.3	6.1	5.9	5.8	6.0	6.1	6.0	6.0	5.8	5.8	5.5	5.8	5.8
09:00 - 09:59	6.1	6.0	5.6	6.2	6.1	6.0	6.2	6.1	6.0	6.0	5.8	5.8	5.6	5.9	5.1
10:00 - 10:59	6.0	5.9	5.8	6.0	5.7	5.7	6.1	6.0	5.8	5.8	5.6	5.5	5.4	5.4	5.2
11:00 - 11:59	5.9	5.9	5.9	5.9	5.9	5.9	5.8	5.9	5.8	5.7	5.5	5.3	5.3	5.3	5.4
12:00 - 12:59	5.9	5.8	6.0	5.7	5.8	5.9	5.9	5.9	5.8	5.5	5.5	5.4	5.3	5.5	5.7
13:00 - 13:59	5.9	6.0	6.1	5.8	5.8	5.7	5.8	5.8	5.6	5.3	5.4	5.4	5.1	5.4	5.5
14:00 - 14:59	5.7	5.9	6.0	5.7	5.9	5.7	5.6	5.6	5.2	5.3	5.4	5.2	5.2	5.5	5.4
15:00 - 15:59	5.7	5.8	5.8	5.5	5.9	5.5	5.5	5.4	5.2	5.5	5.3	5.3	5.2	5.4	5.4
16:00 - 16:59	5.5	5.5	5.3	5.5	5.6	5.6	5.5	5.5	5.4	5.4	5.4	5.2	5.2	5.2	5.4
17:00 - 17:59	5.4	5.6	5.8	5.6	5.6	5.7	5.5	5.7	5.3	5.4	5.4	5.5	5.1	5.1	5.1
18:00 - 18:59	5.6	5.6	5.7	5.7	5.7	5.7	5.4	5.8	5.3	5.3	5.3	5.3	5.2	5.3	5.9
19:00 - 19:59	5.7	5.7	5.5	5.7	5.9	5.7	5.7	5.8	5.4	5.1	5.4	5.5	5.2	5.4	5.8
20:00 - 20:59	5.5	5.8	5.3	6.1	5.7	5.8	5.8	5.7	5.6	5.6	5.3	5.2	6.9	5.4	6.1
21:00 - 21:59	5.7	6.1	5.5	6.0	5.5	5.5	5.8	5.8	5.7	5.4	5.3	5.3	5.8	5.4	24.8
22:00 - 22:59	5.8	5.9	5.7	5.8	5.3	5.4	6.0	5.8	5.6	5.3	5.3	5.0	5.7	5.0	6.5
23:00 - 23:59	5.9	5.7	5.4	5.7	5.6	5.4	5.9	5.8	5.6	5.5	5.6	5.1	5.6	5.8	6.0

Unit 1 PM (ppmv) - May 2025

Time	1-May	2-May	3-May	4-May	5-May	6-May	7-May	8-May	9-May	10-May	11-May	12-May	13-May	14-May	15-May
00:00 - 00:59	22.9	5.2	5.6	5.6	5.5	5.3	5.1	5.7	5.6	5.2	5.0	3.9	5.5	5.5	5.7
01:00 - 01:59	6.9	5.5	55.2	5.9	5.4	5.7	5.4	5.7	5.4	5.2	4.8	61.4	5.6	5.8	5.7
02:00 - 02:59	6.8	4.8	5.4	5.8	5.7	5.8	5.3	5.6	5.2	5.3	4.8	6.9	5.6	5.9	5.8
03:00 - 03:59	5.1	4.6	5.8	5.8	5.7	5.8	5.6	5.5	5.4	5.3	4.7	6.5	25.2	5.7	5.7
04:00 - 04:59	4.9	4.4	5.6	5.8	5.6	5.9	5.0	5.5	5.2	5.6	4.7	6.7	73.9	5.6	5.9
05:00 - 05:59	5.3	4.4	5.3	5.9	5.1	5.6	5.5	5.5	5.2	5.2	4.9	60.7	5.6	5.5	5.8
06:00 - 06:59	4.5	4.5	5.5	6.3	5.9	5.7	5.2	5.6	5.4	5.1	5.0	6.1	5.6	5.7	5.8
07:00 - 07:59	5.8	4.9	5.7	6.0	5.5	5.8	5.4	5.6	5.6	5.3	5.1	6.1	6.0	5.8	5.7
08:00 - 08:59	5.9	4.8	5.7	6.0	5.7	5.8	5.9	5.7	5.5	5.5	5.1	5.6	5.9	5.9	5.8
09:00 - 09:59	6.0	4.8	5.9	6.1	5.6	5.7	5.9	5.6	5.3	5.4	5.3	6.0	5.8	6.0	5.7
10:00 - 10:59	5.5	4.1	5.8	5.6	5.3	5.7	5.5	5.6	5.4	5.4	5.2	6.0	5.8	5.8	5.6
11:00 - 11:59	5.1	4.5	5.8	5.7	5.4	5.4	5.1	5.6	5.4	5.6	5.4	5.9	5.7	5.7	5.6
12:00 - 12:59	5.5	5.1	5.6	5.6	5.4	5.3	5.4	5.4	5.4	5.3	5.3	5.7	5.7	5.7	5.6
13:00 - 13:59	5.2	5.7	5.6	5.3	5.5	5.5	5.7	5.5	5.3	5.1	5.1	5.5	5.7	5.6	5.6
14:00 - 14:59	5.2	5.1	5.5	5.5	5.6	5.0	5.2	5.4	5.2	4.8	5.0	5.2	5.6	5.4	5.4
15:00 - 15:59	5.3	5.4	5.4	5.3	5.4	5.3	5.2	5.3	5.4	4.6	4.9	5.2	5.4	5.3	5.4
16:00 - 16:59	5.8	5.6	5.4	5.1	5.5	5.3	5.0	5.1	5.2	4.8	4.6	5.4	5.6	4.9	5.6
17:00 - 17:59	5.6	5.4	5.4	5.0	5.3	5.5	5.0	5.0	5.1	5.1	4.3	5.5	5.6	5.2	5.7
18:00 - 18:59	5.5	5.4	5.3	5.3	5.7	5.4	5.0	4.7	5.2	4.8	4.7	5.6	5.7	5.1	5.5
19:00 - 19:59	5.6	5.3	5.4	5.7	5.7	5.6	5.5	5.2	5.5	5.0	4.6	5.6	5.7	5.7	5.7
20:00 - 20:59	5.6	5.4	5.1	5.5	5.3	5.4	5.5	5.5	5.4	5.1	4.8	5.6	5.8	5.7	6.1
21:00 - 21:59	5.7	5.3	5.4	5.4	5.3	5.7	5.3	5.7	5.2	5.0	9.2	5.8	5.7	5.7	6.0
22:00 - 22:59	5.9	5.5	5.7	5.3	5.4	5.4	5.5	5.7	5.0	5.0	5.3	5.8	5.6	5.7	5.9
23:00 - 23:59	5.6	5.3	5.8	5.5	5.3	5.6	5.6	5.6	5.4	5.0	8.2	5.7	5.6	5.7	5.6

Time	16-May	17-May	18-May	19-May	20-May	21-May	22-May	23-May	24-May	25-May	26-May	27-May	28-May	29-May	30-May	31-May
00:00 - 00:59	5.8	5.9	5.1	6.1	5.7	6.1	6.0	5.7	6.1	5.7	4.6	0.0	6.7	7.0	7.0	6.6
01:00 - 01:59	6.2	5.9	5.3	6.0	6.0	5.8	6.0	5.8	6.1	5.3	30.1	1.1	6.8	6.9	7.0	6.7
02:00 - 02:59	127.7	5.9	5.4	6.0	6.0	5.4	5.9	6.1	6.3	5.2	5.9	4.2	6.8	7.7	7.0	6.7
03:00 - 03:59	5.4	5.8	4.5	5.7	6.0	5.1	6.0	6.0	5.9	5.2	53.3	4.8	6.7	7.8	7.0	6.6
04:00 - 04:59	5.6	5.9	4.9	6.1	6.0	5.5	6.0	6.3	5.6	4.8	40.0	4.8	6.6	7.2	6.9	6.7
05:00 - 05:59	5.7	6.0	4.8	6.0	5.8	5.7	6.1	6.2	5.5	4.8	196.5	3.4	6.6	6.8	6.9	6.7
06:00 - 06:59	5.7	6.0	4.9	6.0	5.9	5.9	6.1	6.2	5.1	4.9	125.6	0.0	6.7	7.0	6.9	6.8
07:00 - 07:59	6.0	6.0	5.0	6.1	6.1	6.0	6.1	6.2	4.7	6.2	37.0	0.9	6.6	6.9	6.9	6.8
08:00 - 08:59	6.0	6.1	5.8	5.9	6.0	6.2	6.0	6.2	5.0	8.3	5.2	3.1	6.5	7.0	7.0	7.0
09:00 - 09:59	6.1	6.0	5.7	5.7	6.1	6.1	5.8	6.2	5.2	10.1	5.0	0.0	6.6	7.2	1.4	6.8
10:00 - 10:59	6.0	5.8	5.6	5.5	6.0	5.9	5.6	6.3	5.7	6.9	5.3	0.0	6.7	6.7	3.7	7.0
11:00 - 11:59	5.8	5.5	5.7	5.7	6.0	5.8	5.6	6.3	6.0	6.5	5.3	1.0	6.5	7.1	5.0	6.9
12:00 - 12:59	5.7	5.5	5.6	5.7	6.0	5.7	5.7	5.7	5.5	6.2	5.2	4.5	6.7	6.7	5.3	7.0
13:00 - 13:59	5.7	5.2	5.1	5.6	5.9	5.7	5.7	5.6	5.3	6.0	5.6	4.8	6.7	7.3	1.3	6.7
14:00 - 14:59	5.6	5.3	5.5	5.8	5.6	5.6	5.5	5.8	5.2	5.6	5.6	5.2	6.6	6.7	0.0	6.9
15:00 - 15:59	5.5	5.3	5.4	5.6	5.7	5.3	5.7	5.6	5.7	5.7	5.8	5.4	6.6	6.7	3.6	6.9
16:00 - 16:59	5.1	6.2	5.6	5.5	5.7	5.6	5.7	5.5	6.0	5.8	5.6	4.7	6.7	6.7	6.2	6.9
17:00 - 17:59	5.3	26.3	5.7	5.4	5.7	5.6	5.5	5.1	5.8	5.7	3.4	0.9	6.7	6.6	8.6	6.8
18:00 - 18:59	5.6	5.9	5.7	5.7	5.7	5.5	5.6	5.4	5.8	5.5	1.3	5.1	6.6	6.7	8.8	6.7
19:00 - 19:59	5.7	4.8	5.4	5.8	5.5	5.7	5.7	5.7	5.8	3.7	4.4	4.4	6.5	6.7	8.2	6.8
20:00 - 20:59	5.7	4.4	6.0	5.9	6.1	5.8	6.0	5.7	5.9	19.3	3.3	0.9	6.6	6.6	7.3	6.9
21:00 - 21:59	5.8	6.1	6.1	5.6	6.2	5.8	4.9	5.9	5.9	74.2	0.0	5.7	6.9	7.0	6.7	6.9
22:00 - 22:59	5.9	6.5	6.2	5.1	6.1	5.9	5.5	6.1	6.0	4.7	1.2	6.8	7.1	6.8	6.5	7.0
23:00 - 23:59	5.9	5.6	6.5	5.2	6.1	6.0	5.5	6.1	6.0	3.8	3.2	6.7	6.9	6.8	6.5	7.0

Unit 1 PM (ppmv) - June 2025

Time	1-Jun	2-Jun	3-Jun	4-Jun	5-Jun	6-Jun	7-Jun	8-Jun	9-Jun	10-Jun	11-Jun	12-Jun	13-Jun	14-Jun	15-Jun
00:00 - 00:59	6.9	6.9	6.9	6.8	7.4	6.8	6.1	5.9	6.0	7.1	6.6	6.9	6.7	7.1	6.9
01:00 - 01:59	6.9	7.7	7.0	7.0	6.7	6.6	6.0	6.6	6.2	7.0	6.3	6.9	10.8	6.9	6.8
02:00 - 02:59	6.9	8.0	7.0	7.0	6.5	6.7	6.2	6.0	6.3	6.8	6.3	6.9	6.5	6.8	6.8
03:00 - 03:59	6.9	8.1	7.1	7.0	6.4	6.9	6.3	6.3	6.2	6.7	6.6	7.0	6.6	6.8	7.0
04:00 - 04:59	6.9	8.4	7.1	7.0	6.6	6.8	6.5	26.7	6.6	6.3	6.4	6.5	6.5	6.6	6.9
05:00 - 05:59	6.8	9.7	7.1	7.1	6.8	6.9	6.7	6.3	6.7	6.5	6.5	6.5	7.0	6.8	6.9
06:00 - 06:59	6.8	11.3	7.1	7.3	6.9	7.0	6.8	6.0	6.3	6.5	6.5	7.2	7.5	6.9	7.1
07:00 - 07:59	6.9	8.5	7.1	7.2	7.0	7.0	6.8	6.3	6.6	6.3	6.5	6.6	6.7	6.8	7.2
08:00 - 08:59	6.7	7.4	7.1	7.1	7.1	6.9	6.7	6.3	6.6	6.5	6.5	6.5	6.8	6.9	7.1
09:00 - 09:59	6.6	7.2	7.1	7.1	6.9	6.9	6.7	6.4	6.5	6.6	6.3	6.4	6.4	7.0	7.1
10:00 - 10:59	6.7	6.9	7.0	6.9	6.8	6.4	6.3	6.5	6.4	6.5	6.4	6.4	6.6	7.0	7.0
11:00 - 11:59	6.5	7.1	6.9	6.8	6.6	6.3	6.4	6.5	6.4	6.3	6.4	6.4	6.6	7.0	6.9
12:00 - 12:59	6.7	6.8	6.9	6.7	6.5	6.3	6.3	6.2	6.4	6.4	2.3	6.3	6.5	7.0	6.9
13:00 - 13:59	6.7	6.5	6.8	6.7	6.5	6.4	6.2	6.5	6.1	6.4	38.5	6.2	6.3	6.8	6.8
14:00 - 14:59	6.8	6.5	6.7	6.5	6.1	6.3	5.9	5.7	6.1	6.3	64.8	6.3	6.4	6.7	6.7
15:00 - 15:59	6.6	6.6	6.1	6.5	6.2	6.2	5.7	6.6	5.9	5.8	6.4	5.7	6.1	6.6	6.4
16:00 - 16:59	6.7	6.6	6.1	6.5	6.1	6.1	5.6	6.5	5.9	6.6	6.3	5.7	6.2	6.6	6.6
17:00 - 17:59	6.8	6.6	6.8	6.4	6.2	6.2	6.0	6.1	6.0	5.9	6.4	5.6	6.2	6.4	6.3
18:00 - 18:59	6.8	6.6	6.8	7.0	5.9	6.2	6.3	6.2	6.3	6.5	6.5	21.7	6.5	6.7	6.8
19:00 - 19:59	6.7	6.8	6.8	21.9	6.3	6.2	6.3	6.1	5.6	70.3	6.1	185.2	6.7	6.5	6.8
20:00 - 20:59	6.9	6.8	6.3	6.7	6.5	6.3	6.1	6.2	5.8	6.7	6.6	31.1	6.9	6.7	6.9
21:00 - 21:59	7.0	6.8	6.5	6.8	6.7	6.4	6.2	6.4	6.7	6.5	6.5	6.9	6.9	6.7	7.0
22:00 - 22:59	7.6	6.9	6.8	6.8	6.7	6.1	6.0	6.5	7.1	6.6	6.7	11.4	7.1	6.7	7.1
23:00 - 23:59	7.2	7.0	6.8	7.4	6.7	6.0	5.9	7.1	7.4	6.8	6.9	8.4	7.2	6.7	7.1

Time	16-Jun	17-Jun	18-Jun	19-Jun	20-Jun	21-Jun	22-Jun	23-Jun	24-Jun	25-Jun	26-Jun	27-Jun	28-Jun	29-Jun	30-Jun
00:00 - 00:59	7.1	7.0	7.0	7.0	6.9	6.8	6.6	6.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	7.1	7.0	7.0	7.0	6.9	6.8	6.7	6.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	7.0	6.8	7.0	7.1	7.0	6.7	6.8	6.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	7.1	6.9	7.0	7.1	7.0	6.7	6.7	6.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	7.2	7.0	6.9	7.1	7.0	6.7	6.8	6.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	6.9	7.0	7.0	7.2	7.1	6.8	6.9	7.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	7.1	7.1	7.1	7.1	7.1	6.8	6.9	7.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	7.2	7.1	7.1	7.1	7.1	6.8	6.9	6.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	7.1	7.2	1.4	7.2	7.1	6.8	7.0	6.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	7.1	7.2	5.8	7.2	6.9	6.9	7.0	7.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	7.0	7.1	6.7	7.3	6.9	6.8	7.0	7.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	7.0	7.0	7.2	7.2	6.8	6.9	7.0	7.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	6.9	7.0	6.6	6.9	6.8	6.8	6.9	7.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	6.6	6.7	6.7	6.7	6.8	6.7	6.7	6.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	6.7	6.8	6.6	6.5	6.7	6.8	6.7	6.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	6.4	5.9	6.7	6.5	6.5	6.7	6.7	6.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	6.8	6.3	6.6	6.5	6.6	6.6	6.7	6.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	6.6	8.2	6.7	6.6	6.7	6.6	6.5	6.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	6.7	6.8	6.7	6.6	6.6	6.7	6.4	6.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	6.9	6.9	6.8	6.7	6.6	6.6	6.6	6.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	7.0	6.8	6.8	6.9	6.8	6.8	6.5	6.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	7.0	7.0	6.9	7.0	6.8	6.7	6.6	6.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	7.0	7.0	7.0	7.0	6.9	6.7	6.6	6.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	7.0	7.0	7.0	7.1	6.8	6.7	6.6	7.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Remark: Plant shutdown from 23:29hr on 23 Jun 25 to 02 Jul 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 1 PM (ppmv) - July 2025

Time	1-Jul	2-Jul	3-Jul	4-Jul	5-Jul	6-Jul	7-Jul	8-Jul	9-Jul	10-Jul	11-Jul	12-Jul	13-Jul	14-Jul	15-Jul
00:00 - 00:59	6.3	5.8	6.2	6.9	7.0	6.9	7.0	7.1	7.0	6.8	6.1	6.9	7.0	6.9	6.9
01:00 - 01:59	6.3	5.8	6.3	6.9	7.0	6.8	7.0	8.1	6.9	6.9	6.2	6.9	7.1	6.9	7.0
02:00 - 02:59	6.2	5.8	6.3	6.9	7.0	6.9	7.0	7.6	6.9	6.9	6.1	6.9	7.1	6.9	6.9
03:00 - 03:59	6.2	5.8	6.3	6.8	7.0	6.9	6.8	7.2	6.9	6.8	9.7	6.9	7.0	7.1	7.0
04:00 - 04:59	6.2	5.7	6.3	6.8	6.8	6.9	6.9	7.1	6.9	6.8	6.7	6.8	7.0	8.1	6.9
05:00 - 05:59	6.1	5.7	6.4	6.9	6.8	6.9	6.9	7.7	7.0	6.9	6.5	6.9	7.0	7.6	6.9
06:00 - 06:59	6.2	5.7	6.5	7.0	6.9	6.9	7.0	7.5	6.9	6.7	6.6	6.9	6.8	7.2	6.9
07:00 - 07:59	6.3	5.9	6.9	7.1	7.0	6.9	7.1	6.9	6.8	7.0	6.5	6.9	6.9	7.1	6.9
08:00 - 08:59	6.3	6.1	0.0	7.1	7.0	6.9	7.0	7.0	6.9	7.0	6.4	6.9	6.9	7.7	7.0
09:00 - 09:59	6.4	6.3	0.0	7.1	7.1	7.0	6.3	7.1	7.0	6.9	6.5	6.9	7.0	7.5	6.9
10:00 - 10:59	6.2	6.2	4.5	7.0	7.1	6.9	7.0	7.1	7.0	6.8	6.2	6.9	7.1	6.9	6.8
11:00 - 11:59	6.1	6.2	6.7	7.0	7.0	6.8	6.6	7.0	6.9	6.8	6.7	6.9	7.0	7.0	6.9
12:00 - 12:59	6.1	6.3	6.6	6.9	6.8	6.7	7.1	6.9	7.0	6.6	6.3	7.0	6.3	7.1	7.0
13:00 - 13:59	6.2	6.3	6.6	6.7	6.6	6.6	6.7	6.8	6.9	6.3	6.3	6.9	7.0	7.1	7.0
14:00 - 14:59	6.1	6.3	6.4	6.6	6.6	6.5	6.6	6.7	6.8	6.2	6.2	6.8	6.6	7.0	6.9
15:00 - 15:59	6.2	6.3	6.5	6.6	6.5	6.6	6.6	6.2	6.5	6.1	6.8	6.7	7.1	6.9	7.0
16:00 - 16:59	6.0	6.3	6.5	6.6	6.5	6.6	6.5	8.3	6.4	5.9	6.6	6.6	6.7	6.8	6.9
17:00 - 17:59	6.2	6.4	6.5	6.6	6.7	6.6	6.7	6.2	6.4	6.0	6.6	6.5	6.6	6.7	6.8
18:00 - 18:59	6.1	6.3	6.7	6.6	6.6	6.7	6.6	6.5	6.4	6.2	6.5	6.6	6.6	6.2	6.5
19:00 - 19:59	6.0	6.3	6.9	6.7	6.8	6.6	6.7	6.9	6.7	6.3	6.5	6.6	6.5	8.3	6.4
20:00 - 20:59	6.0	6.2	6.9	6.8	6.9	7.0	6.8	6.9	6.6	6.4	6.7	6.6	6.7	6.2	6.4
21:00 - 21:59	5.9	6.2	6.9	6.8	6.9	7.0	6.9	6.9	6.7	6.5	6.6	6.7	6.6	6.5	6.4
22:00 - 22:59	5.9	6.1	6.9	6.9	6.9	7.1	6.9	7.0	6.7	7.4	6.8	6.6	6.7	6.9	6.7
23:00 - 23:59	5.9	6.1	7.0	7.0	6.9	7.1	6.9	6.9	6.7	6.0	6.9	7.0	6.8	6.9	6.6

Time	16-Jul	17-Jul	18-Jul	19-Jul	20-Jul	21-Jul	22-Jul	23-Jul	24-Jul	25-Jul	26-Jul	27-Jul	28-Jul	29-Jul	30-Jul	31-Jul
00:00 - 00:59	6.7	6.5	6.6	6.5	8.3	6.4	5.9	7.0	6.8	6.9	6.6	6.4	6.8	7.0	6.8	6.9
01:00 - 01:59	6.7	7.4	6.6	6.7	6.2	6.4	6.0	7.0	6.9	6.9	6.7	6.5	6.9	7.0	6.8	6.8
02:00 - 02:59	6.7	6.6	6.7	6.6	6.5	6.4	6.2	7.1	6.9	7.0	6.7	7.4	7.0	6.9	6.9	6.8
03:00 - 03:59	6.8	6.8	6.6	6.7	6.9	6.7	6.3	7.1	6.9	6.9	6.7	7.1	7.0	6.8	6.7	6.9
04:00 - 04:59	6.9	6.9	7.0	6.8	6.9	6.6	6.4	7.0	7.1	7.0	6.8	7.0	6.9	6.8	7.0	6.7
05:00 - 05:59	6.9	6.9	7.0	6.9	6.9	6.7	6.5	7.0	8.1	6.9	6.9	6.9	7.0	6.6	7.0	7.0
06:00 - 06:59	6.8	6.9	7.1	6.9	7.0	6.7	7.4	7.0	7.6	6.9	6.9	6.8	6.9	6.3	6.9	7.0
07:00 - 07:59	6.8	6.9	7.1	6.9	6.9	6.7	6.9	6.8	7.2	6.9	6.8	6.7	6.8	6.2	6.8	6.9
08:00 - 08:59	6.9	6.9	7.0	7.1	7.0	6.8	6.9	6.9	7.1	6.9	6.8	6.2	6.5	6.1	6.8	6.8
09:00 - 09:59	6.7	6.8	7.0	8.1	6.9	6.9	6.9	6.9	7.7	7.0	6.9	8.3	6.4	5.9	6.6	6.8
10:00 - 10:59	7.0	6.9	7.0	7.6	6.9	6.9	6.9	7.0	7.5	6.9	6.7	6.2	6.4	6.0	6.3	6.6
11:00 - 11:59	7.0	6.9	6.8	7.2	6.9	6.8	6.9	7.1	6.9	6.8	7.0	6.5	6.4	6.2	6.2	6.3
12:00 - 12:59	6.9	6.9	6.9	7.1	6.9	6.8	6.9	7.0	7.0	6.9	7.0	6.9	6.7	6.3	6.1	6.2
13:00 - 13:59	6.8	6.9	6.9	7.7	7.0	6.9	7.0	6.3	7.1	7.0	6.9	6.9	6.6	6.4	5.9	6.1
14:00 - 14:59	6.8	6.9	7.0	7.5	6.9	6.7	6.9	7.0	7.1	7.0	6.8	6.9	6.7	6.5	6.0	5.9
15:00 - 15:59	6.6	6.9	7.1	6.9	6.8	7.0	6.8	6.6	7.0	6.9	6.8	7.0	6.7	7.4	6.2	6.0
16:00 - 16:59	6.3	6.9	7.0	7.0	6.9	7.0	6.7	7.1	6.9	7.0	6.6	6.9	6.7	6.7	6.3	6.2
17:00 - 17:59	6.2	7.0	6.3	7.1	7.0	6.9	6.6	6.7	6.8	6.9	6.3	7.0	6.8	6.6	6.4	6.3
18:00 - 18:59	6.1	6.9	7.0	7.1	7.0	6.8	6.5	6.6	6.7	6.8	6.2	6.9	6.9	6.7	6.5	6.4
19:00 - 19:59	5.9	6.8	6.6	7.0	6.9	6.8	6.6	6.6	6.2	6.5	6.1	6.9	6.9	6.7	7.4	6.5
20:00 - 20:59	6.0	6.7	7.1	6.9	7.0	6.6	6.6	6.5	8.3	6.4	5.9	6.9	6.8	6.7	6.7	6.2
21:00 - 21:59	6.2	6.6	6.7	6.8	6.9	6.3	6.6	6.7	6.2	6.4	6.0	6.9	6.8	6.8	6.7	6.3
22:00 - 22:59	6.3	6.5	6.6	6.7	6.8	6.2	6.7	6.6	6.5	6.4	6.2	7.0	6.9	6.9	6.8	6.4
23:00 - 23:59	6.4	6.6	6.6	6.2	6.5	6.1	6.6	6.7	6.9	6.7	6.3	6.9	6.7	6.9	6.9	6.5

Remark: Plant shutdown from 23:29hr on 23 Jun 25 to 02 Jul 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 1 PM (ppmv) - August 2025

Time	1-Aug	2-Aug	3-Aug	4-Aug	5-Aug	6-Aug	7-Aug	8-Aug	9-Aug	10-Aug	11-Aug	12-Aug	13-Aug	14-Aug	15-Aug
00:00 - 00:59	6.2	6.5	6.4	6.2	6.6	6.6	6.8	6.7	6.7	6.7	6.5	6.6	6.3	6.3	6.2
01:00 - 01:59	6.2	6.5	6.5	6.2	6.5	6.6	6.9	6.7	6.7	6.7	6.5	6.7	6.4	6.5	6.3
02:00 - 02:59	6.2	6.3	6.6	6.3	6.5	6.5	6.9	6.8	6.7	6.7	6.6	6.6	6.4	6.5	6.3
03:00 - 03:59	6.3	6.3	6.7	6.4	6.4	6.6	6.8	6.8	6.8	6.8	6.6	6.6	6.5	6.5	6.4
04:00 - 04:59	6.3	6.3	6.6	6.5	6.4	6.7	6.8	6.9	6.8	6.7	6.7	6.7	6.5	6.5	6.5
05:00 - 05:59	6.4	6.5	6.6	6.5	6.4	6.7	6.9	6.9	6.5	6.7	6.7	6.6	6.5	6.5	6.4
06:00 - 06:59	6.4	6.4	6.5	6.5	6.3	6.7	6.9	6.9	6.6	6.7	6.7	6.5	6.5	6.5	6.4
07:00 - 07:59	6.4	6.3	6.5	6.7	6.4	6.7	6.9	6.9	6.8	6.6	6.8	6.6	6.7	6.4	6.6
08:00 - 08:59	6.5	6.2	6.5	6.7	6.3	6.7	6.9	6.9	6.8	6.6	6.8	6.6	6.8	6.3	6.6
09:00 - 09:59	6.4	6.1	6.3	6.7	6.6	6.7	6.9	6.7	6.8	6.7	6.8	6.5	6.8	6.4	6.5
10:00 - 10:59	6.4	6.2	6.5	6.7	6.5	6.7	6.7	6.8	6.6	6.6	6.6	6.6	6.7	6.3	6.4
11:00 - 11:59	6.5	6.6	6.4	6.7	6.4	6.6	6.8	6.9	6.4	6.7	6.5	6.6	6.6	6.4	6.5
12:00 - 12:59	6.6	6.6	6.5	6.6	6.6	6.5	6.8	6.8	6.4	6.6	6.6	6.6	6.6	6.5	6.3
13:00 - 13:59	6.7	6.3	6.5	6.5	6.5	6.1	6.7	6.8	6.4	6.5	6.4	6.6	6.6	6.4	6.3
14:00 - 14:59	6.6	6.2	6.5	6.2	6.4	6.5	6.6	6.6	6.2	6.5	6.2	6.4	6.4	6.3	6.1
15:00 - 15:59	6.6	6.2	6.5	6.3	6.4	6.1	6.4	6.4	6.3	6.4	6.0	6.4	6.2	6.2	5.8
16:00 - 16:59	6.5	6.2	6.3	6.3	6.4	7.2	6.2	6.4	6.3	6.1	6.0	6.3	5.9	6.1	5.8
17:00 - 17:59	6.5	6.3	6.3	6.3	6.4	7.4	6.3	6.4	6.5	6.1	6.3	6.2	5.8	6.2	5.6
18:00 - 18:59	6.5	6.3	6.3	6.4	6.1	7.3	6.4	6.4	6.6	6.3	6.2	6.4	6.2	6.3	5.5
19:00 - 19:59	6.3	6.4	6.5	6.4	7.0	7.2	6.5	6.4	6.6	6.5	6.3	6.4	6.3	6.3	6.0
20:00 - 20:59	6.5	6.4	6.4	6.5	6.6	6.9	6.6	6.5	6.5	6.4	6.5	6.4	6.4	6.1	6.2
21:00 - 21:59	6.4	6.4	6.3	6.5	6.4	6.7	6.7	6.5	6.6	6.4	6.5	6.4	6.4	6.1	6.6
22:00 - 22:59	6.5	6.5	6.2	6.5	6.5	6.8	6.7	6.7	6.7	6.4	6.5	6.3	6.4	5.9	38.1
23:00 - 23:59	6.5	6.4	6.1	6.4	6.3	6.8	6.7	6.7	6.7	6.4	6.4	6.4	6.6	6.1	6.0

Time	16-Aug	17-Aug	18-Aug	19-Aug	20-Aug	21-Aug	22-Aug	23-Aug	24-Aug	25-Aug	26-Aug	27-Aug	28-Aug	29-Aug	30-Aug	31-Aug
00:00 - 00:59	5.8	6.4	6.7	6.8	5.9	4.8	5.0	5.1	5.3	5.6	5.1	6.8	0.0	5.1	5.0	5.6
01:00 - 01:59	5.7	6.2	6.7	6.7	5.9	4.7	5.1	5.2	5.3	5.5	5.4	7.8	0.0	5.2	5.1	5.7
02:00 - 02:59	6.2	5.9	6.6	6.5	5.9	4.6	5.2	5.2	5.2	5.4	5.5	1.5	0.0	5.2	5.0	5.6
03:00 - 03:59	6.9	5.6	6.5	6.5	5.9	4.7	5.1	5.1	5.2	5.4	5.9	0.0	0.0	7.1	4.9	5.7
04:00 - 04:59	1.4	5.8	6.6	6.6	5.7	4.8	5.1	5.1	5.1	5.4	5.7	0.0	0.0	1.3	4.8	5.7
05:00 - 05:59	0.0	6.2	6.5	6.5	5.7	4.8	5.1	5.0	5.1	5.4	3.5	0.0	0.0	0.0	4.9	5.3
06:00 - 06:59	0.0	6.1	6.8	6.6	5.8	4.9	5.2	5.0	5.1	5.4	2.6	0.0	0.0	0.0	5.0	5.1
07:00 - 07:59	0.0	6.2	6.5	6.8	6.0	5.2	5.4	5.3	5.2	5.5	4.8	0.0	4.0	0.0	5.0	5.1
08:00 - 08:59	4.7	6.5	6.6	6.9	6.2	5.4	5.7	5.6	5.5	5.9	2.0	0.0	5.0	4.8	5.4	5.6
09:00 - 09:59	6.7	6.6	6.9	6.9	6.4	5.7	5.9	5.8	5.6	5.5	5.8	4.4	5.3	5.5	5.7	5.7
10:00 - 10:59	6.3	6.7	6.5	6.7	6.3	5.5	5.7	5.6	5.4	5.4	5.7	5.6	5.3	5.5	5.4	5.4
11:00 - 11:59	6.6	6.5	6.5	6.8	6.1	5.7	5.7	5.7	5.5	5.4	5.4	5.6	5.4	5.6	5.6	5.4
12:00 - 12:59	6.9	6.6	6.4	6.4	6.1	5.7	5.8	5.7	5.5	5.2	5.4	5.6	5.4	5.8	5.5	5.3
13:00 - 13:59	6.7	6.4	6.3	6.8	6.1	5.7	5.7	5.6	5.7	5.7	5.4	5.4	5.4	5.2	5.5	5.5
14:00 - 14:59	6.4	6.6	6.3	7.9	6.0	5.6	5.7	5.6	5.5	5.2	5.1	5.5	5.6	5.3	5.4	5.5
15:00 - 15:59	6.1	6.2	6.3	5.9	5.2	5.5	5.5	5.6	5.6	5.4	4.9	5.5	5.5	5.6	5.5	5.6
16:00 - 16:59	5.9	6.0	6.0	5.9	5.0	5.4	5.5	5.4	5.6	5.5	5.1	5.7	5.5	5.6	5.3	5.4
17:00 - 17:59	6.0	5.9	6.3	5.9	4.9	5.5	5.6	5.4	5.7	5.8	5.0	5.5	5.5	5.6	5.4	5.3
18:00 - 18:59	6.0	6.0	6.2	5.9	4.9	5.4	5.5	5.5	5.2	5.5	5.2	5.6	5.5	5.5	5.4	5.6
19:00 - 19:59	5.8	6.3	7.2	5.9	4.9	5.2	5.5	5.5	5.4	5.4	5.0	5.0	5.5	5.4	5.4	5.6
20:00 - 20:59	5.6	39.2	21.5	5.7	4.8	5.0	5.3	5.4	5.4	5.4	5.2	5.8	5.4	5.1	5.5	5.7
21:00 - 21:59	5.7	57.6	6.8	5.7	4.9	5.1	5.4	5.5	5.5	5.5	5.2	0.7	5.3	5.1	5.5	5.7
22:00 - 22:59	7.1	6.6	6.6	5.7	4.9	5.1	5.4	5.4	5.5	5.2	5.2	0.0	5.2	5.1	5.6	5.7
23:00 - 23:59	7.3	6.6	6.7	5.8	4.9	5.0	5.2	5.4	5.6	4.9	5.3	0.0	5.1	5.0	5.7	5.6

Remark: Plant shutdown from 14:00 hr on 19 Aug 25 to17 Sep 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 1 PM (ppmv) - September 2025

Time	1-Sep	2-Sep	3-Sep	4-Sep	5-Sep	6-Sep	7-Sep	8-Sep	9-Sep	10-Sep	11-Sep	12-Sep	13-Sep	14-Sep	15-Sep
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Time	16-Sep	17-Sep	18-Sep	19-Sep	20-Sep	21-Sep	22-Sep	23-Sep	24-Sep	25-Sep	26-Sep	27-Sep	28-Sep	29-Sep	30-Sep
00:00 - 00:59	0.0	0.0	0.0	5.1	4.7	6.4	6.1	6.4	6.1	0.0	6.1	6.5	1.5	5.3	5.8
01:00 - 01:59	0.0	0.0	0.0	5.0	5.0	34.6	5.8	5.9	7.7	0.0	6.0	6.3	0.0	5.4	5.3
02:00 - 02:59	0.0	0.0	0.0	4.8	4.9	5.7	5.9	6.0	8.1	0.0	5.9	6.0	0.0	5.4	5.9
03:00 - 03:59	0.0	0.0	0.0	5.0	4.5	0.4	5.7	6.8	7.3	0.0	6.0	5.4	0.0	5.3	6.1
04:00 - 04:59	0.0	0.0	0.0	4.9	4.4	6.4	5.7	55.4	4.6	0.0	6.1	5.6	0.0	5.5	5.4
05:00 - 05:59	0.0	0.0	0.0	5.1	4.5	4.9	5.9	6.8	1.4	0.0	6.2	5.9	0.0	4.9	5.5
06:00 - 06:59	0.0	0.0	0.0	4.9	4.6	6.7	5.9	6.2	5.9	0.5	6.1	6.1	0.0	2.3	3.7
07:00 - 07:59	0.0	0.0	0.0	4.8	4.7	6.9	5.9	5.9	5.4	5.5	6.0	6.1	0.0	3.0	0.0
08:00 - 08:59	0.0	0.0	0.0	4.6	5.0	5.8	5.8	6.0	6.1	5.8	6.2	6.0	0.0	5.7	0.0
09:00 - 09:59	0.0	0.0	0.0	5.0	4.7	5.7	5.7	6.0	5.8	6.2	6.2	6.0	3.6	5.7	5.4
10:00 - 10:59	0.0	0.0	0.0	5.3	4.8	5.7	5.7	5.7	5.8	6.1	6.2	5.8	5.2	5.3	5.9
11:00 - 11:59	0.0	0.0	0.0	5.3	4.9	5.7	5.4	5.6	5.6	6.2	6.2	6.0	5.2	5.6	6.1
12:00 - 12:59	0.0	0.0	0.0	4.8	4.8	5.7	5.7	5.7	5.6	6.5	6.2	6.1	5.7	5.6	6.7
13:00 - 13:59	0.0	0.0	5.7	4.9	4.8	5.6	5.2	5.7	5.4	5.7	5.9	5.8	5.5	5.5	50.1
14:00 - 14:59	0.0	0.0	5.8	4.7	4.7	5.6	5.6	5.7	5.9	6.0	5.8	5.9	5.3	6.8	7.0
15:00 - 15:59	0.0	0.0	6.1	4.3	4.6	5.6	5.2	5.4	5.3	5.9	5.7	5.5	5.2	10.4	6.3
16:00 - 16:59	0.0	0.0	4.6	4.7	4.5	5.4	5.2	5.3	5.1	6.5	5.9	43.0	5.3	7.0	4.7
17:00 - 17:59	0.0	0.0	4.1	4.6	4.4	6.4	5.3	5.5	4.1	5.9	5.9	6.0	5.3	5.4	1.8
18:00 - 18:59	0.0	0.0	4.2	4.5	4.6	6.1	6.0	5.3	0.8	5.9	5.7	6.3	5.4	5.1	5.9
19:00 - 19:59	0.0	0.0	4.2	85.5	4.8	6.1	5.2	5.6	4.5	6.0	0.7	6.2	5.4	5.1	6.2
20:00 - 20:59	0.0	0.0	3.9	53.9	4.0	5.7	5.7	5.5	0.0	5.9	5.4	5.7	5.3	5.1	6.4
21:00 - 21:59	0.0	0.0	4.7	5.9	0.0	6.0	6.0	5.6	0.7	6.1	5.9	5.9	5.9	5.3	6.0
22:00 - 22:59	0.0	0.0	5.0	4.7	0.0	6.0	6.3	6.0	4.4	6.3	6.4	5.4	5.8	5.5	5.8
23:00 - 23:59	0.0	0.0	5.1	5.0	0.5	5.9	6.7	5.8	0.0	6.0	6.5	5.2	5.5	5.2	5.5

Remark: Plant shutdown from 14:00 hr on 19 Aug 25 to17 Sep 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 1 PM (ppmv) - October 2025

Time	1-Oct	2-Oct	3-Oct	4-Oct	5-Oct	6-Oct	7-Oct	8-Oct	9-Oct	10-Oct	11-Oct	12-Oct	13-Oct	14-Oct	15-Oct
00:00 - 00:59	5.3	7.5	24.1	6.9	6.5	6.6	6.5	6.8	6.7	6.3	6.7	6.3	32.6	6.9	6.8
01:00 - 01:59	6.3	7.5	6.9	6.9	6.7	6.7	6.2	6.9	6.9	6.7	6.7	6.5	6.3	68.6	6.3
02:00 - 02:59	6.8	7.4	6.7	6.7	6.8	6.6	0.7	7.0	6.8	6.9	6.3	6.4	5.9	121.1	6.0
03:00 - 03:59	6.7	7.3	6.9	6.8	6.8	6.4	6.5	6.9	6.8	33.2	6.1	6.6	6.3	6.6	5.8
04:00 - 04:59	6.6	7.1	7.1	60.5	6.6	6.5	6.6	7.0	6.8	58.7	5.9	6.7	6.0	6.4	62.8
05:00 - 05:59	6.4	7.1	7.0	6.3	6.4	6.5	6.7	7.1	6.9	4.3	6.1	6.7	5.7	6.5	6.4
06:00 - 06:59	6.4	7.0	6.5	6.6	6.6	6.7	6.8	7.3	6.9	6.1	6.2	6.8	4.1	6.5	47.9
07:00 - 07:59	6.4	7.0	6.9	6.5	6.6	6.5	6.3	7.1	6.8	6.4	6.3	6.9	0.0	6.1	13.0
08:00 - 08:59	6.5	7.3	6.3	6.6	6.3	6.6	6.5	6.9	6.7	6.7	6.6	6.9	1.5	6.6	6.0
09:00 - 09:59	6.6	7.3	6.8	6.4	6.4	6.6	6.8	7.0	6.4	6.6	6.6	6.8	6.1	6.9	6.4
10:00 - 10:59	6.7	7.1	6.4	6.7	6.2	6.3	6.7	6.7	6.3	6.1	6.2	6.4	6.0	6.4	6.2
11:00 - 11:59	6.6	7.1	6.7	6.4	6.5	6.3	6.8	7.0	6.0	6.5	6.7	6.6	5.8	6.3	6.5
12:00 - 12:59	6.6	6.8	6.3	6.4	6.6	6.4	6.7	6.9	6.5	6.6	6.7	6.7	5.8	6.3	6.4
13:00 - 13:59	6.6	6.3	6.4	6.1	6.4	6.4	6.3	6.7	6.2	6.2	6.6	6.4	5.4	6.4	5.9
14:00 - 14:59	6.5	7.3	5.9	6.2	6.3	6.3	6.5	6.4	6.6	6.0	6.5	6.6	6.1	5.9	3.1
15:00 - 15:59	6.2	6.7	6.0	6.3	6.2	6.4	6.5	6.1	5.9	6.4	6.3	5.9	6.1	6.0	3.4
16:00 - 16:59	7.2	6.8	5.9	6.1	5.7	5.8	6.3	6.1	5.9	6.3	6.3	5.8	6.4	6.1	6.5
17:00 - 17:59	7.2	6.6	5.8	6.0	6.5	6.1	6.2	6.1	6.2	6.7	6.1	5.6	6.5	6.0	6.4
18:00 - 18:59	7.1	6.7	6.2	6.0	6.4	6.5	6.1	6.3	6.0	6.5	6.0	6.3	6.7	5.8	6.4
19:00 - 19:59	7.2	6.8	6.4	6.3	6.3	6.8	6.3	6.6	6.1	6.4	6.1	6.2	6.7	2.8	6.9
20:00 - 20:59	7.4	6.9	6.5	7.4	6.3	6.7	6.3	6.7	6.3	7.4	6.2	6.2	6.6	83.1	41.4
21:00 - 21:59	9.8	6.9	6.6	6.7	6.2	6.6	6.6	6.7	6.1	6.5	6.0	6.3	6.5	16.9	6.8
22:00 - 22:59	8.7	7.1	6.9	6.1	6.6	6.6	6.7	6.8	5.9	23.9	6.2	6.1	6.4	32.5	6.9
23:00 - 23:59	7.5	40.5	6.9	6.5	6.7	6.5	6.7	6.5	6.2	36.7	6.3	6.1	6.4	6.3	6.8

Time	16-Oct	17-Oct	18-Oct	19-Oct	20-Oct	21-Oct	22-Oct	23-Oct	24-Oct	25-Oct	26-Oct	27-Oct	28-Oct	29-Oct	30-Oct	31-Oct
00:00 - 00:59	7.0	6.7	37.6	5.4	0.0	6.1	6.0	6.6	6.3	6.8	6.4	6.0	6.0	6.3	6.4	6.2
01:00 - 01:59	7.0	6.3	6.3	5.8	5.8	6.5	5.9	6.8	5.9	6.5	6.4	6.4	6.2	6.3	6.2	6.3
02:00 - 02:59	7.1	6.3	6.3	6.0	5.6	6.4	6.1	6.5	6.4	6.3	6.4	6.2	6.3	6.3	6.0	5.9
03:00 - 03:59	7.1	6.3	6.0	5.6	6.0	5.7	2.8	6.3	6.7	6.5	6.2	6.2	6.1	6.5	6.4	5.8
04:00 - 04:59	7.0	6.3	6.3	0.0	5.7	5.6	3.2	6.5	7.0	6.3	5.7	6.2	6.1	6.7	6.6	5.7
05:00 - 05:59	6.9	5.9	5.6	0.0	5.5	5.8	5.7	6.8	6.7	6.5	6.5	6.3	6.3	6.1	6.3	2.1
06:00 - 06:59	6.9	6.7	6.2	0.0	5.6	1.9	6.2	6.7	6.4	6.3	6.4	6.1	6.2	6.6	6.4	0.0
07:00 - 07:59	6.6	6.9	6.4	0.0	5.9	0.0	6.3	6.7	6.7	7.0	6.4	6.4	6.5	6.6	6.5	3.9
08:00 - 08:59	6.5	6.6	6.1	0.0	6.2	3.8	6.4	6.6	6.8	7.0	6.5	6.3	6.8	6.6	6.6	6.7
09:00 - 09:59	6.7	6.6	6.4	6.2	5.7	6.0	6.3	6.6	6.8	6.8	6.7	6.5	6.8	7.0	6.6	6.6
10:00 - 10:59	6.9	6.1	5.9	5.8	5.7	6.0	5.9	6.5	6.0	6.5	6.4	6.8	6.7	6.4	6.5	6.1
11:00 - 11:59	6.4	6.5	6.0	6.3	6.2	6.1	6.3	6.2	6.5	6.5	6.8	6.6	6.7	7.0	6.5	6.4
12:00 - 12:59	6.3	6.0	6.5	6.6	6.2	6.5	6.4	6.6	6.7	6.6	6.6	6.4	6.3	6.1	6.6	6.6
13:00 - 13:59	6.9	6.3	6.6	6.5	6.0	6.5	6.5	6.3	6.0	6.3	6.5	6.5	6.3	6.7	6.5	6.6
14:00 - 14:59	6.2	6.0	6.5	6.6	6.3	6.3	6.5	6.5	6.4	6.4	6.3	6.5	6.5	6.5	6.4	6.7
15:00 - 15:59	6.3	5.5	6.6	6.4	6.1	6.2	6.3	6.1	6.2	6.2	6.2	6.4	6.4	6.2	6.2	6.5
16:00 - 16:59	6.3	5.8	6.2	6.3	6.0	6.1	6.2	6.3	6.1	6.3	5.9	6.2	6.2	6.1	5.9	6.1
17:00 - 17:59	6.6	5.8	6.1	6.0	5.9	6.0	5.7	6.5	6.6	6.2	5.8	6.1	5.9	6.0	5.8	5.8
18:00 - 18:59	6.5	5.4	5.6	6.4	5.7	5.9	6.3	6.4	6.4	6.4	6.0	6.2	6.0	6.2	6.0	5.9
19:00 - 19:59	6.1	5.4	0.4	6.5	6.0	6.0	6.8	6.1	6.6	6.7	6.1	6.3	6.2	6.1	6.3	6.0
20:00 - 20:59	6.1	5.3	5.1	6.6	6.2	6.2	6.8	6.1	6.2	6.5	6.3	6.3	5.9	6.3	6.3	6.2
21:00 - 21:59	6.5	5.5	0.4	6.4	6.3	6.3	6.9	6.3	6.5	6.2	6.3	6.1	6.2	6.2	6.4	6.3
22:00 - 22:59	6.8	5.6	5.2	6.0	6.1	6.1	7.0	6.4	6.5	6.3	6.1	6.1	5.8	6.1	6.2	6.1
23:00 - 23:59	6.4	6.2	0.3	0.5	6.2	6.0	6.8	6.6	6.7	6.2	6.1	5.8	6.2	5.9	6.3	6.1

Unit 1 PM (ppmv) - November 2025

Time	1-Nov	2-Nov	3-Nov	4-Nov	5-Nov	6-Nov	7-Nov	8-Nov	9-Nov	10-Nov	11-Nov	12-Nov	13-Nov	14-Nov	15-Nov
00:00 - 00:59	6.4	182.0	6.5	6.7	6.4	6.9	6.4	5.7	5.9	6.5	6.5	5.8	5.8	5.5	6.4
01:00 - 01:59	6.0	6.2	6.5	6.6	6.4	6.9	6.1	6.3	6.0	6.1	6.5	5.8	5.8	5.6	6.6
02:00 - 02:59	6.4	71.2	6.5	6.7	6.3	6.7	6.2	6.5	5.9	6.6	6.3	5.8	5.8	5.7	6.1
03:00 - 03:59	6.1	6.5	6.7	6.8	6.7	6.7	5.9	6.1	5.7	6.8	6.0	5.8	6.0	5.7	6.5
04:00 - 04:59	6.3	6.3	6.1	6.5	6.7	6.7	6.2	5.8	6.3	6.8	7.0	5.7	6.0	6.7	6.5
05:00 - 05:59	6.2	6.4	6.2	5.9	6.6	6.8	5.9	5.8	6.2	6.9	6.0	5.6	6.0	7.2	6.4
06:00 - 06:59	6.3	6.6	6.3	0.0	6.8	6.6	1.8	5.9	6.2	6.9	6.1	5.5	6.0	6.3	6.7
07:00 - 07:59	6.7	6.7	6.1	0.4	6.9	6.5	0.0	6.2	6.4	7.1	6.2	5.7	6.2	6.4	7.0
08:00 - 08:59	6.3	6.8	6.7	6.1	7.1	6.9	0.0	6.3	6.4	6.4	6.5	6.0	6.4	6.6	6.8
09:00 - 09:59	6.3	6.9	6.5	6.5	7.2	6.9	0.0	6.2	6.7	6.5	6.4	6.0	6.4	6.3	6.7
10:00 - 10:59	6.6	6.9	6.3	6.2	6.9	6.6	4.0	6.1	6.3	6.5	5.7	5.4	5.8	6.1	6.2
11:00 - 11:59	6.3	6.7	6.7	6.7	7.0	6.8	6.1	6.3	6.6	6.5	6.3	6.1	6.5	6.4	6.6
12:00 - 12:59	6.6	6.7	6.1	6.5	6.7	6.7	5.9	6.3	6.5	6.5	6.4	6.4	6.6	6.7	6.9
13:00 - 13:59	6.6	6.3	6.3	6.1	6.9	6.7	6.1	6.3	6.5	6.7	6.3	6.1	6.4	6.6	6.8
14:00 - 14:59	6.2	6.2	6.8	6.4	6.8	6.5	6.1	6.4	6.5	6.3	6.1	5.9	6.1	6.6	6.8
15:00 - 15:59	6.3	6.3	4.8	6.5	6.8	6.6	6.1	6.2	6.4	6.3	5.7	6.0	5.9	6.6	6.5
16:00 - 16:59	6.3	6.1	0.9	6.7	6.3	6.1	5.9	6.1	6.3	6.4	5.5	5.6	5.7	6.2	6.3
17:00 - 17:59	6.1	6.2	5.6	6.5	6.4	6.4	5.7	6.0	5.9	6.2	5.3	5.5	5.4	6.1	6.1
18:00 - 18:59	6.3	6.3	6.1	6.4	6.4	6.3	5.9	6.0	6.4	6.3	5.4	5.7	5.5	6.4	6.4
19:00 - 19:59	6.4	6.0	5.8	6.5	6.6	6.5	6.0	6.2	6.3	6.4	5.5	5.9	5.6	6.5	6.4
20:00 - 20:59	6.3	6.5	5.7	6.5	6.6	6.5	6.0	6.1	6.4	6.6	5.6	5.8	5.6	6.7	6.6
21:00 - 21:59	6.6	6.4	7.4	6.4	6.7	6.4	5.7	5.9	6.4	6.5	5.6	5.9	5.5	6.9	6.6
22:00 - 22:59	6.7	6.5	8.3	6.4	6.8	6.1	5.8	5.8	6.4	6.5	5.6	5.6	5.5	6.8	6.6
23:00 - 23:59	9.4	6.4	7.4	6.2	6.9	6.4	5.9	5.8	6.6	6.2	5.6	5.7	5.5	6.2	6.5

Time	16-Nov	17-Nov	18-Nov	19-Nov	20-Nov	21-Nov	22-Nov	23-Nov	24-Nov	25-Nov	26-Nov	27-Nov	28-Nov	29-Nov	30-Nov
00:00 - 00:59	6.3	6.5	6.5	6.2	6.6	6.3	6.8	6.4	6.5	6.2	6.5	6.4	6.2	6.7	7.0
01:00 - 01:59	6.3	6.5	6.5	6.2	6.6	6.3	6.8	6.4	6.5	6.2	6.5	6.4	6.2	6.7	7.0
02:00 - 02:59	6.4	6.5	6.1	5.9	6.6	6.4	6.6	6.6	6.3	6.0	6.3	6.2	6.1	6.7	6.9
03:00 - 03:59	6.3	6.4	6.2	6.1	6.5	6.2	6.7	6.5	6.4	6.1	6.2	6.3	6.0	6.6	7.0
04:00 - 04:59	6.1	6.2	5.4	6.1	6.4	6.3	6.6	6.7	6.5	6.2	6.6	6.1	6.1	6.8	6.9
05:00 - 05:59	6.2	6.2	6.5	6.3	6.3	6.1	6.7	6.7	6.4	6.1	6.2	1.2	6.1	6.8	6.9
06:00 - 06:59	6.1	6.3	6.0	6.2	6.4	6.1	6.9	6.3	6.2	6.0	6.7	0.0	6.6	6.9	6.9
07:00 - 07:59	6.2	6.3	6.2	6.1	6.4	6.3	7.0	6.5	6.2	5.9	6.5	4.7	6.5	6.7	6.8
08:00 - 08:59	6.6	6.4	6.2	6.3	6.5	6.2	7.2	6.8	6.1	0.4	6.6	6.2	6.7	7.1	7.0
09:00 - 09:59	6.4	6.7	6.8	6.6	6.4	6.6	7.2	6.8	6.4	6.6	6.8	6.6	6.7	7.1	7.5
10:00 - 10:59	6.5	6.5	6.7	6.3	6.6	6.1	6.6	6.5	6.5	6.5	6.9	6.4	6.7	6.9	7.0
11:00 - 11:59	6.2	6.5	6.4	6.2	6.2	6.1	6.7	6.6	6.0	6.1	6.4	6.4	6.7	7.0	6.7
12:00 - 12:59	6.6	6.8	6.8	6.4	6.7	6.6	6.6	6.8	6.4	6.5	6.8	6.8	7.0	7.0	7.0
13:00 - 13:59	6.6	6.9	6.8	6.9	6.6	6.6	6.9	6.8	6.8	6.6	7.1	7.0	6.8	7.2	7.0
14:00 - 14:59	6.5	6.8	6.8	6.6	6.5	6.4	6.9	6.8	6.7	5.5	6.6	6.7	6.6	7.1	6.8
15:00 - 15:59	6.5	6.7	6.6	6.7	6.6	6.4	6.7	6.9	6.8	6.1	6.7	6.6	6.6	7.0	6.7
16:00 - 16:59	6.3	6.5	6.4	6.3	6.5	6.2	6.4	6.4	6.4	5.8	6.6	6.4	6.6	6.5	6.4
17:00 - 17:59	6.1	6.3	6.3	6.2	6.5	6.1	6.4	6.4	6.2	5.7	6.4	6.4	6.4	6.4	6.6
18:00 - 18:59	6.1	6.2	6.1	6.2	6.5	6.1	6.0	6.4	5.8	5.7	6.3	6.4	6.2	6.2	6.5
19:00 - 19:59	6.4	6.4	6.3	6.3	6.6	6.3	6.6	6.6	6.1	9.8	6.6	6.5	6.5	6.5	6.5
20:00 - 20:59	6.4	6.6	6.3	6.6	6.5	6.5	6.3	6.9	6.3	6.9	6.7	6.5	6.4	6.7	6.5
21:00 - 21:59	6.3	6.7	6.5	6.7	6.5	6.5	6.2	6.5	6.4	6.5	6.7	6.4	6.5	6.9	6.7
22:00 - 22:59	6.4	6.5	6.5	6.6	6.3	6.3	6.2	6.5	6.3	6.5	6.6	6.2	6.5	6.7	6.5
23:00 - 23:59	6.4	6.6	6.3	6.7	6.5	6.4	6.1	6.6	6.3	6.6	6.6	6.3	6.1	6.6	6.1

Remark: GT#11 Borosopic Inspection from 12 Nov 25 to14 Nov 25.

Unit 1 PM (ppmv) - December 2025

Time	1-Dec	2-Dec	3-Dec	4-Dec	5-Dec	6-Dec	7-Dec	8-Dec	9-Dec	10-Dec	11-Dec	12-Dec	13-Dec	14-Dec	15-Dec
00:00 - 00:59	6.6	6.7	6.1	6.2	6.5	6.5	6.4	6.4	6.2	6.3	6.5	6.4	6.6	6.3	6.6
01:00 - 01:59	6.6	6.9	6.5	6.1	6.4	6.1	6.1	6.4	6.6	5.7	6.2	6.3	6.7	6.4	6.4
02:00 - 02:59	6.7	6.7	6.5	6.3	6.5	6.3	6.4	6.4	6.7	6.3	6.3	6.3	6.5	6.3	6.2
03:00 - 03:59	6.3	6.7	6.6	6.2	6.5	6.0	6.0	6.4	6.9	6.5	6.4	6.2	6.5	5.8	6.2
04:00 - 04:59	6.6	6.7	6.7	6.2	6.4	6.5	6.3	6.4	6.5	6.6	6.2	6.2	6.4	6.4	6.3
05:00 - 05:59	6.5	6.8	6.6	6.2	6.2	6.8	5.9	6.4	6.3	6.4	6.1	6.0	6.4	6.3	6.4
06:00 - 06:59	6.5	6.9	6.7	6.4	6.3	6.5	6.1	6.4	6.4	6.7	6.2	6.1	6.1	6.3	6.2
07:00 - 07:59	6.6	7.2	6.9	6.7	6.3	6.3	6.4	6.4	7.0	6.8	6.6	6.4	6.8	6.5	6.9
08:00 - 08:59	7.1	7.2	7.2	6.8	6.6	7.2	6.9	6.4	7.2	6.8	6.7	6.6	6.8	6.6	6.8
09:00 - 09:59	6.5	7.0	7.0	6.6	6.7	7.0	6.6	6.4	6.9	6.8	6.6	6.6	6.8	6.7	6.5
10:00 - 10:59	6.4	6.7	6.8	6.3	6.7	6.5	6.4	6.4	6.6	6.6	6.1	6.4	6.3	6.6	6.5
11:00 - 11:59	7.0	7.0	6.9	6.5	7.0	6.9	6.7	6.8	6.9	6.8	6.6	6.7	6.6	6.8	6.6
12:00 - 12:59	6.9	7.0	7.0	6.6	6.9	6.9	6.7	6.8	6.8	7.0	6.5	6.8	7.0	6.9	6.7
13:00 - 13:59	6.6	6.7	6.9	6.5	6.9	6.7	6.4	6.6	6.7	6.9	6.5	6.7	6.8	6.9	6.6
14:00 - 14:59	6.5	6.7	7.0	6.6	6.8	6.8	6.6	6.7	6.9	6.9	6.4	6.7	6.9	6.7	6.7
15:00 - 15:59	6.3	6.7	6.7	6.5	6.5	6.3	6.5	6.4	6.7	6.6	6.5	6.5	6.6	6.6	6.4
16:00 - 16:59	6.7	6.5	6.6	6.2	6.3	6.4	6.4	6.3	6.5	6.5	6.4	6.2	6.5	6.4	6.2
17:00 - 17:59	6.2	6.2	6.4	6.2	6.1	6.1	6.4	6.4	6.2	6.2	6.3	6.0	6.3	6.1	6.0
18:00 - 18:59	6.4	6.4	6.5	6.4	6.3	6.5	6.4	6.4	6.4	6.5	6.3	6.4	6.4	6.3	5.9
19:00 - 19:59	6.5	6.3	6.5	6.5	6.5	6.5	6.4	6.6	6.6	6.7	6.3	6.6	6.4	6.5	6.2
20:00 - 20:59	6.9	6.8	6.9	6.7	6.6	6.5	6.4	6.6	6.7	6.8	6.3	6.5	6.4	6.6	6.3
21:00 - 21:59	7.0	7.1	6.8	6.8	6.5	6.6	6.4	6.6	6.9	6.6	6.5	6.7	6.4	6.5	6.3
22:00 - 22:59	6.4	6.9	6.4	6.8	6.5	6.5	6.4	6.4	7.0	6.5	6.5	6.7	6.6	6.6	6.2
23:00 - 23:59	6.5	6.6	6.4	6.7	6.5	6.1	6.4	6.2	6.6	6.4	6.4	6.7	6.5	6.4	6.4

Time	16-Dec	17-Dec	18-Dec	19-Dec	20-Dec	21-Dec	22-Dec	23-Dec	24-Dec	25-Dec	26-Dec	27-Dec	28-Dec	29-Dec	30-Dec	31-Dec
00:00 - 00:59	6.1	6.4	6.4	6.2	6.3	6.7	6.3	6.6	6.6	6.5	6.7	6.5	6.4	6.6	6.6	6.8
01:00 - 01:59	5.8	6.4	6.1	5.7	6.3	6.4	6.3	6.3	6.6	6.4	6.7	6.4	6.5	6.5	6.6	6.5
02:00 - 02:59	5.9	6.6	5.9	6.1	6.4	5.8	6.2	6.1	6.6	6.4	6.7	6.4	6.5	6.2	6.0	6.6
03:00 - 03:59	6.0	6.4	6.4	6.5	6.6	6.1	6.1	6.3	6.6	6.4	6.5	6.5	5.9	6.2	6.4	6.6
04:00 - 04:59	6.3	6.4	6.3	6.4	6.6	6.8	6.2	6.5	6.5	5.7	6.5	6.7	6.4	6.1	6.5	6.3
05:00 - 05:59	6.4	6.4	6.2	6.3	6.6	6.5	6.1	6.1	6.5	6.2	6.4	6.5	6.2	6.4	6.6	6.4
06:00 - 06:59	6.4	6.5	6.4	6.2	6.5	6.1	6.1	6.4	6.6	6.2	6.6	6.5	5.7	6.6	6.4	6.1
07:00 - 07:59	6.5	6.4	6.5	6.6	6.8	6.6	6.4	6.6	6.2	6.4	6.0	6.4	6.3	6.2	6.3	6.0
08:00 - 08:59	6.9	6.8	6.7	6.7	7.1	6.9	6.6	6.9	6.9	6.4	7.0	6.9	6.8	6.9	6.9	6.7
09:00 - 09:59	6.6	6.6	6.9	6.6	6.7	7.1	6.6	7.0	6.8	6.2	6.7	6.7	6.2	6.9	6.4	6.8
10:00 - 10:59	6.6	6.6	6.6	6.4	6.5	6.6	6.2	6.5	6.5	6.2	6.5	6.7	6.4	6.6	6.3	6.5
11:00 - 11:59	6.5	6.6	6.6	6.4	6.8	6.6	6.3	6.6	6.4	6.2	6.5	6.5	6.5	6.4	6.4	6.8
12:00 - 12:59	6.6	6.9	6.7	6.6	6.9	6.9	6.3	6.7	6.6	6.5	6.7	6.7	6.6	6.7	6.4	6.8
13:00 - 13:59	6.6	6.9	6.7	6.5	6.8	6.9	6.4	6.5	6.6	6.2	6.7	6.5	6.5	6.5	6.4	6.4
14:00 - 14:59	6.5	6.9	6.8	6.0	6.5	6.8	6.3	6.4	6.6	6.2	6.6	6.6	6.2	6.2	6.0	6.5
15:00 - 15:59	6.3	6.6	6.5	6.3	6.2	6.6	6.2	6.3	6.4	6.1	6.2	6.3	6.3	6.4	6.3	6.4
16:00 - 16:59	6.3	6.2	6.2	6.2	6.5	6.3	6.1	6.2	6.0	5.9	6.2	6.3	6.2	6.4	5.9	6.3
17:00 - 17:59	6.1	6.1	5.8	6.1	6.2	6.1	5.8	6.1	6.2	6.1	6.3	5.9	5.9	5.9	5.6	6.0
18:00 - 18:59	6.3	6.5	6.2	6.2	6.5	6.3	6.1	6.4	6.4	6.1	6.1	6.2	6.2	6.1	6.1	6.1
19:00 - 19:59	6.7	6.7	6.4	6.3	6.7	6.7	6.3	6.6	6.4	6.3	6.3	6.6	6.5	6.5	6.0	6.2
20:00 - 20:59	6.7	6.6	6.1	6.4	6.8	6.6	6.5	6.9	6.7	6.5	6.4	6.7	6.6	6.5	6.0	6.4
21:00 - 21:59	6.8	6.6	6.3	6.5	6.9	6.5	6.6	6.7	6.1	6.8	6.5	6.5	6.3	6.1	6.1	6.3
22:00 - 22:59	6.7	6.6	6.5	6.4	6.5	6.5	6.4	6.4	6.4	6.6	6.2	6.0	6.4	6.3	6.5	6.0
23:00 - 23:59	6.1	6.6	6.3	6.2	6.4	6.3	6.1	6.3	6.5	5.8	6.4	5.7	6.3	6.7	6.6	6.1

Unit 1 PM (ppmv) - January 2026

Time	1-Jan	2-Jan	3-Jan	4-Jan	5-Jan	6-Jan	7-Jan	8-Jan	9-Jan	10-Jan	11-Jan	12-Jan	13-Jan	14-Jan	15-Jan
00:00 - 00:59	6.5	6.2	6.5	6.1	6.8	6.7	6.1	6.3	6.1	6.4	6.5	6.2	6.0	6.1	6.1
01:00 - 01:59	6.3	6.4	6.6	6.1	6.1	6.5	6.1	6.2	5.9	6.2	6.2	6.3	5.9	6.1	6.0
02:00 - 02:59	6.3	6.2	6.6	5.9	6.6	6.4	6.0	6.1	5.9	6.1	5.8	6.2	5.7	6.1	5.9
03:00 - 03:59	6.0	6.1	6.6	6.0	6.9	6.4	6.0	6.5	5.9	6.0	6.3	6.2	5.9	6.1	6.4
04:00 - 04:59	6.1	6.2	6.5	6.1	6.3	6.6	6.0	6.5	5.9	5.9	6.3	6.0	5.9	6.1	6.3
05:00 - 05:59	6.4	6.3	6.5	6.0	6.2	6.3	6.0	6.4	6.2	6.0	5.8	6.1	5.8	6.0	6.2
06:00 - 06:59	6.1	5.8	6.5	6.3	6.5	5.9	5.8	5.9	6.1	5.8	6.3	6.3	5.7	6.1	5.9
07:00 - 07:59	6.5	6.1	6.0	6.5	6.8	6.4	6.1	6.4	6.3	5.9	6.3	6.1	5.9	6.4	5.9
08:00 - 08:59	6.8	6.6	6.6	6.9	7.2	6.9	6.4	6.6	6.6	6.4	6.7	6.1	6.5	6.4	6.4
09:00 - 09:59	6.8	6.7	6.6	6.6	6.9	6.7	6.5	6.4	6.9	6.2	6.4	6.5	6.1	6.3	6.1
10:00 - 10:59	6.4	6.3	6.7	6.6	6.5	6.3	6.3	6.4	6.2	6.1	6.3	6.6	6.0	6.4	6.4
11:00 - 11:59	6.4	6.3	6.7	6.6	6.3	6.3	6.4	6.7	6.5	6.0	6.3	6.4	6.1	6.7	6.6
12:00 - 12:59	6.5	6.5	6.9	6.6	6.8	6.6	6.5	6.6	6.6	6.4	6.5	6.4	6.3	7.0	6.1
13:00 - 13:59	6.5	6.5	6.7	6.7	6.6	6.6	6.2	6.5	6.6	6.4	6.8	6.5	6.4	6.4	6.6
14:00 - 14:59	6.2	6.4	6.4	6.5	6.5	6.4	6.0	6.5	6.2	6.1	6.5	6.5	6.0	6.3	6.5
15:00 - 15:59	6.4	5.9	6.3	6.2	6.4	6.1	6.0	6.4	6.3	5.8	6.2	6.2	5.8	6.3	6.0
16:00 - 16:59	6.1	6.1	6.1	6.4	6.0	6.1	5.8	6.2	6.0	6.0	5.9	5.7	5.6	6.1	6.0
17:00 - 17:59	5.5	6.0	6.2	6.2	5.8	5.8	6.0	5.8	5.8	5.7	6.1	5.7	5.9	6.0	6.2
18:00 - 18:59	5.7	6.3	6.2	6.5	6.3	6.1	6.2	6.2	6.0	6.0	6.2	6.1	6.0	6.3	6.1
19:00 - 19:59	6.1	6.5	6.1	6.5	6.6	6.4	6.1	6.4	6.3	6.1	6.1	6.1	6.1	6.5	6.1
20:00 - 20:59	6.3	6.0	6.2	6.3	6.6	6.5	6.2	6.5	6.3	6.3	6.2	6.1	6.3	6.4	6.3
21:00 - 21:59	6.0	6.0	6.4	6.1	6.2	6.3	6.3	6.5	6.1	6.3	6.3	6.4	6.2	5.9	6.1
22:00 - 22:59	5.9	6.7	5.8	6.8	6.2	5.6	6.0	6.4	5.7	5.7	5.9	6.3	6.1	6.1	5.7
23:00 - 23:59	6.2	6.7	5.8	6.9	6.5	6.2	6.3	5.9	6.3	6.2	6.4	5.9	5.8	6.1	6.0

Time	16-Jan	17-Jan	18-Jan	19-Jan	20-Jan	21-Jan	22-Jan	23-Jan	24-Jan	25-Jan	26-Jan	27-Jan	28-Jan	29-Jan	30-Jan	31-Jan
00:00 - 00:59	6.2	6.1	6.2	6.1	6.5	6.3	6.4	6.2	6.0	6.4	6.2	5.7	6.4	6.4	6.1	0.0
01:00 - 01:59	6.0	6.3	6.4	6.0	6.4	6.3	6.3	6.1	5.9	6.2	6.2	6.0	6.0	6.1	6.3	0.0
02:00 - 02:59	5.9	6.2	6.3	6.1	6.5	6.1	6.0	6.1	5.8	6.5	6.2	5.8	5.8	6.0	6.1	0.0
03:00 - 03:59	5.8	6.1	6.5	5.9	6.6	5.9	6.3	5.9	5.6	6.0	6.2	6.1	6.2	5.9	5.9	0.0
04:00 - 04:59	5.8	6.1	6.0	5.9	6.3	6.0	5.9	6.0	6.0	6.2	6.0	6.1	6.0	5.9	6.1	0.0
05:00 - 05:59	5.7	5.9	6.0	5.9	6.1	6.2	5.9	5.9	5.5	6.2	5.9	5.9	5.9	6.2	6.1	0.0
06:00 - 06:59	5.6	5.9	6.1	6.3	6.0	5.6	6.1	5.7	5.7	6.0	5.9	6.0	6.0	5.9	6.1	0.0
07:00 - 07:59	5.7	6.2	6.2	6.0	5.8	5.8	5.7	6.1	6.1	6.0	5.9	6.0	6.0	5.7	0.0	0.0
08:00 - 08:59	5.9	6.5	6.7	6.3	6.3	6.2	6.3	6.4	5.8	6.3	6.1	6.3	6.3	6.1	0.0	0.0
09:00 - 09:59	6.3	6.5	6.3	5.9	6.2	5.9	6.3	6.3	6.2	6.4	6.0	6.3	6.2	5.8	0.0	0.0
10:00 - 10:59	6.0	6.3	6.4	6.3	5.9	6.0	6.1	6.4	6.3	6.3	6.2	6.2	6.1	6.0	0.0	0.0
11:00 - 11:59	5.8	6.3	6.3	6.2	6.1	6.0	6.4	6.2	6.2	6.3	6.4	5.5	6.1	6.3	0.0	0.0
12:00 - 12:59	6.2	6.6	6.6	6.4	6.4	6.2	6.3	6.4	6.4	6.5	6.2	6.1	6.4	6.3	0.0	0.0
13:00 - 13:59	6.3	6.6	6.5	6.4	6.4	6.1	6.5	6.5	6.3	6.4	6.2	6.1	6.6	6.3	0.0	0.0
14:00 - 14:59	6.0	6.3	6.2	6.3	6.1	6.0	6.4	6.1	6.2	6.1	5.9	10.4	6.2	6.1	0.0	0.0
15:00 - 15:59	6.1	6.2	5.8	6.0	6.1	5.6	6.1	6.1	5.8	5.8	5.7	7.2	5.9	5.9	0.0	0.0
16:00 - 16:59	5.9	5.7	6.0	5.6	5.9	5.7	5.9	5.8	5.7	5.8	5.6	6.2	5.6	6.0	0.0	0.0
17:00 - 17:59	5.8	5.7	5.7	5.8	5.8	5.7	5.9	5.6	5.7	6.0	5.5	5.5	5.6	5.8	0.0	0.0
18:00 - 18:59	5.9	6.1	5.5	6.1	5.9	5.7	5.8	5.7	6.0	6.0	5.7	5.9	5.8	5.8	0.0	0.0
19:00 - 19:59	6.1	6.2	5.9	6.1	6.0	5.9	6.0	5.8	6.1	6.1	5.7	6.3	5.7	5.9	0.0	0.0
20:00 - 20:59	6.2	6.3	5.8	6.0	6.0	6.0	6.0	5.9	6.0	6.1	5.8	6.1	5.5	5.7	0.0	0.0
21:00 - 21:59	6.2	6.4	5.8	6.3	6.0	6.1	6.1	6.0	6.1	6.2	5.9	6.2	5.3	5.8	0.0	0.0
22:00 - 22:59	6.0	6.1	5.9	6.1	5.7	5.8	6.0	5.5	6.0	6.1	6.0	6.0	5.9	6.0	0.0	0.0
23:00 - 23:59	5.8	5.6	5.8	6.5	6.2	6.0	6.0	5.7	6.2	6.1	5.6	5.9	6.4	6.0	0.0	0.0

Remark: Plant shutdown from 30 Jan 26 to 01 Feb 26 due to Steel Mill-Thapyaywa Line Maintenance

Unit 1 PM (ppmv) - February 2026

Time	1-Feb	2-Feb	3-Feb	4-Feb	5-Feb	6-Feb	7-Feb	8-Feb	9-Feb	10-Feb	11-Feb	12-Feb	13-Feb	14-Feb
00:00 - 00:59	0.0	0.0	5.5	5.8	6.1	6.0	5.9	6.2	5.6	5.9	5.8	6.1	6.1	5.9
01:00 - 01:59	0.0	0.0	5.6	5.9	5.9	6.0	6.0	6.3	5.7	6.0	5.8	6.2	6.0	5.7
02:00 - 02:59	0.0	0.0	5.6	5.8	5.8	5.9	5.3	5.9	5.4	5.9	5.8	6.2	5.8	5.9
03:00 - 03:59	0.0	0.0	5.7	5.8	5.9	5.9	5.6	6.2	5.7	5.8	5.7	5.9	5.7	5.9
04:00 - 04:59	0.0	0.0	5.5	5.9	5.2	6.0	5.8	5.9	5.5	5.4	5.8	5.8	5.8	5.3
05:00 - 05:59	0.0	0.0	5.6	6.0	5.6	5.6	5.2	5.5	5.5	5.8	5.7	6.0	5.9	5.4
06:00 - 06:59	0.0	0.0	5.5	6.0	5.8	5.9	5.3	5.6	5.6	5.7	5.8	6.0	5.8	5.8
07:00 - 07:59	0.0	5.7	5.6	6.0	5.3	5.9	5.6	5.8	5.4	6.0	5.6	6.0	5.7	5.7
08:00 - 08:59	0.0	6.1	5.6	6.3	5.9	6.1	6.0	6.2	5.7	6.2	6.0	5.8	6.4	5.9
09:00 - 09:59	0.0	6.0	6.0	6.2	6.0	6.3	5.9	6.3	6.0	5.5	5.7	5.9	6.0	6.0
10:00 - 10:59	0.0	10.7	5.7	6.1	5.7	6.1	5.8	5.9	5.8	5.7	5.6	5.7	5.8	5.4
11:00 - 11:59	0.0	6.8	4.6	6.1	5.9	6.2	5.8	6.0	5.8	5.8	5.8	6.3	6.2	5.9
12:00 - 12:59	0.0	6.3	5.5	6.1	5.8	6.1	5.8	6.1	5.9	5.9	5.9	6.3	6.1	6.2
13:00 - 13:59	0.0	6.2	10.3	6.2	5.8	5.9	5.8	6.0	6.0	5.8	6.0	6.3	6.2	5.8
14:00 - 14:59	0.0	6.2	7.7	6.0	5.8	5.9	5.9	6.0	5.9	5.9	5.9	6.4	6.1	5.6
15:00 - 15:59	0.0	6.1	6.1	6.0	5.8	5.7	5.6	5.8	5.8	5.9	5.7	5.2	6.0	5.7
16:00 - 16:59	0.0	5.8	5.9	5.9	5.5	5.7	5.5	5.8	5.6	5.8	5.6	5.2	5.6	5.7
17:00 - 17:59	0.0	5.8	5.7	5.9	5.5	5.5	5.5	5.6	5.4	5.6	5.5	7.5	5.6	5.5
18:00 - 18:59	0.0	5.9	5.7	6.0	5.7	5.6	5.6	5.6	5.7	5.5	5.6	5.8	5.6	5.5
19:00 - 19:59	0.0	6.0	5.8	6.2	5.8	5.7	5.8	5.4	5.5	5.7	5.8	5.4	5.6	5.6
20:00 - 20:59	0.0	5.9	5.9	6.1	5.8	5.9	6.0	5.4	5.7	5.6	6.0	5.3	5.6	5.5
21:00 - 21:59	0.0	5.9	6.0	5.8	5.7	6.0	6.0	5.5	5.8	5.8	5.6	5.4	5.4	5.9
22:00 - 22:59	0.0	5.6	5.9	5.8	5.6	5.7	5.7	5.7	5.8	5.7	6.0	5.9	5.8	6.2
23:00 - 23:59	0.0	5.7	5.4	6.0	6.0	5.9	5.8	5.5	5.7	5.7	6.2	6.1	5.7	6.1

Time	15-Feb	16-Feb	17-Feb	18-Feb	19-Feb	20-Feb	21-Feb	22-Feb	23-Feb	24-Feb	25-Feb	26-Feb	27-Feb	28-Feb
00:00 - 00:59	6.1	6.1	6.0	5.6	5.6	5.6	5.8	5.8	5.5	5.7	5.9	5.9	5.7	5.5
01:00 - 01:59	6.2	6.1	6.0	5.9	5.1	5.7	5.5	5.6	5.5	5.4	5.7	5.8	5.9	1.3
02:00 - 02:59	6.1	6.0	5.9	5.7	5.4	5.5	5.4	5.4	5.3	5.3	5.6	5.7	5.9	3.7
03:00 - 03:59	6.2	5.8	5.6	5.6	5.7	5.4	5.6	5.4	5.4	5.8	5.4	5.6	5.5	4.9
04:00 - 04:59	5.9	5.8	5.4	5.7	5.1	4.8	5.5	5.4	5.3	5.7	5.6	5.9	5.4	1.4
05:00 - 05:59	5.9	6.0	5.5	5.5	5.3	5.2	5.6	5.3	5.4	5.5	5.8	6.0	5.6	3.9
06:00 - 06:59	3.8	5.9	5.5	5.9	5.6	5.4	5.7	21.9	1.6	5.4	5.7	6.0	5.5	5.4
07:00 - 07:59	2.2	5.8	5.5	5.8	5.8	5.5	5.6	18.1	0.0	5.5	5.8	6.0	5.7	5.7
08:00 - 08:59	6.2	6.3	5.8	5.9	5.7	5.3	5.8	4.9	0.0	5.7	5.5	6.1	6.0	5.9
09:00 - 09:59	6.1	6.0	6.1	6.0	5.7	5.7	5.9	5.7	3.9	5.8	5.4	5.9	6.0	5.9
10:00 - 10:59	5.9	5.9	5.6	5.8	5.6	5.6	5.5	5.8	5.5	5.7	5.6	5.7	5.4	5.4
11:00 - 11:59	6.1	6.1	5.7	6.0	5.8	5.6	5.7	6.2	5.3	5.8	5.9	5.9	5.9	5.7
12:00 - 12:59	6.1	6.3	5.8	6.0	5.9	5.9	6.0	6.2	5.2	5.8	6.0	5.9	5.7	5.8
13:00 - 13:59	6.0	6.1	5.7	5.9	5.9	5.8	5.6	6.2	5.0	5.8	5.5	5.7	5.8	5.5
14:00 - 14:59	5.9	6.0	5.5	5.8	5.8	5.7	5.8	6.1	4.8	5.4	5.2	5.7	5.6	5.6
15:00 - 15:59	5.6	5.9	5.6	5.3	5.7	5.6	5.7	5.8	8.9	5.6	0.4	5.5	5.6	5.3
16:00 - 16:59	5.3	5.8	5.5	5.3	5.6	5.7	5.3	5.7	5.7	5.4	5.3	4.9	5.5	5.4
17:00 - 17:59	5.3	5.6	5.4	4.9	5.4	5.3	5.5	5.4	5.3	5.4	5.3	5.0	5.5	5.3
18:00 - 18:59	5.6	5.8	5.5	5.1	5.3	5.1	5.3	5.6	5.2	5.2	5.3	5.5	5.5	5.6
19:00 - 19:59	5.5	5.8	5.6	5.4	5.5	5.5	5.6	5.9	5.6	5.5	5.6	5.5	5.5	5.6
20:00 - 20:59	5.5	5.8	5.8	5.3	5.3	5.7	5.7	5.9	5.7	5.5	5.9	5.3	5.5	5.4
21:00 - 21:59	5.4	5.7	5.9	5.3	5.6	5.6	5.5	5.8	5.8	5.4	6.0	5.5	5.7	5.5
22:00 - 22:59	6.1	5.5	5.6	10.8	5.4	5.3	5.7	5.8	5.7	5.7	6.0	5.7	5.4	5.7
23:00 - 23:59	6.2	5.5	5.3	6.1	5.6	5.6	5.6	5.8	6.0	5.7	5.9	5.2	5.5	5.6

Remark: Plant shutdown from 30 Jan 26 to 01 Feb 26 due to Steel Mill-Thapyaywa Line Maintenance

Unit 1 PM (ppmv) - March 2026

Time	1-Mar	2-Mar	3-Mar	4-Mar	5-Mar	6-Mar	7-Mar	8-Mar	9-Mar	10-Mar	11-Mar	12-Mar	13-Mar	14-Mar	15-Mar
00:00 - 00:59	5.6	4.7	5.9	0.0	5.5	5.4	5.8	0.0	5.6	5.7	3.8	5.5	5.3	5.5	5.5
01:00 - 01:59	5.7	5.2	5.8	0.0	5.4	5.5	5.7	2.9	5.7	5.5	3.8	5.5	5.2	0.7	5.4
02:00 - 02:59	5.6	5.5	5.6	0.4	5.3	5.3	5.7	2.5	5.9	3.2	3.8	5.6	5.2	0.0	5.3
03:00 - 03:59	5.4	5.4	5.4	5.1	5.0	5.2	5.7	2.8	5.9	2.1	3.8	5.7	5.1	4.6	5.3
04:00 - 04:59	5.5	9.1	5.9	5.2	5.0	5.4	5.7	5.2	5.8	5.3	3.8	5.7	5.6	5.4	5.2
05:00 - 05:59	5.4	6.1	5.7	5.1	5.0	4.8	5.7	5.3	5.8	5.5	3.8	5.7	5.5	5.4	5.1
06:00 - 06:59	5.2	5.5	5.1	5.1	5.1	4.2	5.7	5.5	5.5	5.6	1.4	5.7	5.6	5.3	5.1
07:00 - 07:59	5.1	5.6	5.7	5.4	5.1	3.6	5.6	7.8	5.6	5.7	4.2	5.1	5.0	5.3	5.0
08:00 - 08:59	2.3	6.0	5.4	5.5	5.1	3.0	5.6	6.4	5.6	5.6	1.4	0.6	5.6	5.2	4.9
09:00 - 09:59	0.0	6.0	5.6	5.8	5.1	2.4	5.6	6.4	5.6	5.8	5.6	5.8	5.6	5.2	4.9
10:00 - 10:59	3.0	6.0	5.5	5.5	5.1	1.8	3.5	6.4	5.1	3.4	5.4	5.7	5.6	5.1	4.8
11:00 - 11:59	2.4	5.9	5.7	5.7	5.1	4.3	5.8	12.0	5.5	0.0	5.7	5.6	5.6	5.1	4.7
12:00 - 12:59	0.0	5.8	5.9	5.8	5.1	5.6	5.8	4.9	5.6	0.0	5.6	5.2	5.6	5.1	4.7
13:00 - 13:59	3.2	5.6	5.8	5.8	5.1	5.4	5.9	3.1	5.5	1.9	4.3	4.7	5.6	5.0	3.6
14:00 - 14:59	5.2	3.3	5.6	5.8	5.1	5.4	5.8	6.1	6.7	5.6	1.1	4.3	5.6	5.0	5.5
15:00 - 15:59	5.4	2.2	5.6	5.5	4.4	5.4	5.6	5.3	2.5	5.4	5.4	3.9	5.6	4.9	5.2
16:00 - 16:59	5.6	3.1	4.5	5.3	5.2	5.3	5.4	4.8	2.2	5.3	5.0	3.5	5.6	4.0	1.8
17:00 - 17:59	5.5	2.1	0.7	0.0	5.4	5.3	5.4	2.6	2.4	5.0	5.0	4.9	4.8	5.1	3.4
18:00 - 18:59	5.3	5.4	4.7	5.3	5.4	5.3	5.3	2.1	2.3	5.3	4.2	5.1	0.5	5.2	5.5
19:00 - 19:59	5.5	5.5	0.7	5.4	5.2	5.4	5.4	3.0	128.9	5.2	0.0	5.3	4.7	5.4	5.4
20:00 - 20:59	5.4	5.5	5.6	5.6	5.1	1.6	5.4	2.3	6.3	5.4	0.0	5.1	5.3	1.3	5.4
21:00 - 21:59	5.6	5.5	5.6	5.9	0.9	4.0	2.3	5.5	5.4	5.5	0.9	5.1	5.3	4.1	5.4
22:00 - 22:59	5.3	5.5	5.4	5.7	4.7	5.7	0.0	5.6	5.6	5.5	5.4	5.4	5.4	5.5	5.4
23:00 - 23:59	4.9	5.8	4.8	5.4	5.6	5.8	0.0	5.6	5.7	5.4	5.5	5.4	5.5	5.5	5.3

Time	16-Mar	17-Mar	18-Mar	19-Mar	20-Mar	21-Mar	22-Mar	23-Mar	24-Mar	25-Mar	26-Mar	27-Mar	28-Mar	29-Mar	30-Mar	31-Mar
00:00 - 00:59	5.3	3.7	5.2	5.1	6.4	6.4	4.1	3.8	0.0	9.8	10.2	10.2	10.1	9.9	10.0	9.8
01:00 - 01:59	5.3	3.5	5.4	5.0	6.6	6.6	4.0	3.7	0.0	10.0	9.6	10.0	10.1	9.8	11.2	10.4
02:00 - 02:59	5.3	3.2	5.6	4.8	6.9	6.9	3.9	2.5	0.0	10.1	10.0	10.2	9.7	9.8	9.5	10.2
03:00 - 03:59	5.3	2.9	5.8	4.7	7.1	7.1	3.8	5.4	0.0	10.0	9.8	10.4	10.0	9.8	9.6	10.1
04:00 - 04:59	5.3	2.6	5.9	4.6	7.3	7.3	3.7	5.2	0.0	9.8	10.1	10.1	9.9	9.6	14.1	10.1
05:00 - 05:59	5.3	2.4	6.1	4.5	7.6	7.6	3.5	5.5	0.0	9.7	9.8	9.8	9.9	9.8	11.2	10.0
06:00 - 06:59	5.2	3.9	6.3	4.4	7.8	7.8	3.4	6.0	0.0	9.9	10.0	10.0	9.7	9.7	10.2	9.9
07:00 - 07:59	5.2	5.4	6.5	4.2	8.0	8.0	3.3	6.4	0.0	10.1	10.2	10.3	10.0	10.2	9.9	9.9
08:00 - 08:59	5.2	5.8	6.6	4.1	8.3	8.3	6.1	6.9	0.0	10.3	10.4	10.4	10.1	10.4	10.3	10.1
09:00 - 09:59	5.2	5.8	6.8	4.0	8.5	8.5	6.4	7.4	10.2	10.2	10.5	10.3	9.9	10.5	10.2	10.1
10:00 - 10:59	5.2	5.9	7.0	3.9	8.7	8.7	6.6	7.8	10.0	10.2	10.2	10.1	9.9	10.0	10.0	11.5
11:00 - 11:59	5.6	6.0	7.2	3.8	9.0	4.6	6.9	8.3	10.3	10.6	10.4	10.1	10.2	10.5	10.1	9.9
12:00 - 12:59	5.6	6.0	7.3	3.7	9.2	4.5	7.1	8.8	10.4	10.1	10.3	10.5	10.0	10.1	10.1	10.2
13:00 - 13:59	5.4	5.9	3.2	2.5	9.5	4.4	7.3	9.2	10.1	9.9	10.1	10.1	10.1	10.1	9.9	9.5
14:00 - 14:59	0.6	5.7	5.2	5.4	9.7	4.2	7.6	9.7	10.1	10.4	12.4	9.7	10.1	9.9	10.0	9.7
15:00 - 15:59	4.5	5.3	5.5	5.2	2.5	4.1	7.8	10.2	9.8	10.2	16.2	9.8	10.0	10.3	10.0	12.7
16:00 - 16:59	5.0	5.2	5.0	5.1	7.4	4.0	8.0	1.0	9.6	9.9	16.6	9.7	10.0	9.8	9.9	10.0
17:00 - 17:59	5.2	1.5	4.9	2.9	4.6	3.9	8.3	0.0	9.8	9.8	11.2	9.7	9.9	10.1	9.6	10.1
18:00 - 18:59	5.4	3.7	5.2	2.1	3.4	3.8	4.5	5.1	10.3	10.0	10.0	9.9	10.1	10.0	10.0	10.2
19:00 - 19:59	5.1	5.3	5.3	5.2	0.0	3.7	4.4	5.3	10.1	10.1	10.1	9.9	10.0	10.0	9.9	10.5
20:00 - 20:59	4.8	5.5	5.1	5.4	0.0	4.6	4.2	5.5	10.0	10.3	10.2	9.7	10.0	9.9	9.7	10.5
21:00 - 21:59	4.6	5.3	5.4	5.7	1.4	4.5	4.1	0.0	9.8	10.3	10.0	9.6	10.0	9.7	9.9	9.9
22:00 - 22:59	4.3	5.1	5.3	5.9	3.9	4.4	4.0	0.0	9.5	10.1	10.0	10.0	9.6	9.9	9.9	10.0
23:00 - 23:59	4.0	5.1	5.2	6.1	6.1	4.2	3.9	0.0	9.9	10.2	10.1	10.1	9.8	10.1	9.9	10.1

Unit 2 PM - April 2025

Time	1-Apr	2-Apr	3-Apr	4-Apr	5-Apr	6-Apr	7-Apr	8-Apr	9-Apr	10-Apr	11-Apr	12-Apr	13-Apr	14-Apr	15-Apr
00:00 - 00:59	9.7	10.4	10.3	10.2	10.3	10.3	9.7	9.9	9.9	10.0	9.8	10.2	9.7	9.6	16.4
01:00 - 01:59	9.7	10.2	10.2	10.3	10.5	10.2	10.0	10.0	9.7	10.0	9.9	10.3	9.9	9.6	9.9
02:00 - 02:59	9.8	10.3	10.3	10.4	10.5	9.8	9.7	9.9	9.9	10.0	10.0	10.4	9.6	9.6	9.0
03:00 - 03:59	9.8	10.4	10.2	10.4	10.2	9.8	9.9	9.5	9.7	10.1	10.0	10.2	9.9	9.8	10.3
04:00 - 04:59	9.8	10.4	10.3	10.3	10.4	9.9	10.0	9.7	9.9	10.0	10.0	10.2	10.0	9.7	62.4
05:00 - 05:59	9.7	10.3	10.3	10.4	10.3	9.6	9.9	9.8	10.0	10.0	9.9	10.2	10.0	9.6	39.1
06:00 - 06:59	9.8	10.4	10.3	10.5	10.3	9.8	10.1	9.9	9.7	10.1	10.0	10.2	10.1	9.5	9.7
07:00 - 07:59	9.9	10.6	10.4	10.3	10.5	10.0	10.1	9.8	9.9	10.1	10.1	10.5	10.4	9.8	10.1
08:00 - 08:59	10.0	10.6	10.5	10.5	10.5	10.3	9.8	10.1	9.8	10.0	10.3	10.6	10.5	9.9	10.5
09:00 - 09:59	10.2	11.1	10.7	10.9	10.7	10.0	10.1	10.2	9.6	10.0	10.3	10.5	10.4	10.3	10.2
10:00 - 10:59	10.1	10.8	10.8	10.6	10.7	9.9	9.9	10.0	9.9	9.6	10.3	10.4	10.2	10.2	10.2
11:00 - 11:59	10.2	10.6	10.7	10.8	10.7	9.7	10.1	9.7	9.9	9.8	9.9	10.3	9.9	10.0	9.8
12:00 - 12:59	10.3	10.9	10.4	10.7	10.6	9.8	10.0	9.8	9.5	10.1	9.7	10.3	10.0	8.9	9.7
13:00 - 13:59	13.0	10.6	10.7	10.5	10.6	10.1	10.1	10.0	9.6	9.6	9.6	10.2	10.1	10.0	9.5
14:00 - 14:59	12.9	10.7	10.5	10.5	10.5	10.0	10.2	9.7	9.9	9.6	9.7	10.1	10.0	10.3	9.5
15:00 - 15:59	12.5	10.4	10.4	10.5	10.3	9.8	10.0	9.7	9.8	9.4	9.8	10.1	9.8	10.0	9.9
16:00 - 16:59	12.2	10.4	10.3	10.5	10.4	9.6	10.1	9.7	9.8	9.7	9.7	9.7	9.8	9.3	9.5
17:00 - 17:59	12.3	10.1	10.2	10.3	9.9	9.6	10.0	9.6	9.5	9.6	9.6	9.7	9.6	9.5	9.4
18:00 - 18:59	11.8	10.2	10.1	10.1	10.1	9.5	9.9	9.6	9.7	9.7	9.6	9.7	9.2	9.8	10.1
19:00 - 19:59	13.5	10.2	10.1	10.2	95.2	9.6	9.8	9.7	9.6	9.6	9.6	9.8	9.7	75.3	8.4
20:00 - 20:59	16.4	10.2	10.1	10.4	10.2	9.8	9.8	9.6	9.8	9.7	9.6	9.8	9.5	229.2	10.4
21:00 - 21:59	11.2	10.1	10.1	10.4	10.1	9.8	9.9	9.5	9.9	9.7	9.9	9.8	10.0	10.1	55.4
22:00 - 22:59	10.6	10.1	10.3	10.2	10.3	9.7	10.0	9.9	10.0	9.8	9.9	9.9	9.5	162.7	10.3
23:00 - 23:59	10.4	10.3	10.3	10.5	10.4	10.2	10.1	9.9	10.1	9.9	10.1	10.0	9.9	224.8	10.0

Time	16-Apr	17-Apr	18-Apr	19-Apr	20-Apr	21-Apr	22-Apr	23-Apr	24-Apr	25-Apr	26-Apr	27-Apr	28-Apr	29-Apr	30-Apr
00:00 - 00:59	9.6	9.7	9.6	9.3	13.0	12.9	12.9	12.9	13.0	12.9	12.9	12.8	12.7	13.4	18.2
01:00 - 01:59	12.7	9.9	9.7	9.5	13.2	12.9	13.0	12.9	12.9	13.0	13.0	13.0	13.0	13.1	18.7
02:00 - 02:59	10.7	9.6	9.3	9.8	13.3	12.9	13.3	13.1	12.9	13.0	13.0	13.0	13.0	13.8	16.5
03:00 - 03:59	9.8	9.4	9.6	9.6	13.0	13.2	12.6	13.0	13.0	13.1	13.0	13.0	13.1	13.2	16.5
04:00 - 04:59	9.4	9.5	9.8	9.6	13.1	13.0	12.7	13.0	13.0	13.1	13.1	13.0	13.2	13.5	16.2
05:00 - 05:59	9.5	9.4	9.7	9.6	12.6	12.9	12.8	13.0	13.0	13.1	13.0	13.0	12.9	13.6	108.4
06:00 - 06:59	9.5	9.8	10.0	9.7	13.1	12.8	13.2	13.2	13.0	13.1	13.2	13.1	12.9	13.8	15.4
07:00 - 07:59	9.6	9.8	9.8	9.7	13.5	13.5	13.6	13.2	13.2	13.2	13.3	13.3	13.3	14.1	14.6
08:00 - 08:59	9.9	9.5	9.5	9.8	13.3	13.3	13.2	13.3	13.4	13.3	13.4	13.3	13.3	14.3	14.5
09:00 - 09:59	10.3	9.7	9.5	9.7	13.5	13.3	13.3	13.5	13.3	13.4	13.3	13.4	13.4	14.5	14.5
10:00 - 10:59	10.1	9.6	9.6	9.8	12.9	12.8	13.1	13.2	12.9	13.2	13.1	13.1	13.1	13.8	14.4
11:00 - 11:59	9.5	9.8	9.7	9.5	13.0	12.8	13.1	13.0	12.9	12.9	13.2	13.2	12.9	13.4	14.1
12:00 - 12:59	9.5	9.7	9.6	8.9	12.8	12.9	12.8	12.8	12.8	12.8	12.9	12.8	12.9	13.7	14.0
13:00 - 13:59	9.6	9.6	9.6	9.5	12.6	12.7	12.4	12.5	12.6	12.8	12.7	12.7	12.5	13.2	13.7
14:00 - 14:59	9.6	9.5	9.5	41.3	12.9	12.5	12.4	12.5	12.2	12.4	12.6	12.7	12.6	13.1	13.9
15:00 - 15:59	9.7	9.5	9.5	12.4	12.5	12.6	12.2	12.4	12.2	12.2	12.3	12.6	12.4	13.3	13.8
16:00 - 16:59	9.5	9.0	9.1	12.2	11.9	12.5	12.2	12.4	12.2	12.4	12.5	12.4	12.1	13.2	14.1
17:00 - 17:59	9.2	9.1	9.0	12.1	12.4	12.7	12.4	12.3	12.0	12.4	13.1	12.6	12.1	13.2	17.4
18:00 - 18:59	9.2	9.3	9.2	12.5	12.6	12.8	12.1	12.4	12.3	12.5	12.2	12.7	12.4	13.4	14.5
19:00 - 19:59	9.3	9.0	9.0	12.4	12.6	13.4	12.3	12.6	12.6	12.2	12.5	12.9	12.5	13.3	14.7
20:00 - 20:59	9.3	9.7	9.0	13.1	12.7	13.5	12.6	12.7	12.7	12.7	12.8	12.8	38.3	13.4	15.2
21:00 - 21:59	9.7	9.8	9.5	12.7	12.6	12.9	12.8	12.8	12.8	12.6	12.8	12.8	19.6	13.5	38.1
22:00 - 22:59	9.6	9.7	9.3	12.9	12.7	12.6	12.7	12.8	12.8	12.8	12.8	12.5	14.1	13.4	15.8
23:00 - 23:59	9.7	9.4	9.2	12.8	12.7	12.7	12.8	12.9	12.9	12.8	12.8	12.5	13.9	39.1	15.6

Unit 2 PM - May 2025

Time	1-May	2-May	3-May	4-May	5-May	6-May	7-May	8-May	9-May	10-May	11-May	12-May	13-May	14-May	15-May
00:00 - 00:59	31.3	14.1	14.2	13.9	13.9	13.7	13.3	13.9	14.0	14.1	14.3	14.6	14.3	14.2	14.5
01:00 - 01:59	17.8	14.3	14.2	14.0	13.6	13.9	14.0	13.9	14.1	14.1	14.3	81.4	14.8	14.6	14.5
02:00 - 02:59	15.1	14.1	13.9	14.3	14.0	14.0	13.8	13.9	13.8	14.2	14.6	37.9	14.7	14.7	14.4
03:00 - 03:59	14.6	13.8	14.7	14.1	14.1	14.0	14.3	13.9	13.8	14.1	14.0	17.4	28.3	14.4	14.3
04:00 - 04:59	14.6	14.0	14.3	14.1	14.3	14.2	13.7	14.0	13.6	14.5	14.3	17.8	15.0	14.3	14.6
05:00 - 05:59	15.0	14.1	14.0	14.5	13.4	14.1	14.1	14.2	13.3	14.3	14.4	27.1	14.9	14.1	14.7
06:00 - 06:59	14.6	14.1	14.0	14.8	14.6	14.0	14.1	14.3	14.0	14.3	14.6	15.1	14.3	14.0	14.6
07:00 - 07:59	14.9	14.1	14.0	14.4	14.4	14.3	14.1	14.4	14.2	14.4	14.7	14.8	14.7	14.2	14.6
08:00 - 08:59	14.9	14.0	14.5	14.2	14.3	14.4	14.7	14.6	13.9	14.4	14.7	14.3	14.7	14.4	14.7
09:00 - 09:59	14.9	13.9	14.4	14.5	14.3	14.3	14.7	14.4	14.1	14.1	14.8	14.7	14.6	14.5	14.7
10:00 - 10:59	14.9	13.9	14.3	14.0	13.7	14.0	14.5	14.0	13.8	14.3	14.3	14.6	14.6	14.3	14.3
11:00 - 11:59	14.1	13.6	14.2	13.7	13.5	13.6	13.7	13.8	14.1	14.1	14.3	14.4	14.1	14.1	14.1
12:00 - 12:59	14.0	13.9	13.7	13.4	13.4	13.5	13.8	13.9	13.8	15.9	14.1	14.2	13.8	13.9	13.7
13:00 - 13:59	14.3	13.9	13.8	13.5	13.8	13.8	14.1	14.1	13.7	18.3	13.9	14.2	13.9	13.7	13.7
14:00 - 14:59	13.9	13.6	13.7	13.6	13.6	13.6	13.5	13.5	13.7	18.0	13.5	13.7	13.8	13.5	13.2
15:00 - 15:59	16.6	13.7	13.2	13.5	13.3	13.8	13.6	13.5	13.8	18.5	13.5	13.4	13.7	13.4	13.7
16:00 - 16:59	14.4	13.9	13.4	13.5	13.5	13.3	14.0	13.6	13.8	18.0	13.5	13.7	14.0	13.0	13.9
17:00 - 17:59	13.9	13.5	13.6	13.5	13.5	13.3	13.7	13.6	13.5	14.9	13.3	13.7	66.5	13.1	13.6
18:00 - 18:59	14.1	13.8	13.5	13.3	14.1	13.3	13.9	13.2	13.8	14.1	13.7	14.2	75.8	13.2	14.1
19:00 - 19:59	14.2	14.1	14.0	13.7	13.9	13.9	14.2	14.0	14.5	14.1	14.2	14.3	14.1	14.2	14.4
20:00 - 20:59	14.2	13.9	13.3	13.8	13.7	14.0	14.1	14.0	14.1	14.2	14.3	14.2	14.3	14.3	14.9
21:00 - 21:59	14.2	13.9	13.7	13.9	13.8	14.4	13.5	14.5	14.0	14.0	13.7	14.4	14.3	14.1	14.9
22:00 - 22:59	14.3	14.2	14.0	13.4	14.0	13.8	13.8	14.7	13.9	14.2	63.6	14.4	14.2	14.1	14.7
23:00 - 23:59	14.5	14.3	14.3	14.1	13.6	14.0	14.0	13.9	14.5	14.3	24.2	14.5	14.2	14.2	14.6

Time	16-May	17-May	18-May	19-May	20-May	21-May	22-May	23-May	24-May	25-May	26-May	27-May	28-May	29-May	30-May	31-May
00:00 - 00:59	14.5	14.7	14.4	14.9	14.7	14.5	14.8	14.9	14.7	14.6	14.7	13.8	16.0	15.4	15.2	15.3
01:00 - 01:59	15.1	14.9	14.4	14.5	14.9	14.6	14.7	14.7	14.6	14.4	14.8	14.0	16.3	16.0	15.0	15.3
02:00 - 02:59	17.9	14.9	15.1	14.4	14.7	14.6	14.6	15.3	14.6	14.3	21.9	14.2	16.0	17.4	15.3	15.4
03:00 - 03:59	14.7	14.9	14.7	14.6	14.7	14.4	14.6	15.4	14.4	14.5	14.6	14.2	15.7	17.2	15.4	15.2
04:00 - 04:59	15.0	14.8	15.8	14.8	14.7	15.3	14.7	15.6	14.3	14.2	55.7	14.1	15.5	16.1	15.5	15.0
05:00 - 05:59	14.8	14.9	15.8	14.5	14.7	15.2	14.7	15.5	14.4	13.7	214.0	14.0	15.4	15.8	15.2	15.1
06:00 - 06:59	14.9	14.9	15.1	14.6	14.9	18.0	14.8	15.5	14.3	14.3	15.4	13.5	15.6	15.7	15.0	15.3
07:00 - 07:59	15.0	15.0	14.2	14.8	15.0	14.7	14.9	15.0	14.2	16.6	14.3	14.1	15.4	15.2	15.0	15.1
08:00 - 08:59	14.9	14.9	14.4	14.7	15.0	14.8	14.8	14.9	14.5	266.1	14.3	14.0	15.3	15.2	14.9	14.9
09:00 - 09:59	14.8	14.8	14.4	14.1	14.6	14.5	14.7	14.6	14.0	214.4	14.3	13.8	15.3	58.5	14.7	14.7
10:00 - 10:59	14.7	14.7	13.6	13.5	14.4	14.1	14.6	14.3	13.7	16.1	14.1	14.2	15.3	15.4	14.5	14.8
11:00 - 11:59	14.5	14.3	13.4	13.8	14.3	13.9	13.6	14.2	14.1	14.9	14.1	13.9	14.6	15.7	14.2	14.6
12:00 - 12:59	14.3	14.0	13.9	13.5	13.9	13.4	13.8	13.4	13.7	14.7	14.1	13.7	14.7	15.0	14.3	14.6
13:00 - 13:59	14.2	14.1	13.4	13.8	13.7	13.4	13.8	13.9	13.6	14.2	14.3	13.9	14.5	15.3	14.4	14.4
14:00 - 14:59	13.8	13.7	14.3	14.0	13.4	13.7	13.1	13.4	13.3	13.7	14.0	13.8	14.4	14.9	14.0	14.9
15:00 - 15:59	13.7	13.5	14.0	13.5	13.6	13.5	13.5	13.3	14.0	14.1	14.0	14.1	14.5	14.9	14.2	14.8
16:00 - 16:59	13.6	15.1	13.9	13.4	13.6	13.3	13.7	13.1	16.6	14.3	14.0	14.1	14.5	14.7	15.2	14.6
17:00 - 17:59	13.7	86.3	14.0	13.7	13.7	13.9	13.5	13.2	199.3	14.0	13.6	14.6	14.6	14.5	65.8	14.5
18:00 - 18:59	14.2	14.6	14.2	14.3	13.7	13.9	13.4	13.4	15.4	14.7	14.0	17.0	14.5	14.7	84.4	14.7
19:00 - 19:59	14.4	15.0	13.8	14.2	26.1	14.2	73.9	13.1	14.5	14.3	14.0	16.9	14.6	14.6	17.4	14.8
20:00 - 20:59	14.5	17.1	14.9	36.0	49.7	14.4	251.5	13.7	14.4	171.2	14.0	155.2	14.8	14.7	16.5	15.1
21:00 - 21:59	14.5	23.1	14.9	43.1	15.1	14.2	15.8	14.2	14.6	52.8	14.1	16.0	15.3	15.5	15.6	15.0
22:00 - 22:59	14.6	19.7	15.2	14.8	14.8	14.3	14.2	14.8	14.9	14.8	14.1	16.8	15.3	15.2	15.3	15.1
23:00 - 23:59	14.7	14.6	15.1	14.7	14.8	14.4	14.5	14.8	14.8	14.4	14.0	16.1	15.3	15.1	15.4	15.0

Unit 2 PM - June 2025

Time	1-Jun	2-Jun	3-Jun	4-Jun	5-Jun	6-Jun	7-Jun	8-Jun	9-Jun	10-Jun	11-Jun	12-Jun	13-Jun	14-Jun	15-Jun
00:00 - 00:59	15.0	15.2	14.9	15.4	15.5	14.8	14.4	14.0	14.2	14.4	14.4	14.3	14.0	14.5	14.1
01:00 - 01:59	15.0	16.7	15.0	15.5	15.2	14.9	14.0	14.1	14.3	14.4	13.9	14.3	42.5	14.3	14.1
02:00 - 02:59	15.1	17.3	15.0	15.6	14.6	15.0	14.3	14.1	14.8	14.4	14.3	14.5	86.1	14.1	14.1
03:00 - 03:59	15.1	17.8	15.2	15.6	14.4	15.2	14.3	14.1	14.2	14.0	14.3	14.4	18.8	14.3	14.1
04:00 - 04:59	15.1	18.0	15.2	15.7	14.3	15.1	14.8	15.7	15.2	14.2	14.5	14.4	20.9	14.0	14.0
05:00 - 05:59	15.0	83.1	15.2	15.8	14.7	15.2	15.1	18.4	15.1	13.5	14.4	14.0	15.8	14.1	14.0
06:00 - 06:59	15.0	290.1	15.2	15.8	14.9	15.3	15.1	14.1	14.6	14.0	14.4	14.2	14.6	14.4	14.2
07:00 - 07:59	15.1	17.3	15.1	15.5	15.0	15.2	15.0	14.4	14.5	14.3	14.0	13.5	32.0	14.2	14.2
08:00 - 08:59	14.9	15.7	14.9	15.0	15.0	15.0	14.8	14.4	14.5	14.8	14.2	14.0	76.8	14.1	14.2
09:00 - 09:59	14.9	15.4	14.9	14.8	14.7	14.8	14.7	14.4	14.5	15.1	13.5	14.3	13.9	14.1	14.2
10:00 - 10:59	14.7	15.1	14.7	14.6	14.4	14.4	14.3	14.0	14.3	15.4	14.0	14.2	13.9	14.0	14.0
11:00 - 11:59	14.4	15.0	14.6	14.5	14.4	14.2	14.3	14.2	14.1	14.9	14.3	15.2	13.7	13.9	13.8
12:00 - 12:59	14.5	14.7	14.5	14.4	13.9	13.9	14.0	13.5	14.4	14.2	14.8	15.1	13.6	13.8	13.6
13:00 - 13:59	14.4	14.2	14.5	14.3	13.9	13.8	14.0	14.0	13.9	14.3	15.1	14.6	13.3	13.7	13.7
14:00 - 14:59	14.6	14.5	14.4	14.1	13.4	14.0	13.9	13.4	14.3	14.8	15.4	13.9	13.1	13.4	14.0
15:00 - 15:59	14.4	14.5	13.9	14.0	13.9	13.8	13.5	14.6	14.3	14.2	14.9	12.7	12.6	13.3	13.5
16:00 - 16:59	14.3	14.6	14.8	14.1	13.8	13.7	13.3	14.6	14.5	15.2	14.2	13.3	13.3	13.4	13.7
17:00 - 17:59	14.6	14.6	15.3	129.8	13.7	13.6	13.8	13.9	14.0	15.1	14.3	16.6	12.9	13.1	13.5
18:00 - 18:59	14.6	14.7	15.3	152.8	13.4	13.8	14.1	14.1	14.1	14.6	14.8	16.7	13.4	13.8	13.9
19:00 - 19:59	14.7	14.8	23.9	127.7	13.9	13.6	14.4	14.3	14.1	14.5	14.2	16.5	13.8	13.4	14.0
20:00 - 20:59	14.9	14.8	14.6	16.2	14.3	13.9	13.9	14.8	14.1	14.5	15.2	83.2	14.0	14.0	14.1
21:00 - 21:59	15.3	14.7	14.7	15.5	14.5	14.1	14.3	15.1	15.7	14.5	15.1	14.5	13.9	13.9	14.0
22:00 - 22:59	16.2	14.9	15.1	15.3	14.6	14.2	14.3	15.4	18.4	14.3	14.6	14.4	14.3	14.0	14.2
23:00 - 23:59	15.4	14.9	15.4	15.2	14.7	14.3	14.5	14.9	14.1	14.1	13.9	14.4	14.5	14.0	14.2

Time	16-Jun	17-Jun	18-Jun	19-Jun	20-Jun	21-Jun	22-Jun	23-Jun	24-Jun	25-Jun	26-Jun	27-Jun	28-Jun	29-Jun	30-Jun
00:00 - 00:59	14.2	14.1	14.1	14.2	14.1	13.9	14.0	13.9	45.4	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	14.1	14.1	14.2	14.1	13.9	14.0	14.1	13.9	17.2	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	14.1	14.1	14.3	14.1	13.9	14.0	14.2	14.0	35.1	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	14.2	14.2	14.2	14.1	14.1	14.0	14.2	14.1	48.3	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	14.2	14.1	14.2	14.2	14.1	14.0	14.2	14.3	25.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	14.3	14.2	14.3	14.3	14.1	14.2	14.3	14.3	24.1	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	14.3	14.2	14.3	14.2	14.3	14.3	14.4	14.4	36.3	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	14.3	14.3	14.3	14.1	14.3	14.3	14.3	14.4	26.8	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	14.3	14.2	14.3	14.1	14.3	14.5	14.2	14.2	26.1	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	14.3	14.1	14.3	14.0	14.0	14.4	14.1	14.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	14.1	14.1	14.2	14.2	13.9	14.0	13.8	14.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	14.1	14.1	14.4	14.0	13.9	13.8	13.7	14.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	13.9	14.0	14.2	13.6	13.6	13.7	13.5	13.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	13.8	13.9	13.8	13.3	13.6	13.5	13.4	13.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	13.8	13.8	13.8	13.2	13.5	13.5	13.5	13.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	13.6	13.7	13.8	13.3	13.2	13.6	13.4	13.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	13.9	13.7	13.7	13.3	13.3	13.7	13.3	13.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	13.7	13.7	13.7	13.3	13.3	13.5	13.4	13.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	13.9	13.8	13.8	13.3	13.3	13.7	13.5	13.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	14.1	13.8	14.0	13.5	13.3	13.4	13.6	13.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	14.1	13.8	14.0	13.6	13.5	13.8	13.7	13.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	14.1	14.1	14.1	13.9	13.8	13.9	13.8	13.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	14.1	14.1	14.2	13.9	13.9	14.0	13.8	14.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	14.1	14.2	14.1	14.1	13.9	14.0	13.8	13.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Remark: Plant shutdown from 23:29hr on 23 Jun 25 to 02 Jul 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 2 PM - July 2025

Time	1-Jul	2-Jul	3-Jul	4-Jul	5-Jul	6-Jul	7-Jul	8-Jul	9-Jul	10-Jul	11-Jul	12-Jul	13-Jul	14-Jul	15-Jul
00:00 - 00:59	0.0	0.0	15.1	14.1	14.1	14.1	14.4	14.6	14.6	14.4	14.1	14.4	14.6	14.6	14.5
01:00 - 01:59	0.0	0.0	15.8	14.1	14.1	14.2	14.4	16.5	14.4	14.4	14.1	14.5	103.9	14.4	14.5
02:00 - 02:59	0.0	0.0	16.0	14.2	14.2	14.1	14.5	15.5	14.5	14.4	14.1	14.4	13.6	14.5	14.4
03:00 - 03:59	0.0	0.0	16.1	14.1	14.1	14.0	14.5	14.6	14.5	14.4	14.2	14.3	13.4	14.4	27.8
04:00 - 04:59	0.0	0.0	16.1	14.1	14.1	14.1	14.5	14.6	14.5	14.3	14.3	14.4	14.0	14.5	21.3
05:00 - 05:59	0.0	0.0	16.8	14.1	14.1	14.0	14.5	16.1	14.5	14.5	14.3	14.4	14.4	14.5	14.4
06:00 - 06:59	0.0	0.0	18.4	14.3	14.2	14.2	14.5	15.6	14.5	14.5	14.5	14.5	14.5	14.4	14.6
07:00 - 07:59	0.0	0.0	19.3	14.2	14.2	14.1	14.6	14.7	14.5	14.5	14.4	14.5	14.4	14.5	14.5
08:00 - 08:59	0.0	0.0	13.6	14.3	14.1	14.1	14.5	14.7	14.5	14.5	14.4	14.5	14.6	14.6	14.6
09:00 - 09:59	0.0	0.0	14.1	14.4	14.3	14.1	14.5	14.8	14.5	14.5	14.6	14.6	14.2	14.5	14.2
10:00 - 10:59	0.0	0.0	14.1	14.2	14.2	14.0	14.1	14.7	14.5	14.4	14.2	14.4	14.4	14.6	14.2
11:00 - 11:59	0.0	0.0	13.8	14.0	14.1	14.1	14.0	14.3	14.3	14.3	14.0	14.3	14.2	14.3	13.6
12:00 - 12:59	0.0	0.0	13.8	13.8	13.9	13.9	14.4	14.1	14.3	14.2	13.6	14.3	14.1	14.3	13.3
13:00 - 13:59	0.0	0.0	13.7	13.7	13.8	13.9	14.3	14.0	14.2	14.1	13.9	14.0	14.0	14.1	13.9
14:00 - 14:59	0.0	0.0	13.6	13.7	13.7	13.7	14.2	14.0	14.1	13.8	13.7	13.6	14.0	14.1	2.3
15:00 - 15:59	0.0	0.0	13.6	13.7	13.7	13.7	13.9	13.5	13.9	13.8	13.2	13.8	13.9	14.1	0.0
16:00 - 16:59	0.0	0.0	13.6	13.7	13.6	13.7	13.8	27.2	14.0	13.4	13.4	13.5	13.8	14.3	0.0
17:00 - 17:59	0.0	0.0	13.6	13.7	13.9	13.7	13.9	13.9	13.9	13.3	12.9	14.1	13.7	14.2	11.9
18:00 - 18:59	0.0	0.0	13.8	13.7	13.5	13.8	14.1	13.9	14.0	13.3	14.4	72.0	14.2	14.2	14.1
19:00 - 19:59	0.0	0.0	14.0	13.7	13.8	13.8	14.1	14.6	14.1	13.7	14.0	14.5	13.9	14.2	14.1
20:00 - 20:59	0.0	0.0	14.0	13.9	13.9	14.2	14.1	14.8	14.3	13.9	14.6	14.3	14.0	14.4	14.2
21:00 - 21:59	0.0	0.0	14.0	13.9	13.9	14.3	14.2	14.7	14.3	13.9	14.6	14.5	14.2	14.5	14.1
22:00 - 22:59	0.0	15.2	14.0	14.1	14.0	14.3	14.1	14.8	14.5	14.1	14.7	14.5	14.4	14.4	14.3
23:00 - 23:59	0.0	172.7	14.1	14.1	14.1	14.4	14.2	14.7	14.4	14.0	14.7	174.9	14.5	14.5	14.4

Time	16-Jul	17-Jul	18-Jul	19-Jul	20-Jul	21-Jul	22-Jul	23-Jul	24-Jul	25-Jul	26-Jul	27-Jul	28-Jul	29-Jul	30-Jul	31-Jul
00:00 - 00:59	14.6	15.3	15.1	14.8	14.5	14.5	14.5	14.6	14.7	15.7	14.6	14.9	17.7	14.7	15.1	14.5
01:00 - 01:59	14.7	15.0	14.8	14.8	14.5	14.5	14.5	14.6	14.7	15.7	14.7	14.9	140.5	14.9	15.1	14.5
02:00 - 02:59	14.6	14.7	14.6	14.9	14.6	14.6	14.4	14.7	14.7	15.9	14.6	15.0	327.7	14.8	15.0	14.4
03:00 - 03:59	14.6	14.7	14.9	14.9	14.5	14.5	14.5	14.6	14.8	15.8	14.7	14.9	289.3	14.8	15.1	14.6
04:00 - 04:59	14.6	14.7	15.1	14.9	14.4	14.4	14.5	14.6	17.5	15.9	14.8	15.0	18.7	14.7	15.0	14.6
05:00 - 05:59	14.6	14.8	14.9	14.9	14.4	14.5	14.5	14.6	14.9	15.8	14.7	14.9	16.5	14.7	15.0	14.3
06:00 - 06:59	14.5	14.9	14.8	14.8	14.5	14.4	14.8	14.6	15.8	15.8	14.7	14.8	15.9	14.8	14.9	14.5
07:00 - 07:59	14.5	14.8	14.9	14.8	14.8	14.6	14.7	14.5	15.3	15.7	14.8	14.9	15.6	14.8	15.1	14.7
08:00 - 08:59	14.6	14.8	14.9	14.9	14.8	14.6	14.7	14.8	15.1	15.7	14.8	14.8	15.2	15.0	15.0	14.6
09:00 - 09:59	14.5	15.2	14.8	14.7	14.3	14.7	14.7	14.6	14.8	15.8	14.8	14.8	15.0	14.8	15.1	14.7
10:00 - 10:59	14.5	14.7	14.6	14.7	14.0	14.4	14.3	14.8	14.8	18.1	14.6	14.8	15.1	14.3	14.8	14.4
11:00 - 11:59	14.6	14.6	14.5	14.4	14.7	14.2	14.3	14.5	14.8	14.6	14.5	14.7	14.8	14.6	14.6	14.2
12:00 - 12:59	14.5	14.6	14.5	14.4	13.6	13.9	14.1	14.4	14.3	14.6	14.2	14.5	14.6	15.2	14.4	14.0
13:00 - 13:59	19.9	14.5	14.2	13.9	14.0	13.9	14.4	13.9	14.6	14.5	14.5	14.3	14.6	14.9	14.3	13.9
14:00 - 14:59	14.2	14.5	14.1	13.8	13.9	13.9	13.8	13.4	14.5	14.6	14.1	14.2	14.4	14.3	14.3	13.7
15:00 - 15:59	14.7	13.9	14.0	14.1	13.3	13.7	13.9	13.9	15.3	14.1	14.3	14.3	14.4	14.1	14.5	13.8
16:00 - 16:59	14.2	14.2	14.2	14.1	14.2	13.5	13.8	14.3	15.5	14.7	14.2	14.3	14.7	13.9	14.5	13.7
17:00 - 17:59	15.5	14.1	13.8	14.3	13.7	13.7	13.8	14.4	15.7	14.6	14.2	14.3	14.1	14.3	13.9	13.7
18:00 - 18:59	15.6	14.1	14.3	13.5	13.8	13.1	13.6	14.4	15.8	14.6	14.3	14.6	14.2	14.5	13.9	13.8
19:00 - 19:59	15.2	13.8	14.3	14.0	13.8	13.9	14.1	14.5	15.8	14.5	14.4	14.6	14.2	14.4	14.1	14.0
20:00 - 20:59	15.5	18.8	14.4	14.1	14.1	14.0	14.3	14.6	15.7	14.5	14.5	14.6	14.6	14.4	14.1	14.0
21:00 - 21:59	15.6	29.6	14.6	14.1	14.5	13.9	14.1	14.7	15.7	14.6	14.6	14.6	14.3	14.8	14.2	14.1
22:00 - 22:59	15.6	22.4	14.7	14.3	14.5	14.4	14.4	14.7	15.6	14.6	14.7	14.8	14.4	15.0	14.1	14.3
23:00 - 23:59	15.8	14.7	14.8	14.4	14.5	14.5	14.4	14.6	15.8	14.6	14.8	16.2	14.6	15.0	14.3	14.4

Remark: Plant shutdown from 23:29hr on 23 Jun 25 to 02 Jul 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 2 PM - August 2025

Time	1-Aug	2-Aug	3-Aug	4-Aug	5-Aug	6-Aug	7-Aug	8-Aug	9-Aug	10-Aug	11-Aug	12-Aug	13-Aug	14-Aug	15-Aug
00:00 - 00:59	14.4	14.4	14.1	14.1	14.5	14.7	15.0	14.8	14.7	14.7	14.7	14.3	14.7	14.5	14.4
01:00 - 01:59	14.3	14.4	14.2	14.2	14.7	14.7	15.0	14.8	14.8	14.8	14.6	14.7	14.6	14.7	14.5
02:00 - 02:59	14.5	14.5	14.3	14.3	14.4	14.7	14.9	14.9	14.9	14.9	14.8	14.7	14.7	14.8	14.6
03:00 - 03:59	14.6	14.6	14.4	14.4	14.4	14.8	14.9	14.9	14.9	14.9	14.8	14.8	14.8	14.7	14.6
04:00 - 04:59	14.7	14.5	14.5	14.4	14.5	14.9	14.8	14.9	14.9	14.9	14.8	14.9	14.8	14.7	14.8
05:00 - 05:59	14.7	14.2	14.5	14.5	14.6	14.8	14.8	14.9	14.8	14.9	14.8	14.8	14.7	14.7	14.5
06:00 - 06:59	14.8	14.4	14.5	14.6	14.7	14.8	14.9	14.9	14.7	14.9	14.8	14.7	14.6	14.7	14.7
07:00 - 07:59	14.8	14.7	14.7	14.7	14.7	14.7	14.9	14.9	14.9	14.9	14.9	14.8	14.7	15.1	14.5
08:00 - 08:59	14.7	14.7	14.7	14.7	14.6	14.4	14.9	14.9	14.7	14.8	14.9	14.8	14.9	14.9	14.5
09:00 - 09:59	14.7	14.7	14.5	14.7	14.3	14.4	14.8	14.9	14.7	14.8	14.6	14.8	14.9	14.4	14.2
10:00 - 10:59	14.8	14.1	14.6	14.4	14.3	14.4	14.5	14.6	14.3	14.7	14.3	14.4	14.5	14.4	13.9
11:00 - 11:59	14.2	13.8	14.2	14.2	14.0	14.2	14.5	14.6	14.0	14.3	14.1	14.4	14.3	13.9	14.1
12:00 - 12:59	14.3	13.8	14.1	14.1	14.0	14.0	14.3	14.5	14.0	14.0	14.1	14.2	14.1	14.0	14.0
13:00 - 13:59	14.0	13.9	13.9	14.0	13.8	13.3	14.1	14.5	13.8	14.0	13.9	14.2	14.1	14.1	13.9
14:00 - 14:59	14.0	13.7	13.9	14.0	14.0	14.2	14.1	14.2	13.7	14.0	13.7	14.0	14.0	13.8	13.7
15:00 - 15:59	14.1	13.6	13.9	13.9	13.9	14.2	14.0	14.1	13.8	13.7	13.7	13.8	13.9	13.4	13.5
16:00 - 16:59	14.2	13.6	13.7	13.9	13.6	18.5	14.1	14.0	13.6	13.6	13.8	13.7	13.7	13.8	13.4
17:00 - 17:59	14.0	13.6	13.7	13.9	13.8	16.0	14.1	14.3	13.7	13.6	14.0	13.8	13.7	13.7	13.0
18:00 - 18:59	14.1	13.7	13.6	14.0	13.4	15.8	14.3	14.1	13.9	13.6	13.6	13.9	13.8	13.9	12.8
19:00 - 19:59	14.1	13.8	13.9	13.9	14.9	15.5	14.3	14.1	14.0	13.9	13.8	13.9	14.0	14.3	13.9
20:00 - 20:59	14.1	13.8	14.0	14.0	14.6	15.1	14.5	14.1	14.2	14.0	14.0	14.1	13.8	13.6	14.3
21:00 - 21:59	14.2	13.6	14.1	14.1	14.3	15.2	14.7	14.3	14.3	14.2	14.2	14.2	14.1	13.8	14.6
22:00 - 22:59	14.5	14.1	14.1	14.3	14.4	15.1	14.8	14.6	14.4	14.2	14.3	14.2	14.1	14.2	15.3
23:00 - 23:59	14.4	14.1	14.1	14.4	14.6	14.9	14.8	14.7	14.6	14.4	14.2	14.6	14.3	14.3	14.3

Time	16-Aug	17-Aug	18-Aug	19-Aug	20-Aug	21-Aug	22-Aug	23-Aug	24-Aug	25-Aug	26-Aug	27-Aug	28-Aug	29-Aug	30-Aug	31-Aug
00:00 - 00:59	14.2	14.8	14.4	14.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	13.9	14.8	14.8	14.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	14.3	14.1	14.8	14.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	15.2	14.2	14.5	14.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	15.1	14.1	14.7	14.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	101.3	14.5	14.3	14.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	83.9	14.5	14.6	14.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	14.2	14.5	14.4	14.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	14.1	14.6	14.5	14.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	14.7	14.5	14.6	14.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	37.6	14.4	14.4	14.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	14.3	14.0	14.0	13.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	14.4	14.0	14.1	13.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	14.3	13.8	13.8	14.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	13.8	13.9	13.7	15.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	13.6	13.7	13.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	13.7	13.9	13.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	14.0	13.6	13.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	14.4	13.3	13.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	14.5	13.8	14.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	14.0	28.8	76.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	13.6	14.5	13.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	15.5	14.1	14.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	15.8	14.6	13.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Remark: Plant shutdown from 14:00 hr on 19 Aug 25 to17 Sep 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 2 PM - September 2025

Time	1-Sep	2-Sep	3-Sep	4-Sep	5-Sep	6-Sep	7-Sep	8-Sep	9-Sep	10-Sep	11-Sep	12-Sep	13-Sep	14-Sep	15-Sep
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Time	16-Sep	17-Sep	18-Sep	19-Sep	20-Sep	21-Sep	22-Sep	23-Sep	24-Sep	25-Sep	26-Sep	27-Sep	28-Sep	29-Sep	30-Sep
00:00 - 00:59	0.0	0.0	0.0	13.6	13.4	22.2	13.6	0.0	13.0	12.9	13.6	13.5	12.6	13.0	13.4
01:00 - 01:59	0.0	0.0	13.6	13.8	14.0	21.7	13.7	0.0	14.5	13.2	13.5	13.3	12.7	13.0	13.0
02:00 - 02:59	0.0	0.0	13.5	13.6	13.4	16.2	13.8	0.0	14.2	13.2	13.5	14.1	12.9	12.9	13.2
03:00 - 03:59	0.0	0.0	13.5	13.6	13.5	61.4	13.6	0.0	14.2	13.5	13.5	12.9	12.8	13.0	13.1
04:00 - 04:59	0.0	0.0	13.6	13.6	13.5	17.2	13.1	0.0	13.5	12.6	13.6	13.1	12.6	12.6	13.3
05:00 - 05:59	0.0	0.0	15.3	14.0	13.2	12.8	13.3	0.0	13.2	13.1	13.5	13.4	12.7	12.3	13.3
06:00 - 06:59	0.0	0.0	15.4	14.0	13.6	13.4	13.6	0.0	67.4	12.7	13.5	13.7	12.6	12.5	13.4
07:00 - 07:59	0.0	0.0	15.3	13.6	13.3	13.5	13.6	0.0	13.2	13.0	13.8	27.4	12.4	12.5	13.4
08:00 - 08:59	0.0	0.0	15.4	13.4	13.7	14.0	13.7	10.1	13.6	13.2	13.8	13.8	12.3	12.7	13.5
09:00 - 09:59	0.0	0.0	18.7	13.8	13.1	13.9	13.7	13.8	13.5	13.5	13.5	13.8	12.5	12.7	13.5
10:00 - 10:59	0.0	0.0	14.2	14.0	13.1	13.4	13.6	13.2	13.3	13.5	13.5	13.2	12.9	12.3	13.0
11:00 - 11:59	0.0	0.0	41.2	14.1	13.1	13.7	13.5	13.7	13.2	13.5	13.5	13.0	12.6	12.5	28.8
12:00 - 12:59	0.0	0.0	12.5	12.6	12.4	13.4	13.1	13.2	13.2	13.8	13.4	12.6	13.0	12.4	13.4
13:00 - 13:59	0.0	0.0	13.0	12.8	12.5	13.2	12.9	13.0	12.9	13.0	13.0	12.6	12.7	12.4	13.4
14:00 - 14:59	0.0	0.0	13.4	12.9	12.6	13.2	13.3	13.2	13.5	13.7	13.2	12.9	12.6	13.9	13.5
15:00 - 15:59	0.0	0.0	12.6	12.7	12.6	13.2	12.8	12.7	13.3	13.3	13.1	12.1	12.4	11.6	13.1
16:00 - 16:59	0.0	0.0	12.7	13.4	12.4	12.6	12.3	12.6	13.2	23.3	13.2	42.7	12.1	7.5	63.0
17:00 - 17:59	0.0	0.0	12.9	13.3	12.8	13.8	0.6	12.7	13.3	13.1	12.8	13.4	12.5	13.1	13.1
18:00 - 18:59	0.0	0.0	13.1	13.5	13.0	13.4	0.0	12.8	13.1	13.2	13.6	13.6	12.7	12.4	12.9
19:00 - 19:59	0.0	0.0	13.1	13.4	13.0	13.4	0.0	12.9	12.9	13.4	68.5	13.6	12.8	12.5	13.3
20:00 - 20:59	0.0	0.0	13.1	31.8	11.8	13.4	0.0	13.3	12.7	13.4	13.8	13.4	12.7	12.6	13.5
21:00 - 21:59	0.0	0.0	13.5	54.8	272.9	13.5	0.0	13.2	13.0	13.5	79.9	12.9	12.8	13.0	13.3
22:00 - 22:59	0.0	0.0	13.5	13.3	173.1	13.7	0.0	13.5	13.0	13.6	17.3	12.8	12.8	12.8	13.1
23:00 - 23:59	0.0	0.0	13.6	13.5	13.1	13.6	0.0	13.6	12.9	13.6	13.5	12.8	12.8	12.8	13.0

Remark: Plant shutdown from 14:00 hr on 19 Aug 25 to17 Sep 25 due to Steel Mill-Thapyaywa Line Breakdown

Unit 2 PM - October 2025

Time	1-Oct	2-Oct	3-Oct	4-Oct	5-Oct	6-Oct	7-Oct	8-Oct	9-Oct	10-Oct	11-Oct	12-Oct	13-Oct	14-Oct	15-Oct
00:00 - 00:59	12.6	13.8	13.7	13.6	13.5	13.5	13.6	13.6	13.5	13.2	13.3	13.4	13.6	13.6	57.4
01:00 - 01:59	13.5	13.7	13.7	13.7	13.6	13.6	13.8	13.7	13.6	13.3	56.3	13.4	19.7	13.7	13.6
02:00 - 02:59	13.7	13.8	13.6	13.6	13.7	13.8	13.3	13.7	13.6	21.5	13.7	13.4	13.2	13.3	13.2
03:00 - 03:59	13.7	13.8	13.7	13.7	13.8	13.2	13.5	13.7	13.4	24.5	13.3	13.4	13.4	13.4	12.6
04:00 - 04:59	13.7	13.4	13.9	13.3	13.7	13.5	13.6	13.6	13.4	175.7	13.1	13.6	13.3	13.6	13.6
05:00 - 05:59	13.6	13.6	14.1	13.6	13.4	13.6	13.7	13.6	13.6	13.5	13.8	13.6	13.2	13.7	13.1
06:00 - 06:59	13.6	13.5	13.9	13.4	13.4	13.8	77.6	13.8	13.5	13.2	13.5	13.6	13.2	13.6	18.8
07:00 - 07:59	13.5	13.4	14.1	13.4	13.7	13.8	13.9	13.9	13.8	13.5	12.9	13.8	13.5	13.1	21.2
08:00 - 08:59	13.5	13.9	13.6	13.8	13.6	13.8	13.5	13.9	13.7	16.4	13.6	13.8	13.5	13.9	13.6
09:00 - 09:59	13.7	13.8	13.8	13.4	13.7	13.9	13.5	13.7	13.5	13.9	13.5	13.6	13.5	13.9	13.2
10:00 - 10:59	13.8	13.7	13.1	13.6	13.4	13.5	13.4	13.4	13.2	13.1	12.9	13.2	13.2	13.2	13.1
11:00 - 11:59	13.7	13.6	13.1	13.4	13.5	13.2	13.4	13.6	13.4	13.8	13.4	13.4	13.2	13.2	13.4
12:00 - 12:59	13.6	13.4	12.7	13.4	13.2	13.0	13.2	13.5	13.4	13.6	13.2	13.5	12.2	13.0	12.6
13:00 - 13:59	13.6	13.1	12.8	12.6	13.1	13.1	13.1	13.2	12.7	12.7	12.6	12.8	12.6	13.1	12.3
14:00 - 14:59	13.5	14.2	12.8	13.1	13.4	12.9	13.2	13.3	13.4	12.5	12.7	13.1	13.5	12.2	33.2
15:00 - 15:59	13.0	13.6	12.5	13.3	12.9	12.8	13.0	13.1	12.2	12.9	12.9	12.5	13.3	12.6	14.2
16:00 - 16:59	13.6	13.5	12.7	12.8	11.9	12.1	12.8	12.8	13.7	13.0	13.0	11.9	13.5	12.9	13.4
17:00 - 17:59	13.5	13.3	12.5	12.8	13.2	13.1	13.0	12.9	13.5	13.1	13.2	12.0	13.5	12.7	13.3
18:00 - 18:59	13.5	13.5	13.0	13.2	13.5	13.4	13.0	13.0	13.3	13.7	12.8	12.8	13.7	12.4	24.4
19:00 - 19:59	13.7	13.6	13.4	13.0	13.2	13.6	13.4	13.3	13.2	13.4	12.5	13.1	13.7	18.7	131.3
20:00 - 20:59	13.9	13.6	13.3	13.1	13.8	13.6	13.4	13.4	13.5	13.4	13.4	13.5	13.6	39.0	69.3
21:00 - 21:59	16.1	13.8	13.5	12.9	13.1	13.5	13.4	13.4	13.3	12.8	13.3	13.4	13.2	13.4	75.4
22:00 - 22:59	15.4	13.7	13.7	13.2	13.4	13.6	13.6	13.5	13.0	13.5	13.1	12.9	13.0	42.5	15.4
23:00 - 23:59	13.8	13.6	13.7	13.5	13.7	13.3	13.6	13.6	13.4	28.3	13.5	13.0	13.2	13.1	13.5

Time	16-Oct	17-Oct	18-Oct	19-Oct	20-Oct	21-Oct	22-Oct	23-Oct	24-Oct	25-Oct	26-Oct	27-Oct	28-Oct	29-Oct	30-Oct	31-Oct
00:00 - 00:59	13.6	13.2	13.2	13.2	12.6	12.9	13.1	13.6	13.3	13.8	12.8	13.1	12.9	13.3	24.9	12.8
01:00 - 01:59	13.7	13.5	13.4	13.1	12.9	13.7	13.1	13.7	12.9	13.1	13.1	12.9	13.5	13.3	17.6	12.9
02:00 - 02:59	13.6	13.1	13.4	13.2	13.2	12.9	12.5	13.1	13.6	12.9	13.1	12.9	13.2	13.2	12.8	12.8
03:00 - 03:59	13.5	13.1	12.9	12.9	13.3	12.7	12.9	13.1	13.2	22.3	13.2	13.2	12.8	13.3	13.4	12.7
04:00 - 04:59	13.2	13.2	13.7	12.9	13.3	12.9	13.0	13.3	13.5	13.2	12.9	12.9	13.0	13.6	13.5	12.8
05:00 - 05:59	13.2	13.1	13.2	12.8	13.1	13.0	13.0	13.5	13.3	13.4	13.5	12.9	13.4	12.9	13.1	12.8
06:00 - 06:59	13.4	13.4	13.6	13.1	13.3	13.1	13.3	13.5	13.4	13.2	13.3	12.7	13.0	13.5	13.5	13.1
07:00 - 07:59	13.6	14.0	13.6	13.3	13.5	13.2	13.4	14.0	14.0	14.1	13.7	13.5	13.5	13.8	13.6	13.0
08:00 - 08:59	13.3	13.4	13.6	13.3	13.4	13.3	13.6	14.1	13.6	13.7	12.9	13.2	13.6	13.6	13.4	13.1
09:00 - 09:59	13.7	13.6	13.7	13.4	12.5	12.7	13.1	13.6	13.3	13.5	13.1	12.6	13.4	13.1	13.1	13.2
10:00 - 10:59	13.6	12.9	12.4	12.5	12.6	12.6	12.4	13.3	12.8	12.6	12.5	12.3	13.1	12.6	12.8	12.5
11:00 - 11:59	13.4	13.0	12.7	12.2	12.8	12.6	12.8	12.6	12.5	12.4	12.5	12.4	12.7	13.3	12.3	12.7
12:00 - 12:59	12.8	12.2	13.0	12.6	12.5	12.8	12.4	13.1	12.9	12.1	12.4	12.4	12.1	12.2	12.2	12.7
13:00 - 13:59	13.5	13.3	13.3	12.4	12.6	12.5	12.3	12.6	12.6	12.2	12.3	12.2	12.2	12.5	12.3	12.5
14:00 - 14:59	12.8	12.8	12.4	12.6	12.6	12.5	12.6	12.3	12.6	13.1	12.2	12.4	12.2	12.6	12.3	13.0
15:00 - 15:59	12.8	12.7	12.7	12.5	12.4	12.3	12.5	11.9	12.0	12.8	12.1	12.2	12.3	12.4	12.3	12.7
16:00 - 16:59	12.4	12.9	12.4	12.6	12.5	12.3	12.5	12.1	12.4	12.5	12.3	12.0	12.0	11.7	12.3	12.0
17:00 - 17:59	13.4	13.0	12.4	12.7	12.4	12.5	12.2	12.7	13.0	12.4	12.2	12.3	12.1	12.1	12.3	12.3
18:00 - 18:59	13.4	12.3	12.8	12.9	12.8	12.7	12.9	13.0	13.3	13.1	12.5	12.7	12.7	12.7	12.7	12.6
19:00 - 19:59	13.3	12.8	12.6	13.5	13.1	12.9	13.7	13.3	13.1	13.5	12.9	12.8	12.8	12.8	13.4	13.1
20:00 - 20:59	13.2	12.9	12.9	13.4	13.3	13.4	13.6	13.1	12.4	13.3	13.3	13.6	12.5	13.0	12.7	13.0
21:00 - 21:59	13.3	13.2	13.0	13.1	13.6	13.7	13.8	12.7	13.3	12.4	13.0	12.7	12.8	12.8	13.1	13.3
22:00 - 22:59	26.4	13.0	12.9	12.9	13.4	13.4	13.8	13.2	13.2	12.7	12.7	13.1	12.9	13.2	13.4	13.0
23:00 - 23:59	13.3	13.6	13.2	12.3	13.2	12.9	13.8	13.3	13.6	13.1	12.9	13.2	13.2	13.1	13.0	13.1

Unit 2 PM - November 2025

Time	1-Nov	2-Nov	3-Nov	4-Nov	5-Nov	6-Nov	7-Nov	8-Nov	9-Nov	10-Nov	11-Nov	12-Nov	13-Nov	14-Nov	15-Nov
00:00 - 00:59	13.4	13.3	13.1	13.5	13.6	13.6	0.0	0.0	0.0	0.0	0.0	11.4	11.4	11.3	11.6
01:00 - 01:59	12.9	13.6	13.2	13.1	13.5	13.7	0.0	0.0	0.0	0.0	0.0	11.2	11.5	11.9	11.1
02:00 - 02:59	13.5	31.9	13.7	13.2	13.3	13.7	0.0	0.0	0.0	0.0	0.0	11.5	11.6	11.3	10.9
03:00 - 03:59	12.9	13.5	13.3	13.3	13.5	13.7	0.0	0.0	0.0	0.0	0.0	11.5	11.4	11.4	11.2
04:00 - 04:59	13.4	13.2	12.9	13.6	13.6	13.7	0.0	0.0	0.0	0.0	0.0	11.3	11.4	11.0	11.6
05:00 - 05:59	12.8	13.1	13.3	14.0	13.5	13.5	0.0	0.0	0.0	0.0	0.0	11.0	11.5	11.0	11.6
06:00 - 06:59	13.3	13.4	13.4	13.4	13.6	13.4	0.0	0.0	0.0	0.0	0.0	11.5	11.6	10.8	11.6
07:00 - 07:59	13.4	13.4	13.0	13.3	13.8	13.7	0.0	0.0	0.0	0.0	0.0	11.5	12.2	11.8	11.6
08:00 - 08:59	12.9	13.7	13.7	13.7	14.0	13.9	0.0	0.0	0.0	0.0	0.0	11.5	12.1	11.9	11.3
09:00 - 09:59	12.9	13.7	13.1	13.8	13.8	13.8	8.9	0.0	0.0	0.0	0.0	10.7	2.3	11.4	11.1
10:00 - 10:59	12.7	13.5	12.7	12.8	13.5	13.3	13.1	0.0	0.0	0.0	0.0	10.2	0.0	10.6	10.5
11:00 - 11:59	12.7	13.2	13.1	13.2	10.1	13.4	12.9	0.0	0.0	0.0	10.4	10.5	0.0	10.6	11.1
12:00 - 12:59	13.2	13.1	12.0	13.3	13.1	13.1	12.8	0.0	0.0	0.0	10.4	10.6	0.0	10.8	10.9
13:00 - 13:59	13.0	13.0	12.9	13.0	13.2	12.7	12.8	0.0	0.0	0.0	10.8	10.6	2.5	10.8	9.9
14:00 - 14:59	12.5	12.5	13.9	13.2	13.2	12.6	12.4	0.0	0.0	0.0	10.9	10.4	10.4	10.6	10.3
15:00 - 15:59	12.7	13.1	12.7	13.0	13.1	12.6	12.4	0.0	0.0	0.0	10.6	10.5	10.3	10.6	6.7
16:00 - 16:59	13.2	13.0	13.3	13.4	13.0	3.1	12.2	0.0	0.0	0.0	10.8	10.3	10.2	10.1	1.9
17:00 - 17:59	13.1	13.3	12.8	13.4	13.3	0.0	12.5	0.0	0.0	0.0	10.2	10.3	10.5	10.2	10.2
18:00 - 18:59	13.4	13.4	13.3	13.1	13.0	0.0	12.9	0.0	0.0	0.0	10.6	11.1	10.8	10.6	10.7
19:00 - 19:59	13.5	12.8	13.0	13.3	13.4	0.0	13.0	0.0	0.0	0.0	11.0	12.2	11.8	11.3	10.9
20:00 - 20:59	13.3	13.4	12.9	13.4	13.4	0.0	12.9	0.0	0.0	0.0	10.9	11.0	11.6	12.2	11.4
21:00 - 21:59	13.4	13.4	14.9	13.3	13.5	0.0	12.9	0.0	0.0	0.0	10.8	11.2	11.3	12.2	11.8
22:00 - 22:59	13.5	13.3	15.7	13.5	13.6	0.0	13.0	0.0	0.0	0.0	11.4	11.1	11.1	11.5	11.7
23:00 - 23:59	13.5	13.1	65.2	13.5	13.5	0.0	15.5	0.0	0.0	0.0	11.0	11.4	10.9	10.8	11.6

Time	16-Nov	17-Nov	18-Nov	19-Nov	20-Nov	21-Nov	22-Nov	23-Nov	24-Nov	25-Nov	26-Nov	27-Nov	28-Nov	29-Nov	30-Nov
00:00 - 00:59	11.0	11.3	11.8	12.9	13.1	12.9	13.3	13.4	13.3	13.1	13.2	12.8	13.1	13.4	0.0
01:00 - 01:59	11.4	11.6	11.7	12.7	12.9	12.9	12.8	13.6	13.1	13.0	13.2	13.2	13.2	13.4	0.0
02:00 - 02:59	11.6	11.1	11.6	12.5	13.1	12.7	12.9	13.1	13.1	12.7	13.1	13.8	13.1	13.4	0.0
03:00 - 03:59	11.0	10.9	11.6	12.8	12.9	13.1	13.0	13.6	13.2	12.9	13.4	13.2	13.3	13.4	0.0
04:00 - 04:59	11.5	11.1	11.9	12.7	12.9	12.8	13.2	13.7	13.2	12.6	12.3	12.6	13.1	13.7	0.0
05:00 - 05:59	11.0	11.1	11.9	12.8	13.0	12.9	13.2	13.2	13.1	13.1	0.0	12.7	13.7	13.9	0.0
06:00 - 06:59	11.6	11.2	12.1	13.0	12.7	12.8	13.4	13.0	13.0	13.4	0.0	13.4	13.6	13.5	0.0
07:00 - 07:59	12.0	11.7	12.1	13.0	13.2	13.1	13.9	14.0	13.0	13.4	0.0	13.6	13.9	13.9	0.0
08:00 - 08:59	11.2	11.3	12.3	13.4	13.5	13.2	13.9	14.0	13.0	13.7	0.0	13.5	13.8	14.2	0.0
09:00 - 09:59	11.0	11.3	12.5	13.0	13.6	13.1	13.4	13.3	13.1	13.5	0.0	13.2	13.6	14.0	0.0
10:00 - 10:59	10.9	11.3	11.9	13.0	12.4	12.3	12.7	12.9	13.1	12.8	0.0	13.1	13.5	13.3	4.9
11:00 - 11:59	11.2	9.0	12.3	13.1	12.8	13.1	12.7	13.7	13.2	13.3	0.0	14.0	13.9	13.3	4.8
12:00 - 12:59	10.9	9.5	11.4	13.3	12.2	12.4	13.2	13.3	13.5	13.3	0.0	13.8	13.4	13.5	6.5
13:00 - 13:59	11.0	11.1	12.0	12.6	12.5	12.7	13.0	13.1	13.3	12.3	0.0	13.6	12.8	13.8	13.4
14:00 - 14:59	10.7	9.4	11.8	12.4	12.8	12.4	12.8	13.2	13.1	12.9	11.1	13.2	12.5	13.5	12.7
15:00 - 15:59	10.4	55.7	12.9	12.1	12.6	12.3	12.3	12.3	12.9	0.0	13.0	13.0	12.8	12.8	12.7
16:00 - 16:59	10.2	25.7	12.5	12.4	12.7	12.0	12.1	12.4	12.7	0.0	12.7	12.9	12.8	12.6	13.2
17:00 - 17:59	10.6	11.4	12.5	12.4	12.6	12.2	12.4	12.6	12.4	0.0	12.4	13.1	12.2	12.6	13.2
18:00 - 18:59	10.9	11.6	12.4	12.5	12.9	12.8	13.1	13.2	12.9	5.9	13.1	13.2	12.8	13.1	13.3
19:00 - 19:59	11.0	11.8	12.6	12.9	13.0	13.1	13.4	13.4	13.2	13.2	13.3	13.1	13.1	13.5	13.4
20:00 - 20:59	10.9	12.2	13.0	13.1	12.7	13.0	13.2	13.0	13.4	13.1	13.2	13.1	13.1	14.0	13.8
21:00 - 21:59	10.9	12.2	13.0	13.0	12.9	12.8	13.2	13.3	13.5	13.1	13.3	13.0	13.3	0.9	13.3
22:00 - 22:59	11.2	12.2	13.0	13.1	13.0	12.7	12.6	13.1	13.2	13.3	13.3	13.0	12.6	0.0	13.2
23:00 - 23:59	11.2	12.0	13.0	13.2	12.9	13.3	12.8	13.5	13.4	13.4	13.5	13.3	13.2	0.0	13.5

Remark: GT#12 Borosopic Inspection from 07 Nov 25 to 12 Nov 25.

Unit 2 PM - December 2025

Time	1-Dec	2-Dec	3-Dec	4-Dec	5-Dec	6-Dec	7-Dec	8-Dec	9-Dec	10-Dec	11-Dec	12-Dec	13-Dec	14-Dec	15-Dec
00:00 - 00:59	13.8	13.7	13.6	14.0	14.0	14.4	14.5	14.4	13.8	14.4	14.5	14.6	14.7	13.9	14.8
01:00 - 01:59	13.7	13.8	14.2	13.5	13.8	14.1	14.2	13.9	14.5	13.5	14.2	14.5	14.7	13.9	14.5
02:00 - 02:59	14.0	13.6	13.9	13.9	14.0	14.2	14.3	14.6	14.6	14.3	14.2	14.3	14.5	14.0	14.2
03:00 - 03:59	13.2	13.5	14.1	14.1	13.7	13.7	14.2	14.2	15.2	14.4	14.4	14.4	14.5	13.9	14.1
04:00 - 04:59	13.4	13.6	14.1	13.8	13.8	14.2	14.4	14.1	14.2	14.8	14.0	13.9	14.4	14.4	14.0
05:00 - 05:59	13.4	13.8	14.1	14.0	13.9	14.5	14.1	14.1	14.1	14.0	14.0	13.9	14.4	14.1	14.5
06:00 - 06:59	13.4	13.8	14.1	14.5	14.1	14.3	13.9	14.2	14.1	14.4	13.9	14.4	14.1	14.3	14.3
07:00 - 07:59	13.8	14.5	14.4	14.4	14.4	13.9	14.5	14.7	15.0	14.7	15.1	14.4	14.9	14.8	15.1
08:00 - 08:59	14.8	14.2	14.6	14.4	14.1	14.8	14.9	15.1	15.2	14.6	14.4	14.6	14.8	15.0	14.5
09:00 - 09:59	13.6	13.8	14.0	14.4	14.2	14.7	14.5	14.5	14.3	14.5	14.2	14.4	14.7	14.8	14.4
10:00 - 10:59	13.2	13.4	13.7	13.9	14.0	14.1	14.1	14.1	14.1	14.1	14.1	14.1	14.5	14.1	14.0
11:00 - 11:59	13.7	14.2	14.1	14.2	14.3	14.3	14.5	14.4	14.6	14.3	14.2	14.7	14.5	14.5	14.1
12:00 - 12:59	13.7	13.9	14.1	14.1	13.9	14.2	14.3	14.4	14.1	14.5	14.2	14.4	14.7	14.3	13.6
13:00 - 13:59	13.4	13.4	14.2	14.0	14.2	14.3	14.4	14.2	14.3	14.5	14.3	14.6	14.7	14.7	14.3
14:00 - 14:59	12.9	14.0	14.2	13.9	13.6	14.0	14.1	14.3	14.4	14.2	14.4	14.2	14.5	14.5	14.3
15:00 - 15:59	12.6	14.1	13.8	13.9	13.2	13.7	14.0	14.2	14.3	14.3	14.5	14.1	14.3	14.3	14.0
16:00 - 16:59	13.1	13.2	13.7	13.4	13.2	13.7	13.4	14.1	13.9	13.9	14.0	13.5	13.9	14.1	13.5
17:00 - 17:59	12.7	13.4	13.5	13.3	13.4	13.2	13.4	14.4	13.7	13.6	13.7	13.2	13.8	13.7	13.5
18:00 - 18:59	13.1	13.7	13.7	13.6	13.5	13.7	13.7	14.5	13.9	14.0	14.2	14.1	14.1	14.5	14.0
19:00 - 19:59	13.5	14.1	13.9	13.9	14.0	14.1	14.3	14.5	14.3	14.4	14.5	14.2	14.2	14.6	14.1
20:00 - 20:59	14.0	14.4	14.4	14.2	14.2	14.1	14.8	14.5	14.5	14.6	14.3	14.4	14.1	14.7	14.3
21:00 - 21:59	14.0	14.4	14.3	14.4	14.3	14.4	14.7	14.6	14.7	14.6	14.6	14.6	14.2	14.6	14.2
22:00 - 22:59	13.1	14.1	14.0	14.4	14.4	14.5	14.8	14.5	14.7	14.4	14.6	14.7	14.4	14.7	14.3
23:00 - 23:59	13.5	14.3	14.2	14.5	14.4	14.0	14.7	14.0	14.7	14.3	14.4	14.7	14.2	14.6	14.1

Time	16-Dec	17-Dec	18-Dec	19-Dec	20-Dec	21-Dec	22-Dec	23-Dec	24-Dec	25-Dec	26-Dec	27-Dec	28-Dec	29-Dec	30-Dec	31-Dec
00:00 - 00:59	14.0	14.2	14.1	14.1	14.4	14.3	14.1	14.6	14.2	14.3	14.4	14.3	14.5	14.7	14.3	14.7
01:00 - 01:59	13.8	13.9	13.9	13.2	14.1	14.6	14.2	14.4	14.2	14.3	14.5	14.3	14.5	14.8	15.1	14.6
02:00 - 02:59	14.0	14.4	13.7	13.9	13.9	14.0	14.0	14.1	14.3	14.7	14.7	14.6	15.1	14.5	13.6	14.8
03:00 - 03:59	13.9	14.0	14.4	14.5	14.3	13.5	13.9	14.0	14.5	14.8	14.4	14.3	14.0	14.2	14.3	14.9
04:00 - 04:59	14.1	14.0	14.4	14.4	14.3	14.9	13.7	14.5	14.2	13.7	14.9	14.4	14.8	14.1	14.5	14.6
05:00 - 05:59	14.2	14.1	14.2	14.4	14.2	14.3	14.1	13.8	14.3	14.3	14.6	14.4	14.5	14.3	14.7	14.6
06:00 - 06:59	13.9	14.1	14.0	14.4	14.3	13.8	14.1	14.1	14.3	14.3	14.5	14.4	13.9	15.0	14.5	14.2
07:00 - 07:59	14.4	14.2	14.4	14.5	14.4	14.6	14.4	14.4	14.2	14.9	14.2	14.2	14.4	14.2	14.7	14.3
08:00 - 08:59	15.2	14.6	14.5	15.0	15.1	14.8	14.7	15.0	15.3	14.9	15.3	15.0	15.5	15.1	15.5	15.1
09:00 - 09:59	14.4	14.3	14.4	14.6	14.7	14.6	14.6	15.0	14.8	14.8	14.9	14.9	14.9	15.0	14.9	14.9
10:00 - 10:59	13.6	14.1	14.2	14.0	13.9	14.2	14.2	14.3	14.3	14.4	14.2	14.5	14.3	14.4	14.4	14.3
11:00 - 11:59	14.1	14.0	14.1	14.1	14.2	14.2	14.1	14.2	14.2	14.1	14.2	14.6	14.5	14.4	14.5	14.1
12:00 - 12:59	14.2	14.2	14.1	14.4	14.2	14.2	14.1	14.4	14.0	14.3	14.3	14.0	14.0	14.6	14.4	14.7
13:00 - 13:59	14.1	14.3	14.4	14.3	14.3	14.4	14.4	14.2	14.2	14.3	14.3	13.9	14.5	14.4	13.9	14.2
14:00 - 14:59	13.7	14.2	13.9	13.9	13.9	14.3	14.1	13.5	13.9	14.0	14.0	13.9	14.1	14.0	13.7	14.2
15:00 - 15:59	13.2	14.1	13.8	13.8	13.6	14.1	14.2	13.5	13.8	13.8	14.2	13.6	13.4	13.9	13.7	13.6
16:00 - 16:59	13.5	13.6	13.7	13.1	12.8	13.7	13.8	13.5	13.3	13.2	13.7	13.7	13.8	13.8	14.0	14.0
17:00 - 17:59	13.6	13.7	13.2	13.5	13.5	13.8	13.6	13.7	13.7	13.9	13.3	14.0	14.0	13.6	14.1	14.0
18:00 - 18:59	14.1	14.5	14.1	13.9	14.1	14.0	13.8	14.1	14.3	14.2	13.6	14.4	14.3	14.2	14.0	14.3
19:00 - 19:59	14.3	14.6	13.7	14.0	14.4	14.4	14.3	14.5	14.6	14.6	14.1	14.4	14.4	14.6	14.2	14.6
20:00 - 20:59	14.3	14.3	13.6	13.9	14.5	14.5	14.4	14.3	14.4	14.6	14.3	14.6	14.3	14.2	14.0	14.4
21:00 - 21:59	14.5	14.3	13.9	14.2	14.6	14.4	14.5	14.1	14.0	14.7	13.9	14.5	14.3	14.1	14.2	14.5
22:00 - 22:59	14.4	14.3	14.2	14.2	13.9	14.4	14.0	14.1	14.1	14.8	13.8	14.4	14.4	14.3	14.3	14.1
23:00 - 23:59	13.8	14.3	14.0	13.9	14.1	14.0	14.0	14.2	14.5	13.6	14.3	13.9	14.3	14.4	14.4	14.0

Unit 2 PM - January 2026

Time	1-Jan	2-Jan	3-Jan	4-Jan	5-Jan	6-Jan	7-Jan	8-Jan	9-Jan	10-Jan	11-Jan	12-Jan	13-Jan	14-Jan	15-Jan
00:00 - 00:59	14.7	14.5	14.4	14.2	14.7	14.6	14.6	14.9	14.6	14.6	14.8	14.9	14.5	14.5	14.6
01:00 - 01:59	14.5	14.9	14.5	14.4	14.1	14.5	14.4	14.4	14.5	14.5	14.8	14.9	14.0	14.5	14.8
02:00 - 02:59	14.6	14.4	14.5	14.1	14.5	14.2	14.5	14.2	14.5	14.8	14.0	14.4	14.1	14.7	14.4
03:00 - 03:59	14.1	14.6	14.7	14.6	15.1	14.8	14.3	14.8	14.3	14.4	14.8	14.6	14.3	14.5	15.2
04:00 - 04:59	13.9	14.5	14.2	14.0	14.4	14.9	14.8	14.9	13.8	14.5	14.9	14.7	14.7	14.6	14.8
05:00 - 05:59	14.9	14.2	14.4	14.3	13.6	14.4	14.6	14.8	14.2	14.7	14.1	14.7	14.6	14.4	14.6
06:00 - 06:59	13.8	14.1	14.5	14.6	14.3	13.9	14.3	14.2	14.3	14.6	15.0	14.6	14.1	14.5	14.5
07:00 - 07:59	14.7	14.2	14.8	14.4	14.8	14.6	14.7	14.7	14.6	14.9	15.0	14.8	15.0	14.8	14.4
08:00 - 08:59	15.3	15.2	14.5	14.9	15.4	15.4	14.9	15.0	15.3	15.0	15.3	14.8	15.3	15.1	15.0
09:00 - 09:59	14.8	15.0	15.0	14.5	14.9	14.9	15.2	15.0	15.3	15.0	14.9	14.9	15.1	14.9	14.7
10:00 - 10:59	14.4	14.1	14.2	14.3	14.3	14.5	14.5	14.3	14.5	14.6	14.4	14.8	14.6	14.8	15.1
11:00 - 11:59	14.3	13.9	14.4	14.7	14.4	14.4	14.2	14.4	14.6	14.5	14.7	14.7	14.6	15.2	14.9
12:00 - 12:59	14.3	14.7	14.3	14.5	14.4	14.6	14.6	14.7	14.6	14.6	14.9	14.3	14.8	14.9	14.3
13:00 - 13:59	14.7	14.3	14.1	14.5	14.2	14.6	14.6	14.4	14.4	14.5	14.6	14.8	14.6	14.2	14.8
14:00 - 14:59	13.9	14.4	14.2	14.1	14.1	13.9	14.2	14.4	14.1	14.1	14.7	14.8	14.2	14.4	14.8
15:00 - 15:59	14.2	13.9	14.1	13.8	13.6	13.9	14.0	14.1	14.2	14.1	14.3	14.2	14.0	14.5	14.2
16:00 - 16:59	14.0	13.6	13.2	14.2	13.6	13.6	14.1	13.9	13.9	14.1	14.2	13.9	13.9	14.4	14.5
17:00 - 17:59	13.9	13.9	13.7	14.3	13.9	14.2	14.1	14.0	14.1	14.1	14.3	14.1	14.3	14.4	14.7
18:00 - 18:59	14.0	14.3	14.0	14.5	14.5	14.5	14.1	14.5	14.4	14.5	14.5	14.1	14.5	14.8	14.4
19:00 - 19:59	14.5	14.8	13.7	14.6	14.8	14.8	14.7	14.7	14.7	14.7	14.7	14.6	14.8	15.0	14.7
20:00 - 20:59	14.3	14.2	13.9	14.4	14.5	14.9	14.4	14.9	14.7	14.7	14.5	14.7	14.7	14.5	14.7
21:00 - 21:59	13.9	13.7	14.5	13.9	14.3	14.7	14.3	14.8	14.6	14.8	14.8	14.9	14.5	14.2	14.1
22:00 - 22:59	14.1	14.4	14.2	14.4	14.1	13.6	14.1	14.8	13.9	14.0	14.1	15.0	14.6	14.6	14.0
23:00 - 23:59	14.3	14.4	14.0	14.5	14.4	14.6	14.5	14.1	14.4	14.6	14.6	14.7	14.2	14.5	14.4

Time	16-Jan	17-Jan	18-Jan	19-Jan	20-Jan	21-Jan	22-Jan	23-Jan	24-Jan	25-Jan	26-Jan	27-Jan	28-Jan	29-Jan	30-Jan	31-Jan
00:00 - 00:59	15.0	14.9	14.6	14.6	14.6	14.7	14.5	14.9	15.2	14.7	14.7	14.5	14.7	14.8	14.8	0.0
01:00 - 01:59	14.4	14.8	14.5	14.7	14.6	14.7	15.1	15.0	14.9	14.6	14.7	14.9	15.0	14.9	14.7	0.0
02:00 - 02:59	14.4	14.6	14.5	14.8	14.6	14.8	14.6	15.0	14.7	15.2	14.6	14.5	14.5	14.9	15.0	0.0
03:00 - 03:59	14.6	14.5	14.8	14.7	15.1	14.3	15.1	14.5	14.6	14.5	15.2	15.4	15.5	14.6	14.6	0.0
04:00 - 04:59	14.7	14.5	14.8	14.3	14.9	14.7	14.7	14.6	14.8	14.7	14.7	14.6	14.9	14.5	15.2	0.0
05:00 - 05:59	14.7	14.7	14.5	14.5	14.8	15.3	14.6	14.5	14.2	15.2	14.8	14.8	14.9	15.2	15.8	0.0
06:00 - 06:59	14.5	14.7	14.6	15.1	14.6	14.1	14.7	14.2	14.4	14.6	14.7	14.9	14.8	15.0	0.0	0.0
07:00 - 07:59	14.6	14.7	14.7	15.0	14.4	14.6	14.7	14.9	15.2	14.7	15.0	14.9	15.1	15.1	0.0	0.0
08:00 - 08:59	14.7	15.1	15.4	15.3	15.0	15.3	15.1	15.1	14.9	15.1	15.1	15.2	15.2	15.3	0.0	0.0
09:00 - 09:59	15.0	14.8	15.4	14.8	15.0	15.2	15.2	15.1	15.0	15.1	15.0	15.2	15.0	15.2	0.0	0.0
10:00 - 10:59	14.7	14.5	14.6	14.4	14.6	14.8	14.8	15.0	14.9	14.8	14.8	15.1	14.7	14.9	0.0	0.0
11:00 - 11:59	14.3	14.6	14.6	14.7	14.7	14.8	14.6	14.7	15.0	15.1	15.1	19.2	14.9	14.7	0.0	0.0
12:00 - 12:59	14.6	14.6	15.0	14.9	14.6	14.9	14.6	15.1	15.0	15.0	14.8	29.5	14.9	14.9	0.0	0.0
13:00 - 13:59	14.8	14.3	14.4	14.7	14.7	14.7	14.6	15.0	14.5	14.9	14.7	21.9	15.0	14.6	0.0	0.0
14:00 - 14:59	14.7	14.4	14.4	14.4	14.5	14.7	14.9	14.7	14.7	14.7	14.7	14.1	14.8	14.4	0.0	0.0
15:00 - 15:59	14.6	14.1	14.4	14.0	14.3	14.3	14.4	14.8	14.0	14.1	14.4	14.2	14.3	14.2	0.0	0.0
16:00 - 16:59	14.2	14.0	13.9	14.1	14.2	13.9	14.1	14.4	14.0	14.2	14.2	14.5	14.2	14.1	0.0	0.0
17:00 - 17:59	14.2	14.0	14.0	14.3	14.1	14.2	14.4	14.3	14.2	14.6	14.4	13.9	14.0	14.4	0.0	0.0
18:00 - 18:59	14.5	14.4	14.2	14.4	14.4	14.6	14.7	14.6	14.7	14.6	14.7	14.7	14.7	14.5	0.0	0.0
19:00 - 19:59	14.5	14.8	14.8	14.6	14.6	14.7	14.9	14.8	14.8	14.7	14.8	14.6	14.6	14.7	0.0	0.0
20:00 - 20:59	14.8	14.8	14.7	14.1	14.7	14.6	14.4	14.8	14.4	14.1	14.6	14.9	14.3	14.2	0.0	0.0
21:00 - 21:59	14.6	14.8	14.2	14.3	14.4	14.5	14.3	14.7	14.4	14.4	14.2	14.9	14.0	14.3	0.0	0.0
22:00 - 22:59	14.3	14.7	14.4	14.4	14.1	14.3	14.4	14.1	14.4	14.6	14.7	14.5	14.6	14.6	0.0	0.0
23:00 - 23:59	14.1	13.8	14.2	14.5	14.5	14.5	14.6	14.6	14.4	14.4	14.5	14.3	14.6	14.7	0.0	0.0

Remark: Plant shutdown from 30 Jan 26 to 01 Feb 26 due to Steel Mill-Thapyaywa Line Maintenance

Unit 2 PM (ppmv) -February 2026

Time	1-Feb	2-Feb	3-Feb	4-Feb	5-Feb	6-Feb	7-Feb	8-Feb	9-Feb	10-Feb	11-Feb	12-Feb	13-Feb	14-Feb
00:00 - 00:59	0.0	0.0	15.5	15.3	15.8	15.5	15.5	15.6	15.5	15.4	15.4	15.7	15.7	15.8
01:00 - 01:59	0.0	0.0	15.8	15.9	15.3	15.8	15.9	15.8	15.9	15.6	15.6	15.5	15.6	15.4
02:00 - 02:59	0.0	0.0	15.5	15.5	15.5	15.5	15.2	15.4	15.3	15.6	15.5	15.5	15.5	15.7
03:00 - 03:59	0.0	0.0	15.8	15.4	15.9	15.7	15.8	15.9	15.6	15.5	15.2	15.6	15.1	15.8
04:00 - 04:59	0.0	0.0	15.1	15.6	14.8	15.7	15.6	15.3	15.5	15.0	15.5	15.4	15.3	15.1
05:00 - 05:59	0.0	0.0	15.6	15.3	15.7	15.4	15.2	15.3	15.3	15.3	15.2	15.6	15.8	14.9
06:00 - 06:59	0.0	0.0	15.7	15.5	16.2	15.6	15.3	15.1	15.6	15.7	15.6	15.5	15.5	15.4
07:00 - 07:59	0.0	0.0	15.4	15.6	14.9	15.6	16.0	15.4	15.6	15.9	15.5	16.1	15.3	15.5
08:00 - 08:59	0.0	0.0	15.5	16.2	16.3	15.9	16.2	16.1	15.7	16.2	16.3	16.1	16.4	16.2
09:00 - 09:59	0.0	0.0	15.8	16.1	16.0	16.0	15.7	16.1	15.7	15.6	15.3	15.3	16.1	16.3
10:00 - 10:59	0.0	15.1	15.3	14.9	15.1	15.6	15.7	15.5	15.4	14.7	15.1	15.2	15.2	15.6
11:00 - 11:59	0.0	15.4	15.5	15.1	15.4	15.4	15.2	15.5	15.5	15.3	15.4	15.5	15.6	15.8
12:00 - 12:59	0.0	15.6	15.5	15.2	15.4	15.7	15.4	15.5	15.3	15.2	15.4	15.7	15.3	15.7
13:00 - 13:59	0.0	15.4	15.3	15.4	15.3	15.0	15.6	15.7	15.5	15.1	15.5	15.5	15.8	15.5
14:00 - 14:59	0.0	15.4	15.4	15.3	15.0	15.3	15.4	15.5	15.3	15.4	15.3	17.8	15.5	15.4
15:00 - 15:59	0.0	15.2	15.2	15.3	14.7	14.7	14.6	14.9	14.7	15.1	14.7	102.9	15.3	15.3
16:00 - 16:59	0.0	15.1	15.2	15.3	14.7	14.5	14.6	15.1	14.8	15.4	14.6	243.6	15.0	15.3
17:00 - 17:59	0.0	15.2	15.2	15.4	15.0	14.6	14.7	15.1	15.0	15.1	14.9	15.6	15.0	15.3
18:00 - 18:59	0.0	15.4	15.4	15.5	15.2	14.9	15.4	15.1	14.9	15.0	15.1	15.3	15.3	14.9
19:00 - 19:59	0.0	15.6	15.4	15.8	15.4	15.4	15.5	14.9	14.9	14.8	15.3	15.1	15.4	15.2
20:00 - 20:59	0.0	15.6	15.6	15.2	15.3	15.2	15.4	15.0	15.2	14.9	15.4	15.1	15.2	15.2
21:00 - 21:59	0.0	15.6	15.7	15.0	15.0	15.5	15.1	15.0	15.4	15.1	15.1	14.8	14.9	15.6
22:00 - 22:59	0.0	15.2	15.5	15.4	15.0	15.2	15.1	15.3	15.7	15.2	15.5	15.5	15.4	15.8
23:00 - 23:59	0.0	15.9	14.9	15.6	15.3	15.5	15.2	15.3	15.1	15.2	15.7	15.6	15.2	15.8

Time	15-Feb	16-Feb	17-Feb	18-Feb	19-Feb	20-Feb	21-Feb	22-Feb	23-Feb	24-Feb	25-Feb	26-Feb	27-Feb	28-Feb
00:00 - 00:59	15.8	15.8	15.8	15.7	16.1	15.8	16.1	16.0	15.6	15.9	16.1	16.0	16.0	16.1
01:00 - 01:59	15.8	16.0	15.7	16.0	15.3	15.9	15.9	15.9	15.9	15.6	15.8	16.0	16.2	16.2
02:00 - 02:59	15.9	15.8	15.8	15.9	15.5	15.6	15.8	15.8	15.1	15.6	16.0	15.9	16.2	15.5
03:00 - 03:59	15.9	15.7	15.3	15.8	16.4	15.9	15.9	15.8	15.6	16.1	15.7	16.0	15.9	15.4
04:00 - 04:59	15.7	15.6	15.6	15.8	15.3	15.2	16.1	16.0	15.7	15.9	15.8	16.2	15.9	15.8
05:00 - 05:59	15.4	15.4	15.6	15.3	15.6	15.5	16.0	15.8	15.8	15.9	15.8	16.3	16.4	15.5
06:00 - 06:59	15.7	15.6	15.7	16.1	16.0	16.0	16.1	15.6	16.0	15.8	16.2	16.4	16.1	15.9
07:00 - 07:59	15.8	15.7	15.6	16.1	16.3	16.1	16.2	16.4	16.2	16.0	16.2	16.6	16.1	16.1
08:00 - 08:59	16.1	16.4	16.2	16.1	16.2	16.0	16.4	15.9	16.3	16.3	15.9	16.7	16.2	16.7
09:00 - 09:59	16.1	16.3	16.6	16.4	15.9	15.9	16.4	15.9	16.2	16.3	15.9	16.8	16.4	16.4
10:00 - 10:59	15.6	15.4	15.7	15.8	15.7	16.1	15.7	15.5	15.8	15.9	15.9	16.0	15.8	15.8
11:00 - 11:59	15.5	15.5	16.0	15.8	15.9	15.8	15.8	15.9	15.6	16.1	16.5	16.1	16.1	15.9
12:00 - 12:59	15.5	16.0	15.7	15.9	15.9	15.9	16.1	16.2	16.0	15.9	16.0	15.9	15.7	16.2
13:00 - 13:59	15.4	15.7	15.8	15.7	15.8	15.8	15.6	16.2	16.4	15.8	15.6	15.7	15.6	15.4
14:00 - 14:59	15.4	15.7	15.8	15.5	15.8	15.7	15.9	15.9	16.8	15.5	15.8	16.0	15.9	15.7
15:00 - 15:59	14.9	15.6	15.7	16.7	15.7	15.5	15.8	15.6	17.2	15.6	15.7	15.5	15.4	15.7
16:00 - 16:59	15.1	15.6	15.4	16.1	15.7	15.8	15.4	15.3	15.7	15.6	15.6	15.5	15.2	15.7
17:00 - 17:59	15.3	15.5	15.4	14.7	15.7	15.5	15.6	15.3	15.2	15.4	15.9	15.7	15.6	15.6
18:00 - 18:59	15.2	15.6	15.5	13.2	15.4	15.6	15.6	15.7	15.3	15.4	15.6	16.0	15.9	15.7
19:00 - 19:59	15.4	15.7	15.7	11.8	15.7	15.6	15.8	15.9	16.0	15.7	15.5	16.1	15.6	16.0
20:00 - 20:59	15.1	15.7	15.9	10.4	15.1	15.9	15.8	15.6	16.0	15.9	16.0	15.8	15.8	15.7
21:00 - 21:59	15.1	15.4	16.1	8.9	15.9	15.7	15.4	15.4	15.8	15.9	16.0	15.8	16.3	15.7
22:00 - 22:59	15.9	15.3	15.4	15.2	15.4	15.2	15.8	15.7	15.5	15.8	16.1	16.0	15.6	16.0
23:00 - 23:59	15.8	15.2	15.2	15.9	15.6	15.7	15.8	15.9	16.2	15.9	16.0	15.3	15.9	16.0

Remark: Plant shutdown from 30 Jan 26 to 01 Feb 26 due to Steel Mill-Thapyaywa Line Maintenance

Unit 2 PM - March 2026

Time	1-Mar	2-Mar	3-Mar	4-Mar	5-Mar	6-Mar	7-Mar	8-Mar	9-Mar	10-Mar	11-Mar	12-Mar	13-Mar	14-Mar	15-Mar
00:00 - 00:59	16.0	15.4	16.3	15.5	15.8	15.8	16.0	15.8	16.3	16.3	16.0	16.5	16.4	16.4	16.2
01:00 - 01:59	16.1	15.3	15.9	15.6	15.9	16.0	16.0	15.8	16.5	16.2	16.2	16.2	15.7	16.2	16.1
02:00 - 02:59	16.1	15.3	16.0	15.9	15.7	15.8	16.0	15.9	16.6	15.9	16.2	16.2	16.1	16.3	16.1
03:00 - 03:59	15.6	15.3	15.9	15.9	15.7	15.9	16.1	15.7	16.7	16.3	16.2	16.4	16.4	16.1	16.2
04:00 - 04:59	16.1	15.3	16.2	16.0	15.6	16.1	16.1	15.6	16.5	16.0	16.2	16.4	16.4	16.3	16.2
05:00 - 05:59	16.2	16.0	15.8	15.8	15.4	15.3	16.2	15.4	16.6	16.2	16.2	16.5	16.2	16.2	16.4
06:00 - 06:59	15.5	15.5	15.5	15.5	15.8	16.1	16.2	15.9	16.4	16.2	16.2	16.3	16.8	16.4	16.3
07:00 - 07:59	16.5	15.9	16.2	15.6	16.1	16.0	16.2	16.8	16.6	16.4	16.5	16.5	15.6	16.7	16.5
08:00 - 08:59	16.1	16.5	16.2	16.6	16.2	16.0	16.4	15.6	16.3	16.5	16.7	16.7	16.6	16.9	16.7
09:00 - 09:59	16.4	16.6	16.5	15.7	16.1	16.2	16.5	14.4	16.5	16.7	16.7	16.7	16.7	16.9	16.7
10:00 - 10:59	16.0	16.6	15.7	15.8	15.8	16.0	16.1	13.1	15.8	16.2	16.2	16.6	15.9	16.6	16.1
11:00 - 11:59	16.1	16.4	15.9	16.1	16.1	15.9	16.4	11.9	16.5	16.3	16.1	16.3	16.0	16.7	15.8
12:00 - 12:59	16.2	16.1	16.1	15.8	15.9	16.0	16.1	17.2	16.1	16.1	16.3	16.4	15.7	16.4	16.0
13:00 - 13:59	16.2	15.5	16.1	15.8	15.9	15.8	16.1	15.9	16.1	16.0	16.0	16.2	15.8	16.3	15.9
14:00 - 14:59	15.4	15.7	15.9	16.1	16.0	15.7	16.0	15.5	17.6	16.4	16.3	16.3	15.9	16.2	16.2
15:00 - 15:59	15.7	16.0	15.9	15.5	15.7	15.6	15.8	15.1	23.6	16.0	16.0	16.0	16.0	16.1	16.0
16:00 - 16:59	15.9	15.1	15.8	15.9	15.7	15.6	15.6	14.8	29.6	16.0	15.6	16.1	15.9	15.9	15.7
17:00 - 17:59	15.8	15.4	15.7	15.7	15.7	15.7	15.6	14.5	35.5	15.6	15.6	15.3	15.8	15.6	15.9
18:00 - 18:59	15.6	15.9	16.0	15.7	15.8	15.6	15.5	14.1	41.5	15.8	16.2	15.9	15.8	15.7	16.2
19:00 - 19:59	15.5	16.0	16.1	15.7	15.4	15.7	15.7	16.0	47.5	15.7	15.9	15.9	15.9	16.0	16.1
20:00 - 20:59	15.3	15.5	16.2	15.9	15.4	15.9	15.7	16.1	16.0	15.8	16.1	15.9	16.2	16.0	16.2
21:00 - 21:59	15.6	15.5	16.1	16.1	15.7	15.8	15.7	16.1	16.1	15.9	16.3	15.9	16.2	16.1	16.1
22:00 - 22:59	15.7	15.8	16.1	16.1	15.8	15.9	15.7	16.3	16.1	15.8	16.4	15.9	16.3	16.2	16.3
23:00 - 23:59	15.6	16.0	15.6	15.8	15.9	16.0	15.8	16.4	16.3	15.9	16.4	16.2	16.3	16.2	16.5

Time	16-Mar	17-Mar	18-Mar	19-Mar	20-Mar	21-Mar	22-Mar	23-Mar	24-Mar	25-Mar	26-Mar	27-Mar	28-Mar	29-Mar	30-Mar	31-Mar
00:00 - 00:59	16.0	16.2	16.2	16.1	15.9	16.2	16.0	16.2	16.0	16.2	16.8	17.0	16.6	16.3	16.4	16.4
01:00 - 01:59	16.0	15.9	15.7	16.3	15.6	16.5	15.9	16.1	16.9	16.3	16.0	16.5	16.6	16.3	16.4	16.6
02:00 - 02:59	15.9	15.8	16.2	15.8	16.1	16.5	16.2	16.3	16.3	16.6	16.1	16.6	16.2	16.9	16.5	16.6
03:00 - 03:59	16.1	16.5	15.4	16.1	16.3	16.4	16.5	16.6	16.3	16.5	16.1	16.7	16.4	16.6	16.6	16.7
04:00 - 04:59	15.9	16.0	15.8	16.1	16.4	16.4	16.1	16.3	16.3	16.1	16.4	16.8	16.5	16.2	16.5	16.6
05:00 - 05:59	15.7	16.2	16.2	15.8	15.6	179.8	15.9	16.3	16.5	16.0	16.0	16.6	16.5	16.8	16.6	16.6
06:00 - 06:59	16.6	16.1	16.3	15.7	16.0	15.3	16.1	16.3	16.3	16.3	16.4	16.7	16.4	16.7	16.7	16.2
07:00 - 07:59	16.5	16.4	16.7	16.3	16.3	16.1	16.7	16.3	16.5	16.4	16.7	16.8	16.8	16.8	16.8	16.7
08:00 - 08:59	16.5	16.5	16.4	16.3	16.3	16.6	16.8	16.6	16.8	16.7	16.7	16.9	17.1	16.9	16.9	16.6
09:00 - 09:59	16.8	16.5	16.2	16.4	16.4	16.2	16.5	16.8	16.9	16.4	16.9	16.8	16.7	17.0	16.8	16.5
10:00 - 10:59	15.9	16.6	15.5	16.0	16.3	16.2	15.9	16.3	16.2	16.3	16.5	16.9	16.6	16.5	16.7	16.3
11:00 - 11:59	16.4	16.6	16.3	16.2	16.1	16.2	43.5	16.5	16.4	16.9	16.8	16.8	16.7	16.8	16.7	16.2
12:00 - 12:59	16.2	16.5	16.1	16.4	16.2	16.2	25.0	16.6	16.3	16.2	16.4	16.9	16.5	16.1	16.5	16.1
13:00 - 13:59	16.0	16.4	16.2	16.3	16.2	15.8	16.7	16.3	16.1	15.9	16.0	16.5	16.2	16.1	16.3	15.9
14:00 - 14:59	16.0	16.3	16.0	16.0	15.8	15.8	23.6	15.7	16.0	16.4	16.6	16.1	16.4	16.0	16.4	15.8
15:00 - 15:59	15.8	16.1	16.3	16.0	19.4	15.9	16.5	16.3	15.8	16.2	15.4	16.4	16.1	16.6	16.1	16.6
16:00 - 16:59	15.9	15.6	15.6	16.0	25.2	15.5	16.1	16.1	15.9	16.2	15.3	16.2	16.0	16.0	16.3	16.0
17:00 - 17:59	15.5	15.9	15.5	15.3	18.8	15.4	15.9	15.7	15.9	16.3	15.4	16.5	16.1	16.6	16.3	16.4
18:00 - 18:59	16.2	15.8	15.7	16.0	12.3	15.8	15.9	16.2	16.3	16.2	15.5	16.5	16.4	16.3	16.4	16.5
19:00 - 19:59	15.6	16.1	15.9	16.1	5.9	15.7	16.1	16.4	16.3	16.4	15.5	16.4	16.3	16.5	16.4	16.6
20:00 - 20:59	16.1	16.0	15.3	16.3	16.1	15.8	16.1	16.2	15.9	16.3	260.0	16.0	16.6	16.7	16.2	16.6
21:00 - 21:59	15.8	15.6	15.7	15.8	15.8	15.4	16.1	15.7	15.6	16.2	174.9	16.2	16.5	16.5	16.4	16.4
22:00 - 22:59	16.3	15.8	15.9	16.3	16.3	16.1	15.9	16.0	16.0	16.1	16.4	16.3	16.2	16.4	16.3	16.1
23:00 - 23:59	16.3	15.9	16.1	16.1	15.5	16.0	16.1	16.4	16.4	16.2	16.7	16.7	16.5	16.4	16.1	16.2

Sembcorp Myingyan Power Co., Ltd.

Central Monitoring Basin

Effluent Water Discharge to River

Table of Contents

List of Tables ii

List of Figures ii

1. Introduction 1
2. Methodology 2
3. Sampling Location 4
4. Effluent Monitoring Results 5
5. Annex - 1 Residual Chlorine 6
6. Annex - 2 Temperature Increase 18
7. Annex - 3 pH 30

List of Tables

Table 2.1 Effluent Guidelines 2

Table 2.2 Equipment Used for Effluent Monitoring at Central Monitoring Basin and River Water Temperature 3

List of Figures

Figure 3.1 Conductivity, pH and Free Chlorine Sampling Location at Central Monitoring Basin 3

Figure 3.2 Temperature sensor location at CMB 3

Figure 3.3 River Water Temperature sensor location (RWI Barge) 3

1. Introduction

Pursuant to National Environmental Quality (Emission) Guidelines Chapter 1, Paragraph 7, the specified guideline should be achieved, without dilution, at least 95% of the time that a project is operating, to be calculated as a proportion of annual operating hours. This document is for internal evidentiary record keeping purposes to prove compliance of this guideline should it be required to be proven. This report covers the following parameters which are measured continuously via online meters:

1) pH
2) Chlorine
3) Temperature increase

Moving forward, we will review our instrumentation and environmental monitoring plans to include regular and possibly continuous monitoring of:

1) Iron (currently on weekly grab sampling)
2) O&G (currently on quarterly grab sampling)
3) TSS (currently on quarterly grab sampling)
4) Temperature increase – to consider removing this monitoring since it does not apply to SMPC (evaporative cooling versus once-through cooling)

2. Methodology

The Effluent Water at the Central Monitoring Basin is monitored by pH, Conductivity, Residual Chlorine and Temperature online sensors. The River water temperature is monitored by online Temperature sensor at the River Water Intake Barge then compared to the effluent water temperature.

Table 2.1 Effluent Guidelines

Effluent Levels

Parameter	Unit	Guideline Value
Arsenic	mg/l	0.5
Cadmium	mg/l	0.1
Chromium (total)	mg/l	0.5
Copper	mg/l	0.5
Iron	mg/l	1
Lead	mg/l	0.5
Mercury	mg/l	0.005
Oil and grease	mg/l	10
pH	S.U.[a]	6-9
Temperature increase	°C	<3[b]
Total residual chlorine	mg/l	0.2
Total suspended solids	mg/l	50
Zinc	mg/l	1

[a] Standard unit

[b] Temperature increase due to discharge of once-through cooling water

Source: 2.1.1, National Environmental Quality Emission Guidelines.

Table 2.2 Equipment Used for Effluent Monitoring at Central Monitoring Basin and River Water Temperature

Rosemount pH Sensor & Liquid Analytical Transmitter pH	
Rosemount Conductivity Sensor & Liquid Analytical Transmitter Conductivity	
Rosemount Chlorine Sensor & Liquid Analytical Transmitter Residual Chlorine	
Rosemount Temperature Sensor and Transmitter Effluent Temperature	
Rosemount Temperature Sensor and Transmitter River water temperature	

3. Sampling Location

Effluent water at the Central Monitoring Basin is continuously monitored using the online sensor and transmitters. When the effluent water from the Central Monitoring Basin is within the guidelines and reached the high level, it is then pumped out to the river.



Figure 3.1 Conductivity, pH and Residual Chlorine Sampling Location at Central Monitoring Basin



Figure 3.2 Temperature Sensor Location at Central Monitoring Basin

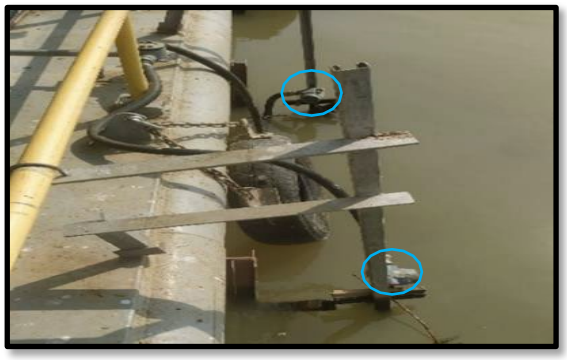


Figure 3.3 River Water Temperature Sensor Location (RWI Barge)

4. Effluent Water Result

pH, Conductivity, Residual Chlorine and Temperature of effluent water is measured continuously at the Central Monitoring Basin. River Water Inlet Temperature is measured continuously at the Barge.

Findings:

1) Residual chlorine – within limit of 0.2 ppm for 100% of annual operating hours. Please refer to hourly data in Annex - 1.
2) Temperature increase – within limit of 3 ^{o}C for 100% of annual operating hours. Please refer to hourly data in Annex - 2.
3) pH – within limit for 100% of annual operating hours. Please refer to hourly data in Annex – 3

Annex-1

Residual Chlorine (ppm) - April 2025

Time	1-Apr	2-Apr	3-Apr	4-Apr	5-Apr	6-Apr	7-Apr	8-Apr	9-Apr	10-Apr	11-Apr	12-Apr	13-Apr	14-Apr	15-Apr	NEQE Limit	Remarks
00:00 - 00:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
01:00 - 01:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
02:00 - 02:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
03:00 - 03:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
04:00 - 04:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
05:00 - 05:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
06:00 - 06:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
07:00 - 07:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
08:00 - 08:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
09:00 - 09:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
10:00 - 10:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
11:00 - 11:59	0.03	0.02	0.02	0.02	0.02	0.02	0.03	0.02	0.02	0.02	0.03	0.02	0.02	0.02	0.02	0.20	Compliant
12:00 - 12:59	0.03	0.03	0.03	0.03	0.03	0.02	0.02	0.03	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
13:00 - 13:59	0.03	0.03	0.03	0.03	0.02	0.02	0.02	0.03	0.02	0.03	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
14:00 - 14:59	0.03	0.03	0.03	0.03	0.03	0.02	0.02	0.03	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
15:00 - 15:59	0.03	0.03	0.03	0.03	0.03	0.02	0.02	0.03	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
16:00 - 16:59	0.03	0.03	0.03	0.03	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
17:00 - 17:59	0.02	0.02	0.03	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
18:00 - 18:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
19:00 - 19:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
20:00 - 20:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
21:00 - 21:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
22:00 - 22:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
23:00 - 23:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant

Time	16-Apr	17-Apr	18-Apr	19-Apr	20-Apr	21-Apr	22-Apr	23-Apr	24-Apr	25-Apr	26-Apr	27-Apr	28-Apr	29-Apr	30-Apr	NEQE Limit	Remarks
00:00 - 00:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
01:00 - 01:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
02:00 - 02:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
03:00 - 03:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
04:00 - 04:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
05:00 - 05:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
06:00 - 06:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
07:00 - 07:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
08:00 - 08:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
09:00 - 09:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
10:00 - 10:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.02	0.02	0.20	Compliant
11:00 - 11:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.02	0.02	0.03	0.02	0.02	0.20	Compliant
12:00 - 12:59	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.02	0.03	0.03	0.03	0.02	0.02	0.02	0.02	0.20	Compliant
13:00 - 13:59	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.03	0.03	0.03	0.02	0.03	0.02	0.02	0.20	Compliant
14:00 - 14:59	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.02	0.02	0.20	Compliant
15:00 - 15:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.03	0.03	0.03	0.03	0.02	0.02	0.20	Compliant
16:00 - 16:59	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.03	0.03	0.03	0.03	0.02	0.03	0.02	0.02	0.20	Compliant
17:00 - 17:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
18:00 - 18:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
19:00 - 19:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
20:00 - 20:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
21:00 - 21:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
22:00 - 22:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
23:00 - 23:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant

Residual Chlorine (ppm) - May 2025

Time	1-May	2-May	3-May	4-May	5-May	6-May	7-May	8-May	9-May	10-May	11-May	12-May	13-May	14-May	15-May	NEQE Limit	Remarks
00:00 - 00:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
01:00 - 01:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
02:00 - 02:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
03:00 - 03:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
04:00 - 04:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
05:00 - 05:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
06:00 - 06:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
07:00 - 07:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
08:00 - 08:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
09:00 - 09:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
10:00 - 10:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
11:00 - 11:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
12:00 - 12:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
13:00 - 13:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.02	0.02	0.02	0.02	0.20	Compliant
14:00 - 14:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
15:00 - 15:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.03	0.02	0.02	0.03	0.02	0.20	Compliant
16:00 - 16:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
17:00 - 17:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
18:00 - 18:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
19:00 - 19:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
20:00 - 20:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
21:00 - 21:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
22:00 - 22:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
23:00 - 23:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant

Time	16-May	17-May	18-May	19-May	20-May	21-May	22-May	23-May	24-May	25-May	26-May	27-May	28-May	29-May	30-May	31-May	NEQE Limit	Remarks
00:00 - 00:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
01:00 - 01:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
02:00 - 02:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
03:00 - 03:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
04:00 - 04:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
05:00 - 05:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
06:00 - 06:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
07:00 - 07:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
08:00 - 08:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
09:00 - 09:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
10:00 - 10:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
11:00 - 11:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
12:00 - 12:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
13:00 - 13:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
14:00 - 14:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
15:00 - 15:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
16:00 - 16:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
17:00 - 17:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
18:00 - 18:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
19:00 - 19:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
20:00 - 20:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
21:00 - 21:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
22:00 - 22:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
23:00 - 23:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant

Residual Chlorine (ppm) - June 2025

Time	1-Jun	2-Jun	3-Jun	4-Jun	5-Jun	6-Jun	7-Jun	8-Jun	9-Jun	10-Jun	11-Jun	12-Jun	13-Jun	14-Jun	15-Jun	NEQE Limit	Remarks
00:00 - 00:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
01:00 - 01:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
02:00 - 02:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
03:00 - 03:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
04:00 - 04:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
05:00 - 05:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
06:00 - 06:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
07:00 - 07:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
08:00 - 08:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
09:00 - 09:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
10:00 - 10:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
11:00 - 11:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
12:00 - 12:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
13:00 - 13:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
14:00 - 14:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
15:00 - 15:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
16:00 - 16:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
17:00 - 17:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
18:00 - 18:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
19:00 - 19:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
20:00 - 20:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
21:00 - 21:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
22:00 - 22:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
23:00 - 23:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant

Time	16-Jun	17-Jun	18-Jun	19-Jun	20-Jun	21-Jun	22-Jun	23-Jun	24-Jun	25-Jun	26-Jun	27-Jun	28-Jun	29-Jun	30-Jun	NEQE Limit	Remarks
00:00 - 00:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
01:00 - 01:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
02:00 - 02:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
03:00 - 03:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
04:00 - 04:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
05:00 - 05:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
06:00 - 06:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
07:00 - 07:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
08:00 - 08:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
09:00 - 09:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
10:00 - 10:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
11:00 - 11:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
12:00 - 12:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
13:00 - 13:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
14:00 - 14:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.02	0.02	0.02	0.20	Compliant
15:00 - 15:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.02	0.02	0.02	0.20	Compliant
16:00 - 16:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
17:00 - 17:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
18:00 - 18:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
19:00 - 19:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
20:00 - 20:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
21:00 - 21:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
22:00 - 22:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
23:00 - 23:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant

Residual Chlorine (ppm) - July 2025

Time	1-Jul	2-Jul	3-Jul	4-Jul	5-Jul	6-Jul	7-Jul	8-Jul	9-Jul	10-Jul	11-Jul	12-Jul	13-Jul	14-Jul	15-Jul	NEQE Limit	Remarks
00:00 - 00:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
01:00 - 01:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
02:00 - 02:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
03:00 - 03:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
04:00 - 04:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
05:00 - 05:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
06:00 - 06:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
07:00 - 07:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
08:00 - 08:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
09:00 - 09:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
10:00 - 10:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
11:00 - 11:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
12:00 - 12:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
13:00 - 13:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
14:00 - 14:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
15:00 - 15:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
16:00 - 16:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
17:00 - 17:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
18:00 - 18:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
19:00 - 19:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
20:00 - 20:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
21:00 - 21:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
22:00 - 22:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
23:00 - 23:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant

Time	16-Jul	17-Jul	18-Jul	19-Jul	20-Jul	21-Jul	22-Jul	23-Jul	24-Jul	25-Jul	26-Jul	27-Jul	28-Jul	29-Jul	30-Jul	31-Jul	NEQE Limit	Remarks
00:00 - 00:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
01:00 - 01:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
02:00 - 02:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
03:00 - 03:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
04:00 - 04:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
05:00 - 05:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
06:00 - 06:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
07:00 - 07:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
08:00 - 08:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
09:00 - 09:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
10:00 - 10:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
11:00 - 11:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
12:00 - 12:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
13:00 - 13:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
14:00 - 14:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
15:00 - 15:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
16:00 - 16:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
17:00 - 17:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
18:00 - 18:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
19:00 - 19:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
20:00 - 20:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
21:00 - 21:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
22:00 - 22:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
23:00 - 23:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant

Residual Chlorine (ppm) - August 2025

Time	1-Aug	2-Aug	3-Aug	4-Aug	5-Aug	6-Aug	7-Aug	8-Aug	9-Aug	10-Aug	11-Aug	12-Aug	13-Aug	14-Aug	15-Aug	NEQE Limit	Remarks
00:00 - 00:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
01:00 - 01:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
02:00 - 02:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
03:00 - 03:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
04:00 - 04:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
05:00 - 05:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
06:00 - 06:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
07:00 - 07:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
08:00 - 08:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
09:00 - 09:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
10:00 - 10:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
11:00 - 11:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
12:00 - 12:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
13:00 - 13:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
14:00 - 14:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
15:00 - 15:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
16:00 - 16:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
17:00 - 17:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
18:00 - 18:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
19:00 - 19:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
20:00 - 20:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
21:00 - 21:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
22:00 - 22:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
23:00 - 23:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant

Time	16-Aug	17-Aug	18-Aug	19-Aug	20-Aug	21-Aug	22-Aug	23-Aug	24-Aug	25-Aug	26-Aug	27-Aug	28-Aug	29-Aug	30-Aug	31-Aug	NEQE Limit	Remarks
00:00 - 00:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
01:00 - 01:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
02:00 - 02:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
03:00 - 03:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
04:00 - 04:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
05:00 - 05:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
06:00 - 06:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
07:00 - 07:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
08:00 - 08:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
09:00 - 09:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
10:00 - 10:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
11:00 - 11:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
12:00 - 12:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
13:00 - 13:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
14:00 - 14:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
15:00 - 15:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
16:00 - 16:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
17:00 - 17:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
18:00 - 18:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
19:00 - 19:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
20:00 - 20:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
21:00 - 21:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
22:00 - 22:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
23:00 - 23:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant

Residual Chlorine (ppm) - September 2025

Time	1-Sep	2-Sep	3-Sep	4-Sep	5-Sep	6-Sep	7-Sep	8-Sep	9-Sep	10-Sep	11-Sep	12-Sep	13-Sep	14-Sep	15-Sep	NEQE Limit	Remarks
00:00 - 00:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
01:00 - 01:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
02:00 - 02:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
03:00 - 03:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
04:00 - 04:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
05:00 - 05:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
06:00 - 06:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
07:00 - 07:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
08:00 - 08:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
09:00 - 09:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
10:00 - 10:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
11:00 - 11:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
12:00 - 12:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
13:00 - 13:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
14:00 - 14:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
15:00 - 15:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
16:00 - 16:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
17:00 - 17:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
18:00 - 18:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
19:00 - 19:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
20:00 - 20:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
21:00 - 21:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
22:00 - 22:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
23:00 - 23:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant

Time	16-Sep	17-Sep	18-Sep	19-Sep	20-Sep	21-Sep	22-Sep	23-Sep	24-Sep	25-Sep	26-Sep	27-Sep	28-Sep	29-Sep	30-Sep	NEQE Limit	Remarks
00:00 - 00:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
01:00 - 01:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
02:00 - 02:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
03:00 - 03:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
04:00 - 04:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
05:00 - 05:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
06:00 - 06:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
07:00 - 07:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
08:00 - 08:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
09:00 - 09:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
10:00 - 10:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
11:00 - 11:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
12:00 - 12:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
13:00 - 13:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
14:00 - 14:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
15:00 - 15:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
16:00 - 16:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
17:00 - 17:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
18:00 - 18:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
19:00 - 19:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
20:00 - 20:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
21:00 - 21:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
22:00 - 22:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
23:00 - 23:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant

Residual Chlorine (ppm) - October 2025

Time	1-Oct	2-Oct	3-Oct	4-Oct	5-Oct	6-Oct	7-Oct	8-Oct	9-Oct	10-Oct	11-Oct	12-Oct	13-Oct	14-Oct	15-Oct	NEQE Limit	Remarks
00:00 - 00:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
01:00 - 01:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
02:00 - 02:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
03:00 - 03:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
04:00 - 04:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
05:00 - 05:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
06:00 - 06:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
07:00 - 07:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
08:00 - 08:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
09:00 - 09:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
10:00 - 10:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
11:00 - 11:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
12:00 - 12:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
13:00 - 13:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
14:00 - 14:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
15:00 - 15:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
16:00 - 16:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
17:00 - 17:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
18:00 - 18:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
19:00 - 19:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
20:00 - 20:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
21:00 - 21:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
22:00 - 22:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
23:00 - 23:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant

Time	16-Oct	17-Oct	18-Oct	19-Oct	20-Oct	21-Oct	22-Oct	23-Oct	24-Oct	25-Oct	26-Oct	27-Oct	28-Oct	29-Oct	30-Oct	31-Oct	NEQE Limit	Remarks
00:00 - 00:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
01:00 - 01:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
02:00 - 02:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
03:00 - 03:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
04:00 - 04:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
05:00 - 05:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
06:00 - 06:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
07:00 - 07:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
08:00 - 08:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
09:00 - 09:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
10:00 - 10:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
11:00 - 11:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
12:00 - 12:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
13:00 - 13:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
14:00 - 14:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
15:00 - 15:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
16:00 - 16:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
17:00 - 17:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
18:00 - 18:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
19:00 - 19:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
20:00 - 20:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
21:00 - 21:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
22:00 - 22:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
23:00 - 23:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant

Residual Chlorine (ppm) - November 2025

Time	1-Nov	2-Nov	3-Nov	4-Nov	5-Nov	6-Nov	7-Nov	8-Nov	9-Nov	10-Nov	11-Nov	12-Nov	13-Nov	14-Nov	15-Nov	NEQE Limit	Remarks
00:00 - 00:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
01:00 - 01:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
02:00 - 02:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
03:00 - 03:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
04:00 - 04:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
05:00 - 05:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
06:00 - 06:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
07:00 - 07:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
08:00 - 08:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
09:00 - 09:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
10:00 - 10:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
11:00 - 11:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.02	0.20	Compliant
12:00 - 12:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.02	0.20	Compliant
13:00 - 13:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.02	0.20	Compliant
14:00 - 14:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.02	0.20	Compliant
15:00 - 15:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.02	0.20	Compliant
16:00 - 16:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
17:00 - 17:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
18:00 - 18:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
19:00 - 19:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
20:00 - 20:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
21:00 - 21:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
22:00 - 22:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
23:00 - 23:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant

Time	16-Nov	17-Nov	18-Nov	19-Nov	20-Nov	21-Nov	22-Nov	23-Nov	24-Nov	25-Nov	26-Nov	27-Nov	28-Nov	29-Nov	30-Nov	NEQE Limit	Remarks
00:00 - 00:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
01:00 - 01:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
02:00 - 02:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
03:00 - 03:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
04:00 - 04:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
05:00 - 05:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
06:00 - 06:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
07:00 - 07:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
08:00 - 08:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
09:00 - 09:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
10:00 - 10:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.20	Compliant
11:00 - 11:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.20	Compliant
12:00 - 12:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.20	Compliant
13:00 - 13:59	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.03	0.20	Compliant
14:00 - 14:59	0.03	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.20	Compliant
15:00 - 15:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.20	Compliant
16:00 - 16:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.02	0.02	0.20	Compliant
17:00 - 17:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
18:00 - 18:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
19:00 - 19:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
20:00 - 20:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
21:00 - 21:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
22:00 - 22:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
23:00 - 23:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant

Residual Chlorine (ppm) - December 2025

Time	1-Dec	2-Dec	3-Dec	4-Dec	5-Dec	6-Dec	7-Dec	8-Dec	9-Dec	10-Dec	11-Dec	12-Dec	13-Dec	14-Dec	15-Dec	NEQE Limit	Remarks
00:00 - 00:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
01:00 - 01:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
02:00 - 02:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
03:00 - 03:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
04:00 - 04:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
05:00 - 05:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
06:00 - 06:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
07:00 - 07:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
08:00 - 08:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
09:00 - 09:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
10:00 - 10:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
11:00 - 11:59	0.02	0.02	0.02	0.03	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.02	0.02	0.20	Compliant
12:00 - 12:59	0.03	0.03	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.02	0.02	0.02	0.03	0.02	0.02	0.20	Compliant
13:00 - 13:59	0.03	0.03	0.02	0.02	0.02	0.02	0.03	0.03	0.03	0.02	0.02	0.02	0.02	0.03	0.03	0.20	Compliant
14:00 - 14:59	0.03	0.03	0.02	0.03	0.02	0.02	0.02	0.03	0.03	0.02	0.03	0.03	0.02	0.02	0.03	0.20	Compliant
15:00 - 15:59	0.02	0.03	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.03	0.03	0.02	0.03	0.02	0.20	Compliant
16:00 - 16:59	0.02	0.03	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.02	0.02	0.03	0.02	0.02	0.02	0.20	Compliant
17:00 - 17:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
18:00 - 18:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
19:00 - 19:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
20:00 - 20:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
21:00 - 21:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
22:00 - 22:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
23:00 - 23:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant

Time	16-Dec	17-Dec	18-Dec	19-Dec	20-Dec	21-Dec	22-Dec	23-Dec	24-Dec	25-Dec	26-Dec	27-Dec	28-Dec	29-Dec	30-Dec	31-Dec	NEQE Limit	Remarks
00:00 - 00:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
01:00 - 01:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
02:00 - 02:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
03:00 - 03:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
04:00 - 04:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
05:00 - 05:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
06:00 - 06:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
07:00 - 07:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
08:00 - 08:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
09:00 - 09:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
10:00 - 10:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
11:00 - 11:59	0.02	0.02	0.02	0.03	0.02	0.03	0.02	0.02	0.02	0.02	0.03	0.03	0.03	0.03	0.02	0.02	0.20	Compliant
12:00 - 12:59	0.02	0.02	0.02	0.03	0.02	0.03	0.03	0.03	0.02	0.03	0.03	0.03	0.02	0.03	0.03	0.03	0.20	Compliant
13:00 - 13:59	0.03	0.03	0.02	0.03	0.02	0.03	0.02	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.02	0.20	Compliant
14:00 - 14:59	0.03	0.03	0.03	0.03	0.03	0.03	0.02	0.03	0.02	0.03	0.02	0.03	0.03	0.03	0.03	0.02	0.20	Compliant
15:00 - 15:59	0.03	0.03	0.02	0.03	0.03	0.03	0.03	0.02	0.03	0.02	0.02	0.03	0.02	0.02	0.03	0.02	0.20	Compliant
16:00 - 16:59	0.02	0.02	0.02	0.03	0.02	0.02	0.02	0.02	0.03	0.03	0.03	0.02	0.02	0.02	0.03	0.02	0.20	Compliant
17:00 - 17:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
18:00 - 18:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
19:00 - 19:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
20:00 - 20:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
21:00 - 21:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
22:00 - 22:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant
23:00 - 23:59	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.20	Compliant

Residual Chlorine(ppm) January 2026

Time	1-Jan	2-Jan	3-Jan	4-Jan	5-Jan	6-Jan	7-Jan	8-Jan	9-Jan	10-Jan	11-Jan	12-Jan	13-Jan	14-Jan	15-Jan	NEQE Limit	Remarks
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant

Time	16-Jan	17-Jan	18-Jan	19-Jan	20-Jan	21-Jan	22-Jan	23-Jan	24-Jan	25-Jan	26-Jan	27-Jan	28-Jan	29-Jan	30-Jan	31-Jan	NEQE Limit	Remarks
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant

Residual Chlorine(ppm) February 2026

Time	1-Feb	2-Feb	3-Feb	4-Feb	5-Feb	6-Feb	7-Feb	8-Feb	9-Feb	10-Feb	11-Feb	12-Feb	13-Feb	14-Feb	NEQE Limit	Remarks
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant

Time	15-Feb	16-Feb	17-Feb	18-Feb	19-Feb	20-Feb	21-Feb	22-Feb	23-Feb	24-Feb	25-Feb	26-Feb	27-Feb	28-Feb	NEQE Limit	Remarks
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant

Residual Chlorine(ppm) March 2026

Time	1-Mar	2-Mar	3-Mar	4-Mar	5-Mar	6-Mar	7-Mar	8-Mar	9-Mar	10-Mar	11-Mar	12-Mar	13-Mar	14-Mar	15-Mar	NEQE Limit	Remarks
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant

Time	16-Mar	17-Mar	18-Mar	19-Mar	20-Mar	21-Mar	22-Mar	23-Mar	24-Mar	25-Mar	26-Mar	27-Mar	28-Mar	29-Mar	30-Mar	31-Mar	NEQE Limit	Remarks
00:00 - 00:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
01:00 - 01:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
02:00 - 02:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
03:00 - 03:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
04:00 - 04:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
05:00 - 05:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
06:00 - 06:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
07:00 - 07:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
08:00 - 08:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
09:00 - 09:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
10:00 - 10:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
11:00 - 11:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
12:00 - 12:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
13:00 - 13:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
14:00 - 14:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
15:00 - 15:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
16:00 - 16:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
17:00 - 17:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
18:00 - 18:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
19:00 - 19:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
20:00 - 20:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
21:00 - 21:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
22:00 - 22:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant
23:00 - 23:59	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	Compliant

Annex-2

Effluent Temperature Increase (°C) - April 2025

Time	1-Apr	2-Apr	3-Apr	4-Apr	5-Apr	6-Apr	7-Apr	8-Apr	9-Apr	10-Apr	11-Apr	12-Apr	13-Apr	14-Apr	15-Apr	NEQE Limit	Remarks
00:00 - 00:59	1.3	-0.5	-0.8	-1.7	-1.4	-1.3	-0.9	-1.8	-1.4	-1.6	-1.6	-0.7	-0.7	-1.0	-1.8	< 3.0	Compliant
01:00 - 01:59	1.2	-0.7	-0.9	-1.7	-1.5	-1.2	-0.9	-1.6	-1.6	-1.6	-1.6	-0.6	-0.6	-1.2	-1.6	< 3.0	Compliant
02:00 - 02:59	1.1	-0.6	-1.0	-1.5	-1.7	-1.4	-0.9	-1.6	-1.4	-1.7	-1.7	-0.5	-0.6	-1.1	-1.9	< 3.0	Compliant
03:00 - 03:59	1.1	-0.4	-1.0	-1.6	-1.6	-1.4	-1.4	-1.8	-1.5	-1.7	-1.7	-0.4	-0.7	-1.1	-1.7	< 3.0	Compliant
04:00 - 04:59	0.9	-0.5	-1.1	-1.5	-1.6	-1.5	-1.3	-1.8	-1.8	-1.9	-1.5	-0.4	-0.6	-1.1	-1.9	< 3.0	Compliant
05:00 - 05:59	0.5	-0.3	-1.1	-1.5	-1.7	-1.5	-1.7	-1.7	-1.9	-2.0	-1.4	-0.2	-0.7	-1.1	-2.0	< 3.0	Compliant
06:00 - 06:59	0.3	-0.3	-1.0	-1.5	-1.6	-1.3	-1.4	-1.8	-1.8	-2.1	-1.4	-0.2	-0.6	-1.1	-2.0	< 3.0	Compliant
07:00 - 07:59	0.3	-0.3	-1.0	-1.7	-1.8	-1.4	-1.7	-1.7	-2.0	-2.1	-1.4	-0.2	-0.6	-1.1	-2.1	< 3.0	Compliant
08:00 - 08:59	0.3	-0.2	-1.0	-1.3	-1.7	-1.2	-1.6	-1.4	-1.9	-2.2	-1.4	-0.1	-0.5	-1.1	-1.9	< 3.0	Compliant
09:00 - 09:59	0.3	-0.1	-1.0	-1.5	-1.6	-1.2	-1.5	-1.5	-1.9	-2.1	-1.4	-0.2	-0.5	-1.0	-2.2	< 3.0	Compliant
10:00 - 10:59	0.3	-0.1	-0.9	-1.3	-1.7	-1.2	-1.4	-1.3	-1.8	-2.0	-1.4	-0.2	-0.5	-0.8	-2.0	< 3.0	Compliant
11:00 - 11:59	0.3	0.0	-1.0	-1.5	-1.9	-1.3	-1.5	-1.3	-1.9	-1.8	-1.5	0.0	-0.2	-0.9	-1.7	< 3.0	Compliant
12:00 - 12:59	0.4	0.3	-1.0	-1.4	-1.3	-1.1	-1.2	-0.9	-1.7	-1.7	-1.0	0.1	-0.1	-0.9	-1.6	< 3.0	Compliant
13:00 - 13:59	0.6	0.4	-0.8	-1.5	-1.2	-0.9	-1.4	-1.1	-1.6	-1.6	-0.8	0.0	-0.3	-0.6	-1.3	< 3.0	Compliant
14:00 - 14:59	0.6	0.6	-0.6	-1.5	-1.3	-0.9	-1.2	-1.1	-1.7	-1.5	-0.9	0.1	0.1	-0.9	-1.2	< 3.0	Compliant
15:00 - 15:59	0.7	-1.3	-0.7	-1.3	-1.1	-0.9	-1.3	-1.2	-1.7	-1.6	-0.8	-0.1	0.0	-1.1	-1.2	< 3.0	Compliant
16:00 - 16:59	0.8	-1.2	-0.3	-1.2	-1.0	-0.7	-1.1	-0.9	-1.8	-1.5	-0.9	0.0	-0.2	-0.7	-1.4	< 3.0	Compliant
17:00 - 17:59	0.7	-0.9	-0.5	-1.1	-0.8	-0.4	-1.2	-1.0	-1.6	-1.6	-0.8	-0.2	-0.3	-0.8	-1.5	< 3.0	Compliant
18:00 - 18:59	1.0	-0.8	-0.7	-1.1	-0.8	-0.7	-1.3	-1.2	-1.5	-1.6	-0.8	-0.2	-0.1	-0.9	-1.9	< 3.0	Compliant
19:00 - 19:59	0.9	-0.6	-0.7	-1.1	-1.1	-0.4	-1.3	-1.2	-1.6	-1.6	-0.6	-0.3	-0.6	-1.0	-2.1	< 3.0	Compliant
20:00 - 20:59	0.7	-0.9	-0.9	-1.3	-1.0	-0.5	-1.4	-1.3	-1.7	-1.6	-0.8	-0.4	-0.9	-1.1	-2.3	< 3.0	Compliant
21:00 - 21:59	0.3	-0.6	-1.2	-1.4	-1.0	-0.6	-1.5	-1.4	-1.6	-1.5	-0.5	-0.6	-0.9	-1.4	-2.1	< 3.0	Compliant
22:00 - 22:59	-0.5	-0.6	-1.5	-1.3	-1.0	-0.6	-1.4	-1.4	-1.5	-1.6	-0.7	-0.7	-0.9	-1.2	-1.9	< 3.0	Compliant
23:00 - 23:59	-0.5	-0.7	-1.5	-1.3	-1.3	-0.6	-1.6	-1.3	-1.7	-1.6	-0.8	-0.8	-1.1	-1.6	-2.1	< 3.0	Compliant

Time	16-Apr	17-Apr	18-Apr	19-Apr	20-Apr	21-Apr	22-Apr	23-Apr	24-Apr	25-Apr	26-Apr	27-Apr	28-Apr	29-Apr	30-Apr	NEQE Limit	Remarks
00:00 - 00:59	-1.9	-1.6	-1.9	-2.8	-3.1	-3.2	-3.4	-2.5	-3.2	-3.0	-2.9	-3.6	-3.1	-3.3	-3.4	< 3.0	Compliant
01:00 - 01:59	-1.9	-1.8	-1.9	-2.8	-2.8	-3.2	-3.3	-2.7	-3.0	-2.8	-2.9	-3.4	-3.2	-3.2	-2.9	< 3.0	Compliant
02:00 - 02:59	-1.6	-2.0	-1.8	-2.5	-2.8	-3.3	-3.3	-2.5	-3.0	-2.8	-2.9	-3.3	-2.9	-3.4	-2.8	< 3.0	Compliant
03:00 - 03:59	-1.7	-1.8	-2.1	-2.5	-2.7	-3.1	-3.4	-2.5	-3.1	-2.7	-3.0	-3.2	-3.1	-3.2	-2.9	< 3.0	Compliant
04:00 - 04:59	-1.7	-2.0	-1.9	-2.7	-2.8	-3.3	-3.5	-2.5	-3.2	-2.8	-3.2	-2.9	-3.2	-3.5	-3.0	< 3.0	Compliant
05:00 - 05:59	-1.8	-2.1	-2.1	-2.8	-2.7	-3.3	-3.5	-2.5	-3.1	-2.6	-2.9	-2.9	-3.4	-3.5	-2.9	< 3.0	Compliant
06:00 - 06:59	-1.8	-2.3	-2.0	-2.7	-2.5	-3.4	-3.3	-2.5	-3.2	-2.6	-2.9	-2.6	-3.4	-3.5	-2.6	< 3.0	Compliant
07:00 - 07:59	-1.8	-2.3	-2.0	-2.7	-2.6	-3.4	-3.2	-2.7	-3.1	-2.6	-2.6	-2.8	-3.3	-3.4	-2.7	< 3.0	Compliant
08:00 - 08:59	-1.7	-2.2	-2.0	-2.7	-2.5	-3.3	-3.3	-2.5	-3.0	-2.5	-2.4	-2.8	-3.3	-3.3	-2.7	< 3.0	Compliant
09:00 - 09:59	-1.5	-2.1	-1.9	-2.6	-2.7	-3.3	-3.2	-2.5	-2.9	-2.5	-2.7	-2.6	-3.1	-3.6	-2.6	< 3.0	Compliant
10:00 - 10:59	-1.2	-2.1	-1.9	-2.7	-2.7	-3.3	-3.2	-2.4	-2.8	-2.3	-2.6	-2.4	-2.9	-3.4	-3.0	< 3.0	Compliant
11:00 - 11:59	-1.1	-2.2	-2.0	-2.5	-2.6	-3.2	-2.9	-2.2	-2.9	-2.4	-2.2	-2.4	-3.0	-3.3	-2.7	< 3.0	Compliant
12:00 - 12:59	-1.3	-1.8	-1.5	-2.3	-2.0	-2.7	-2.4	-2.0	-2.2	-2.3	-2.0	-1.9	-2.3	-3.6	-2.3	< 3.0	Compliant
13:00 - 13:59	-1.4	-1.8	-1.5	-2.3	-2.2	-2.4	-2.4	-2.2	-2.7	-2.2	-1.8	-1.6	-2.4	-3.8	-2.6	< 3.0	Compliant
14:00 - 14:59	-1.3	-1.5	-1.5	-2.3	-2.4	-2.7	-2.4	-1.9	-2.5	-2.4	-2.0	-1.8	-2.3	-3.9	-1.7	< 3.0	Compliant
15:00 - 15:59	-0.6	-1.5	-1.6	-2.4	-2.2	-2.5	-1.8	-1.9	-2.9	-2.6	-2.2	-1.9	-2.2	-2.9	-1.9	< 3.0	Compliant
16:00 - 16:59	-0.4	-1.8	-1.8	-2.3	-2.5	-2.8	-2.1	-2.0	-2.7	-2.7	-2.3	-2.0	-2.5	-2.8	-1.8	< 3.0	Compliant
17:00 - 17:59	-0.7	-1.8	-2.2	-2.4	-2.6	-2.9	-2.2	-2.1	-3.0	-3.2	-2.4	-2.3	-2.6	-2.7	-1.8	< 3.0	Compliant
18:00 - 18:59	-0.9	-2.0	-2.4	-2.7	-2.8	-3.0	-2.6	-2.4	-3.2	-3.0	-3.0	-2.5	-2.7	-3.0	-1.6	< 3.0	Compliant
19:00 - 19:59	-1.3	-2.4	-2.6	-2.9	-3.1	-3.3	-2.7	-2.6	-3.4	-3.1	-3.0	-2.6	-2.9	-2.9	-1.9	< 3.0	Compliant
20:00 - 20:59	-1.1	-2.2	-2.6	-2.8	-3.1	-3.6	-2.8	-2.7	-3.3	-2.8	-3.2	-2.5	-3.1	-3.0	-2.1	< 3.0	Compliant
21:00 - 21:59	-1.2	-2.0	-2.6	-3.1	-3.1	-3.5	-2.8	-2.7	-3.2	-2.9	-3.1	-2.8	-3.0	-2.9	-1.8	< 3.0	Compliant
22:00 - 22:59	-1.4	-2.0	-2.6	-2.8	-3.0	-3.7	-2.8	-3.0	-3.2	-3.1	-3.5	-3.0	-3.0	-3.3	-1.8	< 3.0	Compliant
23:00 - 23:59	-1.6	-1.9	-2.8	-2.9	-3.0	-3.6	-2.8	-3.0	-3.0	-2.8	-3.3	-2.9	-3.0	-3.0	-1.8	< 3.0	Compliant

Remarks: (-) value: effluent is cooler than River water temperature

Effluent Temperature Increase (°C) - May 2025

Time	1-May	2-May	3-May	4-May	5-May	6-May	7-May	8-May	9-May	10-May	11-May	12-May	13-May	14-May	15-May	NEQE Limit	Remarks
00:00 - 00:59	-1.6	-0.9	0.1	0.6	0.4	-0.3	-1.0	-1.4	-1.7	-1.7	-2.3	-2.3	-1.9	-2.2	-2.1	< 3.0	Compliant
01:00 - 01:59	-2.0	-1.1	0.1	0.6	0.5	-0.6	-0.9	-1.4	-1.6	-1.7	-2.3	-2.2	-2.3	-2.3	-2.1	< 3.0	Compliant
02:00 - 02:59	-1.8	-0.8	0.4	0.7	0.5	-0.7	-0.8	-1.7	-2.0	-1.7	-2.2	-1.9	-2.2	-2.6	-1.9	< 3.0	Compliant
03:00 - 03:59	-1.9	-1.0	0.1	0.5	0.5	-0.9	-0.9	-1.7	-1.8	-1.7	-2.2	-2.0	-2.0	-2.4	-2.1	< 3.0	Compliant
04:00 - 04:59	-2.0	-1.1	0.4	0.5	0.2	-1.0	-1.1	-1.7	-1.8	-1.9	-2.4	-2.1	-2.2	-2.5	-2.0	< 3.0	Compliant
05:00 - 05:59	-2.2	-1.1	0.4	0.3	0.5	-1.1	-1.2	-1.6	-1.7	-1.7	-2.1	-2.3	-2.0	-2.6	-2.0	< 3.0	Compliant
06:00 - 06:59	-2.2	-1.2	0.5	0.1	0.3	-1.1	-1.3	-1.6	-1.7	-1.8	-2.3	-2.2	-2.2	-2.8	-1.9	< 3.0	Compliant
07:00 - 07:59	-2.2	-1.0	0.4	0.0	0.2	-0.9	-1.4	-1.5	-1.3	-1.8	-2.1	-2.4	-2.0	-2.6	-2.0	< 3.0	Compliant
08:00 - 08:59	-2.2	-0.5	0.4	0.2	0.1	-0.9	-1.2	-1.7	-1.6	-1.9	-2.1	-2.3	-2.0	-2.6	-1.9	< 3.0	Compliant
09:00 - 09:59	-2.3	-0.4	0.6	0.4	0.1	-0.6	-1.4	-1.5	-1.6	-1.7	-2.1	-2.3	-1.8	-2.8	-1.9	< 3.0	Compliant
10:00 - 10:59	-2.2	-0.4	0.5	0.6	0.0	-0.7	-1.2	-1.6	-1.6	-1.8	-2.2	-2.1	-1.9	-2.8	-1.9	< 3.0	Compliant
11:00 - 11:59	-2.0	-0.6	0.8	0.4	0.1	-0.5	-1.4	-1.4	-1.8	-1.7	-1.6	-2.0	-1.6	-2.5	-1.7	< 3.0	Compliant
12:00 - 12:59	-1.5	-0.5	0.3	0.7	0.7	-0.3	-0.7	-0.9	-1.1	-1.4	-1.6	-1.9	-1.5	-2.1	-1.9	< 3.0	Compliant
13:00 - 13:59	-1.4	-0.8	0.7	0.4	0.5	-0.4	-0.4	-1.0	-1.2	-1.4	-1.5	-1.7	-1.2	-2.1	-1.5	< 3.0	Compliant
14:00 - 14:59	-1.3	-0.6	0.6	0.7	0.5	-0.6	-0.5	-0.7	-1.3	-1.5	-1.2	-1.7	-1.3	-1.8	-1.7	< 3.0	Compliant
15:00 - 15:59	-1.2	-0.5	0.6	0.8	0.4	-0.5	-0.3	-0.8	-1.3	-1.5	-1.3	-1.5	-1.1	-1.9	-1.6	< 3.0	Compliant
16:00 - 16:59	-1.0	-0.3	0.7	0.7	0.0	-0.7	-0.8	-1.1	-1.7	-1.8	-1.2	-1.8	-1.4	-2.0	-1.3	< 3.0	Compliant
17:00 - 17:59	-1.1	-0.3	0.3	0.6	0.2	-0.6	-0.8	-1.4	-1.8	-1.8	-1.6	-1.7	-1.7	-2.2	-1.5	< 3.0	Compliant
18:00 - 18:59	-1.4	-0.4	0.6	0.3	0.0	-0.9	-1.2	-1.6	-1.8	-2.1	-1.6	-1.7	-1.8	-2.2	-1.5	< 3.0	Compliant
19:00 - 19:59	-1.2	-0.4	0.5	0.2	-0.3	-0.9	-0.9	-1.6	-1.8	-2.6	-1.7	-1.8	-1.8	-2.0	-1.6	< 3.0	Compliant
20:00 - 20:59	-1.3	-0.3	0.3	0.4	-0.1	-0.9	-1.1	-1.7	-2.1	-2.5	-1.7	-2.1	-1.7	-2.1	-1.7	< 3.0	Compliant
21:00 - 21:59	-1.2	-0.1	0.7	0.5	-0.4	-0.9	-0.8	-1.8	-1.7	-2.4	-1.9	-1.8	-2.1	-2.2	-1.8	< 3.0	Compliant
22:00 - 22:59	-1.1	-0.3	0.6	0.6	-0.5	-1.1	-1.1	-1.7	-1.9	-2.4	-2.0	-2.2	-2.0	-2.1	-1.8	< 3.0	Compliant
23:00 - 23:59	-1.2	-0.1	0.6	0.5	-0.2	-1.1	-1.0	-1.7	-1.7	-2.3	-2.4	-2.1	-2.3	-1.9	-2.0	< 3.0	Compliant

Time	16-May	17-May	18-May	19-May	20-May	21-May	22-May	23-May	24-May	25-May	26-May	27-May	28-May	29-May	30-May	31-May	NEQE Limit	Remarks
00:00 - 00:59	-2.0	-2.1	-2.1	-1.7	-1.3	-1.5	-0.8	-1.1	-1.1	-1.7	-2.0	-1.5	-1.4	-1.1	-1.0	-0.8	< 3.0	Compliant
01:00 - 01:59	-2.1	-1.9	-2.2	-1.8	-1.5	-1.4	-0.8	-0.9	-1.0	-1.7	-2.0	-1.0	-1.5	-1.0	-1.1	-0.9	< 3.0	Compliant
02:00 - 02:59	-2.1	-2.1	-2.2	-1.7	-1.7	-1.3	-0.9	-1.3	-1.4	-1.6	-1.8	-1.2	-1.6	-1.0	-1.2	-0.8	< 3.0	Compliant
03:00 - 03:59	-2.0	-2.1	-2.1	-1.5	-1.8	-1.5	-0.7	-1.2	-1.4	-1.6	-2.0	-1.3	-1.5	-1.2	-1.3	-0.7	< 3.0	Compliant
04:00 - 04:59	-2.0	-2.1	-2.0	-1.7	-1.7	-1.2	-1.0	-1.1	-1.5	-1.6	-2.0	-1.4	-1.6	-1.2	-1.3	-1.0	< 3.0	Compliant
05:00 - 05:59	-1.9	-2.2	-1.9	-1.7	-1.5	-1.3	-1.1	-1.3	-1.4	-1.6	-2.0	-1.4	-1.5	-1.3	-1.3	-0.7	< 3.0	Compliant
06:00 - 06:59	-1.9	-2.1	-1.9	-1.7	-1.5	-1.5	-1.0	-0.9	-1.5	-1.6	-2.2	-1.5	-1.7	-1.1	-1.4	-0.9	< 3.0	Compliant
07:00 - 07:59	-2.1	-2.1	-1.9	-1.9	-1.5	-1.4	-1.5	-1.3	-0.9	-1.5	-2.1	-1.5	-1.5	-1.1	-1.4	-0.8	< 3.0	Compliant
08:00 - 08:59	-2.0	-1.9	-1.8	-1.8	-1.4	-1.6	-1.0	-1.1	-1.4	-1.6	-2.2	-1.5	-1.6	-1.1	-1.4	-0.7	< 3.0	Compliant
09:00 - 09:59	-2.1	-1.9	-2.0	-1.8	-1.4	-1.2	-1.4	-1.0	-1.1	-1.6	-2.0	-1.6	-1.5	-1.1	-1.2	-0.8	< 3.0	Compliant
10:00 - 10:59	-1.8	-1.9	-2.1	-1.7	-1.4	-1.6	-1.3	-1.1	-1.3	-1.5	-2.1	-1.6	-1.5	-1.1	-1.0	-0.6	< 3.0	Compliant
11:00 - 11:59	-1.7	-1.6	-1.9	-1.6	-1.4	-1.9	-1.2	-0.9	-1.4	-1.5	-2.1	-1.9	-1.5	-0.8	-0.9	-0.7	< 3.0	Compliant
12:00 - 12:59	-1.5	-1.6	-1.5	-1.5	-0.8	-1.0	-0.6	-1.0	-1.0	-1.7	-1.9	-1.5	-1.0	-0.8	-0.2	-0.1	< 3.0	Compliant
13:00 - 13:59	-1.3	-1.8	-1.8	-1.5	-1.0	-0.6	-0.4	-0.6	-0.9	-1.5	-1.8	-1.4	-0.7	-0.8	-0.3	0.1	< 3.0	Compliant
14:00 - 14:59	-1.2	-1.9	-1.7	-1.7	-1.1	-0.7	-0.6	-1.0	-1.2	-1.5	-1.4	-1.2	-0.6	-0.5	-0.3	0.2	< 3.0	Compliant
15:00 - 15:59	-1.3	-1.8	-1.7	-2.0	-0.8	-1.1	-1.2	-0.5	-1.2	-1.4	-1.2	-1.3	-0.6	-0.5	-0.2	0.4	< 3.0	Compliant
16:00 - 16:59	-1.3	-1.9	-1.5	-2.0	-1.1	-0.7	-1.0	-0.8	-1.7	-1.3	-1.2	-1.3	-0.8	-0.6	-0.3	0.5	< 3.0	Compliant
17:00 - 17:59	-1.2	-2.0	-1.8	-1.5	-1.0	-1.0	-0.9	-0.8	-1.5	-1.5	-1.3	-1.2	-0.7	-0.5	-0.3	0.6	< 3.0	Compliant
18:00 - 18:59	-1.3	-1.9	-1.7	-1.2	-1.4	-0.7	-1.3	-0.6	-1.6	-1.3	-1.3	-1.2	-0.8	-0.5	-0.7	0.4	< 3.0	Compliant
19:00 - 19:59	-1.5	-2.1	-1.5	-1.5	-1.4	-1.0	-1.0	-0.5	-1.8	-1.3	-1.4	-1.1	-0.7	-0.6	-0.7	0.3	< 3.0	Compliant
20:00 - 20:59	-1.7	-2.1	-1.5	-1.3	-1.4	-1.1	-1.2	-1.1	-1.9	-1.6	-1.2	-1.1	-0.9	-0.4	-0.5	0.1	< 3.0	Compliant
21:00 - 21:59	-1.9	-2.3	-1.7	-1.1	-1.4	-0.7	-1.0	-1.0	-1.7	-1.8	-1.6	-1.3	-1.0	-0.6	-0.7	-0.1	< 3.0	Compliant
22:00 - 22:59	-2.0	-1.9	-1.8	-1.4	-1.4	-1.0	-1.3	-0.7	-1.9	-2.2	-1.3	-1.4	-0.9	-0.8	-0.7	0.0	< 3.0	Compliant
23:00 - 23:59	-2.0	-2.2	-1.9	-1.6	-1.5	-0.9	-1.0	-1.1	-2.0	-2.0	-1.6	-1.6	-1.1	-0.8	-0.8	0.1	< 3.0	Compliant

Remarks: (-) value: effluent is cooler than River water temperature

Effluent Temperature Increase (°C) - June 2025

Time	1-Jun	2-Jun	3-Jun	4-Jun	5-Jun	6-Jun	7-Jun	8-Jun	9-Jun	10-Jun	11-Jun	12-Jun	13-Jun	14-Jun	15-Jun	NEQE Limit	Remarks
00:00 - 00:59	0.0	0.2	-0.3	-0.4	1.0	1.6	2.3	2.2	1.7	1.5	0.8	0.9	-0.1	-0.5	-0.9	< 3.0	Compliant
01:00 - 01:59	0.1	0.1	-0.3	-0.2	1.1	1.4	2.2	2.7	1.8	1.3	1.0	0.7	-0.3	-0.6	-1.1	< 3.0	Compliant
02:00 - 02:59	-0.1	0.1	-0.4	-0.1	0.9	1.2	2.4	2.8	1.5	1.0	0.9	0.3	-0.3	-0.6	-1.2	< 3.0	Compliant
03:00 - 03:59	0.0	0.5	-0.5	0.1	0.8	1.1	2.3	2.7	1.4	1.1	0.9	0.5	-0.5	-0.7	-1.4	< 3.0	Compliant
04:00 - 04:59	-0.1	-0.1	-0.5	0.2	0.5	1.0	2.2	2.6	1.5	1.2	0.7	0.6	-0.8	-0.9	-1.5	< 3.0	Compliant
05:00 - 05:59	-0.3	-0.5	-0.6	0.1	0.6	0.9	2.1	2.6	1.3	1.0	0.7	0.4	-1.0	-1.0	-1.5	< 3.0	Compliant
06:00 - 06:59	-0.2	-0.2	-0.7	0.2	0.4	1.0	2.2	2.4	1.4	1.1	0.9	0.3	-1.3	-1.0	-1.7	< 3.0	Compliant
07:00 - 07:59	-0.4	-0.2	-0.7	0.2	0.3	0.8	1.9	2.2	1.3	1.1	1.1	0.5	-1.2	-1.0	-1.6	< 3.0	Compliant
08:00 - 08:59	-0.3	-0.2	-0.8	0.3	0.4	0.7	2.1	2.4	1.2	1.1	0.8	0.3	-1.2	-1.0	-1.9	< 3.0	Compliant
09:00 - 09:59	-0.2	-0.2	-0.6	0.3	0.4	0.8	2.1	2.5	1.2	1.1	0.9	0.3	-1.2	-0.9	-1.8	< 3.0	Compliant
10:00 - 10:59	-0.2	-0.2	-0.4	0.4	0.4	1.0	2.3	2.6	1.3	0.9	0.8	0.3	-1.4	-1.0	-1.5	< 3.0	Compliant
11:00 - 11:59	-0.3	-0.1	-0.1	0.7	0.5	1.4	2.3	2.5	1.3	1.5	1.0	0.3	-1.2	-0.9	-1.6	< 3.0	Compliant
12:00 - 12:59	0.2	0.0	0.2	1.0	1.0	1.7	2.7	2.8	1.7	1.5	1.0	0.3	-0.8	-0.7	-1.3	< 3.0	Compliant
13:00 - 13:59	0.4	0.2	0.3	1.2	0.8	1.8	2.7	2.5	1.8	1.7	0.9	0.6	-0.6	-0.5	-1.1	< 3.0	Compliant
14:00 - 14:59	0.7	0.0	0.8	1.4	1.3	1.9	2.5	2.7	2.1	1.6	0.9	0.7	-0.6	-0.5	-1.2	< 3.0	Compliant
15:00 - 15:59	0.6	0.0	1.1	1.5	1.1	1.7	1.7	2.9	2.1	1.6	0.6	0.7	-0.5	-0.3	-1.3	< 3.0	Compliant
16:00 - 16:59	0.6	-0.1	0.9	1.8	1.3	1.9	1.8	2.8	2.4	1.5	0.6	0.9	-0.5	-0.2	-1.1	< 3.0	Compliant
17:00 - 17:59	0.7	0.0	0.4	1.8	1.3	2.2	1.9	2.7	2.2	1.8	0.7	0.9	-0.4	-0.3	-1.2	< 3.0	Compliant
18:00 - 18:59	0.5	-0.2	-0.1	1.7	1.5	2.1	1.7	2.8	2.3	1.6	0.6	0.6	-0.3	-0.1	-1.3	< 3.0	Compliant
19:00 - 19:59	0.6	-0.1	-0.1	1.7	1.6	2.1	1.9	2.7	1.9	1.5	0.8	0.5	-0.1	-0.6	-1.5	< 3.0	Compliant
20:00 - 20:59	0.5	0.2	-0.1	1.3	1.6	2.2	1.7	2.6	1.9	1.4	1.1	0.4	-0.3	-0.5	-1.3	< 3.0	Compliant
21:00 - 21:59	0.4	0.2	0.1	1.3	1.5	2.1	1.3	2.6	1.7	1.4	1.1	0.2	-0.3	-0.5	-1.4	< 3.0	Compliant
22:00 - 22:59	0.3	0.0	-0.1	0.9	1.6	2.5	1.3	2.2	1.6	1.2	0.9	0.2	-0.1	-0.6	-1.5	< 3.0	Compliant
23:00 - 23:59	0.1	0.0	-0.1	1.1	1.6	2.3	2.1	1.7	1.3	1.2	0.9	0.0	-0.3	-0.7	-1.6	< 3.0	Compliant

Time	16-Jun	17-Jun	18-Jun	19-Jun	20-Jun	21-Jun	22-Jun	23-Jun	24-Jun	25-Jun	26-Jun	27-Jun	28-Jun	29-Jun	30-Jun	NEQE Limit	Remarks
00:00 - 00:59	-1.6	-1.8	-1.7	-1.4	-0.9	-1.3	-1.3	-1.3	-1.5	-1.3	-1.2	-1.7	-1.8	-1.1	-1.4	< 3.0	Compliant
01:00 - 01:59	-1.4	-1.6	-1.8	-1.2	-1.2	-1.2	-1.3	-1.4	-1.9	-1.3	-1.2	-1.5	-1.9	-1.2	-1.2	< 3.0	Compliant
02:00 - 02:59	-1.7	-1.8	-1.8	-1.3	-1.2	-1.1	-1.4	-1.2	-2.1	-1.5	-1.3	-1.8	-2.2	-1.3	-1.2	< 3.0	Compliant
03:00 - 03:59	-1.7	-1.9	-2.0	-1.5	-1.1	-1.1	-1.5	-1.2	-2.0	-1.1	-1.5	-1.8	-2.0	-1.1	-1.1	< 3.0	Compliant
04:00 - 04:59	-1.8	-2.1	-1.8	-1.4	-1.3	-1.3	-1.5	-1.3	-1.9	-1.0	-1.8	-1.5	-1.9	-1.2	-1.3	< 3.0	Compliant
05:00 - 05:59	-1.8	-2.1	-1.9	-1.2	-1.1	-1.4	-1.7	-1.5	-2.0	-0.9	-1.6	-1.6	-1.8	-1.3	-1.2	< 3.0	Compliant
06:00 - 06:59	-2.0	-2.1	-2.2	-1.4	-1.1	-1.4	-1.5	-1.8	-1.9	-0.9	-1.8	-1.6	-1.8	-1.5	-1.1	< 3.0	Compliant
07:00 - 07:59	-2.1	-2.2	-2.0	-1.4	-1.4	-1.2	-1.8	-1.6	-2.0	-0.8	-1.6	-1.6	-1.9	-1.3	-1.1	< 3.0	Compliant
08:00 - 08:59	-2.0	-2.2	-1.9	-1.4	-1.1	-1.2	-1.8	-1.8	-2.0	-0.7	-1.9	-1.6	-1.8	-1.4	-1.1	< 3.0	Compliant
09:00 - 09:59	-2.2	-2.1	-1.8	-1.3	-1.2	-1.1	-1.5	-1.6	-1.8	-0.6	-1.9	-1.6	-1.8	-1.5	-1.1	< 3.0	Compliant
10:00 - 10:59	-1.9	-1.9	-1.8	-1.3	-1.1	-1.3	-1.6	-1.5	-1.9	-0.6	-2.0	-1.6	-1.8	-1.5	-1.0	< 3.0	Compliant
11:00 - 11:59	-1.8	-2.0	-1.6	-1.5	-1.2	-1.2	-1.4	-1.5	-1.8	-0.5	-2.1	-1.6	-1.8	-1.6	-1.0	< 3.0	Compliant
12:00 - 12:59	-1.6	-1.7	-1.4	-1.1	-0.8	-1.0	-0.9	-1.4	-1.9	-1.4	-2.2	-1.6	-1.7	-1.6	-1.0	< 3.0	Compliant
13:00 - 13:59	-1.7	-1.6	-1.3	-1.0	-0.6	-0.8	-0.9	-1.4	-2.0	-1.4	-2.0	-1.6	-1.7	-1.6	-0.9	< 3.0	Compliant
14:00 - 14:59	-1.3	-1.5	-1.0	-0.9	-0.5	-0.8	-0.9	-1.0	-2.0	-1.3	-1.7	-1.5	-1.7	-1.7	-0.9	< 3.0	Compliant
15:00 - 15:59	-1.5	-1.3	-0.8	-0.9	-0.6	-0.9	-0.9	-1.2	-2.0	-1.3	-1.6	-1.5	-1.7	-1.7	-0.9	< 3.0	Compliant
16:00 - 16:59	-1.2	-1.3	-0.9	-0.8	-0.3	-0.9	-0.8	-1.2	-2.1	-1.5	-1.5	-1.5	-1.7	-1.8	-0.8	< 3.0	Compliant
17:00 - 17:59	-1.2	-1.3	-0.8	-0.7	-0.4	-1.0	-0.8	-1.1	-2.1	-1.1	-1.3	-1.5	-1.6	-1.8	-0.8	< 3.0	Compliant
18:00 - 18:59	-1.4	-1.4	-1.0	-0.7	-0.4	-0.9	-1.0	-1.2	-2.1	-1.0	-1.1	-1.5	-1.6	-1.8	-0.8	< 3.0	Compliant
19:00 - 19:59	-1.5	-1.6	-0.9	-0.6	-0.8	-1.0	-0.9	-1.2	-2.2	-1.1	-0.9	-1.5	-1.6	-1.9	-0.8	< 3.0	Compliant
20:00 - 20:59	-1.4	-1.3	-1.1	-0.9	-0.8	-1.2	-1.1	-1.3	-2.2	-1.0	-0.8	-1.5	-1.6	-1.9	-0.7	< 3.0	Compliant
21:00 - 21:59	-1.4	-1.4	-1.1	-0.8	-1.0	-1.0	-1.1	-1.4	-2.3	-1.0	-0.6	-1.5	-1.5	-2.0	-0.7	< 3.0	Compliant
22:00 - 22:59	-1.6	-1.7	-1.3	-0.9	-1.0	-1.1	-1.1	-1.2	-2.3	-0.9	-0.4	-1.5	-1.5	-2.0	-0.7	< 3.0	Compliant
23:00 - 23:59	-1.5	-1.6	-1.4	-0.9	-1.0	-1.4	-1.1	-1.5	-2.3	-0.8	-0.2	-1.5	-1.5	-2.0	-0.7	< 3.0	Compliant

Remarks: (-) value: effluent is cooler than River water temperature

Effluent Temperature Increase (°C) - July 2025

Time	1-Jul	2-Jul	3-Jul	4-Jul	5-Jul	6-Jul	7-Jul	8-Jul	9-Jul	10-Jul	11-Jul	12-Jul	13-Jul	14-Jul	15-Jul	NEQE Limit	Remarks
00:00 - 00:59	-0.9	-0.9	-0.6	0.6	0.0	-0.5	-0.4	-0.5	0.0	0.1	-0.5	-0.3	-0.6	-0.6	-0.5	< 3.0	Compliant
01:00 - 01:59	-0.8	-0.9	-0.2	0.5	-0.1	-0.5	-0.5	-0.6	-0.1	0.0	-0.7	-0.2	-0.6	-0.5	-0.7	< 3.0	Compliant
02:00 - 02:59	-0.7	-0.9	-0.2	0.3	-0.4	-0.6	-0.7	-0.7	-0.2	0.0	-0.8	0.0	-0.8	-0.4	-0.9	< 3.0	Compliant
03:00 - 03:59	-0.5	-0.9	-0.4	0.5	-0.5	-0.7	-0.8	-0.7	-0.1	-0.2	-1.1	0.0	-0.7	-0.3	-0.7	< 3.0	Compliant
04:00 - 04:59	-0.3	-0.5	-0.3	0.2	-0.5	-0.7	-0.9	-0.8	-0.3	-0.3	-0.9	-0.2	-0.7	-0.5	-0.8	< 3.0	Compliant
05:00 - 05:59	-0.2	-0.5	-0.3	0.1	-0.6	-0.8	-1.0	-0.8	-0.2	-0.3	-1.2	-0.2	-0.3	-0.6	-0.8	< 3.0	Compliant
06:00 - 06:59	0.0	-0.6	-0.2	-0.1	-0.4	-0.9	-0.9	-0.8	-0.3	-0.3	-1.0	-0.5	-0.3	-0.6	-0.5	< 3.0	Compliant
07:00 - 07:59	0.0	-0.4	-0.1	-0.1	-0.7	-0.9	-1.0	-0.9	-0.3	-0.5	-1.2	-0.4	0.1	-0.8	-0.8	< 3.0	Compliant
08:00 - 08:59	0.2	-0.4	-0.1	0.0	-0.6	-0.9	-0.9	-0.9	-0.3	-0.4	-0.7	-0.6	-0.6	-0.5	-0.8	< 3.0	Compliant
09:00 - 09:59	0.4	-0.3	-0.1	0.0	-0.4	-0.9	-0.6	-0.8	-0.3	-0.4	-0.7	-0.5	-0.2	-0.6	-0.6	< 3.0	Compliant
10:00 - 10:59	0.5	-0.2	-0.8	0.1	-0.6	-0.5	-0.8	-0.7	-0.2	-0.3	-0.5	-0.2	-0.2	-0.4	-0.5	< 3.0	Compliant
11:00 - 11:59	0.6	-0.2	-0.8	0.2	-0.4	-0.5	-0.8	-0.5	-0.2	-0.2	-1.0	-0.4	-0.4	-0.1	-0.7	< 3.0	Compliant
12:00 - 12:59	0.8	-0.1	0.3	0.3	-0.3	-0.6	-0.6	-0.3	0.1	0.1	-0.4	-0.3	-0.3	-0.4	-0.6	< 3.0	Compliant
13:00 - 13:59	0.9	0.0	0.7	0.5	-0.3	-0.3	-0.5	-0.2	0.4	-0.1	-0.5	-0.1	-0.3	0.1	-0.3	< 3.0	Compliant
14:00 - 14:59	1.1	0.1	0.7	0.3	-0.3	0.0	-0.2	0.0	0.1	0.3	-0.5	-0.5	-0.1	-0.2	-0.9	< 3.0	Compliant
15:00 - 15:59	1.2	0.1	0.7	0.7	0.2	0.1	-0.1	0.0	0.5	0.0	0.0	-0.4	0.2	-0.2	-0.7	< 3.0	Compliant
16:00 - 16:59	1.4	0.2	0.8	0.6	0.2	0.1	-0.1	0.2	0.4	0.3	0.0	-0.1	0.2	0.0	-0.7	< 3.0	Compliant
17:00 - 17:59	-0.3	0.3	1.3	0.8	0.3	0.1	0.0	-0.1	0.7	0.2	0.5	-0.4	0.3	0.1	-0.3	< 3.0	Compliant
18:00 - 18:59	-0.2	0.3	1.0	0.8	0.3	0.0	-0.3	-0.3	0.6	0.1	0.3	-0.2	0.2	-0.1	-0.3	< 3.0	Compliant
19:00 - 19:59	0.1	0.4	1.3	0.6	0.1	0.1	-0.3	0.1	0.5	0.1	0.3	-0.4	0.1	0.0	-0.4	< 3.0	Compliant
20:00 - 20:59	-0.1	0.5	1.1	0.5	0.2	-0.1	-0.2	-0.1	0.5	0.1	0.1	-0.3	-0.2	-0.2	-0.7	< 3.0	Compliant
21:00 - 21:59	0.3	0.6	0.9	0.4	0.2	-0.2	-0.1	-0.1	0.2	-0.1	0.3	-0.4	-0.3	-0.4	-0.6	< 3.0	Compliant
22:00 - 22:59	0.0	0.6	0.8	0.3	-0.2	-0.1	-0.4	0.0	0.0	-0.2	0.0	-0.4	-0.3	-0.4	-0.3	< 3.0	Compliant
23:00 - 23:59	0.3	0.7	0.8	0.0	-0.4	-0.5	-0.4	0.0	-0.1	-0.4	0.1	-0.5	0.0	-0.5	-0.7	< 3.0	Compliant

Time	16-Jul	17-Jul	18-Jul	19-Jul	20-Jul	21-Jul	22-Jul	23-Jul	24-Jul	25-Jul	26-Jul	27-Jul	28-Jul	29-Jul	30-Jul	31-Jul	NEQE Limit	Remarks
00:00 - 00:59	-0.8	-1.5	-1.3	-1.5	-1.7	-1.4	-1.3	-1.5	-1.4	-1.3	-0.8	-0.8	-0.8	-0.4	-0.6	-1.2	< 3.0	Compliant
01:00 - 01:59	-0.8	-1.4	-1.3	-1.6	-1.5	-1.5	-1.2	-1.7	-1.5	-1.3	-0.9	-1.1	-0.6	-0.5	-0.8	-1.1	< 3.0	Compliant
02:00 - 02:59	-0.7	-1.6	-1.5	-1.7	-1.5	-1.4	-1.1	-1.4	-1.6	-1.3	-0.9	-0.9	-0.7	-0.4	-0.7	-1.2	< 3.0	Compliant
03:00 - 03:59	-1.0	-1.7	-1.3	-1.9	-1.6	-1.4	-1.5	-1.6	-1.6	-1.3	-1.2	-1.0	-0.9	-0.5	-0.9	-1.3	< 3.0	Compliant
04:00 - 04:59	-1.1	-1.5	-1.8	-1.9	-1.6	-1.5	-1.5	-1.8	-1.7	-1.3	-1.2	-1.0	-1.0	-0.5	-0.9	-1.5	< 3.0	Compliant
05:00 - 05:59	-1.2	-1.4	-1.6	-2.0	-1.6	-1.7	-1.6	-1.5	-1.6	-1.4	-1.2	-1.2	-1.0	-0.6	-0.9	-1.5	< 3.0	Compliant
06:00 - 06:59	-1.3	-1.5	-1.7	-2.0	-1.7	-1.7	-1.6	-1.8	-1.7	-1.4	-1.3	-1.1	-0.9	-0.7	-0.9	-1.6	< 3.0	Compliant
07:00 - 07:59	-1.3	-1.6	-1.7	-1.7	-1.7	-1.8	-1.8	-1.8	-1.7	-1.5	-1.4	-1.2	-1.0	-0.8	-1.0	-1.6	< 3.0	Compliant
08:00 - 08:59	-1.4	-1.5	-1.7	-2.1	-1.8	-1.7	-1.7	-1.9	-1.7	-1.5	-1.3	-1.2	-1.1	-0.7	-1.2	-1.5	< 3.0	Compliant
09:00 - 09:59	-1.0	-1.4	-1.5	-1.7	-1.5	-1.8	-1.7	-1.7	-1.8	-1.4	-1.5	-1.3	-1.1	-0.7	-1.1	-1.6	< 3.0	Compliant
10:00 - 10:59	-1.0	-1.5	-1.7	-1.9	-1.8	-2.0	-1.7	-2.1	-1.8	-1.4	-1.4	-1.3	-1.1	-0.7	-1.2	-1.5	< 3.0	Compliant
11:00 - 11:59	-0.9	-1.4	-1.7	-1.8	-2.0	-1.8	-1.9	-1.9	-1.8	-1.5	-1.1	-1.3	-1.2	-0.9	-1.0	-1.7	< 3.0	Compliant
12:00 - 12:59	-1.1	-1.1	-1.7	-1.6	-1.9	-1.9	-1.8	-2.0	-1.4	-1.2	-1.0	-1.1	-0.8	-0.8	-0.7	-1.6	< 3.0	Compliant
13:00 - 13:59	-0.9	-1.0	-1.4	-1.5	-1.6	-2.0	-1.9	-2.1	-1.4	-1.2	-1.0	-0.8	-0.7	-0.6	-0.8	-1.6	< 3.0	Compliant
14:00 - 14:59	-0.9	-1.1	-1.5	-1.9	-1.9	-1.8	-1.7	-2.0	-1.4	-1.0	-1.2	-1.0	-0.5	-0.6	-0.9	-1.9	< 3.0	Compliant
15:00 - 15:59	-0.7	-0.9	-1.5	-1.8	-1.5	-1.7	-2.1	-2.1	-1.1	-0.9	-0.9	-1.1	-0.6	-0.6	-0.9	-1.7	< 3.0	Compliant
16:00 - 16:59	-1.0	-0.9	-1.5	-1.4	-1.8	-1.5	-2.0	-2.1	-1.1	-0.7	-0.7	-0.8	-0.7	-0.2	-1.1	-1.2	< 3.0	Compliant
17:00 - 17:59	-1.2	-0.9	-1.2	-1.3	-1.5	-1.4	-1.6	-1.8	-1.0	-0.7	-0.8	-0.7	-0.6	-0.4	-1.1	-1.1	< 3.0	Compliant
18:00 - 18:59	-1.1	-1.0	-1.3	-1.4	-1.4	-1.4	-1.7	-1.8	-1.1	-0.6	-0.6	-0.8	-0.7	-0.6	-1.1	-1.1	< 3.0	Compliant
19:00 - 19:59	-1.1	-0.9	-1.2	-1.4	-1.4	-1.3	-1.9	-1.6	-1.3	-0.7	-0.7	-0.9	-0.5	-0.4	-1.3	-1.1	< 3.0	Compliant
20:00 - 20:59	-1.1	-1.2	-1.2	-1.3	-1.3	-1.2	-1.8	-1.6	-1.2	-0.8	-0.8	-0.8	-0.5	-0.5	-1.4	-1.3	< 3.0	Compliant
21:00 - 21:59	-1.1	-1.1	-1.5	-1.4	-1.4	-1.0	-1.8	-1.6	-1.2	-0.8	-1.0	-0.7	-0.5	-0.4	-1.2	-1.0	< 3.0	Compliant
22:00 - 22:59	-1.4	-1.3	-1.3	-1.4	-1.5	-1.3	-1.4	-1.5	-1.3	-0.7	-0.8	-0.5	-0.4	-0.6	-1.1	-1.2	< 3.0	Compliant
23:00 - 23:59	-1.3	-1.3	-1.4	-1.3	-1.2	-1.4	-1.6	-1.6	-1.3	-0.6	-0.8	-0.6	-0.6	-0.6	-1.2	-1.3	< 3.0	Compliant

Remarks: (-) value: effluent is cooler than River water temperature

Effluent Temperature Increase (^{o}C) - August 2025

Time	1-Aug	2-Aug	3-Aug	4-Aug	5-Aug	6-Aug	7-Aug	8-Aug	9-Aug	10-Aug	11-Aug	12-Aug	13-Aug	14-Aug	15-Aug	NEQE Limit	Remarks
00:00 - 00:59	-1.1	-0.9	-1.3	-1.6	-1.2	-1.1	-1.6	-0.3	0.1	0.0	-0.1	-0.5	-0.8	-1.2	-1.4	< 3.0	Compliant
01:00 - 01:59	-1.1	-1.0	-1.3	-1.6	-1.2	-1.1	-1.7	-0.2	0.2	0.0	0.0	-0.5	-0.8	-1.1	-1.4	< 3.0	Compliant
02:00 - 02:59	-1.4	-0.9	-1.5	-1.6	-1.2	-1.1	-1.6	-0.2	0.2	0.1	-0.1	-0.5	-0.8	-1.1	-1.2	< 3.0	Compliant
03:00 - 03:59	-1.4	-1.1	-1.4	-1.9	-1.3	-1.1	-1.5	0.0	0.4	0.2	0.0	-0.4	-0.8	-1.1	-1.2	< 3.0	Compliant
04:00 - 04:59	-1.3	-1.2	-1.6	-2.0	-1.4	-1.3	-1.6	-0.1	0.2	0.1	-0.1	-0.3	-0.9	-1.0	-1.2	< 3.0	Compliant
05:00 - 05:59	-1.7	-1.0	-1.4	-1.9	-1.6	-1.5	-1.6	-0.1	0.4	0.1	0.0	-0.3	-0.8	-1.0	-1.2	< 3.0	Compliant
06:00 - 06:59	-1.7	-1.2	-1.7	-2.1	-1.5	-1.5	-1.7	0.0	0.4	0.2	0.0	-0.3	-0.7	-0.9	-1.2	< 3.0	Compliant
07:00 - 07:59	-2.0	-1.3	-1.7	-2.1	-1.4	-1.6	-1.6	0.1	0.5	0.1	0.1	-0.4	-0.8	-1.0	-1.2	< 3.0	Compliant
08:00 - 08:59	-1.6	-1.5	-1.7	-2.3	-1.4	-1.7	-1.5	0.2	0.4	0.1	0.0	-0.3	-0.8	-0.8	-1.3	< 3.0	Compliant
09:00 - 09:59	-1.6	-1.3	-1.4	-1.9	-1.4	-1.5	-1.7	0.1	0.4	0.1	0.0	-0.4	-0.8	-0.9	-1.2	< 3.0	Compliant
10:00 - 10:59	-1.6	-1.4	-1.4	-2.0	-1.3	-1.8	-1.4	0.2	0.4	0.4	-0.1	-0.3	-0.8	-1.1	-1.2	< 3.0	Compliant
11:00 - 11:59	-1.7	-1.3	-1.4	-2.1	-1.6	-1.7	-1.4	0.1	0.1	0.2	-0.2	-0.5	-1.0	-1.2	-1.2	< 3.0	Compliant
12:00 - 12:59	-1.4	-1.3	-1.2	-1.7	-1.1	-1.4	-1.2	-0.1	0.2	0.1	-0.3	-0.7	-1.2	-1.3	-1.6	< 3.0	Compliant
13:00 - 13:59	-1.3	-0.8	-0.8	-1.6	-1.3	-1.1	-0.8	0.0	0.0	0.1	-0.5	-0.8	-1.1	-1.5	-1.6	< 3.0	Compliant
14:00 - 14:59	-0.9	-0.4	-1.4	-1.4	-1.1	-1.2	-0.7	-0.3	-0.2	0.0	-0.6	-0.8	-1.2	-1.5	-1.7	< 3.0	Compliant
15:00 - 15:59	-0.9	-0.9	-1.1	-1.4	-1.1	-0.9	-0.6	-0.3	-0.3	-0.3	-0.8	-1.1	-1.2	-1.5	-1.7	< 3.0	Compliant
16:00 - 16:59	-0.9	-0.8	-1.0	-1.2	-1.1	-1.1	-0.4	-0.3	-0.4	-0.4	-0.8	-1.2	-1.3	-1.5	-2.0	< 3.0	Compliant
17:00 - 17:59	-0.8	-0.7	-1.0	-1.1	-1.0	-1.2	-0.6	-0.3	-0.6	-0.4	-1.1	-1.2	-1.2	-1.5	-2.0	< 3.0	Compliant
18:00 - 18:59	-0.8	-0.8	-1.0	-1.2	-1.1	-1.0	-0.5	-0.4	-0.5	-0.3	-0.9	-1.3	-1.3	-1.4	-2.0	< 3.0	Compliant
19:00 - 19:59	-0.6	-0.9	-0.9	-1.2	-1.1	-1.3	-0.5	-0.2	-0.5	-0.3	-0.8	-1.2	-1.3	-1.4	-1.7	< 3.0	Compliant
20:00 - 20:59	-0.8	-1.1	-1.3	-1.4	-1.1	-1.6	-0.4	-0.1	-0.4	-0.3	-0.7	-1.2	-1.2	-1.3	-1.7	< 3.0	Compliant
21:00 - 21:59	-0.9	-1.0	-1.2	-1.4	-1.1	-1.7	-0.4	0.0	-0.1	-0.2	-0.5	-1.1	-1.3	-1.4	-1.6	< 3.0	Compliant
22:00 - 22:59	-0.8	-1.3	-1.5	-1.4	-1.0	-1.6	-0.4	0.0	-0.1	-0.2	-0.6	-1.1	-1.2	-1.4	-1.8	< 3.0	Compliant
23:00 - 23:59	-0.9	-1.3	-1.4	-1.4	-0.9	-1.7	-0.3	0.1	0.0	-0.1	-0.5	-1.0	-1.2	-1.4	-1.2	< 3.0	Compliant

Time	16-Aug	17-Aug	18-Aug	19-Aug	20-Aug	21-Aug	22-Aug	23-Aug	24-Aug	25-Aug	26-Aug	27-Aug	28-Aug	29-Aug	30-Aug	31-Aug	NEQE Limit	Remarks
00:00 - 00:59	-1.4	-0.8	-1.2	-1.1	-1.2	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
01:00 - 01:59	-1.6	-0.8	-1.1	-1.3	-1.2	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
02:00 - 02:59	-1.5	-0.9	-0.8	-1.0	-1.2	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
03:00 - 03:59	-1.2	-1.0	-1.1	-1.0	-1.2	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
04:00 - 04:59	-1.3	-0.8	-1.1	-1.0	-1.0	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
05:00 - 05:59	-1.2	-0.9	-0.9	-1.0	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
06:00 - 06:59	-1.2	-0.9	-1.0	-1.0	-0.9	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
07:00 - 07:59	-1.3	-0.8	-0.8	-0.7	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
08:00 - 08:59	-1.2	-0.6	-0.7	-0.8	-0.7	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
09:00 - 09:59	-1.1	-0.8	-0.9	-0.7	-0.7	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
10:00 - 10:59	-1.0	-0.8	-0.8	-0.7	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
11:00 - 11:59	-1.1	-0.9	-0.9	-0.9	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
12:00 - 12:59	-1.1	-0.9	-1.1	-1.1	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
13:00 - 13:59	-1.2	-1.1	-1.3	-1.2	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
14:00 - 14:59	-1.4	-1.2	-1.3	-1.3	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
15:00 - 15:59	-1.3	-1.2	-1.3	-1.3	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
16:00 - 16:59	-1.7	-1.6	-1.2	-1.3	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
17:00 - 17:59	-1.6	-1.4	-1.4	-1.3	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
18:00 - 18:59	-1.5	-1.6	-1.4	-1.4	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
19:00 - 19:59	-1.4	-1.5	-1.3	-1.4	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
20:00 - 20:59	-1.2	-1.5	-1.2	-1.5	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
21:00 - 21:59	-1.1	-1.2	-1.3	-1.2	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
22:00 - 22:59	-1.2	-1.2	-1.1	-1.2	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
23:00 - 23:59	-1.1	-1.2	-1.1	-1.3	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant

Remarks: (-) value: effluent is cooler than River water temperature

Effluent Temperature Increase (^{o}C) - September 2025

Time	1-Sep	2-Sep	3-Sep	4-Sep	5-Sep	6-Sep	7-Sep	8-Sep	9-Sep	10-Sep	11-Sep	12-Sep	13-Sep	14-Sep	15-Sep	NEQE Limit	Remarks
00:00 - 00:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
01:00 - 01:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
02:00 - 02:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
03:00 - 03:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
04:00 - 04:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
05:00 - 05:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
06:00 - 06:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
07:00 - 07:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
08:00 - 08:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
09:00 - 09:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
10:00 - 10:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
11:00 - 11:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
12:00 - 12:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
13:00 - 13:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
14:00 - 14:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
15:00 - 15:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
16:00 - 16:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
17:00 - 17:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
18:00 - 18:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
19:00 - 19:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
20:00 - 20:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
21:00 - 21:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
22:00 - 22:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant
23:00 - 23:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	< 3.0	Compliant

Time	16-Sep	17-Sep	18-Sep	19-Sep	20-Sep	21-Sep	22-Sep	23-Sep	24-Sep	25-Sep	26-Sep	27-Sep	28-Sep	29-Sep	30-Sep	NEQE Limit	Remarks
00:00 - 00:59	-0.8	-0.8	-0.8	-0.8	-0.5	-1.2	-0.8	-1.1	-1.3	-1.1	-0.9	-1.0	-1.2	-1.1	-1.7	< 3.0	Compliant
01:00 - 01:59	-0.8	-0.8	-0.8	-0.8	-0.5	-1.3	-0.8	-1.0	-1.2	-1.2	-0.9	-1.0	-1.3	-1.2	-1.8	< 3.0	Compliant
02:00 - 02:59	-0.8	-0.8	-0.8	-0.8	-0.6	-1.1	-1.0	-0.9	-1.2	-1.3	-0.8	-0.9	-1.2	-1.2	-1.6	< 3.0	Compliant
03:00 - 03:59	-0.8	-0.8	-0.8	-0.8	-0.6	-1.1	-0.9	-1.0	-1.3	-1.1	-0.9	-1.1	-1.2	-1.3	-1.7	< 3.0	Compliant
04:00 - 04:59	-0.8	-0.8	-0.8	-0.8	-0.5	-1.0	-0.9	-1.1	-1.4	-1.1	-0.8	-1.0	-1.2	-1.1	-1.6	< 3.0	Compliant
05:00 - 05:59	-0.8	-0.8	-0.8	-0.8	-0.7	-0.9	-1.0	-0.9	-1.2	-1.1	-0.7	-1.1	-1.2	-1.1	-1.7	< 3.0	Compliant
06:00 - 06:59	-0.8	-0.8	-0.8	-0.8	-0.4	-1.0	-0.9	-0.9	-1.3	-1.0	-0.7	-1.2	-1.3	-1.2	-1.6	< 3.0	Compliant
07:00 - 07:59	-0.8	-0.8	-0.8	-0.8	-0.6	-0.9	-1.0	-0.9	-1.3	-1.0	-0.6	-1.0	-1.1	-1.2	-1.6	< 3.0	Compliant
08:00 - 08:59	-0.8	-0.8	-0.8	-0.8	-0.6	-0.9	-0.9	-1.0	-1.2	-1.1	-0.8	-1.0	-1.2	-1.2	-1.6	< 3.0	Compliant
09:00 - 09:59	-0.8	-0.8	-0.8	-0.8	-0.6	-0.9	-1.0	-1.0	-1.2	-1.0	-0.7	-1.3	-1.2	-1.3	-1.6	< 3.0	Compliant
10:00 - 10:59	-0.8	-0.8	-0.8	-0.8	-0.8	-0.8	-1.0	-1.0	-1.2	-1.0	-0.7	-1.2	-1.2	-1.2	-1.5	< 3.0	Compliant
11:00 - 11:59	-0.8	-0.8	-0.8	-0.8	-1.0	-0.8	-1.1	-1.1	-1.2	-1.1	-0.9	-1.2	-1.3	-1.6	-1.5	< 3.0	Compliant
12:00 - 12:59	-0.8	-0.8	-0.8	-0.8	-1.0	-1.0	-1.2	-1.3	-1.2	-1.0	-1.1	-1.5	-1.6	-1.9	-1.5	< 3.0	Compliant
13:00 - 13:59	-0.8	-0.8	-0.8	-0.8	-1.3	-1.1	-1.2	-1.2	-1.4	-1.3	-1.2	-1.7	-1.7	-2.1	-1.6	< 3.0	Compliant
14:00 - 14:59	-0.8	-0.8	-0.8	-0.9	-1.2	-1.2	-1.4	-1.3	-1.5	-1.4	-1.5	-2.0	-2.0	-2.2	-1.5	< 3.0	Compliant
15:00 - 15:59	-0.8	-0.8	-0.8	-0.9	-1.3	-1.2	-1.4	-1.5	-1.6	-1.2	-1.3	-2.1	-2.0	-2.5	-1.3	< 3.0	Compliant
16:00 - 16:59	-0.8	-0.8	-0.8	-1.0	-1.3	-1.4	-1.3	-1.6	-1.8	-1.4	-1.4	-2.0	-2.1	-2.3	-1.3	< 3.0	Compliant
17:00 - 17:59	-0.8	-0.8	-0.8	-1.0	-1.4	-1.2	-1.4	-1.7	-1.6	-1.2	-1.6	-2.1	-2.1	-2.4	-1.3	< 3.0	Compliant
18:00 - 18:59	-0.8	-0.8	-0.8	-0.8	-1.3	-1.4	-1.5	-1.6	-1.6	-1.3	-1.6	-2.0	-2.1	-2.5	-1.2	< 3.0	Compliant
19:00 - 19:59	-0.8	-0.8	-0.8	-0.9	-1.2	-1.3	-1.3	-1.6	-1.4	-1.2	-1.4	-1.7	-1.7	-2.1	-1.2	< 3.0	Compliant
20:00 - 20:59	-0.8	-0.8	-0.8	-0.8	-1.2	-1.1	-1.2	-1.5	-1.4	-1.2	-1.3	-1.8	-1.6	-2.1	-1.2	< 3.0	Compliant
21:00 - 21:59	-0.8	-0.8	-0.8	-0.6	-1.2	-1.0	-1.2	-1.3	-1.2	-1.1	-1.2	-1.5	-1.5	-1.9	-1.2	< 3.0	Compliant
22:00 - 22:59	-0.8	-0.8	-0.8	-0.5	-1.1	-1.0	-1.3	-1.2	-1.2	-1.0	-1.2	-1.4	-1.3	-1.9	-1.1	< 3.0	Compliant
23:00 - 23:59	-0.8	-0.8	-0.8	-0.6	-1.0	-0.9	-1.2	-1.4	-1.3	-0.9	-0.9	-1.3	-1.2	-1.7	-1.0	< 3.0	Compliant

Remarks: (-) value: effluent is cooler than River water temperature

Effluent Temperature Increase (°C) - October 2025

Time	1-Oct	2-Oct	3-Oct	4-Oct	5-Oct	6-Oct	7-Oct	8-Oct	9-Oct	10-Oct	11-Oct	12-Oct	13-Oct	14-Oct	15-Oct	NEQE Limit	Remarks
00:00 - 00:59	-1.0	-0.9	-0.8	-1.1	-1.3	-1.2	-1.3	-1.2	-0.8	-0.5	-0.4	-0.4	-0.5	-0.5	-0.8	< 3.0	Compliant
01:00 - 01:59	-0.8	-0.8	-0.6	-0.9	-1.2	-1.2	-1.1	-1.2	-0.7	-0.5	-0.4	-0.3	-0.5	-0.5	-0.6	< 3.0	Compliant
02:00 - 02:59	-0.9	-0.8	-0.6	-0.9	-1.3	-1.1	-1.1	-1.1	-0.7	-0.4	-0.4	-0.4	-0.3	-0.4	-0.6	< 3.0	Compliant
03:00 - 03:59	-0.9	-0.6	-0.6	-0.8	-1.0	-1.1	-1.1	-1.2	-0.6	-0.4	-0.4	-0.4	-0.3	-0.6	-0.6	< 3.0	Compliant
04:00 - 04:59	-0.8	-0.6	-0.5	-0.9	-1.1	-0.9	-1.1	-1.1	-0.6	-0.4	-0.4	-0.3	-0.5	-0.6	-0.6	< 3.0	Compliant
05:00 - 05:59	-0.7	-0.5	-0.5	-0.8	-0.9	-0.9	-1.2	-1.0	-0.6	-0.4	-0.4	-0.2	-0.5	-0.6	-0.6	< 3.0	Compliant
06:00 - 06:59	-0.7	-0.4	-0.5	-0.8	-0.9	-0.9	-1.0	-0.9	-0.4	-0.3	-0.3	-0.2	-0.5	-0.6	-0.5	< 3.0	Compliant
07:00 - 07:59	-0.8	-0.4	-0.3	-0.9	-0.9	-0.9	-1.0	-1.0	-0.6	-0.4	-0.3	-0.2	-0.4	-0.6	-0.4	< 3.0	Compliant
08:00 - 08:59	-0.6	-0.4	-0.5	-0.8	-1.0	-1.0	-1.0	-1.0	-0.6	-0.3	-0.3	-0.2	-0.4	-0.6	-0.5	< 3.0	Compliant
09:00 - 09:59	-0.6	-0.5	-0.5	-0.8	-1.0	-0.9	-1.2	-1.0	-0.6	-0.4	-0.4	-0.4	-0.6	-0.7	-0.6	< 3.0	Compliant
10:00 - 10:59	-0.7	-0.5	-0.5	-1.0	-1.3	-1.0	-1.2	-1.1	-0.6	-0.3	-0.4	-0.3	-0.6	-0.8	-0.7	< 3.0	Compliant
11:00 - 11:59	-0.8	-0.6	-0.9	-1.2	-1.3	-1.2	-1.3	-1.2	-0.8	-0.4	-0.5	-0.6	-0.9	-1.1	-0.9	< 3.0	Compliant
12:00 - 12:59	-0.8	-0.9	-1.1	-1.3	-1.6	-1.5	-1.5	-1.3	-1.1	-0.7	-0.9	-0.8	-1.0	-1.2	-1.0	< 3.0	Compliant
13:00 - 13:59	-0.9	-1.0	-1.3	-1.3	-1.7	-1.7	-1.8	-1.4	-1.2	-1.1	-1.0	-1.1	-0.9	-1.5	-1.3	< 3.0	Compliant
14:00 - 14:59	-1.2	-0.9	-1.3	-1.6	-2.1	-1.8	-2.0	-1.6	-1.3	-1.1	-1.3	-1.3	-1.1	-1.6	-1.2	< 3.0	Compliant
15:00 - 15:59	-1.2	-1.0	-1.4	-1.8	-2.0	-1.9	-1.9	-1.7	-1.5	-0.9	-1.3	-1.2	-1.3	-1.4	-1.2	< 3.0	Compliant
16:00 - 16:59	-1.2	-1.2	-1.6	-1.8	-2.1	-2.0	-2.0	-1.6	-1.2	-1.0	-1.2	-1.4	-0.9	-1.4	-1.1	< 3.0	Compliant
17:00 - 17:59	-1.2	-1.2	-1.7	-1.8	-1.7	-2.1	-2.1	-1.6	-1.1	-1.0	-1.1	-1.4	-1.1	-1.3	-1.0	< 3.0	Compliant
18:00 - 18:59	-1.3	-1.2	-1.7	-1.8	-1.6	-1.7	-1.7	-1.5	-1.1	-0.7	-1.1	-1.2	-1.0	-1.2	-1.0	< 3.0	Compliant
19:00 - 19:59	-1.2	-1.0	-1.5	-1.7	-1.6	-1.7	-1.8	-1.4	-1.0	-0.7	-0.8	-1.1	-0.8	-1.2	-1.0	< 3.0	Compliant
20:00 - 20:59	-1.1	-1.0	-1.4	-1.6	-1.5	-1.6	-1.5	-1.2	-0.9	-0.6	-0.9	-0.8	-0.8	-0.9	-0.7	< 3.0	Compliant
21:00 - 21:59	-1.1	-1.0	-1.2	-1.6	-1.4	-1.4	-1.3	-1.2	-0.8	-0.5	-0.7	-0.8	-0.6	-0.9	-0.5	< 3.0	Compliant
22:00 - 22:59	-1.1	-0.8	-1.2	-1.4	-1.3	-1.2	-1.2	-1.0	-0.7	-0.4	-0.6	-0.6	-0.6	-0.8	-0.5	< 3.0	Compliant
23:00 - 23:59	-1.0	-0.9	-1.2	-1.3	-1.2	-1.3	-1.2	-0.9	-0.6	-0.4	-0.3	-0.5	-0.6	-0.7	-0.3	< 3.0	Compliant

Time	16-Oct	17-Oct	18-Oct	19-Oct	20-Oct	21-Oct	22-Oct	23-Oct	24-Oct	25-Oct	26-Oct	27-Oct	28-Oct	29-Oct	30-Oct	31-Oct	NEQE Limit	Remarks
00:00 - 00:59	-0.3	-0.3	-0.4	-0.4	-0.4	-0.1	-0.4	-0.4	-0.4	-0.3	-0.8	-1.0	-1.0	-0.8	-0.9	-1.1	< 3.0	Compliant
01:00 - 01:59	-0.4	-0.4	-0.2	-0.4	-0.3	-0.1	-0.2	-0.3	-0.4	-0.3	-0.7	-0.9	-1.0	-0.7	-0.8	-1.0	< 3.0	Compliant
02:00 - 02:59	-0.3	-0.4	-0.2	-0.4	-0.3	0.0	-0.2	-0.2	-0.3	-0.3	-0.6	-0.9	-0.8	-0.6	-0.8	-1.0	< 3.0	Compliant
03:00 - 03:59	-0.4	-0.2	-0.1	-0.4	-0.1	0.2	0.0	-0.2	-0.2	-0.3	-0.6	-0.7	-0.8	-0.6	-0.7	-1.0	< 3.0	Compliant
04:00 - 04:59	-0.2	-0.3	-0.2	-0.3	-0.1	0.2	-0.1	-0.1	-0.2	-0.2	-0.5	-0.7	-0.8	-0.5	-0.8	-0.9	< 3.0	Compliant
05:00 - 05:59	-0.2	-0.4	-0.2	-0.4	-0.1	0.1	-0.1	-0.1	-0.1	-0.2	-0.4	-0.6	-0.7	-0.5	-0.7	-0.9	< 3.0	Compliant
06:00 - 06:59	-0.2	-0.4	-0.2	-0.2	-0.1	0.2	0.0	-0.1	-0.1	-0.2	-0.3	-0.6	-0.6	-0.4	-0.8	-0.8	< 3.0	Compliant
07:00 - 07:59	-0.2	-0.2	-0.1	-0.3	-0.1	0.2	0.0	-0.1	-0.1	-0.2	-0.3	-0.5	-0.6	-0.5	-0.6	-0.7	< 3.0	Compliant
08:00 - 08:59	-0.2	-0.3	0.0	-0.2	-0.1	0.2	-0.1	-0.1	0.0	-0.3	-0.4	-0.5	-0.5	-0.3	-0.8	-0.8	< 3.0	Compliant
09:00 - 09:59	-0.4	-0.3	-0.2	-0.4	0.0	0.1	-0.1	-0.1	-0.1	-0.3	-0.4	-0.6	-0.5	-0.4	-0.6	-0.7	< 3.0	Compliant
10:00 - 10:59	-0.4	-0.4	-0.4	-0.3	-0.3	0.1	-0.2	-0.2	-0.1	-0.3	-0.6	-0.6	-0.7	-0.4	-0.9	-0.8	< 3.0	Compliant
11:00 - 11:59	-0.5	-0.5	-0.5	-0.6	-0.4	-0.3	-0.4	-0.3	-0.4	-0.5	-0.7	-0.8	-0.9	-0.8	-1.1	-0.9	< 3.0	Compliant
12:00 - 12:59	-0.7	-0.7	-0.9	-0.9	-0.5	-0.4	-0.7	-0.8	-0.6	-0.9	-1.1	-1.2	-1.2	-1.1	-1.2	-1.2	< 3.0	Compliant
13:00 - 13:59	-1.0	-0.9	-1.1	-1.1	-1.0	-0.8	-0.9	-1.0	-0.9	-1.3	-1.2	-1.3	-1.3	-1.2	-1.5	-1.5	< 3.0	Compliant
14:00 - 14:59	-1.1	-0.9	-1.2	-1.3	-1.1	-1.0	-1.2	-1.3	-1.2	-1.3	-1.4	-1.5	-1.5	-1.5	-1.7	-1.6	< 3.0	Compliant
15:00 - 15:59	-1.2	-1.0	-1.3	-1.3	-1.0	-1.1	-1.2	-1.2	-1.3	-1.5	-1.6	-1.6	-1.6	-1.5	-1.7	-1.7	< 3.0	Compliant
16:00 - 16:59	-1.2	-1.0	-1.3	-1.4	-1.2	-1.3	-1.3	-1.2	-1.3	-1.5	-1.6	-1.7	-1.5	-1.6	-2.0	-1.8	< 3.0	Compliant
17:00 - 17:59	-1.3	-0.9	-1.2	-1.2	-1.2	-1.3	-1.2	-1.1	-1.3	-1.5	-1.6	-1.6	-1.7	-1.6	-2.0	-1.7	< 3.0	Compliant
18:00 - 18:59	-1.0	-0.9	-1.2	-1.3	-1.0	-1.1	-1.2	-1.0	-1.3	-1.4	-1.5	-1.6	-1.5	-1.6	-1.7	-1.7	< 3.0	Compliant
19:00 - 19:59	-0.9	-0.6	-0.9	-1.1	-0.7	-0.9	-1.0	-0.9	-1.0	-1.3	-1.2	-1.3	-1.2	-1.2	-1.5	-1.4	< 3.0	Compliant
20:00 - 20:59	-0.8	-0.5	-0.8	-0.7	-0.6	-0.8	-0.8	-0.9	-0.9	-1.2	-1.2	-1.2	-1.2	-1.2	-1.3	-1.3	< 3.0	Compliant
21:00 - 21:59	-0.7	-0.5	-0.7	-0.7	-0.4	-0.6	-0.7	-0.8	-0.8	-1.1	-1.3	-1.2	-1.1	-1.2	-1.4	-1.3	< 3.0	Compliant
22:00 - 22:59	-0.5	-0.3	-0.6	-0.6	-0.2	-0.5	-0.5	-0.6	-0.8	-1.0	-1.1	-1.3	-1.0	-1.1	-1.2	-1.3	< 3.0	Compliant
23:00 - 23:59	-0.3	-0.3	-0.5	-0.3	0.0	-0.4	-0.5	-0.5	-0.5	-0.8	-0.9	-0.9	-0.9	-1.0	-1.2	-1.2	< 3.0	Compliant

Remarks: (-) value: effluent is cooler than River water temperature

Effluent Temperature Increase (^{o}C) - November 2025

Time	1-Nov	2-Nov	3-Nov	4-Nov	5-Nov	6-Nov	7-Nov	8-Nov	9-Nov	10-Nov	11-Nov	12-Nov	13-Nov	14-Nov	15-Nov	NEQE Limit	Remarks
00:00 - 00:59	-1.1	-0.6	-0.7	-0.5	-0.3	-0.3	0.1	-0.3	-0.6	-0.3	-0.6	-1.0	-2.3	-3.1	-1.8	< 3.0	Compliant
01:00 - 01:59	-0.9	-0.6	-0.7	-0.4	-0.3	-0.2	0.1	-0.5	-0.7	-0.5	-0.6	-0.9	-2.4	-3.2	-1.9	< 3.0	Compliant
02:00 - 02:59	-0.9	-0.4	-0.6	-0.4	-0.2	-0.2	0.2	-0.7	-0.6	-0.3	-0.6	-1.1	-2.5	-3.5	-1.7	< 3.0	Compliant
03:00 - 03:59	-0.9	-0.5	-0.6	-0.3	-0.1	-0.2	0.4	-0.7	-0.9	-0.3	-0.9	-1.1	-2.6	-3.7	-2.0	< 3.0	Compliant
04:00 - 04:59	-0.9	-0.4	-0.5	-0.4	0.0	0.0	0.3	-0.7	-0.9	-0.5	-0.6	-1.2	-2.4	-3.7	-2.1	< 3.0	Compliant
05:00 - 05:59	-0.8	-0.4	-0.6	-0.3	0.1	0.0	0.5	-0.7	-1.0	-0.5	-0.6	-0.9	-2.5	-3.5	-2.3	< 3.0	Compliant
06:00 - 06:59	-0.7	-0.3	-0.7	-0.3	0.0	0.0	0.6	-0.8	-1.0	-0.4	-0.7	-1.2	-2.7	-3.9	-2.3	< 3.0	Compliant
07:00 - 07:59	-0.7	-0.3	-0.7	-0.4	0.1	0.2	0.5	-0.9	-1.0	-0.6	-0.8	-1.4	-2.9	-3.9	-2.5	< 3.0	Compliant
08:00 - 08:59	-0.6	-0.4	-0.5	-0.2	0.1	0.1	0.5	-0.9	-1.1	-0.7	-0.8	-1.3	-2.8	-3.8	-2.6	< 3.0	Compliant
09:00 - 09:59	-0.8	-0.4	-0.6	-0.3	0.2	0.1	0.5	-1.0	-1.2	-0.7	-0.8	-1.3	-2.8	-3.8	-2.5	< 3.0	Compliant
10:00 - 10:59	-0.8	-0.4	-0.8	-0.3	0.1	0.0	-1.0	-1.2	-1.3	-0.8	-1.0	-1.6	-3.0	-3.9	-2.5	< 3.0	Compliant
11:00 - 11:59	-0.8	-0.6	-0.9	-0.4	-0.2	-0.3	-0.9	-1.4	-1.7	-1.0	-1.3	-1.9	-3.3	-3.6	-2.4	< 3.0	Compliant
12:00 - 12:59	-0.8	-0.7	-1.1	-0.4	-0.4	-0.4	-0.9	-1.5	-1.5	-1.4	-1.3	-1.7	-3.2	-3.7	-2.5	< 3.0	Compliant
13:00 - 13:59	-1.0	-0.9	-1.0	-0.6	-0.6	-0.4	-0.9	-1.5	-1.5	-1.4	-1.4	-1.8	-3.2	-3.7	-2.2	< 3.0	Compliant
14:00 - 14:59	-1.1	-1.2	-1.2	-0.5	-0.8	-0.6	-0.7	-1.1	-1.6	-1.2	-1.3	-2.1	-3.2	-3.5	-2.3	< 3.0	Compliant
15:00 - 15:59	-1.3	-1.0	-1.2	-0.5	-0.7	-0.7	-0.8	-1.1	-1.4	-0.9	-1.3	-2.1	-3.0	-3.0	-2.1	< 3.0	Compliant
16:00 - 16:59	-1.1	-1.0	-1.2	-0.7	-0.8	-0.8	-0.6	-0.9	-1.2	-1.1	-1.3	-2.2	-2.8	-3.2	-2.1	< 3.0	Compliant
17:00 - 17:59	-1.1	-1.1	-1.1	-0.8	-0.9	-0.6	-0.4	-0.9	-1.2	-1.0	-1.4	-2.2	-2.9	-3.0	-2.1	< 3.0	Compliant
18:00 - 18:59	-1.0	-1.1	-1.2	-0.6	-0.7	-0.4	-0.4	-1.0	-1.0	-0.8	-1.3	-1.9	-2.8	-2.5	-1.9	< 3.0	Compliant
19:00 - 19:59	-1.0	-0.9	-1.1	-0.6	-0.6	-0.4	-0.5	-0.5	-0.6	-0.7	-0.9	-2.0	-2.6	-2.3	-1.9	< 3.0	Compliant
20:00 - 20:59	-0.8	-1.0	-1.0	-0.5	-0.5	-0.2	-0.2	-0.7	-0.6	-0.5	-0.9	-1.9	-2.6	-2.2	-1.9	< 3.0	Compliant
21:00 - 21:59	-0.9	-0.9	-0.9	-0.5	-0.5	-0.3	-0.2	-0.7	-0.5	-0.6	-1.0	-1.9	-2.8	-2.1	-1.9	< 3.0	Compliant
22:00 - 22:59	-0.7	-0.8	-0.7	-0.3	-0.4	-0.1	-0.2	-0.8	-0.5	-0.6	-0.8	-2.1	-2.8	-2.1	-1.9	< 3.0	Compliant
23:00 - 23:59	-0.8	-0.9	-0.7	-0.3	-0.4	0.0	-0.4	-0.6	-0.4	-0.5	-1.0	-2.3	-2.9	-1.7	-2.0	< 3.0	Compliant

Time	16-Nov	17-Nov	18-Nov	19-Nov	20-Nov	21-Nov	22-Nov	23-Nov	24-Nov	25-Nov	26-Nov	27-Nov	28-Nov	29-Nov	30-Nov	NEQE Limit	Remarks
00:00 - 00:59	-1.9	-1.7	-1.4	-1.4	-1.1	-1.0	-1.7	-2.0	-2.1	-2.1	-2.8	-1.9	-2.4	-2.8	-2.9	< 3.0	Compliant
01:00 - 01:59	-2.1	-1.7	-1.4	-1.5	-1.1	-1.0	-1.6	-2.0	-2.2	-2.2	-2.8	-1.9	-2.2	-2.8	-3.0	< 3.0	Compliant
02:00 - 02:59	-2.3	-1.7	-1.4	-1.3	-1.1	-1.0	-1.5	-2.1	-2.3	-2.2	-2.9	-1.9	-2.2	-3.1	-3.0	< 3.0	Compliant
03:00 - 03:59	-2.4	-1.9	-1.6	-1.4	-0.9	-1.1	-1.5	-2.3	-2.5	-2.1	-3.0	-1.7	-2.4	-3.2	-3.1	< 3.0	Compliant
04:00 - 04:59	-2.4	-1.9	-1.6	-1.5	-1.2	-1.2	-1.8	-2.2	-2.4	-2.3	-3.1	-2.0	-2.4	-3.3	-3.0	< 3.0	Compliant
05:00 - 05:59	-2.7	-2.0	-1.8	-1.7	-1.1	-1.0	-1.9	-2.3	-2.4	-2.2	-3.2	-2.1	-2.4	-3.2	-3.1	< 3.0	Compliant
06:00 - 06:59	-2.7	-1.9	-1.8	-1.7	-1.1	-1.0	-1.8	-2.5	-2.5	-2.1	-3.2	-2.2	-2.5	-3.4	-3.4	< 3.0	Compliant
07:00 - 07:59	-2.7	-2.2	-1.8	-1.8	-1.2	-1.2	-1.8	-2.6	-2.5	-2.3	-3.3	-2.3	-2.6	-3.5	-3.4	< 3.0	Compliant
08:00 - 08:59	-2.7	-2.2	-1.8	-1.8	-1.4	-1.3	-1.9	-2.4	-2.5	-2.3	-3.3	-2.3	-2.6	-3.5	-3.2	< 3.0	Compliant
09:00 - 09:59	-2.8	-2.1	-1.9	-1.9	-1.0	-1.5	-2.1	-2.5	-2.3	-2.5	-3.4	-2.3	-2.7	-3.5	-3.5	< 3.0	Compliant
10:00 - 10:59	-3.0	-2.2	-1.9	-1.8	-1.3	-1.7	-2.2	-3.0	-2.5	-2.6	-3.4	-2.5	-2.9	-3.9	-3.8	< 3.0	Compliant
11:00 - 11:59	-2.9	-2.4	-2.0	-1.9	-1.2	-1.8	-2.0	-2.7	-2.8	-2.6	-3.0	-2.8	-3.1	-3.7	-3.7	< 3.0	Compliant
12:00 - 12:59	-2.8	-2.3	-2.1	-1.5	-1.2	-1.7	-1.9	-2.4	-2.6	-2.5	-2.7	-2.7	-3.0	-3.8	-3.6	< 3.0	Compliant
13:00 - 13:59	-2.6	-2.3	-2.2	-1.8	-1.2	-1.6	-1.3	-2.2	-2.4	-2.9	-2.3	-2.6	-3.1	-3.4	-3.4	< 3.0	Compliant
14:00 - 14:59	-2.5	-2.5	-2.1	-1.7	-1.2	-1.6	-1.3	-1.9	-2.2	-2.8	-2.1	-2.3	-2.9	-3.2	-3.3	< 3.0	Compliant
15:00 - 15:59	-2.2	-2.7	-1.7	-1.9	-1.1	-1.3	-1.3	-1.7	-2.0	-2.8	-1.9	-2.3	-2.6	-2.9	-2.8	< 3.0	Compliant
16:00 - 16:59	-1.9	-2.5	-1.7	-1.5	-1.0	-1.2	-1.3	-1.8	-1.8	-2.6	-1.8	-2.3	-2.7	-3.0	-2.9	< 3.0	Compliant
17:00 - 17:59	-1.9	-2.0	-1.6	-1.3	-0.7	-1.3	-1.5	-1.6	-1.7	-2.7	-1.8	-1.9	-2.6	-2.9	-2.8	< 3.0	Compliant
18:00 - 18:59	-1.7	-1.8	-1.7	-1.3	-0.8	-1.4	-1.5	-1.8	-2.0	-3.0	-1.7	-2.2	-2.7	-3.0	-2.5	< 3.0	Compliant
19:00 - 19:59	-1.8	-1.4	-1.4	-1.1	-0.8	-1.3	-1.4	-1.9	-1.7	-3.1	-1.7	-2.2	-2.7	-2.5	-2.5	< 3.0	Compliant
20:00 - 20:59	-1.6	-1.3	-1.3	-1.1	-0.9	-1.2	-1.6	-2.0	-1.7	-3.1	-1.8	-2.1	-2.6	-2.5	-2.5	< 3.0	Compliant
21:00 - 21:59	-1.6	-1.5	-1.3	-1.0	-0.9	-1.3	-1.7	-1.9	-1.9	-3.0	-1.9	-2.2	-2.7	-2.6	-2.6	< 3.0	Compliant
22:00 - 22:59	-1.7	-1.3	-1.1	-1.0	-0.8	-1.3	-1.8	-2.2	-2.0	-2.9	-1.8	-2.2	-2.5	-2.6	-2.2	< 3.0	Compliant
23:00 - 23:59	-1.5	-1.4	-1.3	-1.0	-0.9	-1.5	-1.8	-2.1	-1.7	-2.8	-1.8	-2.3	-2.8	-2.8	-2.3	< 3.0	Compliant

Remarks: (-) value: effluent is cooler than River water temperature

Effluent Temperature Increase (°C) - December 2025

Time	1-Dec	2-Dec	3-Dec	4-Dec	5-Dec	6-Dec	7-Dec	8-Dec	9-Dec	10-Dec	11-Dec	12-Dec	13-Dec	14-Dec	15-Dec	NEQE Limit	Remarks
00:00 - 00:59	-2.4	-2.1	-2.5	-1.1	-0.8	-0.6	-0.9	-1.2	-1.6	-1.7	-1.6	-1.5	-0.8	-1.0	-0.7	< 3.0	Compliant
01:00 - 01:59	-2.5	-2.1	-2.6	-1.1	-0.9	-0.5	-1.1	-1.5	-1.9	-1.8	-1.6	-1.2	-0.9	-1.1	-0.8	< 3.0	Compliant
02:00 - 02:59	-2.6	-2.2	-2.6	-1.2	-0.8	-0.8	-1.3	-1.5	-1.7	-1.9	-1.6	-1.4	-1.1	-1.2	-1.0	< 3.0	Compliant
03:00 - 03:59	-2.6	-2.2	-2.8	-1.4	-0.8	-0.8	-1.3	-1.6	-2.0	-1.8	-1.8	-1.5	-1.1	-1.3	-1.1	< 3.0	Compliant
04:00 - 04:59	-2.5	-2.2	-2.8	-1.3	-0.9	-1.1	-1.3	-1.8	-2.0	-2.1	-1.9	-1.6	-1.2	-1.1	-1.1	< 3.0	Compliant
05:00 - 05:59	-2.5	-2.4	-2.9	-1.5	-1.0	-1.3	-1.6	-1.7	-2.1	-1.9	-1.9	-1.8	-1.4	-1.2	-1.4	< 3.0	Compliant
06:00 - 06:59	-2.7	-2.3	-3.0	-1.5	-1.1	-1.3	-1.4	-1.7	-2.2	-2.1	-2.1	-1.7	-1.4	-1.3	-1.4	< 3.0	Compliant
07:00 - 07:59	-2.9	-2.5	-3.1	-1.7	-1.4	-1.5	-1.7	-1.8	-2.3	-2.1	-2.2	-1.7	-1.5	-1.4	-1.4	< 3.0	Compliant
08:00 - 08:59	-2.8	-2.6	-3.1	-1.7	-1.4	-1.4	-1.5	-1.9	-2.3	-2.1	-2.0	-1.6	-1.3	-1.5	-1.5	< 3.0	Compliant
09:00 - 09:59	-2.9	-2.7	-3.3	-1.6	-1.5	-1.6	-1.9	-2.2	-2.6	-2.4	-2.3	-1.9	-1.6	-1.6	-1.5	< 3.0	Compliant
10:00 - 10:59	-3.2	-2.8	-3.1	-1.9	-1.6	-1.9	-2.1	-2.4	-2.9	-2.6	-2.5	-1.9	-1.7	-1.8	-1.7	< 3.0	Compliant
11:00 - 11:59	-3.4	-3.1	-3.1	-2.1	-1.9	-2.0	-2.2	-2.6	-2.7	-2.5	-2.4	-2.0	-1.8	-1.9	-1.9	< 3.0	Compliant
12:00 - 12:59	-3.3	-3.1	-2.3	-1.6	-1.4	-1.7	-1.7	-1.8	-2.9	-2.7	-2.4	-1.7	-1.7	-1.8	-1.7	< 3.0	Compliant
13:00 - 13:59	-3.1	-3.4	-2.0	-1.6	-1.5	-1.8	-1.7	-1.9	-2.6	-2.4	-1.8	-1.3	-1.5	-1.2	-1.4	< 3.0	Compliant
14:00 - 14:59	-2.9	-3.1	-1.8	-1.5	-1.1	-1.1	-1.5	-1.9	-1.9	-2.1	-2.0	-1.2	-1.0	-1.1	-0.8	< 3.0	Compliant
15:00 - 15:59	-2.9	-3.4	-1.6	-1.1	-0.7	-1.2	-1.3	-1.4	-1.9	-1.8	-1.4	-1.1	-0.9	-0.9	-1.0	< 3.0	Compliant
16:00 - 16:59	-2.8	-3.3	-1.4	-0.9	-0.8	-1.1	-1.3	-1.7	-1.8	-1.7	-1.6	-1.3	-0.8	-0.6	-0.6	< 3.0	Compliant
17:00 - 17:59	-2.3	-3.3	-1.1	-0.8	-0.7	-0.9	-1.4	-1.5	-1.7	-1.7	-1.5	-1.1	-0.8	-0.5	-0.7	< 3.0	Compliant
18:00 - 18:59	-2.2	-3.2	-1.3	-0.8	-0.7	-0.9	-1.4	-1.5	-1.6	-1.5	-1.5	-1.0	-0.8	-0.7	-0.7	< 3.0	Compliant
19:00 - 19:59	-2.3	-2.6	-1.2	-0.5	-0.7	-1.0	-1.1	-1.6	-1.4	-1.6	-1.4	-0.8	-0.9	-0.7	-0.7	< 3.0	Compliant
20:00 - 20:59	-2.0	-2.5	-1.2	-0.5	-0.5	-0.8	-1.0	-1.4	-1.5	-1.5	-1.4	-0.7	-1.0	-0.4	-0.5	< 3.0	Compliant
21:00 - 21:59	-2.1	-2.4	-1.3	-0.5	-0.5	-0.9	-1.1	-1.7	-1.7	-1.3	-1.3	-0.7	-1.0	-0.5	-0.5	< 3.0	Compliant
22:00 - 22:59	-2.2	-2.4	-1.0	-0.6	-0.7	-0.8	-1.1	-1.7	-1.6	-1.6	-1.4	-0.9	-1.1	-0.6	-0.8	< 3.0	Compliant
23:00 - 23:59	-2.2	-2.5	-1.3	-0.7	-0.4	-1.0	-0.9	-1.8	-1.6	-1.5	-1.4	-0.9	-0.9	-0.7	-0.8	< 3.0	Compliant

Time	16-Dec	17-Dec	18-Dec	19-Dec	20-Dec	21-Dec	22-Dec	23-Dec	24-Dec	25-Dec	26-Dec	27-Dec	28-Dec	29-Dec	30-Dec	31-Dec	NEQE Limit	Remarks
00:00 - 00:59	-0.9	-0.8	-1.1	-1.0	-1.4	-1.5	-1.3	-0.9	-1.0	-1.1	-1.3	-1.3	-1.0	-1.0	-1.2	-0.5	< 3.0	Compliant
01:00 - 01:59	-0.9	-0.7	-0.9	-1.1	-1.6	-1.4	-1.1	-1.0	-0.8	-1.0	-1.5	-1.3	-1.0	-1.2	-0.9	-0.5	< 3.0	Compliant
02:00 - 02:59	-1.0	-0.8	-1.0	-1.3	-1.8	-1.4	-1.3	-1.1	-0.9	-1.2	-1.4	-1.4	-1.0	-1.3	-1.0	-0.7	< 3.0	Compliant
03:00 - 03:59	-1.1	-0.8	-1.0	-1.4	-1.8	-1.6	-1.4	-1.1	-1.1	-1.2	-1.2	-1.4	-1.2	-1.4	-0.7	-0.6	< 3.0	Compliant
04:00 - 04:59	-1.0	-0.9	-1.1	-1.6	-1.7	-1.5	-1.3	-1.4	-1.2	-1.3	-1.4	-1.6	-1.3	-1.3	-1.1	-0.7	< 3.0	Compliant
05:00 - 05:59	-1.3	-0.9	-1.1	-1.8	-1.9	-1.7	-1.4	-1.2	-1.4	-1.3	-1.6	-1.6	-1.4	-1.4	-1.2	-0.9	< 3.0	Compliant
06:00 - 06:59	-1.1	-1.1	-1.1	-1.5	-2.0	-1.7	-1.1	-1.4	-1.1	-1.6	-1.5	-1.7	-1.5	-1.4	-1.3	-1.2	< 3.0	Compliant
07:00 - 07:59	-1.4	-1.1	-1.5	-1.8	-1.9	-1.8	-1.1	-1.5	-1.2	-1.7	-1.5	-1.7	-1.5	-1.6	-1.5	-1.3	< 3.0	Compliant
08:00 - 08:59	-1.5	-1.2	-1.4	-1.8	-2.2	-1.6	-1.2	-1.7	-1.3	-1.7	-1.6	-1.8	-1.6	-1.4	-1.5	-1.4	< 3.0	Compliant
09:00 - 09:59	-1.6	-1.4	-1.5	-2.0	-2.1	-1.9	-1.7	-1.7	-1.5	-1.6	-1.6	-2.0	-1.9	-1.7	-1.7	-1.6	< 3.0	Compliant
10:00 - 10:59	-1.7	-1.4	-1.6	-2.2	-2.4	-1.9	-1.8	-2.0	-1.3	-2.0	-2.2	-2.3	-2.1	-1.9	-1.7	-1.7	< 3.0	Compliant
11:00 - 11:59	-1.7	-1.6	-1.6	-2.3	-2.2	-2.3	-1.8	-1.9	-1.4	-1.9	-2.1	-2.4	-2.1	-1.9	-1.8	-2.1	< 3.0	Compliant
12:00 - 12:59	-1.6	-1.2	-1.7	-2.2	-2.3	-2.1	-1.5	-2.0	-1.2	-2.2	-1.9	-2.0	-2.3	-2.3	-1.6	-1.9	< 3.0	Compliant
13:00 - 13:59	-1.6	-1.4	-1.3	-1.8	-2.2	-1.9	-1.5	-1.8	-1.3	-2.0	-1.8	-2.0	-1.9	-2.0	-1.7	-1.7	< 3.0	Compliant
14:00 - 14:59	-1.3	-1.1	-1.2	-1.4	-1.7	-1.8	-1.3	-1.4	-0.8	-1.9	-1.5	-1.5	-1.7	-1.8	-1.0	-1.7	< 3.0	Compliant
15:00 - 15:59	-1.1	-0.8	-1.0	-1.4	-1.4	-1.6	-1.1	-1.0	-0.9	-1.7	-1.2	-1.4	-1.5	-1.7	-0.7	-1.0	< 3.0	Compliant
16:00 - 16:59	-0.9	-0.7	-0.6	-1.4	-1.4	-1.3	-0.9	-0.8	-0.6	-1.8	-1.0	-1.1	-1.3	-1.2	-0.5	-0.7	< 3.0	Compliant
17:00 - 17:59	-0.6	-0.4	-0.7	-1.4	-1.1	-1.5	-0.8	-0.7	-0.7	-1.8	-1.1	-1.3	-0.9	-1.0	-0.6	-0.5	< 3.0	Compliant
18:00 - 18:59	-0.8	-0.5	-0.8	-1.5	-1.1	-1.2	-0.7	-0.8	-0.6	-1.7	-1.0	-0.9	-0.9	-1.0	-0.2	-0.5	< 3.0	Compliant
19:00 - 19:59	-0.5	-0.6	-0.6	-1.3	-1.0	-1.1	-0.7	-0.8	-0.6	-1.6	-1.0	-0.6	-0.9	-0.9	-0.3	-0.4	< 3.0	Compliant
20:00 - 20:59	-0.9	-0.5	-0.8	-1.2	-1.0	-1.2	-0.7	-0.9	-0.7	-1.4	-1.0	-0.7	-0.9	-0.9	-0.2	-0.2	< 3.0	Compliant
21:00 - 21:59	-0.5	-0.7	-0.9	-1.3	-1.2	-1.3	-0.6	-0.7	-0.7	-1.3	-1.1	-0.8	-1.0	-0.9	0.0	0.0	< 3.0	Compliant
22:00 - 22:59	-0.6	-0.8	-0.9	-1.4	-1.3	-1.0	-0.7	-0.8	-0.9	-1.2	-1.1	-1.2	-0.7	-0.8	-0.3	-0.4	< 3.0	Compliant
23:00 - 23:59	-0.9	-1.0	-1.1	-1.6	-1.1	-1.1	-0.9	-0.9	-0.9	-1.2	-1.2	-1.0	-1.0	-0.9	-0.3	-0.3	< 3.0	Compliant

Remarks: (-) value: effluent is cooler than River water temperature

Effluent Temperature Increase (C) January 2026

Time	1-Jan	2-Jan	3-Jan	4-Jan	5-Jan	6-Jan	7-Jan	8-Jan	9-Jan	10-Jan	11-Jan	12-Jan	13-Jan	14-Jan	15-Jan	NEQE Limit	Remarks
00:00 - 00:59	-0.4	-0.5	-0.5	-0.6	-1.2	-1.3	-1.3	-1.3	-1.0	-1.5	-1.1	-0.9	-0.3	-0.8	-1.1	< 3.0	Compliant
01:00 - 01:59	-0.4	-0.5	-0.5	-0.8	-1.3	-1.3	-1.5	-1.5	-1.2	-1.5	-1.2	-0.9	-0.7	-1.0	-0.9	< 3.0	Compliant
02:00 - 02:59	-0.3	-0.5	-0.4	-1.2	-1.3	-1.5	-1.7	-1.6	-1.2	-1.6	-1.3	-1.1	-0.5	-1.1	-0.7	< 3.0	Compliant
03:00 - 03:59	-0.5	-0.6	-0.3	-1.2	-1.3	-1.3	-1.6	-1.6	-1.2	-1.9	-1.3	-1.2	-0.7	-1.2	-1.1	< 3.0	Compliant
04:00 - 04:59	-0.6	-0.7	-0.4	-1.3	-1.5	-1.6	-1.6	-1.7	-1.5	-2.0	-1.8	-1.2	-0.9	-1.4	-1.0	< 3.0	Compliant
05:00 - 05:59	-0.5	-0.8	-0.5	-1.5	-1.8	-1.7	-2.0	-1.7	-1.5	-2.0	-1.7	-1.2	-1.0	-1.5	-1.2	< 3.0	Compliant
06:00 - 06:59	-0.7	-1.1	-0.7	-1.7	-2.2	-1.6	-1.9	-1.7	-1.6	-2.1	-1.7	-1.4	-0.9	-1.5	-1.5	< 3.0	Compliant
07:00 - 07:59	-0.9	-0.9	-0.6	-1.8	-2.1	-1.7	-2.0	-1.9	-1.7	-2.0	-1.7	-1.0	-1.1	-1.5	-1.3	< 3.0	Compliant
08:00 - 08:59	-1.1	-1.1	-0.8	-1.8	-2.0	-1.6	-1.9	-1.9	-1.7	-2.0	-2.0	-1.1	-1.1	-1.5	-1.3	< 3.0	Compliant
09:00 - 09:59	-1.1	-1.5	-1.0	-1.9	-2.1	-2.0	-2.0	-2.0	-1.9	-2.2	-1.9	-1.3	-1.3	-1.5	-1.4	< 3.0	Compliant
10:00 - 10:59	-1.3	-1.5	-1.0	-2.1	-2.3	-2.2	-2.4	-2.0	-2.2	-2.4	-2.1	-1.5	-1.3	-1.7	-1.4	< 3.0	Compliant
11:00 - 11:59	-1.3	-1.8	-1.0	-2.2	-2.3	-2.2	-2.2	-2.1	-2.1	-2.2	-2.0	-1.5	-1.1	-1.9	-1.6	< 3.0	Compliant
12:00 - 12:59	-1.3	-1.4	-0.7	-1.6	-2.1	-2.4	-2.2	-2.1	-2.0	-2.1	-1.8	-1.3	-1.2	-1.8	-1.4	< 3.0	Compliant
13:00 - 13:59	-1.0	-1.1	-0.6	-1.6	-2.0	-1.4	-1.6	-1.7	-1.6	-1.8	-1.7	-1.1	-0.9	-2.0	-1.1	< 3.0	Compliant
14:00 - 14:59	-0.8	-0.8	-0.3	-1.1	-1.6	-1.6	-1.3	-1.4	-1.2	-1.2	-1.1	-0.5	-1.1	-1.6	-1.0	< 3.0	Compliant
15:00 - 15:59	-0.4	-0.4	-0.1	-1.0	-1.4	-1.2	-1.4	-1.0	-0.8	-1.0	-1.0	-0.5	-0.8	-1.6	-1.0	< 3.0	Compliant
16:00 - 16:59	-0.3	-0.6	0.1	-1.0	-1.2	-1.0	-0.8	-0.7	-1.0	-1.1	-0.6	-0.3	-0.8	-1.6	-0.4	< 3.0	Compliant
17:00 - 17:59	-0.3	-0.5	0.0	-1.0	-1.1	-1.0	-0.8	-0.5	-1.0	-0.8	-0.7	-0.4	-0.7	-0.9	-0.5	< 3.0	Compliant
18:00 - 18:59	-0.2	-0.3	-0.1	-1.0	-1.2	-1.0	-1.2	-0.8	-1.0	-1.1	-0.7	-0.2	-0.7	-0.6	-0.7	< 3.0	Compliant
19:00 - 19:59	-0.2	-0.3	-0.2	-0.8	-0.8	-0.8	-1.1	-0.8	-1.0	-1.0	-0.8	-0.3	-0.3	-1.1	-0.5	< 3.0	Compliant
20:00 - 20:59	-0.1	-0.4	-0.5	-0.8	-0.9	-1.0	-1.1	-0.6	-1.1	-0.9	-0.8	-0.4	-0.5	-0.7	-0.7	< 3.0	Compliant
21:00 - 21:59	-0.3	-0.5	-0.4	-0.8	-1.0	-1.2	-1.0	-0.7	-1.2	-1.0	-0.8	-0.3	-0.7	-0.9	-0.6	< 3.0	Compliant
22:00 - 22:59	-0.4	-0.6	-0.3	-0.9	-1.1	-1.4	-1.2	-0.7	-1.4	-1.0	-0.8	-0.3	-0.9	-0.8	-1.0	< 3.0	Compliant
23:00 - 23:59	-0.4	-0.7	-0.4	-0.8	-1.1	-1.1	-1.3	-1.0	-1.4	-1.1	-0.8	-0.3	-0.6	-1.1	-0.9	< 3.0	Compliant

Time	16-Jan	17-Jan	18-Jan	19-Jan	20-Jan	21-Jan	22-Jan	23-Jan	24-Jan	25-Jan	26-Jan	27-Jan	28-Jan	29-Jan	30-Jan	31-Jan	NEQE Limit	Remarks
00:00 - 00:59	-1.0	-0.3	-0.8	-0.9	-1.0	-0.7	-0.7	-0.6	-1.1	-1.0	-1.3	-1.2	-1.7	-1.5	-0.9	-2.4	< 3.0	Compliant
01:00 - 01:59	-1.1	-0.4	-1.3	-1.2	-0.9	-0.9	-0.7	-0.9	-0.7	-1.1	-1.1	-1.3	-1.8	-1.4	-1.1	-2.7	< 3.0	Compliant
02:00 - 02:59	-0.8	-0.4	-1.2	-1.2	-1.0	-0.7	-0.7	-1.0	-0.8	-1.1	-1.0	-1.3	-1.9	-1.8	-1.4	-2.2	< 3.0	Compliant
03:00 - 03:59	-1.1	-0.6	-1.3	-1.5	-1.1	-0.9	-0.9	-1.1	-0.7	-1.1	-1.1	-1.2	-2.0	-1.6	-1.4	-2.5	< 3.0	Compliant
04:00 - 04:59	-1.0	-0.6	-1.5	-1.5	-1.2	-1.2	-1.1	-1.1	-0.8	-1.1	-1.3	-2.0	-2.1	-1.6	-1.6	-2.4	< 3.0	Compliant
05:00 - 05:59	-1.1	-0.6	-1.5	-1.5	-1.5	-1.0	-1.1	-1.0	-1.3	-1.2	-1.3	-1.5	-2.1	-1.8	-1.6	-2.4	< 3.0	Compliant
06:00 - 06:59	-1.3	-0.9	-1.7	-1.4	-1.5	-1.2	-1.2	-1.2	-0.7	-1.5	-1.4	-1.8	-2.4	-1.9	-1.6	-2.4	< 3.0	Compliant
07:00 - 07:59	-1.1	-0.9	-1.7	-1.7	-1.5	-1.4	-1.3	-1.3	-1.0	-1.4	-1.0	-1.5	-2.7	-1.9	-1.9	-2.4	< 3.0	Compliant
08:00 - 08:59	-1.1	-0.9	-1.5	-1.9	-1.5	-1.5	-1.3	-1.5	-0.5	-1.5	-1.5	-1.5	-2.2	-2.2	-1.8	-2.4	< 3.0	Compliant
09:00 - 09:59	-1.2	-0.9	-1.7	-1.8	-1.5	-1.6	-1.4	-1.5	-1.0	-1.6	-1.6	-1.3	-2.5	-2.2	-1.9	-2.4	< 3.0	Compliant
10:00 - 10:59	-1.2	-1.1	-2.0	-1.8	-1.8	-1.7	-1.7	-1.4	-1.0	-1.9	-1.4	-1.6	-2.1	-2.1	-1.8	-2.4	< 3.0	Compliant
11:00 - 11:59	-1.6	-1.4	-2.2	-2.1	-2.1	-1.7	-1.8	-1.6	-1.2	-1.9	-1.6	-1.8	-2.5	-2.1	-1.8	-2.4	< 3.0	Compliant
12:00 - 12:59	-1.4	-1.1	-1.7	-1.8	-1.7	-1.8	-1.6	-1.8	-1.5	-1.5	-2.0	-2.0	-2.3	-2.4	-1.6	-2.4	< 3.0	Compliant
13:00 - 13:59	-1.4	-0.8	-1.3	-1.5	-1.4	-1.3	-1.8	-1.6	-1.2	-1.6	-1.5	-2.2	-1.8	-2.5	-1.5	-2.3	< 3.0	Compliant
14:00 - 14:59	-0.8	-0.5	-1.1	-1.2	-1.1	-1.1	-1.6	-1.4	-1.5	-1.6	-0.9	-2.0	-1.3	-2.0	-1.5	-2.3	< 3.0	Compliant
15:00 - 15:59	-0.8	-0.3	-1.0	-1.0	-0.9	-1.0	-1.2	-1.1	-0.9	-1.1	-0.7	-2.3	-1.2	-1.5	-2.3	-2.3	< 3.0	Compliant
16:00 - 16:59	-0.7	-0.4	-0.9	-1.0	-0.7	-0.8	-0.8	-1.0	-0.9	-0.9	-1.0	-2.5	-1.4	-1.2	-1.8	-2.3	< 3.0	Compliant
17:00 - 17:59	-0.4	-0.3	-0.8	-0.7	-0.6	-0.5	-0.7	-0.7	-0.8	-0.9	-1.0	-2.3	-1.2	-0.9	-1.3	-2.3	< 3.0	Compliant
18:00 - 18:59	-0.2	-0.5	-0.9	-0.8	-0.7	-0.5	-0.6	-0.4	-0.2	-0.9	-0.6	-2.0	-1.3	-0.8	-1.2	-2.3	< 3.0	Compliant
19:00 - 19:59	0.0	-0.4	-0.7	-0.7	-0.5	-0.6	-0.7	-0.5	-0.6	-0.7	-0.7	-2.1	-1.1	-0.9	-1.4	-2.3	< 3.0	Compliant
20:00 - 20:59	-0.1	-0.5	-0.7	-0.7	-0.4	-0.3	-0.5	-0.7	-0.5	-0.7	-0.6	-1.8	-1.0	-0.9	-1.2	-2.3	< 3.0	Compliant
21:00 - 21:59	-0.3	-0.8	-0.8	-0.8	-0.4	-0.5	-0.4	-0.9	-0.7	-0.9	-0.6	-1.6	-1.1	-0.8	-1.3	-2.2	< 3.0	Compliant
22:00 - 22:59	-0.2	-0.8	-0.9	-0.8	-0.5	-0.6	-0.5	-0.6	-0.8	-0.9	-1.0	-2.0	-1.1	-0.9	-1.1	-2.2	< 3.0	Compliant
23:00 - 23:59	-0.3	-0.9	-0.9	-0.8	-0.8	-0.6	-0.6	-1.0	-1.0	-0.8	-0.6	-2.0	-1.1	-1.0	-1.0	-2.2	< 3.0	Compliant

Remarks: (-) value: effluent is cooler than River water temperature

Effluent Temperature Increase (C) February 2026

Time	1-Feb	2-Feb	3-Feb	4-Feb	5-Feb	6-Feb	7-Feb	8-Feb	9-Feb	10-Feb	11-Feb	12-Feb	13-Feb	14-Feb	NEQE Limit	Remarks
00:00 - 00:59	-0.7	-0.7	-0.2	-0.6	-0.9	-1.0	-1.3	-1.7	-1.6	-1.2	-1.3	-2.2	-3.2	-2.8	< 3.0	Compliant
01:00 - 01:59	-0.5	-0.8	-0.4	-0.6	-0.6	-1.1	-1.3	-2.1	-1.4	-1.9	-1.3	-2.4	-3.2	-3.1	< 3.0	Compliant
02:00 - 02:59	-0.8	-0.7	-0.5	-0.7	-1.0	-1.1	-0.9	-1.6	-1.7	-1.4	-1.3	-2.7	-3.2	-3.2	< 3.0	Compliant
03:00 - 03:59	-0.7	-1.0	-0.7	-0.7	-0.7	-1.4	-1.6	-2.1	-1.6	-1.3	-1.4	-3.1	-3.8	-3.2	< 3.0	Compliant
04:00 - 04:59	-0.5	-1.0	-0.6	-0.5	-0.8	-1.5	-1.3	-2.5	-2.0	-1.4	-1.5	-2.9	-3.4	-3.2	< 3.0	Compliant
05:00 - 05:59	-0.6	-1.0	-0.7	-0.8	-0.7	-1.3	-1.5	-2.5	-1.7	-1.5	-1.9	-3.6	-3.4	-3.5	< 3.0	Compliant
06:00 - 06:59	-0.6	-0.9	-0.9	-0.7	-1.0	-1.6	-1.7	-2.6	-1.5	-1.6	-1.9	-3.2	-3.4	-3.4	< 3.0	Compliant
07:00 - 07:59	-1.0	-0.9	-0.8	-0.5	-1.0	-1.7	-2.2	-2.8	-1.8	-1.8	-1.5	-3.6	-4.0	-3.4	< 3.0	Compliant
08:00 - 08:59	-0.6	-1.0	-0.9	-0.6	-1.0	-1.7	-1.8	-2.7	-2.1	-1.4	-1.9	-3.7	-3.8	-3.8	< 3.0	Compliant
09:00 - 09:59	-0.7	-1.1	-0.8	-0.6	-0.9	-1.6	-2.2	-2.5	-1.8	-1.8	-1.8	-3.6	-4.0	-3.6	< 3.0	Compliant
10:00 - 10:59	-0.8	-2.3	-1.0	-1.0	-0.9	-1.5	-1.9	-2.4	-1.4	-1.6	-1.9	-3.6	-3.9	-3.7	< 3.0	Compliant
11:00 - 11:59	-0.8	-2.4	-1.4	-0.6	-0.9	-1.9	-2.2	-2.3	-1.9	-2.0	-1.9	-4.1	-3.9	-3.9	< 3.0	Compliant
12:00 - 12:59	-0.8	-2.3	-1.2	-1.1	-0.9	-2.0	-1.9	-3.0	-1.9	-1.6	-1.8	-3.4	-4.2	-3.5	< 3.0	Compliant
13:00 - 13:59	-0.8	-2.0	-0.8	-0.8	-0.9	-2.1	-1.8	-2.0	-1.6	-1.7	-1.7	-3.2	-3.9	-3.7	< 3.0	Compliant
14:00 - 14:59	-0.8	-1.3	-0.8	-1.2	-0.6	-0.8	-1.9	-2.2	-1.4	-1.9	-1.2	-3.2	-3.6	-2.9	< 3.0	Compliant
15:00 - 15:59	-0.8	-1.5	-1.0	-0.8	0.0	-1.2	-1.8	-1.5	-1.5	-0.9	-1.4	-2.6	-3.2	-3.2	< 3.0	Compliant
16:00 - 16:59	-0.9	-1.2	-0.6	-0.8	-0.3	-1.3	-1.6	-1.4	-0.9	-1.1	-1.2	-2.5	-2.5	-2.4	< 3.0	Compliant
17:00 - 17:59	-0.9	-0.9	-1.0	-0.7	-0.2	-0.9	-1.5	-1.3	-1.2	-0.7	-1.2	-2.6	-2.4	-2.1	< 3.0	Compliant
18:00 - 18:59	-0.9	-0.7	-0.9	-0.3	-0.4	-1.0	-1.3	-1.3	-1.3	-0.8	-1.6	-2.4	-2.6	-2.2	< 3.0	Compliant
19:00 - 19:59	-0.9	-0.7	-0.7	-0.5	-0.4	-1.1	-1.5	-0.9	-0.8	-0.8	-1.8	-2.2	-2.1	-1.9	< 3.0	Compliant
20:00 - 20:59	-0.9	-0.8	-0.2	-0.5	-0.7	-1.0	-1.7	-1.1	-1.0	-0.4	-1.6	-2.2	-2.4	-1.8	< 3.0	Compliant
21:00 - 21:59	-0.9	-0.5	-0.4	-0.2	-0.4	-1.3	-1.4	-1.3	-1.3	-0.7	-1.6	-2.1	-2.8	-2.2	< 3.0	Compliant
22:00 - 22:59	-0.9	-0.2	-0.6	-0.4	-0.3	-0.9	-2.0	-1.1	-0.8	-0.8	-1.8	-2.1	-2.6	-1.9	< 3.0	Compliant
23:00 - 23:59	-1.0	-0.6	-0.4	-0.6	-0.7	-1.3	-1.5	-1.5	-0.8	-1.2	-2.2	-3.2	-2.9	-2.2	< 3.0	Compliant

Time	15-Feb	16-Feb	17-Feb	18-Feb	19-Feb	20-Feb	21-Feb	22-Feb	23-Feb	24-Feb	25-Feb	26-Feb	27-Feb	28-Feb	NEQE Limit	Remarks
00:00 - 00:59	-2.1	-2.8	-2.4	-1.3	-3.8	-1.6	-0.9	-0.5	-1.9	-2.7	-2.4	-0.9	-1.6	-2.4	< 3.0	Compliant
01:00 - 01:59	-2.8	-3.2	-2.8	-1.3	-3.8	-1.7	-1.1	-1.0	-1.4	-2.8	-2.4	-1.3	-1.4	-2.4	< 3.0	Compliant
02:00 - 02:59	-2.5	-3.1	-2.8	-2.4	-3.1	-1.4	-1.3	-0.9	-2.4	-2.8	-2.3	-1.0	-1.9	-2.0	< 3.0	Compliant
03:00 - 03:59	-2.5	-3.4	-2.8	-2.4	-3.2	-1.4	-1.4	-0.8	-2.4	-2.7	-2.0	-0.9	-1.9	-2.6	< 3.0	Compliant
04:00 - 04:59	-3.3	-3.3	-3.2	-2.7	-3.4	-1.6	-1.6	-1.2	-2.0	-3.0	-1.9	-1.0	-2.2	-2.2	< 3.0	Compliant
05:00 - 05:59	-3.4	-3.7	-3.2	-2.8	-3.5	-2.1	-1.5	-1.3	-2.4	-2.6	-2.1	-1.3	-1.9	-2.8	< 3.0	Compliant
06:00 - 06:59	-3.5	-3.9	-3.5	-3.0	-3.2	-2.0	-1.3	-1.2	-2.0	-3.2	-1.9	-1.1	-2.4	-2.9	< 3.0	Compliant
07:00 - 07:59	-3.6	-3.7	-3.2	-2.9	-3.3	-1.9	-1.6	-1.7	-2.0	-3.2	-1.9	-1.0	-2.2	-3.1	< 3.0	Compliant
08:00 - 08:59	-3.7	-3.6	-3.5	-3.1	-3.1	-2.0	-1.5	-1.8	-2.7	-3.0	-1.9	-0.9	-2.3	-3.1	< 3.0	Compliant
09:00 - 09:59	-3.3	-4.0	-3.0	-3.0	-3.2	-1.9	-1.7	-1.1	-2.7	-3.0	-1.8	-1.0	-2.2	-2.8	< 3.0	Compliant
10:00 - 10:59	-3.3	-4.1	-3.7	-3.2	-3.1	-1.7	-1.6	-1.1	-2.5	-3.0	-1.9	-0.9	-2.3	-2.8	< 3.0	Compliant
11:00 - 11:59	-3.4	-3.8	-3.3	-3.3	-3.1	-2.5	-1.4	-1.1	-2.1	-2.9	-1.8	-0.9	-2.0	-2.6	< 3.0	Compliant
12:00 - 12:59	-3.4	-3.2	-3.0	-2.6	-2.5	-1.9	-1.6	-1.1	-2.1	-2.9	-1.8	-1.1	-1.8	-2.6	< 3.0	Compliant
13:00 - 13:59	-3.0	-3.4	-2.8	-2.5	-2.4	-1.6	-1.3	-1.1	-2.3	-3.2	-1.6	-0.3	-1.7	-2.9	< 3.0	Compliant
14:00 - 14:59	-2.7	-2.8	-2.1	-2.0	-2.1	-1.8	-1.0	-0.9	-2.3	-2.5	-1.3	-0.5	-1.7	-2.2	< 3.0	Compliant
15:00 - 15:59	-3.4	-2.9	-2.0	-2.1	-1.7	-1.0	-1.0	-1.0	-3.1	-2.0	-1.8	-0.4	-1.5	-2.0	< 3.0	Compliant
16:00 - 16:59	-2.4	-2.4	-1.7	-1.8	-1.6	-0.9	-1.0	-0.6	-3.1	-2.2	-1.3	-0.5	-1.6	-1.8	< 3.0	Compliant
17:00 - 17:59	-2.3	-2.2	-1.5	-1.7	-1.5	-0.9	-1.0	-1.2	-2.9	-2.1	-0.9	-0.7	-1.8	-1.8	< 3.0	Compliant
18:00 - 18:59	-2.5	-2.3	-1.3	-1.7	-1.8	-1.3	-0.6	-1.4	-2.9	-2.5	-1.1	-0.7	-1.8	-2.2	< 3.0	Compliant
19:00 - 19:59	-2.6	-2.1	-1.3	-2.5	-1.3	-1.1	-1.0	-1.4	-3.0	-2.6	-1.3	-1.0	-1.5	-1.7	< 3.0	Compliant
20:00 - 20:59	-2.2	-1.8	-1.1	-2.8	-1.3	-0.5	-0.9	-0.9	-2.5	-2.2	-1.5	-1.5	-1.9	-2.4	< 3.0	Compliant
21:00 - 21:59	-2.7	-2.0	-1.4	-3.0	-1.6	-1.0	-1.1	-1.6	-2.7	-2.3	-0.8	-1.2	-1.4	-1.9	< 3.0	Compliant
22:00 - 22:59	-2.6	-2.7	-1.3	-3.5	-1.5	-1.0	-0.5	-1.4	-2.7	-2.7	-1.0	-1.5	-2.1	-2.2	< 3.0	Compliant
23:00 - 23:59	-2.8	-2.6	-1.3	-3.8	-1.6	-0.9	-0.6	-2.0	-2.8	-2.6	-1.2	-1.6	-1.9	-2.2	< 3.0	Compliant

Remarks: (-) value: effluent is cooler than River water temperature

Effluent Temperature Increase (C) March 2026

Time	1-Mar	2-Mar	3-Mar	4-Mar	5-Mar	6-Mar	7-Mar	8-Mar	9-Mar	10-Mar	11-Mar	12-Mar	13-Mar	14-Mar	15-Mar	NEQE Limit	Remarks
00:00 - 00:59	-2.5	-3.1	-3.3	-2.2	-2.2	-2.5	-1.8	-1.7	-4.3	-4.9	-2.3	-2.6	-1.5	-2.2	-2.2	< 3.0	Compliant
01:00 - 01:59	-2.5	-3.0	-3.6	-2.4	-2.0	-2.7	-1.5	-1.7	-4.8	-4.7	-2.3	-2.2	-1.9	-2.5	-2.6	< 3.0	Compliant
02:00 - 02:59	-2.4	-3.4	-3.5	-2.0	-2.2	-2.7	-1.6	-2.2	-4.1	-4.5	-2.2	-2.0	-1.2	-2.7	-2.3	< 3.0	Compliant
03:00 - 03:59	-2.5	-3.2	-3.7	-2.0	-2.4	-2.7	-2.1	-2.2	-4.1	-4.6	-2.2	-2.3	-1.5	-2.4	-1.7	< 3.0	Compliant
04:00 - 04:59	-2.8	-3.2	-3.6	-2.4	-2.4	-2.7	-1.7	-2.2	-4.3	-4.7	-2.2	-2.4	-2.0	-2.2	-2.3	< 3.0	Compliant
05:00 - 05:59	-3.1	-4.9	-3.7	-2.1	-2.5	-2.7	-1.7	-2.2	-4.3	-5.0	-2.2	-2.5	-1.5	-2.5	-2.5	< 3.0	Compliant
06:00 - 06:59	-3.1	-5.1	-4.0	-2.2	-2.7	-3.1	-1.8	-2.2	-3.9	-4.3	-2.9	-2.1	-1.9	-2.5	-2.2	< 3.0	Compliant
07:00 - 07:59	-3.3	-5.1	-3.8	-2.3	-2.4	-3.3	-1.8	-3.3	-4.0	-4.3	-2.7	-2.2	-1.8	-2.1	-1.9	< 3.0	Compliant
08:00 - 08:59	-3.3	-4.8	-3.5	-2.1	-2.8	-2.7	-1.8	-3.0	-4.1	-4.3	-2.8	-2.5	-2.0	-2.2	-2.2	< 3.0	Compliant
09:00 - 09:59	-3.3	-4.8	-3.5	-2.2	-2.5	-2.7	-1.8	-2.9	-4.0	-4.3	-3.2	-2.6	-1.9	-2.3	-1.8	< 3.0	Compliant
10:00 - 10:59	-3.2	-4.6	-4.0	-2.5	-2.5	-2.7	-1.8	-3.0	-4.2	-4.5	-2.7	-2.6	-1.9	-2.0	-1.7	< 3.0	Compliant
11:00 - 11:59	-3.2	-4.4	-4.1	-2.3	-2.7	-3.1	-1.8	-3.0	-3.5	-4.5	-2.6	-2.6	-1.9	-1.5	-1.7	< 3.0	Compliant
12:00 - 12:59	-2.6	-4.3	-3.2	-2.1	-2.5	-3.1	-1.9	-3.0	-3.1	-3.4	-2.1	-2.2	-1.7	-1.6	-2.4	< 3.0	Compliant
13:00 - 13:59	-2.5	-3.9	-2.9	-2.4	-2.1	-4.0	-2.2	-3.6	-3.1	-3.4	-2.7	-2.2	-2.3	-1.7	-1.3	< 3.0	Compliant
14:00 - 14:59	-2.4	-3.1	-2.9	-1.6	-1.9	-4.0	-2.2	-3.6	-3.5	-3.2	-1.8	-2.2	-1.4	-1.2	-2.2	< 3.0	Compliant
15:00 - 15:59	-2.3	-3.2	-2.7	-1.7	-1.6	-4.0	-0.4	-3.5	-3.1	-3.2	-2.5	-2.2	-1.4	-1.4	-1.5	< 3.0	Compliant
16:00 - 16:59	-2.5	-3.5	-2.6	-1.5	-1.8	-4.0	-0.4	-3.3	-2.7	-2.8	-2.0	-1.9	-2.0	-1.7	-1.3	< 3.0	Compliant
17:00 - 17:59	-2.0	-3.0	-2.5	-2.1	-1.7	-4.0	-0.8	-1.8	-3.6	-2.8	-2.2	-1.7	-2.0	-1.3	-1.6	< 3.0	Compliant
18:00 - 18:59	-2.2	-2.9	-2.8	-1.7	-1.5	-1.5	-0.9	-2.5	-4.1	-2.8	-2.2	-2.1	-2.0	-1.9	-2.3	< 3.0	Compliant
19:00 - 19:59	-2.2	-3.1	-2.8	-1.9	-1.9	-1.5	-0.9	-3.3	-4.7	-2.8	-2.5	-1.8	-2.2	-2.1	-1.5	< 3.0	Compliant
20:00 - 20:59	-2.2	-3.2	-2.5	-2.1	-2.4	-1.6	-1.8	-3.8	-5.2	-2.4	-2.3	-1.7	-1.5	-2.4	-2.2	< 3.0	Compliant
21:00 - 21:59	-2.2	-3.3	-2.4	-2.4	-2.2	-1.7	-1.8	-4.4	-5.6	-2.7	-2.5	-1.9	-2.4	-2.9	-2.2	< 3.0	Compliant
22:00 - 22:59	-3.1	-3.4	-2.1	-2.1	-2.1	-1.7	-1.8	-4.2	-5.0	-2.7	-2.6	-2.0	-2.2	-2.3	-2.2	< 3.0	Compliant
23:00 - 23:59	-3.1	-3.4	-2.5	-2.1	-2.6	-1.7	-2.1	-4.5	-5.0	-2.7	-2.5	-1.4	-2.5	-2.7	-2.2	< 3.0	Compliant

Time	16-Mar	17-Mar	18-Mar	19-Mar	20-Mar	21-Mar	22-Mar	23-Mar	24-Mar	25-Mar	26-Mar	27-Mar	28-Mar	29-Mar	30-Mar	31-Mar	NEQE Limit	Remarks
00:00 - 00:59	-3.2	-2.8	-2.9	-3.2	-3.4	-3.8	-2.2	-2.3	-2.4	-1.8	-2.3	-3.5	-1.6	-1.6	-1.5	-1.5	< 3.0	Compliant
01:00 - 01:59	-3.4	-2.8	-2.8	-3.5	-2.8	-3.0	-2.6	-2.3	-2.9	-1.8	-2.8	-3.1	-1.8	-2.0	-1.5	-1.5	< 3.0	Compliant
02:00 - 02:59	-3.4	-2.8	-2.8	-4.0	-3.0	-3.2	-2.3	-2.3	-2.9	-1.8	-2.5	-3.4	-2.1	-2.0	-1.7	-1.5	< 3.0	Compliant
03:00 - 03:59	-3.4	-2.7	-3.1	-4.1	-3.6	-3.2	-2.1	-2.3	-2.9	-2.5	-2.9	-3.6	-2.0	-1.6	-1.9	-1.3	< 3.0	Compliant
04:00 - 04:59	-3.4	-2.9	-2.9	-4.0	-3.6	-2.6	-2.6	-2.3	-2.6	-2.9	-2.7	-3.4	-1.9	-1.8	-1.8	-1.5	< 3.0	Compliant
05:00 - 05:59	-3.4	-2.9	-3.2	-4.3	-3.2	-3.1	-2.1	-3.3	-2.6	-2.9	-2.8	-3.6	-1.9	-1.8	-1.8	-1.6	< 3.0	Compliant
06:00 - 06:59	-3.4	-3.1	-3.1	-4.3	-3.2	-2.9	-2.3	-2.8	-2.8	-3.2	-2.7	-3.3	-2.6	-1.6	-1.9	-1.8	< 3.0	Compliant
07:00 - 07:59	-3.5	-3.6	-3.6	-4.1	-3.2	-3.2	-2.3	-2.7	-2.7	-3.0	-2.4	-3.1	-2.7	-2.0	-1.8	-1.8	< 3.0	Compliant
08:00 - 08:59	-3.5	-3.0	-3.5	-4.3	-3.3	-2.6	-2.0	-2.7	-2.5	-2.7	-2.1	-3.3	-2.7	-1.5	-2.0	-1.9	< 3.0	Compliant
09:00 - 09:59	-3.5	-3.1	-3.5	-4.2	-3.7	-3.5	-2.1	-2.7	-2.5	-2.5	-2.3	-3.1	-2.7	-1.7	-1.8	-1.6	< 3.0	Compliant
10:00 - 10:59	-3.5	-3.0	-3.5	-4.2	-3.2	-2.8	-2.2	-2.7	-2.5	-2.5	-2.5	-2.9	-2.6	-1.7	-2.0	-1.7	< 3.0	Compliant
11:00 - 11:59	-2.9	-2.6	-3.5	-4.5	-3.1	-3.2	-1.7	-2.8	-2.5	-2.5	-1.4	-2.2	-2.6	-1.3	-2.3	-1.4	< 3.0	Compliant
12:00 - 12:59	-2.9	-3.2	-2.8	-4.3	-2.6	-2.6	-1.9	-2.8	-2.5	-2.5	-1.3	-2.5	-0.7	-0.6	-2.0	-1.7	< 3.0	Compliant
13:00 - 13:59	-2.6	-2.1	-2.8	-3.1	-2.7	-3.2	-1.4	-2.1	-2.5	-2.0	-1.1	-2.3	-0.7	-0.5	-1.5	-2.1	< 3.0	Compliant
14:00 - 14:59	-2.6	-1.9	-2.8	-3.1	-2.3	-2.5	-1.3	-2.1	-2.5	-2.5	-1.7	-2.0	-0.4	-0.9	-0.8	-2.1	< 3.0	Compliant
15:00 - 15:59	-2.7	-2.2	-1.6	-2.9	-1.9	-1.8	-1.4	-2.1	-2.5	-2.1	-1.7	-1.5	-0.9	-1.3	-0.9	-2.2	< 3.0	Compliant
16:00 - 16:59	-2.1	-1.9	-1.0	-2.9	-2.6	-2.1	-1.2	-2.1	-2.5	-1.9	-2.1	-1.4	-0.8	-0.9	-1.0	-2.0	< 3.0	Compliant
17:00 - 17:59	-2.1	-1.8	-1.6	-2.5	-2.9	-1.7	-1.3	-2.1	-2.5	-1.6	-2.4	-1.3	-1.2	-0.9	-0.8	-1.7	< 3.0	Compliant
18:00 - 18:59	-2.1	-2.3	-2.7	-3.0	-3.3	-2.3	-1.7	-2.1	-2.5	-1.9	-2.4	-1.5	-1.3	-0.9	-0.8	-1.8	< 3.0	Compliant
19:00 - 19:59	-2.7	-2.5	-2.5	-3.4	-3.6	-2.6	-1.8	-2.1	-2.5	-2.1	-2.4	-1.4	-1.5	-0.6	-0.9	-1.9	< 3.0	Compliant
20:00 - 20:59	-2.4	-2.2	-3.0	-3.0	-4.1	-2.3	-2.2	-2.1	-2.5	-2.2	-3.2	-1.4	-1.6	-0.9	-0.8	-1.8	< 3.0	Compliant
21:00 - 21:59	-2.4	-2.4	-3.0	-3.3	-3.7	-2.5	-2.3	-2.1	-2.5	-2.4	-3.2	-1.4	-1.5	-0.8	-1.1	-1.9	< 3.0	Compliant
22:00 - 22:59	-2.4	-2.7	-3.0	-3.4	-3.8	-2.5	-2.3	-2.4	-2.5	-2.3	-3.6	-1.5	-1.4	-1.4	-1.2	-1.9	< 3.0	Compliant
23:00 - 23:59	-2.6	-2.3	-3.0	-3.4	-3.7	-2.0	-2.3	-2.4	-1.8	-2.6	-3.6	-1.6	-1.8	-1.5	-1.3	-2.1	< 3.0	Compliant

Remarks: (-) value: effluent is cooler than River water temperature

Annex-3

pH - April 2025

Time	1-Apr	2-Apr	3-Apr	4-Apr	5-Apr	6-Apr	7-Apr	8-Apr	9-Apr	10-Apr	11-Apr	12-Apr	13-Apr	14-Apr	15-Apr	NEQE Limit	Remarks
00:00 - 00:59	8.4	8.5	8.2	8.3	7.9	8.3	8.3	8.3	8.3	8.2	8.3	8.4	8.2	8.3	8.3	6 to 9	Compliant
01:00 - 01:59	8.5	8.6	8.1	8.3	8.2	8.1	8.2	8.4	8.3	8.2	8.3	8.4	8.2	8.3	8.2	6 to 9	Compliant
02:00 - 02:59	8.4	8.4	8.3	8.4	8.0	8.2	8.3	8.4	8.4	8.2	8.3	8.3	8.3	8.3	8.3	6 to 9	Compliant
03:00 - 03:59	8.4	8.5	8.1	8.2	8.1	8.1	8.2	8.3	8.4	8.2	8.3	8.3	8.2	8.3	8.2	6 to 9	Compliant
04:00 - 04:59	8.3	8.5	8.2	8.4	8.3	8.1	8.3	8.4	8.2	8.2	8.3	8.2	8.3	8.2	8.3	6 to 9	Compliant
05:00 - 05:59	8.4	8.5	8.2	8.1	8.2	8.2	8.3	8.4	8.3	8.3	8.3	8.4	8.2	8.2	8.2	6 to 9	Compliant
06:00 - 06:59	8.3	8.4	8.3	8.2	8.3	8.1	8.3	8.4	8.3	8.3	8.3	8.3	8.3	8.3	8.3	6 to 9	Compliant
07:00 - 07:59	8.3	8.4	8.3	8.2	8.2	8.2	8.3	8.4	8.3	8.3	8.3	8.2	8.3	8.3	8.3	6 to 9	Compliant
08:00 - 08:59	8.3	8.4	8.3	8.3	8.2	8.2	8.3	8.3	8.3	8.3	8.3	8.3	8.3	8.2	8.2	6 to 9	Compliant
09:00 - 09:59	8.3	8.5	8.3	8.3	8.2	8.1	8.2	8.3	8.3	8.2	8.3	8.3	8.3	8.3	8.2	6 to 9	Compliant
10:00 - 10:59	8.1	8.5	8.3	8.0	8.2	8.3	8.2	8.3	8.3	8.2	8.3	8.3	8.3	8.2	8.2	6 to 9	Compliant
11:00 - 11:59	8.2	8.4	8.3	8.2	8.1	8.2	8.3	8.4	8.3	8.3	8.3	8.3	8.3	8.2	8.3	6 to 9	Compliant
12:00 - 12:59	8.3	8.5	8.4	8.3	8.3	8.3	8.4	8.4	8.3	8.2	8.3	8.4	8.3	8.3	8.3	6 to 9	Compliant
13:00 - 13:59	8.4	8.5	8.4	8.4	8.2	8.3	8.4	8.4	8.3	8.2	8.4	8.4	8.4	8.4	8.2	6 to 9	Compliant
14:00 - 14:59	8.5	8.4	8.4	8.4	8.3	8.3	8.4	8.4	8.3	8.3	8.3	8.3	8.3	8.3	8.2	6 to 9	Compliant
15:00 - 15:59	8.4	8.6	8.5	8.4	8.3	8.4	8.4	8.3	8.3	8.2	8.3	8.3	8.3	8.3	8.2	6 to 9	Compliant
16:00 - 16:59	8.4	8.5	8.5	8.4	7.9	8.1	8.4	8.4	8.2	8.3	8.3	8.2	8.3	8.2	8.0	6 to 9	Compliant
17:00 - 17:59	8.3	8.6	8.5	8.4	8.3	8.4	8.4	8.4	8.4	8.3	8.3	8.2	8.3	8.4	8.1	6 to 9	Compliant
18:00 - 18:59	8.6	8.6	8.4	8.4	8.2	8.2	8.4	8.4	8.4	8.3	8.3	8.2	8.3	8.3	8.1	6 to 9	Compliant
19:00 - 19:59	8.6	8.4	8.4	8.4	8.4	8.2	8.4	8.4	8.4	8.3	8.4	8.1	8.4	8.3	8.1	6 to 9	Compliant
20:00 - 20:59	8.7	8.4	8.3	8.2	8.3	8.4	8.4	8.4	8.4	8.2	8.3	8.1	8.4	8.3	8.0	6 to 9	Compliant
21:00 - 21:59	8.7	8.5	8.3	8.3	8.2	8.3	8.3	8.4	8.2	8.3	8.4	8.1	8.3	8.3	8.1	6 to 9	Compliant
22:00 - 22:59	8.5	8.2	8.3	8.0	8.4	8.3	8.4	8.4	8.2	8.2	8.3	8.1	8.3	8.3	8.2	6 to 9	Compliant
23:00 - 23:59	8.5	8.4	8.3	8.3	8.4	8.2	8.3	8.4	8.2	8.3	8.4	8.1	8.3	8.3	8.0	6 to 9	Compliant

Time	16-Apr	17-Apr	18-Apr	19-Apr	20-Apr	21-Apr	22-Apr	23-Apr	24-Apr	25-Apr	26-Apr	27-Apr	28-Apr	29-Apr	30-Apr	NEQE Limit	Remarks
00:00 - 00:59	8.2	8.2	8.3	8.3	8.3	8.2	8.2	8.1	8.2	8.3	8.2	8.2	8.2	8.2	8.3	6 to 9	Compliant
01:00 - 01:59	8.1	8.1	8.2	8.3	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.3	8.3	8.2	8.3	6 to 9	Compliant
02:00 - 02:59	8.2	8.1	8.3	8.3	8.1	8.2	8.2	8.1	8.2	8.3	8.2	8.2	8.1	8.1	8.2	6 to 9	Compliant
03:00 - 03:59	8.1	8.1	8.2	8.2	8.3	8.2	8.2	8.1	8.2	8.2	8.1	8.3	8.2	8.2	8.4	6 to 9	Compliant
04:00 - 04:59	8.1	8.1	8.3	8.3	8.2	8.2	8.2	8.2	8.2	8.3	8.2	8.1	8.1	8.0	8.4	6 to 9	Compliant
05:00 - 05:59	8.0	8.1	8.1	8.3	8.2	8.2	8.2	8.1	8.2	8.2	8.3	8.1	8.2	8.2	8.4	6 to 9	Compliant
06:00 - 06:59	8.1	8.1	8.3	8.3	8.2	8.1	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.3	6 to 9	Compliant
07:00 - 07:59	8.0	7.9	8.2	8.2	8.2	8.1	8.2	8.2	8.2	8.2	8.2	8.0	8.1	8.2	8.2	6 to 9	Compliant
08:00 - 08:59	8.2	8.0	8.1	8.1	8.1	8.1	8.2	8.2	8.2	8.2	8.2	8.1	8.2	8.2	8.0	6 to 9	Compliant
09:00 - 09:59	8.0	8.0	7.9	8.1	8.2	8.1	8.2	8.2	8.2	8.2	8.2	8.2	8.1	8.2	8.1	6 to 9	Compliant
10:00 - 10:59	8.2	7.8	7.9	8.2	8.1	8.1	8.2	8.2	8.2	8.2	8.2	8.1	8.1	8.2	8.1	6 to 9	Compliant
11:00 - 11:59	8.2	7.9	8.0	8.3	8.2	8.2	8.1	8.2	8.1	8.3	8.2	7.9	8.1	8.0	8.1	6 to 9	Compliant
12:00 - 12:59	8.2	8.2	8.3	8.3	8.2	8.2	8.2	8.1	8.2	8.3	8.3	8.3	8.2	8.3	8.3	6 to 9	Compliant
13:00 - 13:59	8.2	8.0	8.2	8.4	7.9	8.1	7.9	7.8	8.1	8.2	8.2	8.2	8.1	8.2	8.2	6 to 9	Compliant
14:00 - 14:59	8.2	8.2	8.3	8.2	8.1	7.9	8.1	7.9	8.1	8.1	8.2	8.2	8.2	8.2	8.3	6 to 9	Compliant
15:00 - 15:59	8.2	8.0	8.3	8.2	8.0	8.2	8.2	8.2	8.3	8.3	8.2	8.1	8.3	8.3	8.2	6 to 9	Compliant
16:00 - 16:59	8.1	8.2	8.3	8.3	8.3	8.0	8.1	8.3	8.2	8.3	8.3	8.3	8.2	8.4	8.3	6 to 9	Compliant
17:00 - 17:59	8.1	8.2	8.3	8.2	8.0	8.2	8.3	8.3	8.1	8.3	8.3	8.3	8.3	8.3	8.4	6 to 9	Compliant
18:00 - 18:59	8.0	8.3	8.3	8.2	8.3	8.2	8.1	8.3	8.3	8.3	8.1	8.2	8.2	8.3	8.3	6 to 9	Compliant
19:00 - 19:59	7.9	8.2	8.3	8.3	8.2	8.2	8.3	8.3	8.3	8.2	8.3	8.3	8.2	8.3	8.3	6 to 9	Compliant
20:00 - 20:59	8.1	8.3	8.3	8.3	8.2	8.2	8.1	8.3	8.3	8.3	8.2	8.2	8.1	8.3	8.2	6 to 9	Compliant
21:00 - 21:59	8.0	8.3	8.2	8.3	8.2	8.3	8.1	8.3	8.3	8.2	8.3	8.3	8.2	8.3	8.3	6 to 9	Compliant
22:00 - 22:59	8.1	8.3	8.3	8.3	8.2	8.2	8.1	8.1	8.3	8.2	8.1	8.0	8.2	8.2	8.1	6 to 9	Compliant
23:00 - 23:59	8.0	8.2	8.2	8.3	8.2	8.2	8.2	8.2	8.2	8.2	8.3	8.2	8.2	8.3	8.2	6 to 9	Compliant

pH - May 2025

Time	1-May	2-May	3-May	4-May	5-May	6-May	7-May	8-May	9-May	10-May	11-May	12-May	13-May	14-May	15-May	NEQE Limit	Remarks
00:00 - 00:59	8.1	8.2	8.3	8.2	7.9	8.1	8.1	8.0	8.0	7.7	8.2	8.3	8.2	8.3	8.2	6 to 9	Compliant
01:00 - 01:59	8.2	8.1	8.2	8.2	8.2	7.8	8.0	8.0	8.1	8.1	7.9	8.5	8.3	8.2	8.2	6 to 9	Compliant
02:00 - 02:59	8.1	8.2	8.2	8.2	8.1	8.0	8.0	7.9	7.8	7.9	7.9	8.5	8.1	8.3	8.3	6 to 9	Compliant
03:00 - 03:59	8.2	8.1	8.2	8.2	8.2	7.9	8.0	8.0	8.1	8.2	8.2	8.5	8.1	8.3	8.2	6 to 9	Compliant
04:00 - 04:59	8.1	8.2	8.2	8.2	8.1	7.9	7.9	7.9	7.9	8.0	7.9	8.4	8.1	8.3	8.3	6 to 9	Compliant
05:00 - 05:59	8.1	8.1	8.2	8.2	8.2	8.0	7.8	7.8	8.1	8.0	8.0	8.4	8.3	8.3	8.2	6 to 9	Compliant
06:00 - 06:59	8.0	8.1	8.2	8.2	8.0	8.0	7.7	7.6	8.0	7.9	8.2	8.2	8.2	8.2	8.2	6 to 9	Compliant
07:00 - 07:59	8.0	8.0	8.2	8.2	8.2	8.0	7.7	7.8	8.1	7.7	8.0	8.3	8.2	8.2	8.3	6 to 9	Compliant
08:00 - 08:59	8.1	8.1	8.2	8.2	8.0	8.1	7.8	7.9	7.9	7.9	8.0	8.2	8.3	8.3	8.3	6 to 9	Compliant
09:00 - 09:59	8.0	7.9	8.2	8.2	7.8	7.9	7.9	8.0	7.9	7.7	8.0	8.3	8.3	8.2	8.3	6 to 9	Compliant
10:00 - 10:59	7.9	8.1	8.2	8.1	7.8	8.1	7.8	8.0	8.1	7.6	8.0	8.3	8.2	8.2	8.1	6 to 9	Compliant
11:00 - 11:59	8.1	8.2	8.2	8.1	7.9	8.1	7.8	8.0	8.1	7.6	7.9	8.3	8.3	8.3	8.2	6 to 9	Compliant
12:00 - 12:59	8.2	8.2	8.2	8.2	8.1	8.0	7.9	7.9	8.3	8.0	8.2	8.2	8.2	8.4	8.2	6 to 9	Compliant
13:00 - 13:59	8.1	8.3	8.1	8.0	7.8	8.1	7.9	7.9	8.1	8.0	8.1	8.3	8.4	8.4	8.3	6 to 9	Compliant
14:00 - 14:59	8.2	8.3	8.3	8.3	8.1	8.0	7.8	8.1	8.2	8.1	8.2	8.2	8.3	8.4	8.2	6 to 9	Compliant
15:00 - 15:59	8.2	8.3	8.3	8.1	8.1	8.0	7.9	8.0	8.2	8.1	8.4	8.3	8.4	8.3	8.2	6 to 9	Compliant
16:00 - 16:59	8.2	8.3	8.3	8.2	8.0	8.1	8.0	8.0	8.1	8.0	8.3	8.4	8.3	8.4	8.4	6 to 9	Compliant
17:00 - 17:59	8.2	8.3	8.0	8.1	8.1	7.9	8.1	8.1	8.4	8.1	8.3	8.4	8.4	8.3	8.4	6 to 9	Compliant
18:00 - 18:59	8.2	8.3	8.3	8.2	8.2	8.1	8.0	8.0	8.1	8.2	8.3	8.4	8.4	8.4	8.3	6 to 9	Compliant
19:00 - 19:59	8.1	8.2	8.0	8.2	8.0	7.9	8.1	8.1	8.3	8.2	8.3	8.3	8.3	8.3	8.4	6 to 9	Compliant
20:00 - 20:59	8.2	8.2	8.2	8.2	8.2	8.1	8.0	7.8	8.0	8.1	8.3	8.2	8.3	8.3	8.4	6 to 9	Compliant
21:00 - 21:59	8.1	8.2	8.2	8.2	8.0	7.9	8.0	8.0	8.2	8.2	8.2	8.4	8.2	8.2	8.4	6 to 9	Compliant
22:00 - 22:59	8.2	8.2	8.1	8.0	8.1	8.1	8.0	7.8	8.0	8.2	8.3	8.2	8.4	8.4	8.2	6 to 9	Compliant
23:00 - 23:59	8.0	8.2	8.2	8.0	8.0	8.0	8.0	8.1	8.1	8.0	8.3	8.3	8.3	8.2	8.2	6 to 9	Compliant

Time	16-May	17-May	18-May	19-May	20-May	21-May	22-May	23-May	24-May	25-May	26-May	27-May	28-May	29-May	30-May	31-May	NEQE Limit	Remarks
00:00 - 00:59	8.2	8.1	7.7	8.5	8.2	8.2	7.9	7.8	7.8	7.8	7.9	7.9	7.9	7.8	7.8	7.9	6 to 9	Compliant
01:00 - 01:59	8.3	8.2	7.6	8.5	8.3	8.1	7.8	7.8	7.8	7.8	7.9	8.0	7.8	7.6	7.8	7.8	6 to 9	Compliant
02:00 - 02:59	8.1	8.2	7.7	8.6	8.3	8.1	7.9	7.7	7.7	7.8	7.9	7.9	7.9	7.8	7.8	7.8	6 to 9	Compliant
03:00 - 03:59	8.3	8.2	7.7	8.6	8.2	8.0	7.9	7.7	7.8	7.8	7.9	8.0	7.9	7.7	7.7	7.8	6 to 9	Compliant
04:00 - 04:59	8.1	8.1	7.8	8.6	8.3	8.0	7.9	7.7	7.7	7.8	7.9	7.9	7.9	7.8	7.7	7.8	6 to 9	Compliant
05:00 - 05:59	8.3	8.1	7.8	8.5	8.1	7.9	7.8	7.8	7.8	7.8	7.9	7.9	7.8	7.8	7.7	7.8	6 to 9	Compliant
06:00 - 06:59	8.1	8.0	7.9	8.5	8.3	7.9	7.8	7.7	7.7	7.8	7.8	7.8	7.9	7.8	7.7	7.8	6 to 9	Compliant
07:00 - 07:59	8.1	8.0	7.9	8.4	8.3	7.9	7.7	7.7	7.8	7.8	7.7	7.9	7.8	7.8	7.7	7.8	6 to 9	Compliant
08:00 - 08:59	8.1	7.9	7.9	8.4	8.3	7.8	7.7	7.6	7.8	7.7	7.8	7.8	7.8	7.6	7.7	7.8	6 to 9	Compliant
09:00 - 09:59	8.1	7.9	8.0	8.4	8.3	7.8	7.4	7.6	7.7	7.5	7.8	7.8	7.7	7.7	7.8	7.8	6 to 9	Compliant
10:00 - 10:59	8.2	7.9	8.0	8.3	8.3	7.8	7.6	7.5	7.7	7.7	7.7	7.7	7.8	7.7	7.8	7.8	6 to 9	Compliant
11:00 - 11:59	8.1	7.7	8.0	8.6	8.3	7.8	7.6	7.5	7.7	7.8	7.8	7.8	7.8	7.7	7.8	7.9	6 to 9	Compliant
12:00 - 12:59	8.2	7.8	8.0	8.5	8.3	7.9	7.8	7.7	7.8	7.9	7.7	7.9	7.9	7.8	7.8	7.9	6 to 9	Compliant
13:00 - 13:59	8.3	7.7	8.0	8.7	8.2	7.9	7.4	7.8	7.5	7.7	7.8	7.9	7.9	7.8	7.9	8.0	6 to 9	Compliant
14:00 - 14:59	8.4	7.7	8.0	8.7	8.2	7.9	7.8	7.5	7.8	7.9	7.9	7.9	7.9	7.8	7.9	8.0	6 to 9	Compliant
15:00 - 15:59	8.2	7.9	8.2	8.8	8.2	7.8	7.6	7.8	7.9	7.9	7.9	7.9	7.9	7.8	7.9	8.0	6 to 9	Compliant
16:00 - 16:59	8.4	8.0	8.3	8.1	8.2	7.9	7.8	7.7	7.9	7.9	7.9	7.9	7.9	7.8	7.9	8.1	6 to 9	Compliant
17:00 - 17:59	8.3	7.9	8.3	8.2	8.2	7.9	7.5	7.9	7.9	7.9	7.9	7.9	7.9	7.8	7.9	7.9	6 to 9	Compliant
18:00 - 18:59	8.2	7.7	8.4	8.1	8.2	7.8	7.8	7.5	7.9	7.9	7.9	7.9	7.8	7.8	7.9	7.9	6 to 9	Compliant
19:00 - 19:59	8.2	7.7	8.5	8.3	8.2	7.8	7.8	7.7	7.9	7.9	7.9	7.9	7.8	7.8	7.9	7.9	6 to 9	Compliant
20:00 - 20:59	8.3	7.8	8.5	8.2	8.2	7.8	7.8	7.7	7.9	7.8	8.0	7.8	7.8	7.8	7.9	7.9	6 to 9	Compliant
21:00 - 21:59	8.2	7.7	8.5	8.3	8.2	7.8	7.7	7.8	7.8	7.9	7.8	7.9	7.8	7.8	7.9	7.9	6 to 9	Compliant
22:00 - 22:59	8.3	7.8	8.5	8.3	8.2	7.8	7.7	7.8	7.9	7.7	7.8	7.9	7.8	7.8	7.9	7.9	6 to 9	Compliant
23:00 - 23:59	8.2	7.7	8.5	8.2	8.2	7.7	7.8	7.8	7.8	7.9	7.8	7.8	7.7	7.8	7.9	8.0	6 to 9	Compliant

pH - June 2025

Time	1-Jun	2-Jun	3-Jun	4-Jun	5-Jun	6-Jun	7-Jun	8-Jun	9-Jun	10-Jun	11-Jun	12-Jun	13-Jun	14-Jun	15-Jun	NEQE Limit	Remarks
00:00 - 00:59	8.0	8.3	7.9	7.9	7.9	7.9	7.7	7.7	7.9	7.8	7.8	7.8	7.8	7.9	7.9	6 to 9	Compliant
01:00 - 01:59	8.0	8.3	7.9	7.8	7.9	7.9	7.7	7.7	7.9	7.9	7.9	7.8	7.9	7.9	7.9	6 to 9	Compliant
02:00 - 02:59	8.0	8.3	7.9	7.9	7.8	7.9	7.7	7.8	7.9	7.7	8.0	7.8	7.8	7.9	7.9	6 to 9	Compliant
03:00 - 03:59	8.1	8.3	7.9	7.8	7.8	7.9	7.7	7.7	7.9	7.8	7.9	7.8	7.8	7.9	7.9	6 to 9	Compliant
04:00 - 04:59	8.1	8.3	7.8	7.9	7.5	7.8	7.6	7.8	8.0	7.9	7.9	7.7	7.8	7.9	7.9	6 to 9	Compliant
05:00 - 05:59	8.1	8.2	7.8	7.8	7.8	7.7	7.6	7.9	7.9	7.8	8.0	7.8	7.9	7.9	7.9	6 to 9	Compliant
06:00 - 06:59	8.1	8.2	7.8	7.8	7.8	7.8	7.5	7.8	7.9	7.8	7.9	7.8	7.7	7.9	7.7	6 to 9	Compliant
07:00 - 07:59	8.1	8.2	7.8	7.8	7.8	7.7	7.4	7.6	7.8	7.7	7.9	7.8	7.6	7.9	7.9	6 to 9	Compliant
08:00 - 08:59	8.1	8.2	7.8	7.9	7.8	7.6	7.4	7.6	7.8	7.7	7.9	7.8	7.7	7.9	7.9	6 to 9	Compliant
09:00 - 09:59	8.1	8.2	7.9	7.9	7.9	7.4	7.3	7.6	7.8	7.8	7.8	7.7	7.7	7.9	7.9	6 to 9	Compliant
10:00 - 10:59	8.1	8.2	7.9	7.9	7.9	7.2	7.3	7.8	7.8	7.7	7.7	7.6	7.6	7.8	7.9	6 to 9	Compliant
11:00 - 11:59	8.1	8.2	7.9	7.9	7.6	7.2	7.3	7.8	7.8	8.0	7.5	7.5	7.6	7.9	7.9	6 to 9	Compliant
12:00 - 12:59	8.2	8.2	8.0	7.9	7.9	7.2	7.4	7.9	8.0	8.0	7.9	7.7	7.9	8.0	8.0	6 to 9	Compliant
13:00 - 13:59	8.2	8.2	7.9	7.9	8.0	7.3	7.5	7.9	8.0	8.0	7.9	7.7	7.9	8.0	8.0	6 to 9	Compliant
14:00 - 14:59	8.2	8.1	7.8	7.9	7.8	7.2	7.4	7.9	8.0	8.0	7.7	7.9	7.9	8.0	7.9	6 to 9	Compliant
15:00 - 15:59	8.3	8.1	7.9	7.8	8.0	7.5	7.6	8.0	7.9	7.9	7.8	7.8	8.0	7.8	8.0	6 to 9	Compliant
16:00 - 16:59	8.3	8.1	7.9	8.0	8.0	7.6	7.6	8.0	7.8	8.0	7.8	7.8	8.0	8.0	7.9	6 to 9	Compliant
17:00 - 17:59	8.3	8.1	7.8	8.0	8.0	7.6	7.6	7.8	7.8	7.8	7.8	7.9	8.0	8.0	8.0	6 to 9	Compliant
18:00 - 18:59	8.3	8.0	7.9	7.9	7.9	7.7	7.6	7.8	7.9	7.9	7.8	7.9	8.0	8.0	8.0	6 to 9	Compliant
19:00 - 19:59	8.3	8.0	7.8	7.9	7.9	7.8	7.7	8.0	7.8	8.0	7.8	7.9	8.0	7.9	7.9	6 to 9	Compliant
20:00 - 20:59	8.3	8.0	7.9	7.9	7.9	7.8	7.7	8.0	7.7	8.0	7.8	7.8	8.0	7.9	7.9	6 to 9	Compliant
21:00 - 21:59	8.3	7.9	7.8	7.9	7.9	7.6	7.7	7.9	7.9	7.9	7.6	7.9	7.9	7.9	7.9	6 to 9	Compliant
22:00 - 22:59	8.3	7.9	7.9	7.9	7.9	7.8	7.8	8.0	7.7	7.9	7.8	7.9	7.9	7.9	7.9	6 to 9	Compliant
23:00 - 23:59	8.3	7.9	7.8	7.9	7.9	7.8	7.8	7.9	7.5	7.9	7.8	7.8	8.0	7.8	7.9	6 to 9	Compliant

Time	16-Jun	17-Jun	18-Jun	19-Jun	20-Jun	21-Jun	22-Jun	23-Jun	24-Jun	25-Jun	26-Jun	27-Jun	28-Jun	29-Jun	30-Jun	NEQE Limit	Remarks
00:00 - 00:59	7.9	8.8	8.5	8.9	8.5	8.1	8.5	8.1	8.7	8.9	8.9	8.9	8.9	8.5	8.4	6 to 9	Compliant
01:00 - 01:59	8.0	8.6	8.5	8.9	8.4	8.1	8.5	8.2	8.8	8.9	8.9	8.8	8.8	8.5	8.2	6 to 9	Compliant
02:00 - 02:59	7.9	8.6	8.5	8.9	8.3	8.0	8.5	8.4	8.7	8.8	8.9	8.8	8.8	8.5	8.3	6 to 9	Compliant
03:00 - 03:59	7.8	8.4	8.5	8.9	8.3	8.0	8.6	8.5	8.7	8.8	8.9	8.6	8.6	8.4	8.4	6 to 9	Compliant
04:00 - 04:59	7.9	8.5	8.5	8.9	8.4	7.6	8.6	8.5	8.6	8.8	8.9	8.8	8.8	8.1	8.4	6 to 9	Compliant
05:00 - 05:59	7.9	8.4	8.5	9.0	8.4	7.5	8.6	8.4	8.6	8.8	8.8	8.8	8.8	7.7	8.4	6 to 9	Compliant
06:00 - 06:59	7.8	8.1	8.4	8.9	8.4	7.3	8.5	8.4	8.6	8.8	8.8	8.8	8.9	7.8	8.4	6 to 9	Compliant
07:00 - 07:59	7.8	8.0	8.1	8.8	8.4	7.1	8.6	8.5	8.7	8.8	8.9	8.8	7.8	7.7	8.4	6 to 9	Compliant
08:00 - 08:59	7.9	8.0	7.7	8.4	8.5	6.8	8.5	8.5	8.7	8.8	8.9	8.9	8.0	7.5	8.5	6 to 9	Compliant
09:00 - 09:59	7.9	8.0	7.3	8.3	8.4	6.6	8.6	8.5	8.7	8.8	8.9	8.9	8.0	7.4	8.5	6 to 9	Compliant
10:00 - 10:59	8.0	8.6	6.9	8.3	8.5	6.3	8.6	8.5	8.7	8.8	8.8	8.9	8.0	7.2	8.5	6 to 9	Compliant
11:00 - 11:59	8.0	7.6	7.0	8.2	8.5	6.1	8.7	8.5	8.7	8.9	8.7	8.7	7.9	7.1	8.5	6 to 9	Compliant
12:00 - 12:59	8.0	7.7	6.5	8.2	8.6	8.4	8.2	8.6	8.8	8.9	8.9	8.7	8.0	8.7	8.5	6 to 9	Compliant
13:00 - 13:59	6.7	7.7	7.0	8.2	8.6	8.2	8.2	8.6	8.9	8.9	8.8	8.8	8.0	8.9	8.6	6 to 9	Compliant
14:00 - 14:59	6.2	7.0	7.2	8.1	8.7	8.3	8.2	8.6	8.9	8.9	8.6	8.9	8.0	8.8	8.6	6 to 9	Compliant
15:00 - 15:59	8.0	7.1	8.3	8.1	8.8	8.4	8.2	8.7	8.5	8.9	8.7	8.9	8.0	8.6	8.6	6 to 9	Compliant
16:00 - 16:59	8.2	7.5	8.4	8.3	8.8	8.4	8.2	8.8	8.5	8.9	8.5	8.9	8.0	8.6	8.6	6 to 9	Compliant
17:00 - 17:59	8.5	7.7	8.5	8.4	8.0	8.5	8.2	8.8	8.5	8.9	8.3	8.9	8.0	8.7	8.6	6 to 9	Compliant
18:00 - 18:59	8.5	7.9	8.7	8.5	8.1	8.5	8.2	8.8	8.5	8.9	8.7	8.9	8.1	8.8	8.7	6 to 9	Compliant
19:00 - 19:59	8.6	8.0	8.8	8.6	8.0	8.5	8.2	8.7	8.6	8.4	8.9	8.9	8.1	8.8	8.7	6 to 9	Compliant
20:00 - 20:59	8.7	8.2	9.0	8.6	8.1	8.5	8.2	8.8	8.6	8.5	8.9	8.9	8.1	8.5	8.7	6 to 9	Compliant
21:00 - 21:59	8.7	8.3	9.0	8.5	8.2	8.5	8.2	8.8	8.6	8.5	8.9	8.9	8.1	8.5	8.7	6 to 9	Compliant
22:00 - 22:59	8.8	8.4	9.0	8.5	8.1	8.5	8.2	8.8	8.9	8.5	8.8	8.5	8.1	8.6	8.7	6 to 9	Compliant
23:00 - 23:59	8.7	8.4	9.0	8.4	8.1	8.5	8.2	8.8	8.9	8.9	8.9	8.6	8.1	8.7	8.7	6 to 9	Compliant

pH - July 2025

Time	1-Jul	2-Jul	3-Jul	4-Jul	5-Jul	6-Jul	7-Jul	8-Jul	9-Jul	10-Jul	11-Jul	12-Jul	13-Jul	14-Jul	15-Jul	NEQE Limit	Remarks
00:00 - 00:59	8.7	8.8	8.8	8.7	8.6	8.6	8.7	8.8	8.6	8.6	8.6	8.6	8.0	8.5	8.5	6 to 9	Compliant
01:00 - 01:59	8.7	8.8	8.8	8.7	8.6	8.6	8.7	8.8	8.6	8.6	8.5	8.4	8.5	8.5	8.5	6 to 9	Compliant
02:00 - 02:59	8.7	8.8	8.8	8.7	8.6	8.6	8.7	8.8	8.6	8.6	8.3	8.5	8.5	8.6	8.5	6 to 9	Compliant
03:00 - 03:59	8.7	8.9	8.8	8.7	8.6	8.6	8.7	8.7	8.6	8.7	8.5	8.6	8.4	8.5	8.5	6 to 9	Compliant
04:00 - 04:59	8.6	8.9	8.8	8.7	8.6	8.6	8.7	8.8	8.7	8.6	8.6	8.6	8.4	8.5	8.4	6 to 9	Compliant
05:00 - 05:59	8.6	8.9	8.8	8.7	8.6	8.6	8.6	8.7	8.6	8.6	8.5	8.5	8.4	8.5	8.4	6 to 9	Compliant
06:00 - 06:59	8.7	8.9	8.8	8.7	8.6	8.6	8.6	8.7	8.6	8.6	8.4	8.5	8.6	8.5	8.4	6 to 9	Compliant
07:00 - 07:59	8.7	8.9	8.8	8.7	8.6	8.6	8.7	8.7	8.6	8.6	8.4	8.4	8.6	8.5	8.4	6 to 9	Compliant
08:00 - 08:59	8.6	8.9	8.8	8.7	8.6	8.6	8.7	8.7	8.6	8.6	8.5	8.4	8.7	8.4	8.5	6 to 9	Compliant
09:00 - 09:59	8.6	8.9	8.8	8.7	8.5	8.6	8.7	8.7	8.6	8.6	8.5	8.4	8.5	8.4	8.5	6 to 9	Compliant
10:00 - 10:59	8.6	8.9	8.9	8.7	8.5	8.6	8.7	8.7	8.6	8.6	8.4	8.4	8.5	8.5	8.5	6 to 9	Compliant
11:00 - 11:59	8.6	8.8	8.8	8.7	8.4	8.7	8.7	8.7	8.6	8.6	8.5	8.4	8.5	8.5	7.9	6 to 9	Compliant
12:00 - 12:59	8.7	8.8	8.9	8.7	8.6	8.7	8.7	8.7	8.7	8.6	8.6	8.5	8.7	8.6	7.9	6 to 9	Compliant
13:00 - 13:59	8.7	8.7	8.7	8.7	8.5	8.7	8.8	8.8	8.7	8.6	8.7	8.6	8.7	8.6	8.0	6 to 9	Compliant
14:00 - 14:59	8.7	8.7	8.6	8.7	8.6	8.7	8.8	8.8	8.7	8.7	8.7	8.6	8.7	8.6	7.9	6 to 9	Compliant
15:00 - 15:59	8.7	8.7	8.7	8.7	8.7	8.8	8.8	8.8	8.8	8.6	8.7	8.5	8.7	8.6	8.0	6 to 9	Compliant
16:00 - 16:59	8.7	8.7	8.7	8.7	8.8	8.9	8.9	8.7	8.7	8.7	8.7	8.6	8.7	8.6	8.1	6 to 9	Compliant
17:00 - 17:59	8.7	8.7	8.7	8.6	8.7	8.9	8.9	8.7	8.7	8.7	8.6	8.6	8.7	8.7	8.1	6 to 9	Compliant
18:00 - 18:59	8.7	8.7	8.7	8.7	8.7	8.9	8.8	8.6	8.6	8.7	8.6	8.6	8.8	8.7	8.0	6 to 9	Compliant
19:00 - 19:59	8.7	8.8	8.7	8.6	8.7	8.8	8.8	8.6	8.7	8.5	8.5	8.4	8.7	8.6	8.0	6 to 9	Compliant
20:00 - 20:59	8.7	8.8	8.7	8.6	8.7	8.8	8.8	8.7	8.7	8.6	8.7	8.3	8.5	8.6	8.0	6 to 9	Compliant
21:00 - 21:59	8.7	8.8	8.7	8.6	8.6	8.8	8.9	8.6	8.7	8.7	8.5	8.6	8.2	8.6	8.3	6 to 9	Compliant
22:00 - 22:59	8.7	8.8	8.8	8.6	8.6	8.8	8.9	8.6	8.7	8.6	8.5	8.4	8.5	8.6	8.2	6 to 9	Compliant
23:00 - 23:59	8.7	8.8	8.8	8.6	8.6	8.8	8.8	8.6	8.7	8.5	8.5	8.4	8.5	8.6	8.2	6 to 9	Compliant

Time	16-Jul	17-Jul	18-Jul	19-Jul	20-Jul	21-Jul	22-Jul	23-Jul	24-Jul	25-Jul	26-Jul	27-Jul	28-Jul	29-Jul	30-Jul	31-Jul	NEQE Limit	Remarks
00:00 - 00:59	8.0	8.1	8.1	8.2	8.0	8.0	8.3	8.1	8.1	8.0	8.1	8.1	8.1	8.0	8.0	8.1	6 to 9	Compliant
01:00 - 01:59	8.2	8.1	8.2	8.2	7.9	7.7	8.3	8.1	8.0	8.0	8.1	8.1	8.1	8.1	8.1	8.1	6 to 9	Compliant
02:00 - 02:59	8.2	8.0	8.2	8.1	8.0	8.0	8.3	8.1	8.0	8.1	8.1	8.1	8.1	8.1	8.0	8.0	6 to 9	Compliant
03:00 - 03:59	8.1	8.0	8.1	8.1	8.0	8.1	8.3	8.0	8.1	8.1	8.1	8.1	8.1	8.1	8.1	7.9	6 to 9	Compliant
04:00 - 04:59	8.2	8.1	8.1	8.1	8.1	8.1	8.2	8.0	8.1	8.1	8.1	8.1	8.1	8.1	8.0	8.0	6 to 9	Compliant
05:00 - 05:59	8.1	8.1	8.1	8.1	8.1	8.0	8.2	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.0	8.1	6 to 9	Compliant
06:00 - 06:59	8.0	8.1	8.2	8.1	7.9	8.0	8.2	8.0	8.0	8.1	8.1	8.1	8.1	8.1	8.0	8.1	6 to 9	Compliant
07:00 - 07:59	8.1	8.0	8.1	8.0	8.1	8.3	8.1	8.0	8.1	8.1	8.1	8.1	8.1	8.0	7.9	8.0	6 to 9	Compliant
08:00 - 08:59	8.1	7.9	8.0	8.0	8.0	8.3	8.1	8.0	8.1	8.1	8.1	8.1	8.1	8.0	7.9	8.1	6 to 9	Compliant
09:00 - 09:59	8.0	7.6	8.0	8.0	8.0	8.2	8.0	8.0	8.0	8.1	8.1	8.1	8.1	7.9	7.9	8.1	6 to 9	Compliant
10:00 - 10:59	8.0	7.8	7.7	8.0	7.9	8.3	8.1	8.0	8.1	8.1	8.1	8.1	8.0	8.0	7.9	8.1	6 to 9	Compliant
11:00 - 11:59	8.0	7.9	7.9	7.9	8.0	8.1	8.0	8.0	8.0	8.1	8.1	8.1	8.0	8.0	7.8	8.1	6 to 9	Compliant
12:00 - 12:59	8.1	8.1	8.0	8.1	8.1	8.3	8.2	8.0	8.1	8.2	8.2	8.2	8.1	8.1	8.0	8.1	6 to 9	Compliant
13:00 - 13:59	8.0	7.9	8.1	8.2	8.1	8.3	8.2	7.9	8.1	8.2	8.2	8.2	7.9	8.1	8.1	8.2	6 to 9	Compliant
14:00 - 14:59	8.1	8.0	8.2	8.1	8.0	8.3	8.2	8.0	8.1	8.2	8.2	8.2	7.9	8.1	8.1	8.1	6 to 9	Compliant
15:00 - 15:59	8.1	8.0	8.2	8.2	8.1	8.3	8.1	8.1	8.2	8.2	8.2	8.2	8.1	8.1	8.1	8.2	6 to 9	Compliant
16:00 - 16:59	8.1	8.1	8.2	8.2	8.2	8.3	8.2	8.1	8.2	8.2	8.2	8.2	8.2	8.2	8.1	8.2	6 to 9	Compliant
17:00 - 17:59	8.1	8.2	8.1	8.2	8.2	8.3	8.2	8.1	8.2	8.2	8.2	8.2	8.1	8.2	8.2	8.2	6 to 9	Compliant
18:00 - 18:59	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.1	8.2	8.2	8.1	8.1	8.1	8.2	8.2	8.2	6 to 9	Compliant
19:00 - 19:59	8.1	8.2	8.2	8.2	8.1	8.2	8.2	8.1	8.2	8.2	8.1	8.1	8.1	8.1	8.1	8.2	6 to 9	Compliant
20:00 - 20:59	8.1	8.2	8.2	8.0	8.1	8.2	8.2	8.1	8.2	8.2	8.1	8.1	8.1	8.1	8.1	8.2	6 to 9	Compliant
21:00 - 21:59	8.1	8.1	8.2	8.1	8.1	8.4	8.1	8.1	8.1	8.2	8.0	8.2	8.1	8.1	8.1	8.4	6 to 9	Compliant
22:00 - 22:59	8.1	8.0	8.2	8.1	8.1	8.4	8.1	8.1	8.1	8.1	8.1	8.2	8.1	8.0	8.1	8.4	6 to 9	Compliant
23:00 - 23:59	8.1	8.1	8.1	8.1	8.1	8.4	8.1	8.0	8.1	8.1	8.1	8.1	8.1	8.0	8.1	8.4	6 to 9	Compliant

pH - August 2025

Time	1-Aug	2-Aug	3-Aug	4-Aug	5-Aug	6-Aug	7-Aug	8-Aug	9-Aug	10-Aug	11-Aug	12-Aug	13-Aug	14-Aug	15-Aug	NEQE Limit	Remarks
00:00 - 00:59	8.4	8.1	8.0	8.1	8.1	8.0	8.1	7.8	8.2	8.2	8.0	8.0	8.6	7.8	7.7	6 to 9	Compliant
01:00 - 01:59	8.3	8.0	8.0	8.1	8.1	8.0	8.0	7.8	8.2	7.8	8.0	8.0	8.6	7.9	7.8	6 to 9	Compliant
02:00 - 02:59	8.3	8.0	8.1	8.1	8.1	8.0	8.1	7.9	8.1	7.9	8.0	8.0	8.6	8.1	7.9	6 to 9	Compliant
03:00 - 03:59	8.3	8.0	8.1	8.1	8.1	8.0	8.1	7.9	8.1	7.7	7.9	8.0	8.6	8.0	7.8	6 to 9	Compliant
04:00 - 04:59	8.3	7.9	8.1	8.1	8.1	8.0	8.0	8.0	8.0	7.5	7.9	8.0	8.6	8.0	7.6	6 to 9	Compliant
05:00 - 05:59	8.2	8.0	8.1	8.1	8.0	8.0	8.1	8.0	8.0	7.4	7.9	8.0	8.6	8.0	7.6	6 to 9	Compliant
06:00 - 06:59	8.2	8.1	8.1	8.1	8.0	8.0	8.0	8.1	7.9	7.2	7.9	8.0	8.6	8.0	7.6	6 to 9	Compliant
07:00 - 07:59	8.2	8.1	8.1	8.0	8.1	8.0	8.0	8.1	7.9	7.1	8.0	8.0	8.6	8.0	7.8	6 to 9	Compliant
08:00 - 08:59	8.2	8.0	8.1	8.1	8.0	7.9	8.0	8.2	7.8	8.0	8.1	8.0	8.7	8.0	7.6	6 to 9	Compliant
09:00 - 09:59	8.1	8.0	8.1	8.1	7.9	7.9	8.0	8.2	7.8	8.0	8.1	8.0	8.7	8.0	7.6	6 to 9	Compliant
10:00 - 10:59	8.2	8.0	8.0	8.0	7.8	7.9	8.0	8.3	7.7	8.0	8.0	8.0	8.7	8.2	7.6	6 to 9	Compliant
11:00 - 11:59	8.1	8.0	8.0	8.0	8.0	7.9	8.1	8.3	7.7	8.0	8.1	8.0	8.7	8.3	7.6	6 to 9	Compliant
12:00 - 12:59	8.2	8.1	8.1	8.1	8.1	8.0	8.1	8.4	7.6	7.9	7.9	8.0	8.7	8.0	7.6	6 to 9	Compliant
13:00 - 13:59	8.0	8.1	8.1	8.2	8.1	8.1	8.1	8.4	7.6	8.0	7.9	8.0	8.7	8.0	7.6	6 to 9	Compliant
14:00 - 14:59	8.1	8.2	8.1	8.2	8.1	8.1	8.1	8.5	7.5	7.9	7.9	8.0	8.7	8.0	7.5	6 to 9	Compliant
15:00 - 15:59	8.1	8.1	8.2	8.2	8.1	8.1	8.1	8.2	7.5	7.9	8.0	8.0	8.8	8.0	7.5	6 to 9	Compliant
16:00 - 16:59	8.1	8.1	8.2	8.2	8.2	8.1	8.1	8.2	7.4	7.9	8.1	8.0	8.8	8.0	7.5	6 to 9	Compliant
17:00 - 17:59	8.0	8.1	8.2	8.2	8.1	8.1	8.0	8.2	7.4	7.9	8.1	8.0	8.8	8.0	7.5	6 to 9	Compliant
18:00 - 18:59	7.9	8.0	8.2	8.2	8.0	8.0	8.1	8.1	7.3	7.8	7.9	8.0	8.8	8.0	7.5	6 to 9	Compliant
19:00 - 19:59	8.0	8.0	8.2	8.2	8.1	8.1	8.1	8.2	7.3	7.8	7.9	8.0	8.8	8.0	7.5	6 to 9	Compliant
20:00 - 20:59	8.0	8.0	8.2	8.2	8.1	8.1	8.0	8.1	7.2	7.8	7.9	8.0	8.8	8.0	7.5	6 to 9	Compliant
21:00 - 21:59	7.8	8.0	8.1	8.2	8.1	8.1	8.0	8.2	7.2	7.8	8.0	8.0	8.8	8.0	7.4	6 to 9	Compliant
22:00 - 22:59	7.7	8.0	8.1	8.1	8.1	8.1	8.0	8.0	7.1	7.7	8.1	8.0	8.8	8.0	7.4	6 to 9	Compliant
23:00 - 23:59	8.1	8.0	8.1	8.1	8.1	8.1	8.0	8.0	7.1	7.7	8.1	8.0	8.8	8.0	7.4	6 to 9	Compliant

Time	16-Aug	17-Aug	18-Aug	19-Aug	20-Aug	21-Aug	22-Aug	23-Aug	24-Aug	25-Aug	26-Aug	27-Aug	28-Aug	29-Aug	30-Aug	31-Aug	NEQE Limit	Remarks
00:00 - 00:59	8.0	7.9	8.2	7.6	7.7	7.9	8.0	8.1	8.3	8.4	8.5	8.7	8.8	8.9	8.8	8.5	6 to 9	Compliant
01:00 - 01:59	7.9	7.9	8.2	7.8	7.8	7.9	7.9	8.0	8.0	8.1	8.1	8.1	8.2	8.2	8.3	8.3	6 to 9	Compliant
02:00 - 02:59	7.9	7.9	8.2	7.4	7.9	8.4	8.9	7.8	7.8	7.7	7.7	7.6	7.6	7.5	8.5	8.4	6 to 9	Compliant
03:00 - 03:59	8.0	7.9	8.2	7.8	7.9	8.0	8.1	7.7	7.5	7.4	7.3	7.1	7.0	8.7	8.8	8.9	6 to 9	Compliant
04:00 - 04:59	7.9	7.9	8.1	7.6	7.9	8.1	8.3	7.5	7.3	7.1	6.9	6.6	6.4	8.4	8.5	8.4	6 to 9	Compliant
05:00 - 05:59	7.9	7.9	8.1	7.8	7.9	7.9	7.9	7.4	7.1	6.8	8.0	6.5	7.3	8.1	8.1	8.2	6 to 9	Compliant
06:00 - 06:59	7.9	7.9	8.1	7.5	7.9	8.3	8.7	7.3	6.8	6.4	8.6	6.9	7.4	8.3	8.3	8.5	6 to 9	Compliant
07:00 - 07:59	7.8	7.9	8.1	7.8	7.9	7.9	7.9	7.1	6.6	8.1	8.1	8.1	8.2	8.2	8.2	8.3	6 to 9	Compliant
08:00 - 08:59	7.7	7.8	8.0	7.8	7.8	7.8	7.9	7.0	6.4	7.9	7.9	7.9	8.0	8.0	8.0	8.0	6 to 9	Compliant
09:00 - 09:59	7.5	7.9	8.0	7.8	7.8	7.7	7.7	6.8	6.8	7.6	7.6	7.6	7.6	7.5	7.5	7.5	6 to 9	Compliant
10:00 - 10:59	7.9	8.0	8.0	7.7	7.8	8.0	8.1	6.7	8.3	8.4	8.5	8.6	8.7	8.8	8.9	8.4	6 to 9	Compliant
11:00 - 11:59	7.7	7.9	8.0	7.8	7.9	7.9	7.9	8.0	8.0	8.1	8.1	8.2	8.2	8.2	8.3	8.3	6 to 9	Compliant
12:00 - 12:59	7.7	7.9	8.0	7.8	7.9	7.9	7.9	7.9	8.0	8.0	8.0	8.0	8.1	8.1	8.1	8.1	6 to 9	Compliant
13:00 - 13:59	7.6	7.9	8.0	7.8	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	8.0	8.0	6 to 9	Compliant
14:00 - 14:59	7.6	8.0	7.9	7.9	7.9	7.9	7.8	7.8	7.8	7.8	7.8	7.8	7.8	7.8	7.8	7.8	6 to 9	Compliant
15:00 - 15:59	7.6	8.0	7.9	7.9	7.9	7.8	7.8	7.8	7.8	7.7	7.7	7.7	7.7	7.7	7.6	7.6	6 to 9	Compliant
16:00 - 16:59	7.6	8.0	7.9	7.9	7.9	7.8	7.8	7.7	7.7	7.7	7.6	7.6	7.5	7.5	7.5	7.4	6 to 9	Compliant
17:00 - 17:59	7.5	8.0	7.9	7.9	7.9	7.8	7.8	7.7	7.6	7.6	7.5	7.5	7.4	7.4	7.3	7.3	6 to 9	Compliant
18:00 - 18:59	7.5	8.0	7.9	7.9	7.9	7.8	7.7	7.6	7.6	7.5	7.4	7.4	7.3	7.2	7.1	7.1	6 to 9	Compliant
19:00 - 19:59	7.5	8.0	7.8	8.0	7.9	7.8	7.7	7.6	7.5	7.4	7.3	7.2	7.2	7.1	7.0	6.9	6 to 9	Compliant
20:00 - 20:59	7.4	8.0	7.8	8.0	7.9	7.8	7.7	7.6	7.4	7.3	7.2	7.1	7.0	6.9	6.8	6.7	6 to 9	Compliant
21:00 - 21:59	7.4	8.0	7.8	8.0	7.9	7.7	7.6	7.5	7.4	7.3	7.1	7.0	6.9	6.8	6.7	6.5	6 to 9	Compliant
22:00 - 22:59	7.4	8.0	7.8	8.0	7.9	7.7	7.6	7.5	7.3	7.2	7.0	6.9	6.8	6.6	6.5	6.4	6 to 9	Compliant
23:00 - 23:59	7.4	8.0	7.8	8.0	7.9	7.7	7.6	7.4	7.3	7.1	6.9	6.8	6.6	6.5	6.3	6.2	6 to 9	Compliant

pH - September 2025

Time	1-Sep	2-Sep	3-Sep	4-Sep	5-Sep	6-Sep	7-Sep	8-Sep	9-Sep	10-Sep	11-Sep	12-Sep	13-Sep	14-Sep	15-Sep	NEQE Limit	Remarks
00:00 - 00:59	7.5	7.3	7.1	6.9	6.6	6.4	8.4	8.5	8.4	8.2	8.4	8.5	8.7	8.8	8.8	6 to 9	Compliant
01:00 - 01:59	7.4	7.1	6.8	8.0	6.5	7.3	8.1	8.1	8.2	8.2	8.3	8.5	8.6	8.8	8.9	6 to 9	Compliant
02:00 - 02:59	7.3	6.8	6.4	8.6	6.9	7.4	8.3	8.3	8.5	8.6	8.8	8.4	8.5	8.8	8.4	6 to 9	Compliant
03:00 - 03:59	7.1	6.6	8.1	8.1	8.1	8.2	8.2	8.2	8.3	8.7	8.9	8.3	8.4	8.8	8.6	6 to 9	Compliant
04:00 - 04:59	7.0	6.4	7.9	7.9	7.9	8.0	8.0	8.0	8.0	8.4	8.6	8.2	8.3	8.6	8.5	6 to 9	Compliant
05:00 - 05:59	6.8	6.8	7.6	7.6	7.6	7.6	7.5	7.5	7.5	8.4	7.8	8.2	8.2	8.8	8.1	6 to 9	Compliant
06:00 - 06:59	6.7	8.3	8.4	8.5	8.6	8.7	8.8	8.9	8.4	8.3	7.7	8.1	8.2	8.8	8.6	6 to 9	Compliant
07:00 - 07:59	8.0	8.0	8.1	8.1	8.2	8.2	8.2	8.3	8.3	8.3	7.4	8.0	8.1	8.8	8.6	6 to 9	Compliant
08:00 - 08:59	7.9	8.0	8.0	8.0	8.0	8.1	8.1	8.1	8.1	8.2	7.1	8.0	8.3	8.3	8.3	6 to 9	Compliant
09:00 - 09:59	7.9	7.9	7.9	7.9	7.9	7.9	7.9	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	6 to 9	Compliant
10:00 - 10:59	7.8	7.8	7.8	7.8	7.8	7.8	7.8	7.8	7.8	7.8	7.8	7.8	7.8	7.8	7.7	6 to 9	Compliant
11:00 - 11:59	7.8	7.8	7.7	7.7	7.7	7.7	7.7	7.6	7.6	7.6	7.6	7.5	7.5	7.5	7.5	6 to 9	Compliant
12:00 - 12:59	7.7	7.7	7.7	7.6	7.6	7.5	7.5	7.5	7.4	7.4	7.4	7.3	7.3	7.2	7.2	6 to 9	Compliant
13:00 - 13:59	7.7	7.6	7.6	7.5	7.5	7.4	7.4	7.3	7.3	7.2	7.1	7.1	7.0	7.0	6.9	6 to 9	Compliant
14:00 - 14:59	7.6	7.6	7.5	7.4	7.4	7.3	7.2	7.1	7.1	7.0	6.9	6.9	6.8	6.7	6.6	6 to 9	Compliant
15:00 - 15:59	7.6	7.5	7.4	7.3	7.2	7.2	7.1	7.0	6.9	6.8	6.7	6.6	6.5	6.4	6.4	6 to 9	Compliant
16:00 - 16:59	7.6	7.4	7.3	7.2	7.1	7.0	6.9	6.8	6.7	6.6	6.5	7.0	6.3	6.2	6.1	6 to 9	Compliant
17:00 - 17:59	7.5	7.4	7.3	7.1	7.0	6.9	6.8	6.7	6.5	6.4	6.3	6.8	6.8	6.8	6.8	6 to 9	Compliant
18:00 - 18:59	7.8	7.8	7.7	7.4	7.6	7.4	6.9	6.8	6.7	6.6	6.5	6.9	6.5	6.5	6.5	6 to 9	Compliant
19:00 - 19:59	7.8	7.9	7.7	7.3	7.6	7.4	6.8	6.7	6.6	6.5	6.3	6.4	6.9	6.9	6.9	6 to 9	Compliant
20:00 - 20:59	7.9	7.9	7.7	7.3	7.6	7.3	6.8	6.6	6.5	6.4	6.2	6.2	6.8	6.8	6.8	6 to 9	Compliant
21:00 - 21:59	7.9	8.0	7.7	7.2	7.6	7.3	6.7	6.5	6.4	6.2	6.9	6.8	6.9	6.9	6.9	6 to 9	Compliant
22:00 - 22:59	7.9	8.0	7.8	7.2	7.6	7.3	6.6	6.4	6.3	6.5	6.7	6.7	6.9	6.9	6.9	6 to 9	Compliant
23:00 - 23:59	7.9	8.1	7.8	7.2	7.6	7.3	6.5	6.3	6.2	6.8	6.4	7.0	7.0	7.0	7.0	6 to 9	Compliant

Time	16-Sep	17-Sep	18-Sep	19-Sep	20-Sep	21-Sep	22-Sep	23-Sep	24-Sep	25-Sep	26-Sep	27-Sep	28-Sep	29-Sep	30-Sep	NEQE Limit	Remarks
00:00 - 00:59	7.9	7.9	8.2	7.4	7.9	8.4	8.9	8.5	8.7	8.8	8.9	8.8	8.5	8.7	8.6	6 to 9	Compliant
01:00 - 01:59	8.0	7.9	8.2	7.8	7.9	8.0	8.1	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	6 to 9	Compliant
02:00 - 02:59	7.9	7.9	8.1	7.6	7.9	8.1	8.3	8.2	8.2	8.2	8.3	8.3	8.4	8.4	8.4	6 to 9	Compliant
03:00 - 03:59	7.9	7.9	8.1	7.8	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	6 to 9	Compliant
04:00 - 04:59	7.9	7.9	8.1	7.5	7.9	8.3	8.7	8.4	8.6	8.7	8.8	8.9	9.0	8.5	8.6	6 to 9	Compliant
05:00 - 05:59	7.8	7.9	8.1	7.8	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	8.0	8.0	6 to 9	Compliant
06:00 - 06:59	7.7	7.8	8.0	7.8	7.8	7.8	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	6 to 9	Compliant
07:00 - 07:59	7.5	7.9	8.0	7.8	7.8	7.7	7.7	7.8	7.8	7.8	7.8	7.8	7.8	7.8	7.8	6 to 9	Compliant
08:00 - 08:59	7.9	8.0	8.0	7.7	7.8	8.0	8.1	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	6 to 9	Compliant
09:00 - 09:59	7.7	7.9	8.0	7.8	7.9	7.9	7.9	7.9	8.0	8.0	8.0	8.0	8.0	8.1	8.1	6 to 9	Compliant
10:00 - 10:59	7.7	7.9	8.0	7.8	7.9	7.9	7.9	7.9	7.9	8.0	8.0	8.0	8.0	8.0	8.1	6 to 9	Compliant
11:00 - 11:59	7.6	7.9	8.0	7.8	7.9	7.9	7.9	7.9	7.9	8.0	8.0	8.0	8.0	8.0	8.0	6 to 9	Compliant
12:00 - 12:59	7.6	8.0	7.9	7.9	7.9	7.9	7.8	7.9	7.9	7.9	8.0	8.0	8.0	8.0	8.0	6 to 9	Compliant
13:00 - 13:59	7.6	8.0	7.9	7.9	7.9	7.8	7.8	7.9	7.9	7.9	7.9	7.9	8.0	8.0	8.0	6 to 9	Compliant
14:00 - 14:59	7.6	8.0	7.9	7.9	7.9	7.8	7.8	7.9	7.9	7.9	7.9	7.9	7.9	8.0	8.0	6 to 9	Compliant
15:00 - 15:59	7.5	8.0	7.9	7.9	7.9	7.8	7.8	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	6 to 9	Compliant
16:00 - 16:59	7.5	8.0	7.9	7.9	7.9	7.8	7.7	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	6 to 9	Compliant
17:00 - 17:59	7.5	8.0	7.8	8.0	7.9	7.8	7.7	7.8	7.8	7.9	7.9	7.9	7.9	7.9	7.9	6 to 9	Compliant
18:00 - 18:59	7.4	8.0	7.8	8.0	7.9	7.8	7.7	7.8	7.8	7.8	7.8	7.9	7.9	7.9	7.9	6 to 9	Compliant
19:00 - 19:59	7.4	8.0	7.8	8.0	7.9	7.7	7.5	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	6 to 9	Compliant
20:00 - 20:59	7.4	8.0	7.8	8.0	7.9	7.7	7.5	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	6 to 9	Compliant
21:00 - 21:59	7.4	8.0	7.8	8.1	7.9	7.7	7.5	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.6	6 to 9	Compliant
22:00 - 22:59	7.3	8.0	7.7	8.1	7.9	7.6	7.4	7.7	7.7	7.7	7.6	7.6	7.6	7.6	7.6	6 to 9	Compliant
23:00 - 23:59	7.3	8.0	7.7	8.1	7.9	7.6	7.4	7.7	7.6	7.6	7.6	7.6	7.6	7.6	7.6	6 to 9	Compliant

pH - October 2025

Time	1-Oct	2-Oct	3-Oct	4-Oct	5-Oct	6-Oct	7-Oct	8-Oct	9-Oct	10-Oct	11-Oct	12-Oct	13-Oct	14-Oct	15-Oct	NEQE Limit	Remarks
00:00 - 00:59	7.7	7.8	8.0	8.1	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.1	8.1	8.1	6 to 9	Compliant
01:00 - 01:59	7.8	7.9	7.9	7.9	7.9	8.0	8.0	8.0	8.0	8.0	8.1	8.1	8.1	8.1	8.2	6 to 9	Compliant
02:00 - 02:59	7.8	7.9	7.9	7.9	7.9	7.9	8.0	8.0	8.0	8.0	8.0	8.1	8.1	8.1	8.1	6 to 9	Compliant
03:00 - 03:59	7.8	7.9	7.9	7.9	7.9	7.9	8.0	8.0	8.0	8.0	8.0	8.0	8.1	8.1	8.1	6 to 9	Compliant
04:00 - 04:59	7.9	7.9	7.9	7.8	7.9	7.9	7.9	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.1	6 to 9	Compliant
05:00 - 05:59	7.9	7.9	7.8	7.8	7.9	7.9	7.9	7.9	7.9	8.0	8.0	8.0	8.0	8.0	8.0	6 to 9	Compliant
06:00 - 06:59	7.9	7.9	7.8	7.8	7.9	7.9	7.9	7.9	7.9	7.9	8.0	8.0	8.0	8.0	8.0	6 to 9	Compliant
07:00 - 07:59	7.9	7.9	7.8	7.8	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	8.0	8.0	6 to 9	Compliant
08:00 - 08:59	7.9	7.9	7.8	7.7	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	6 to 9	Compliant
09:00 - 09:59	8.0	7.9	7.8	7.7	7.8	7.8	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	6 to 9	Compliant
10:00 - 10:59	8.0	7.9	7.8	7.7	7.8	7.8	7.8	7.8	7.9	7.9	7.9	7.9	7.9	7.9	7.9	6 to 9	Compliant
11:00 - 11:59	8.0	7.9	7.7	7.5	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	6 to 9	Compliant
12:00 - 12:59	8.0	7.9	7.7	7.5	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.6	7.6	7.6	6 to 9	Compliant
13:00 - 13:59	8.1	7.9	7.7	7.5	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.6	7.6	7.6	7.5	6 to 9	Compliant
14:00 - 14:59	8.1	7.9	7.7	7.5	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.6	7.6	7.6	6 to 9	Compliant
15:00 - 15:59	8.1	7.9	7.6	7.4	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.6	7.6	7.5	6 to 9	Compliant
16:00 - 16:59	8.1	7.9	7.6	7.4	7.7	7.7	7.7	7.7	7.6	7.6	7.6	7.6	7.5	7.5	7.5	6 to 9	Compliant
17:00 - 17:59	8.1	7.9	7.6	7.3	7.7	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.5	7.5	7.5	6 to 9	Compliant
18:00 - 18:59	8.2	7.9	7.6	7.3	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.5	7.4	7.4	6 to 9	Compliant
19:00 - 19:59	8.2	7.9	7.6	7.3	7.6	7.6	7.6	7.6	7.6	7.6	7.5	7.5	7.4	7.4	7.4	6 to 9	Compliant
20:00 - 20:59	8.2	7.9	7.5	7.2	7.6	7.6	7.6	7.6	7.5	7.5	7.5	7.5	7.4	7.4	7.3	6 to 9	Compliant
21:00 - 21:59	8.2	7.9	7.5	7.2	7.6	7.6	7.5	7.5	7.5	7.5	7.5	7.5	7.3	7.3	7.3	6 to 9	Compliant
22:00 - 22:59	8.2	7.9	7.5	7.1	7.6	7.5	7.5	7.5	7.5	7.5	7.5	7.4	7.3	7.3	7.2	6 to 9	Compliant
23:00 - 23:59	8.3	7.9	7.5	7.1	7.5	7.5	7.5	7.5	7.5	7.4	7.4	7.4	7.3	7.2	7.2	6 to 9	Compliant

Time	16-Oct	17-Oct	18-Oct	19-Oct	20-Oct	21-Oct	22-Oct	23-Oct	24-Oct	25-Oct	26-Oct	27-Oct	28-Oct	29-Oct	30-Oct	31-Oct	NEQE Limit	Remarks
00:00 - 00:59	7.7	7.5	7.7	7.7	7.7	7.7	7.7	7.7	7.8	7.8	7.8	7.8	7.9	7.9	7.9	7.9	6 to 9	Compliant
01:00 - 01:59	7.6	7.4	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.8	7.8	7.8	7.8	7.9	7.9	7.9	6 to 9	Compliant
02:00 - 02:59	7.6	7.4	7.7	7.7	7.7	7.7	7.6	7.7	7.7	7.7	7.8	7.8	7.8	7.8	7.9	7.9	6 to 9	Compliant
03:00 - 03:59	7.6	7.3	7.7	7.6	7.6	7.6	7.6	7.7	7.7	7.7	7.7	7.8	7.8	7.8	7.8	7.9	6 to 9	Compliant
04:00 - 04:59	7.6	7.3	7.6	7.6	7.6	7.6	7.6	7.7	7.7	7.7	7.7	7.7	7.8	7.8	7.8	7.8	6 to 9	Compliant
05:00 - 05:59	7.6	7.3	7.6	7.6	7.6	7.6	7.6	7.6	7.7	7.7	7.7	7.7	7.7	7.8	7.8	7.8	6 to 9	Compliant
06:00 - 06:59	7.5	7.2	7.6	7.6	7.6	7.6	7.5	7.6	7.6	7.7	7.7	7.7	7.7	7.8	7.8	7.8	6 to 9	Compliant
07:00 - 07:59	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	6 to 9	Compliant
08:00 - 08:59	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	6 to 9	Compliant
09:00 - 09:59	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.1	6 to 9	Compliant
10:00 - 10:59	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6 to 9	Compliant
11:00 - 11:59	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6 to 9	Compliant
12:00 - 12:59	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	6 to 9	Compliant
13:00 - 13:59	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	6 to 9	Compliant
14:00 - 14:59	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	6 to 9	Compliant
15:00 - 15:59	7.5	7.5	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	6 to 9	Compliant
16:00 - 16:59	7.4	7.5	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.3	7.3	6 to 9	Compliant
17:00 - 17:59	7.4	7.6	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.3	7.3	7.3	7.3	7.3	6 to 9	Compliant
18:00 - 18:59	7.4	7.6	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.3	7.3	7.3	7.3	7.3	7.3	6 to 9	Compliant
19:00 - 19:59	7.4	7.6	7.4	7.4	7.4	7.4	7.4	7.4	7.3	7.3	7.3	7.3	7.3	7.3	7.3	7.2	6 to 9	Compliant
20:00 - 20:59	7.4	7.6	7.4	7.4	7.4	7.4	7.4	7.4	7.3	7.3	7.3	7.3	7.3	7.2	7.2	7.2	6 to 9	Compliant
21:00 - 21:59	7.4	7.6	7.4	7.4	7.4	7.4	7.4	7.3	7.3	7.3	7.3	7.3	7.2	7.2	7.2	7.2	6 to 9	Compliant
22:00 - 22:59	7.4	7.7	7.4	7.4	7.4	7.4	7.4	7.3	7.3	7.3	7.3	7.2	7.2	7.2	7.2	7.1	6 to 9	Compliant
23:00 - 23:59	7.4	7.7	7.3	7.3	7.4	7.4	7.4	7.3	7.3	7.3	7.2	7.2	7.2	7.2	7.1	7.1	6 to 9	Compliant

pH - November 2025

Time	1-Nov	2-Nov	3-Nov	4-Nov	5-Nov	6-Nov	7-Nov	8-Nov	9-Nov	10-Nov	11-Nov	12-Nov	13-Nov	14-Nov	15-Nov	Remarks
00:00 - 00:59	7.6	7.6	7.7	7.7	7.7	7.7	7.7	7.8	7.8	7.8	7.8	7.9	7.9	7.9	8.0	Compliant
01:00 - 01:59	7.6	7.6	7.6	7.6	7.7	7.7	7.7	7.8	7.8	7.8	7.8	7.9	7.9	7.9	7.9	Compliant
02:00 - 02:59	7.6	7.5	7.6	7.6	7.7	7.7	7.7	7.7	7.8	7.8	7.8	7.8	7.9	7.9	7.9	Compliant
03:00 - 03:59	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	Compliant
04:00 - 04:59	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	Compliant
05:00 - 05:59	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.1	Compliant
06:00 - 06:59	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	Compliant
07:00 - 07:59	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	Compliant
08:00 - 08:59	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	Compliant
09:00 - 09:59	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	Compliant
10:00 - 10:59	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	Compliant
11:00 - 11:59	7.6	7.6	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.4	7.4	7.4	Compliant
12:00 - 12:59	7.6	7.6	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.4	7.4	7.4	7.4	Compliant
13:00 - 13:59	7.6	7.6	7.6	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.4	7.4	7.4	7.4	7.4	Compliant
14:00 - 14:59	7.6	7.6	7.6	7.6	7.5	7.5	7.5	7.5	7.5	7.4	7.4	7.4	7.4	7.4	7.4	Compliant
15:00 - 15:59	7.6	7.6	7.6	7.6	7.5	7.5	7.5	7.5	7.5	7.4	7.4	7.4	7.4	7.4	7.3	Compliant
16:00 - 16:59	7.6	7.6	7.6	7.6	7.5	7.5	7.5	7.5	7.5	7.4	7.4	7.4	7.4	7.3	7.3	Compliant
17:00 - 17:59	7.6	7.7	7.6	7.6	7.6	7.5	7.5	7.5	7.4	7.4	7.4	7.4	7.3	7.3	7.3	Compliant
18:00 - 18:59	7.7	7.7	7.6	7.6	7.6	7.5	7.5	7.5	7.4	7.4	7.4	7.4	7.3	7.3	7.3	Compliant
19:00 - 19:59	7.7	7.7	7.6	7.6	7.6	7.5	7.5	7.5	7.4	7.4	7.4	7.3	7.3	7.3	7.2	Compliant
20:00 - 20:59	7.7	7.7	7.6	7.6	7.6	7.5	7.5	7.5	7.4	7.4	7.4	7.3	7.3	7.3	7.2	Compliant
21:00 - 21:59	7.7	7.7	7.6	7.6	7.6	7.5	7.5	7.5	7.4	7.4	7.3	7.3	7.3	7.2	7.2	Compliant
22:00 - 22:59	7.7	7.7	7.6	7.6	7.6	7.5	7.5	7.5	7.4	7.4	7.3	7.3	7.3	7.2	7.2	Compliant
23:00 - 23:59	7.7	7.8	7.6	7.6	7.6	7.5	7.5	7.5	7.4	7.4	7.3	7.3	7.2	7.2	7.1	Compliant

Time	16-Nov	17-Nov	18-Nov	19-Nov	20-Nov	21-Nov	22-Nov	23-Nov	24-Nov	25-Nov	26-Nov	27-Nov	28-Nov	29-Nov	30-Nov	NEQE Limit	Remarks
00:00 - 00:59	8.2	8.2	8.1	8.1	8.2	8.4	8.3	8.1	8.3	8.2	7.9	8.1	8.1	8.7	8.2	6 to 9	Compliant
01:00 - 01:59	8.3	8.2	8.1	8.1	8.2	8.3	8.2	8.2	8.3	8.2	7.9	8.1	8.1	8.5	8.2	6 to 9	Compliant
02:00 - 02:59	8.3	8.1	8.1	8.1	8.2	8.4	8.2	8.2	8.2	8.2	7.9	8.1	8.1	8.7	8.3	6 to 9	Compliant
03:00 - 03:59	8.3	8.1	8.2	8.1	8.2	8.4	8.3	8.1	8.2	8.2	7.8	8.1	8.1	8.6	8.2	6 to 9	Compliant
04:00 - 04:59	8.2	8.2	8.2	8.2	8.1	8.0	8.2	8.2	8.3	8.2	7.8	8.2	8.1	8.6	8.3	6 to 9	Compliant
05:00 - 05:59	8.2	8.2	8.2	8.2	8.1	8.3	8.2	8.3	8.2	8.2	7.8	8.1	8.2	8.6	8.3	6 to 9	Compliant
06:00 - 06:59	8.3	8.2	8.2	8.2	8.1	8.3	8.3	8.2	8.2	8.2	7.8	8.2	8.1	8.5	8.3	6 to 9	Compliant
07:00 - 07:59	8.2	8.1	8.2	8.1	8.0	8.3	8.2	8.5	8.2	8.2	7.8	8.2	8.1	8.5	8.3	6 to 9	Compliant
08:00 - 08:59	8.2	8.2	8.1	8.0	7.9	8.2	8.2	8.5	8.2	8.2	7.8	8.1	8.1	8.5	8.3	6 to 9	Compliant
09:00 - 09:59	8.2	8.1	8.2	8.1	7.9	8.1	8.1	8.3	8.2	8.2	7.8	8.1	8.1	8.4	8.2	6 to 9	Compliant
10:00 - 10:59	8.2	8.1	8.2	8.0	7.7	7.9	7.9	8.5	8.1	8.2	7.7	8.1	8.0	8.4	8.2	6 to 9	Compliant
11:00 - 11:59	8.2	8.2	8.2	8.1	8.0	8.2	7.8	8.6	8.2	8.1	7.7	8.1	8.0	8.3	8.1	6 to 9	Compliant
12:00 - 12:59	8.2	8.2	8.2	8.2	8.1	8.3	8.2	8.5	8.2	8.1	7.8	8.0	8.0	8.4	8.2	6 to 9	Compliant
13:00 - 13:59	8.2	8.3	8.2	8.2	8.2	8.3	8.2	8.5	8.3	8.0	7.8	8.1	8.0	8.4	8.0	6 to 9	Compliant
14:00 - 14:59	8.3	8.2	8.2	8.2	8.2	8.3	8.2	8.4	8.3	8.0	7.7	8.1	8.1	8.4	7.8	6 to 9	Compliant
15:00 - 15:59	8.3	8.2	8.2	8.2	8.2	8.3	8.2	8.3	8.3	8.0	7.7	8.1	8.2	8.3	7.8	6 to 9	Compliant
16:00 - 16:59	8.3	8.0	8.3	8.3	8.2	8.3	8.3	8.2	8.3	8.0	7.8	8.1	8.2	8.4	7.9	6 to 9	Compliant
17:00 - 17:59	8.3	8.1	8.3	8.3	8.2	8.3	8.3	8.3	8.3	8.0	7.8	8.0	8.2	8.4	7.9	6 to 9	Compliant
18:00 - 18:59	8.2	8.1	8.2	8.1	8.0	8.3	8.2	8.3	8.3	8.0	7.8	8.2	8.3	8.4	8.0	6 to 9	Compliant
19:00 - 19:59	8.3	8.0	8.2	8.2	8.0	8.3	8.2	8.2	8.3	8.0	7.8	8.2	8.2	8.3	8.0	6 to 9	Compliant
20:00 - 20:59	8.2	8.1	8.1	8.2	8.0	8.3	8.2	8.2	8.3	7.9	8.0	8.1	8.2	8.3	7.9	6 to 9	Compliant
21:00 - 21:59	8.1	8.1	8.2	8.2	8.7	8.2	8.2	8.3	8.2	7.9	8.0	7.9	8.2	8.3	8.1	6 to 9	Compliant
22:00 - 22:59	8.2	8.1	8.2	8.2	8.4	8.2	8.2	8.2	8.2	7.9	8.0	8.1	8.9	8.3	8.1	6 to 9	Compliant
23:00 - 23:59	8.2	8.2	8.0	8.2	8.5	8.3	8.2	8.2	8.2	7.9	8.1	8.1	8.8	8.3	8.1	6 to 9	Compliant

pH - December 2025

Time	1-Dec	2-Dec	3-Dec	4-Dec	5-Dec	6-Dec	7-Dec	8-Dec	9-Dec	10-Dec	11-Dec	12-Dec	13-Dec	14-Dec	15-Dec	NEQE Limit	Remarks
00:00 - 00:59	8.1	8.1	8.2	8.2	8.0	8.1	8.4	8.4	7.8	7.7	7.8	7.9	8.0	8.1	8.1	6 to 9	Compliant
01:00 - 01:59	8.1	8.6	8.3	8.2	8.0	8.1	8.4	8.3	8.0	7.7	7.8	8.0	8.1	8.1	8.1	6 to 9	Compliant
02:00 - 02:59	8.1	8.6	8.4	8.2	8.0	8.1	8.4	8.3	8.1	7.8	7.8	8.0	8.1	8.1	8.1	6 to 9	Compliant
03:00 - 03:59	8.5	8.6	8.3	8.2	7.9	8.1	8.3	8.3	8.1	7.9	7.9	8.0	8.0	8.2	8.1	6 to 9	Compliant
04:00 - 04:59	8.5	8.6	8.3	8.2	8.0	8.1	8.3	8.3	8.1	7.9	7.9	8.0	8.1	8.1	8.1	6 to 9	Compliant
05:00 - 05:59	8.5	8.6	8.3	8.2	8.1	8.0	8.3	8.2	8.1	7.9	7.9	7.9	8.0	8.1	8.1	6 to 9	Compliant
06:00 - 06:59	8.5	8.5	8.3	8.2	8.1	8.1	8.3	8.2	8.1	7.9	7.9	8.0	8.0	8.1	8.4	6 to 9	Compliant
07:00 - 07:59	8.4	8.5	8.6	8.2	8.0	8.1	8.2	8.2	8.0	7.9	7.9	8.5	8.0	8.1	8.6	6 to 9	Compliant
08:00 - 08:59	8.4	8.4	8.5	8.2	8.0	8.0	8.2	8.2	8.1	7.9	7.9	8.0	7.8	8.1	8.5	6 to 9	Compliant
09:00 - 09:59	8.4	8.4	8.5	8.1	8.0	8.0	8.1	8.2	8.1	7.8	7.8	8.3	8.1	8.1	8.5	6 to 9	Compliant
10:00 - 10:59	8.4	8.4	8.4	8.1	7.8	8.0	8.1	8.1	8.0	7.8	7.9	8.2	8.1	8.0	8.5	6 to 9	Compliant
11:00 - 11:59	8.4	8.4	8.4	8.1	8.0	8.0	8.1	8.1	8.0	7.7	7.9	8.5	8.1	8.0	8.4	6 to 9	Compliant
12:00 - 12:59	8.3	8.2	8.4	8.1	8.0	8.0	8.1	8.1	8.0	7.8	7.8	8.3	8.1	8.0	8.3	6 to 9	Compliant
13:00 - 13:59	8.3	8.3	8.4	8.1	8.1	8.1	8.1	8.1	8.1	7.8	7.9	8.3	8.1	8.0	8.3	6 to 9	Compliant
14:00 - 14:59	8.3	8.4	8.4	8.1	8.1	8.0	8.0	8.0	7.8	7.8	7.9	8.2	8.1	8.0	8.2	6 to 9	Compliant
15:00 - 15:59	8.3	8.3	8.3	8.1	8.1	8.0	8.1	7.9	7.4	7.8	7.9	8.2	8.1	8.0	8.2	6 to 9	Compliant
16:00 - 16:59	8.3	8.3	8.3	8.1	8.1	8.1	8.1	7.9	7.3	7.8	7.9	8.2	8.1	8.0	8.2	6 to 9	Compliant
17:00 - 17:59	8.3	8.4	8.3	8.1	8.1	8.1	8.1	8.0	7.4	7.8	8.0	8.3	8.1	8.0	8.2	6 to 9	Compliant
18:00 - 18:59	8.3	8.4	8.3	8.2	8.1	8.1	8.1	8.0	7.5	7.8	8.0	8.2	8.1	8.0	8.1	6 to 9	Compliant
19:00 - 19:59	8.3	8.6	8.3	8.1	8.1	8.1	8.1	8.0	7.5	7.7	8.0	8.1	8.1	8.1	8.1	6 to 9	Compliant
20:00 - 20:59	8.2	8.6	8.3	7.9	8.0	8.1	8.1	8.0	7.5	7.8	8.0	8.1	8.1	8.1	8.1	6 to 9	Compliant
21:00 - 21:59	8.1	8.5	8.3	7.9	8.1	8.0	8.1	7.9	7.6	7.7	8.0	8.0	8.1	8.1	8.1	6 to 9	Compliant
22:00 - 22:59	8.2	8.5	8.2	7.9	8.1	8.0	8.3	8.0	7.7	7.8	7.9	8.0	8.1	8.1	8.1	6 to 9	Compliant
23:00 - 23:59	8.2	8.4	8.2	8.0	8.1	8.0	8.4	7.9	7.7	7.8	7.9	8.0	8.1	8.1	8.3	6 to 9	Compliant

Time	16-Dec	17-Dec	18-Dec	19-Dec	20-Dec	21-Dec	22-Dec	23-Dec	24-Dec	25-Dec	26-Dec	27-Dec	28-Dec	29-Dec	30-Dec	31-Dec	NEQE Limit	Remarks
00:00 - 00:59	8.2	7.9	7.8	7.9	7.7	7.8	7.4	7.1	7.2	7.2	7.6	7.6	8.8	7.3	8.2	8.3	6 to 9	Compliant
01:00 - 01:59	8.2	7.9	7.8	7.7	7.7	7.8	7.3	7.6	7.4	7.3	7.6	7.5	8.7	7.2	8.3	8.4	6 to 9	Compliant
02:00 - 02:59	8.1	7.8	7.9	7.8	7.7	7.9	7.3	7.8	7.7	7.3	7.5	7.4	8.7	6.7	8.5	8.5	6 to 9	Compliant
03:00 - 03:59	8.2	7.9	7.9	7.9	7.8	7.8	7.4	7.6	7.5	7.4	7.4	7.3	8.8	6.7	8.6	8.6	6 to 9	Compliant
04:00 - 04:59	8.2	8.0	8.0	7.9	7.9	7.8	7.4	7.7	7.4	7.4	7.3	7.3	8.8	6.7	8.5	8.6	6 to 9	Compliant
05:00 - 05:59	8.0	7.9	8.0	7.9	7.8	7.8	7.6	7.7	7.4	7.5	7.4	7.2	8.8	6.7	8.6	8.4	6 to 9	Compliant
06:00 - 06:59	8.1	8.0	7.9	7.9	7.8	7.8	7.6	7.7	7.5	7.4	7.4	7.0	8.7	6.8	8.6	8.5	6 to 9	Compliant
07:00 - 07:59	8.1	8.2	7.9	7.8	8.3	7.8	7.6	7.6	7.5	7.3	7.5	6.9	8.6	6.8	8.5	8.5	6 to 9	Compliant
08:00 - 08:59	8.0	8.0	7.9	7.8	8.0	7.8	7.6	7.6	7.4	7.3	7.5	8.9	8.3	6.7	8.4	8.3	6 to 9	Compliant
09:00 - 09:59	8.0	7.9	7.8	7.9	8.1	7.8	7.5	7.5	7.5	7.0	7.4	8.4	8.0	6.3	8.1	8.0	6 to 9	Compliant
10:00 - 10:59	8.1	8.0	7.5	7.7	8.2	7.7	7.4	7.5	7.4	6.9	8.0	8.1	7.6	7.8	7.5	7.5	6 to 9	Compliant
11:00 - 11:59	8.1	8.0	7.6	7.8	8.1	7.6	7.3	7.2	7.3	6.7	7.6	7.8	7.1	8.0	7.1	7.0	6 to 9	Compliant
12:00 - 12:59	8.0	7.8	7.7	7.6	7.8	7.5	7.3	6.9	6.7	6.5	7.3	8.0	6.5	7.8	6.5	6.3	6 to 9	Compliant
13:00 - 13:59	7.9	7.9	7.8	7.7	7.9	7.5	7.2	6.8	6.6	6.3	7.5	7.8	7.0	7.5	6.9	6.6	6 to 9	Compliant
14:00 - 14:59	8.0	7.8	7.7	7.7	7.9	7.5	7.2	6.6	6.3	6.2	7.1	7.5	6.8	7.4	6.6	6.6	6 to 9	Compliant
15:00 - 15:59	8.0	7.8	7.8	7.7	7.8	7.4	7.1	6.8	6.2	6.3	7.7	7.5	6.8	7.3	6.7	6.3	6 to 9	Compliant
16:00 - 16:59	7.8	7.9	7.8	7.7	7.7	7.5	7.2	6.9	6.3	8.1	7.8	7.7	7.1	6.7	6.9	6.8	6 to 9	Compliant
17:00 - 17:59	7.8	7.9	7.9	7.7	7.7	7.5	7.2	7.1	6.7	8.5	8.3	8.1	7.3	6.7	7.2	8.2	6 to 9	Compliant
18:00 - 18:59	7.7	8.0	7.9	7.7	7.8	7.6	7.3	7.2	7.0	8.8	8.6	8.4	7.8	7.8	7.6	8.5	6 to 9	Compliant
19:00 - 19:59	7.5	7.8	7.9	7.7	7.9	7.5	7.2	7.3	7.0	7.2	8.9	8.6	7.9	8.3	7.9	8.9	6 to 9	Compliant
20:00 - 20:59	7.7	7.6	7.9	7.7	7.8	7.5	7.1	7.4	7.0	7.2	7.8	8.8	8.0	8.4	7.9	8.0	6 to 9	Compliant
21:00 - 21:59	7.8	7.7	7.9	7.8	7.8	7.4	7.1	7.2	7.0	7.1	7.9	8.8	8.0	8.5	8.2	7.8	6 to 9	Compliant
22:00 - 22:59	7.8	8.0	7.6	7.7	7.8	7.5	7.3	7.3	7.3	7.5	7.9	8.8	7.9	8.4	8.0	7.9	6 to 9	Compliant
23:00 - 23:59	7.8	7.9	7.7	7.7	7.8	7.3	7.1	7.2	7.3	7.4	7.9	8.9	8.0	8.4	8.3	7.8	6 to 9	Compliant

pH January 2026

Time	1-Jan	2-Jan	3-Jan	4-Jan	5-Jan	6-Jan	7-Jan	8-Jan	9-Jan	10-Jan	11-Jan	12-Jan	13-Jan	14-Jan	15-Jan	NEQE Limit	Remarks
00:00 - 00:59	8.0	8.4	8.4	8.1	8.3	8.3	8.3	8.3	8.7	8.2	8.2	8.3	8.1	8.0	8.0	6 to 9	Compliant
01:00 - 01:59	7.9	8.8	8.9	8.3	8.3	8.2	8.2	8.3	8.7	8.2	8.2	8.2	8.0	8.0	7.9	6 to 9	Compliant
02:00 - 02:59	7.9	8.6	8.8	8.2	8.4	8.2	8.2	8.3	8.7	8.2	8.5	8.3	8.1	8.1	7.9	6 to 9	Compliant
03:00 - 03:59	7.7	8.5	8.8	8.2	8.4	8.3	8.3	8.3	8.6	8.3	8.5	8.3	8.2	8.1	7.8	6 to 9	Compliant
04:00 - 04:59	7.7	8.7	8.8	8.3	8.4	8.3	8.3	8.3	8.6	8.2	8.4	8.3	8.1	8.1	7.8	6 to 9	Compliant
05:00 - 05:59	7.4	8.6	8.8	8.3	8.3	8.3	8.3	8.4	8.7	8.3	8.4	8.2	8.1	8.1	7.8	6 to 9	Compliant
06:00 - 06:59	7.2	8.4	8.7	8.3	8.5	8.3	8.5	8.4	8.6	8.3	8.4	8.2	8.4	8.3	7.8	6 to 9	Compliant
07:00 - 07:59	7.3	8.4	8.7	8.2	8.5	8.5	8.5	8.3	8.7	8.3	8.4	8.1	8.4	8.3	7.8	6 to 9	Compliant
08:00 - 08:59	7.3	8.7	8.5	8.3	8.4	8.4	8.4	8.3	8.9	8.3	8.4	8.2	8.2	8.1	7.8	6 to 9	Compliant
09:00 - 09:59	7.3	8.3	8.3	8.2	8.2	8.2	8.3	8.2	8.6	8.2	8.3	8.1	7.9	8.0	7.8	6 to 9	Compliant
10:00 - 10:59	7.2	8.2	8.1	8.0	8.1	8.1	8.1	8.2	8.3	8.2	8.2	8.1	7.7	7.8	7.7	6 to 9	Compliant
11:00 - 11:59	7.3	8.1	8.0	7.9	8.0	8.0	8.1	8.3	8.1	8.2	8.1	8.4	7.5	7.6	7.9	6 to 9	Compliant
12:00 - 12:59	7.3	8.3	8.7	7.9	8.0	8.0	8.2	8.3	8.5	8.3	8.1	8.2	7.7	7.5	8.1	6 to 9	Compliant
13:00 - 13:59	8.1	8.6	8.3	8.4	8.4	8.0	8.3	8.5	8.5	8.2	8.5	8.1	7.3	7.3	7.9	6 to 9	Compliant
14:00 - 14:59	8.0	8.4	8.2	8.3	8.1	7.9	8.4	8.5	8.4	8.1	8.4	8.0	7.2	7.3	7.9	6 to 9	Compliant
15:00 - 15:59	8.3	8.4	8.4	8.0	8.0	7.9	8.3	8.4	8.4	8.1	8.2	7.8	8.2	7.1	7.8	6 to 9	Compliant
16:00 - 16:59	8.4	8.7	8.1	8.0	7.9	8.4	8.0	8.5	8.5	8.0	8.4	7.9	8.1	7.1	7.8	6 to 9	Compliant
17:00 - 17:59	8.3	8.5	7.8	8.4	8.3	8.4	8.0	8.5	8.5	8.3	8.4	8.2	8.0	8.1	7.8	6 to 9	Compliant
18:00 - 18:59	8.6	8.5	8.3	8.3	8.4	8.2	8.3	8.5	8.4	8.2	8.3	8.0	7.9	8.1	8.0	6 to 9	Compliant
19:00 - 19:59	8.6	8.4	8.3	8.2	8.3	8.2	8.3	8.5	8.3	8.2	8.3	8.0	8.1	8.0	8.0	6 to 9	Compliant
20:00 - 20:59	8.6	8.4	8.1	8.4	8.1	8.3	8.2	8.4	8.2	8.3	8.4	8.0	8.1	8.0	8.0	6 to 9	Compliant
21:00 - 21:59	8.5	8.3	8.0	8.3	8.3	8.2	8.3	8.4	8.3	8.3	8.3	8.1	8.0	8.1	8.0	6 to 9	Compliant
22:00 - 22:59	8.7	8.5	8.3	8.2	8.2	8.2	8.3	8.5	8.2	8.2	8.2	8.0	8.1	8.0	8.0	6 to 9	Compliant
23:00 - 23:59	8.6	8.5	8.2	8.4	8.1	8.3	8.3	8.5	8.2	8.2	8.3	8.1	8.1	7.9	8.0	6 to 9	Compliant

Time	16-Jan	17-Jan	18-Jan	19-Jan	20-Jan	21-Jan	22-Jan	23-Jan	24-Jan	25-Jan	26-Jan	27-Jan	28-Jan	29-Jan	30-Jan	31-Jan	NEQE Limit	Remarks
00:00 - 00:59	8.0	8.2	8.2	8.5	8.2	8.2	8.2	8.0	8.0	8.0	8.3	8.2	8.1	8.1	8.2	8.3	6 to 9	Compliant
01:00 - 01:59	8.0	8.4	8.2	8.5	8.2	8.2	8.2	8.0	8.0	8.0	8.3	8.3	8.1	8.1	8.2	8.3	6 to 9	Compliant
02:00 - 02:59	8.1	8.4	8.2	8.5	8.2	8.2	8.1	8.0	8.1	8.0	8.2	8.3	8.1	8.1	8.3	8.2	6 to 9	Compliant
03:00 - 03:59	8.1	8.4	8.2	8.4	8.2	8.2	8.1	8.2	8.1	8.0	8.2	8.2	8.1	8.2	8.2	8.3	6 to 9	Compliant
04:00 - 04:59	8.5	8.4	8.2	8.4	8.2	8.2	8.2	8.1	8.1	8.1	8.3	8.3	8.1	8.2	8.3	8.3	6 to 9	Compliant
05:00 - 05:59	8.5	8.4	8.2	8.4	8.2	8.2	8.1	8.1	8.1	8.1	8.3	8.3	8.1	8.2	8.3	8.3	6 to 9	Compliant
06:00 - 06:59	8.5	8.3	8.2	8.4	8.2	8.2	8.1	8.1	7.9	8.1	8.5	8.3	8.1	8.2	8.3	8.2	6 to 9	Compliant
07:00 - 07:59	8.4	8.3	8.3	8.3	8.2	8.2	7.9	8.0	8.0	8.0	8.6	8.2	8.0	8.2	8.3	8.2	6 to 9	Compliant
08:00 - 08:59	8.3	8.2	8.3	8.2	8.0	8.1	7.9	8.1	8.0	7.9	8.4	8.3	7.9	8.2	8.3	8.1	6 to 9	Compliant
09:00 - 09:59	8.2	8.2	8.1	8.1	8.1	8.1	8.0	8.0	7.8	7.9	8.3	8.3	7.9	8.1	8.3	8.1	6 to 9	Compliant
10:00 - 10:59	8.0	8.0	7.9	7.9	7.9	8.0	8.1	7.8	7.7	7.8	8.2	8.3	7.8	8.0	8.3	8.0	6 to 9	Compliant
11:00 - 11:59	7.7	7.9	7.8	8.2	7.8	7.9	8.1	7.9	7.7	8.1	8.3	8.3	8.0	8.1	8.3	7.9	6 to 9	Compliant
12:00 - 12:59	7.8	8.2	8.1	8.0	8.0	8.0	8.1	8.1	8.0	8.1	8.3	8.2	7.9	8.0	8.3	8.0	6 to 9	Compliant
13:00 - 13:59	7.6	8.2	8.2	8.0	8.1	8.5	8.1	8.0	8.0	8.0	8.4	8.1	7.8	8.0	8.3	7.9	6 to 9	Compliant
14:00 - 14:59	8.2	8.1	8.1	8.1	8.3	8.2	8.0	8.1	8.1	7.9	8.2	8.4	8.0	8.1	8.3	8.0	6 to 9	Compliant
15:00 - 15:59	8.0	7.9	7.9	8.3	8.1	8.0	8.2	7.8	7.8	8.2	8.1	8.4	8.0	7.9	8.3	8.0	6 to 9	Compliant
16:00 - 16:59	7.8	7.9	8.2	8.0	7.9	8.0	7.9	7.7	7.7	8.2	8.2	8.2	7.9	8.1	8.2	7.9	6 to 9	Compliant
17:00 - 17:59	7.9	8.2	8.2	8.1	8.0	7.9	8.0	7.8	7.8	8.1	8.2	8.2	7.9	8.2	8.3	7.9	6 to 9	Compliant
18:00 - 18:59	8.3	8.1	8.0	8.3	8.2	8.5	7.9	8.1	8.0	8.2	8.2	8.0	7.9	8.2	8.3	7.9	6 to 9	Compliant
19:00 - 19:59	8.3	8.1	8.2	8.3	8.2	8.2	8.2	8.2	8.0	8.2	8.2	8.1	8.0	8.2	8.3	7.9	6 to 9	Compliant
20:00 - 20:59	8.2	8.2	8.2	8.2	8.2	8.3	8.1	8.1	7.9	8.2	8.2	8.1	8.0	8.2	8.3	7.9	6 to 9	Compliant
21:00 - 21:59	8.2	8.2	8.2	8.2	8.2	8.3	8.0	7.9	8.0	8.2	8.2	8.1	8.0	8.2	8.3	8.0	6 to 9	Compliant
22:00 - 22:59	8.2	8.2	8.6	8.2	8.2	8.2	8.0	8.0	8.0	8.2	8.2	8.1	8.0	8.2	8.3	7.9	6 to 9	Compliant
23:00 - 23:59	8.2	8.2	8.6	8.2	8.2	8.1	8.1	8.1	8.0	8.2	8.2	8.1	8.1	8.2	8.3	7.8	6 to 9	Compliant

pH February 2026

Time	1-Feb	2-Feb	3-Feb	4-Feb	5-Feb	6-Feb	7-Feb	8-Feb	9-Feb	10-Feb	11-Feb	12-Feb	13-Feb	14-Feb	NEQE Limit	Remarks
00:00 - 00:59	7.8	8.1	8.1	6.8	8.4	8.3	8.3	8.3	8.5	8.4	8.3	8.4	8.4	8.7	6 to 9	Compliant
01:00 - 01:59	7.8	7.8	8.1	6.5	8.4	8.3	8.3	8.4	8.5	8.6	8.4	8.3	8.4	8.6	6 to 9	Compliant
02:00 - 02:59	7.9	7.9	8.4	6.0	8.4	8.2	8.3	8.4	8.5	8.7	8.4	8.4	8.4	8.5	6 to 9	Compliant
03:00 - 03:59	7.9	7.9	8.4	5.7	8.2	8.3	8.3	8.7	8.6	8.7	8.4	8.4	8.4	8.6	6 to 9	Compliant
04:00 - 04:59	7.8	7.9	8.5	5.6	8.3	8.3	8.3	8.8	8.6	8.6	8.3	8.4	8.4	8.5	6 to 9	Compliant
05:00 - 05:59	7.9	7.9	8.3	6.0	8.3	8.1	8.5	8.9	8.6	8.5	8.4	8.4	8.4	8.5	6 to 9	Compliant
06:00 - 06:59	7.9	7.9	8.3	6.8	8.2	8.2	8.6	8.9	8.5	8.6	8.4	8.4	8.4	8.6	6 to 9	Compliant
07:00 - 07:59	7.9	7.9	8.4	6.8	7.9	8.3	8.6	8.6	8.5	8.6	8.4	8.3	8.3	8.5	6 to 9	Compliant
08:00 - 08:59	7.8	7.9	8.2	7.0	7.8	8.2	8.6	8.7	8.5	8.5	8.1	8.2	8.3	8.5	6 to 9	Compliant
09:00 - 09:59	7.7	7.8	8.2	7.0	7.5	8.2	8.5	8.6	8.4	8.4	7.8	7.9	8.3	8.5	6 to 9	Compliant
10:00 - 10:59	7.7	7.7	8.1	6.8	7.4	8.1	8.4	8.5	8.3	8.4	7.4	7.4	8.2	8.4	6 to 9	Compliant
11:00 - 11:59	7.6	7.7	8.1	6.8	7.4	8.1	8.4	8.5	8.4	8.3	8.3	7.2	7.9	8.3	6 to 9	Compliant
12:00 - 12:59	7.7	7.5	8.1	6.8	7.4	8.1	8.4	8.4	8.3	8.3	8.3	8.4	7.9	8.3	6 to 9	Compliant
13:00 - 13:59	7.6	7.6	8.0	7.2	7.4	8.2	8.4	8.7	8.4	8.2	8.2	8.3	7.0	8.2	6 to 9	Compliant
14:00 - 14:59	7.6	7.6	8.0	7.9	7.8	8.2	8.4	8.7	8.4	8.2	8.2	8.3	7.0	8.2	6 to 9	Compliant
15:00 - 15:59	7.5	8.1	7.8	8.0	8.2	8.3	8.3	8.6	8.4	8.2	8.2	8.3	8.4	8.2	6 to 9	Compliant
16:00 - 16:59	7.6	8.1	7.6	8.0	8.2	8.2	8.3	8.6	8.3	8.2	8.1	8.2	8.4	8.5	6 to 9	Compliant
17:00 - 17:59	7.6	7.9	7.6	8.0	8.2	8.2	8.4	8.5	8.3	8.4	8.1	8.2	8.4	8.5	6 to 9	Compliant
18:00 - 18:59	7.6	8.0	7.7	8.0	8.2	8.4	8.4	8.6	8.3	8.4	8.4	8.2	8.3	8.5	6 to 9	Compliant
19:00 - 19:59	7.6	8.1	7.6	8.0	8.2	8.4	8.4	8.6	8.4	8.4	8.4	8.2	8.3	8.5	6 to 9	Compliant
20:00 - 20:59	8.1	8.1	7.5	7.8	8.3	8.5	8.3	8.4	8.4	8.4	8.4	8.2	8.4	8.5	6 to 9	Compliant
21:00 - 21:59	8.1	8.1	7.2	8.0	8.3	8.2	8.4	8.5	8.3	8.3	8.4	8.4	8.4	8.6	6 to 9	Compliant
22:00 - 22:59	8.1	8.1	7.0	8.0	8.2	8.2	8.4	8.5	8.3	8.4	8.5	8.4	8.6	8.5	6 to 9	Compliant
23:00 - 23:59	8.1	8.1	7.0	8.3	8.2	8.2	8.4	8.4	8.4	8.4	8.4	8.5	8.7	8.5	6 to 9	Compliant

Time	15-Feb	16-Feb	17-Feb	18-Feb	19-Feb	20-Feb	21-Feb	22-Feb	23-Feb	24-Feb	25-Feb	26-Feb	27-Feb	28-Feb	NEQE Limit	Remarks
00:00 - 00:59	8.5	8.5	8.5	8.6	8.6	8.5	8.5	8.8	8.4	8.7	8.4	8.4	8.5	8.5	6 to 9	Compliant
01:00 - 01:59	8.5	8.5	8.5	8.6	8.6	8.5	8.5	8.7	8.4	8.5	8.5	8.3	8.5	8.5	6 to 9	Compliant
02:00 - 02:59	8.5	8.5	8.5	8.6	8.5	8.6	8.4	8.5	8.6	8.4	8.5	8.4	8.4	8.5	6 to 9	Compliant
03:00 - 03:59	8.5	8.5	8.5	8.5	8.5	8.6	8.5	8.6	8.4	8.5	8.5	8.5	8.4	8.5	6 to 9	Compliant
04:00 - 04:59	8.5	8.5	8.5	8.6	8.5	8.5	8.5	8.6	8.4	8.5	8.5	8.5	8.4	8.5	6 to 9	Compliant
05:00 - 05:59	8.5	8.5	8.6	8.6	8.5	8.5	8.5	8.3	8.5	8.5	8.5	8.4	8.4	8.5	6 to 9	Compliant
06:00 - 06:59	8.4	8.5	8.5	8.5	8.5	8.5	8.5	8.3	8.5	8.6	8.5	8.4	8.4	8.5	6 to 9	Compliant
07:00 - 07:59	8.5	8.5	8.6	8.6	8.7	8.5	8.6	8.6	8.5	8.6	8.5	8.6	8.6	8.5	6 to 9	Compliant
08:00 - 08:59	8.5	8.5	8.5	8.5	8.5	8.4	8.4	8.1	8.5	8.6	8.5	8.3	8.3	8.5	6 to 9	Compliant
09:00 - 09:59	8.4	8.5	8.4	8.4	8.2	8.3	8.3	8.0	8.5	8.0	8.4	8.0	7.9	8.6	6 to 9	Compliant
10:00 - 10:59	8.4	8.5	8.3	8.3	7.8	8.2	8.3	8.0	8.5	7.7	8.3	7.7	7.7	8.2	6 to 9	Compliant
11:00 - 11:59	8.4	8.7	8.3	8.2	8.4	8.5	7.6	8.0	7.8	7.5	8.2	8.4	8.4	8.1	6 to 9	Compliant
12:00 - 12:59	8.5	8.7	8.2	8.8	8.3	8.6	8.3	8.0	7.8	7.4	8.5	8.4	8.2	8.1	6 to 9	Compliant
13:00 - 13:59	8.5	8.6	8.4	8.5	8.2	8.5	8.1	8.0	8.0	7.4	8.4	8.1	8.3	8.0	6 to 9	Compliant
14:00 - 14:59	8.4	8.6	8.5	8.5	8.4	8.5	8.1	8.1	8.0	8.6	8.4	8.4	8.5	8.0	6 to 9	Compliant
15:00 - 15:59	8.5	8.6	8.5	8.5	8.6	8.3	8.1	8.2	8.2	8.6	8.1	8.5	8.4	8.0	6 to 9	Compliant
16:00 - 16:59	8.5	8.5	8.4	8.4	8.5	8.2	8.1	8.5	8.4	8.3	8.1	8.3	8.2	8.6	6 to 9	Compliant
17:00 - 17:59	8.5	8.6	8.6	8.7	8.3	8.6	8.1	8.4	8.6	8.3	8.5	8.2	8.6	8.7	6 to 9	Compliant
18:00 - 18:59	8.5	8.5	8.6	8.7	8.5	8.6	8.5	8.0	8.6	8.6	8.5	8.5	8.6	8.3	6 to 9	Compliant
19:00 - 19:59	8.5	8.6	8.5	8.6	8.6	8.5	8.5	8.4	8.3	8.6	8.2	8.5	8.5	8.5	6 to 9	Compliant
20:00 - 20:59	8.6	8.5	8.6	8.6	8.5	8.5	8.4	8.4	8.5	8.6	8.4	8.4	8.4	8.5	6 to 9	Compliant
21:00 - 21:59	8.6	8.5	8.6	8.6	8.5	8.5	8.4	8.2	8.6	8.4	8.4	8.5	8.5	8.4	6 to 9	Compliant
22:00 - 22:59	8.5	8.6	8.6	8.6	8.5	8.5	8.6	8.3	8.5	8.5	8.2	8.5	8.5	8.4	6 to 9	Compliant
23:00 - 23:59	8.6	8.6	8.6	8.5	8.5	8.5	8.9	8.7	8.6	8.6	8.4	8.4	8.5	8.5	6 to 9	Compliant

pH March 2026

Time	1-Mar	2-Mar	3-Mar	4-Mar	5-Mar	6-Mar	7-Mar	8-Mar	9-Mar	10-Mar	11-Mar	12-Mar	13-Mar	14-Mar	15-Mar	NEQE Limit	Remarks
00:00 - 00:59	8.4	8.5	8.7	8.6	8.7	8.0	8.1	7.9	7.9	7.9	7.6	8.0	7.9	7.8	7.9	6 to 9	Compliant
01:00 - 01:59	8.5	8.5	8.7	8.6	8.7	8.1	8.1	7.9	7.8	7.7	7.6	8.0	7.8	7.6	7.8	6 to 9	Compliant
02:00 - 02:59	8.5	8.5	8.6	8.6	8.7	8.1	7.9	7.9	7.9	7.7	7.6	7.7	7.9	7.9	7.9	6 to 9	Compliant
03:00 - 03:59	8.5	8.6	8.6	8.7	8.7	8.1	7.8	7.9	7.9	7.8	7.6	8.0	8.0	7.9	7.9	6 to 9	Compliant
04:00 - 04:59	8.5	8.6	8.7	8.7	8.7	8.1	8.0	7.9	7.8	7.8	7.6	8.1	7.8	7.7	7.8	6 to 9	Compliant
05:00 - 05:59	8.5	8.5	8.7	8.5	8.8	8.1	8.0	7.9	7.9	7.7	7.6	7.8	7.9	7.9	7.9	6 to 9	Compliant
06:00 - 06:59	8.5	8.6	8.6	8.4	8.7	8.0	7.9	7.9	8.1	7.9	7.8	8.0	7.9	7.9	8.0	6 to 9	Compliant
07:00 - 07:59	8.5	8.7	8.7	8.4	8.7	8.0	7.9	7.8	7.9	7.9	7.8	8.2	7.8	7.7	7.7	6 to 9	Compliant
08:00 - 08:59	8.4	8.4	8.7	8.6	8.7	8.0	7.9	7.9	7.6	7.7	7.8	7.9	7.8	7.6	7.6	6 to 9	Compliant
09:00 - 09:59	8.3	8.3	8.7	8.6	8.7	8.0	7.9	7.9	7.6	7.4	7.9	7.8	7.9	7.6	7.5	6 to 9	Compliant
10:00 - 10:59	8.2	8.2	8.6	8.7	8.7	8.0	7.9	8.0	7.7	7.2	7.8	7.8	7.6	7.5	7.5	6 to 9	Compliant
11:00 - 11:59	8.1	8.1	8.6	8.7	8.7	8.0	7.9	8.0	7.6	7.0	7.8	7.8	7.5	7.4	7.7	6 to 9	Compliant
12:00 - 12:59	8.5	8.1	8.7	8.7	8.7	8.0	7.9	8.0	7.5	6.9	7.3	7.1	7.4	7.4	7.9	6 to 9	Compliant
13:00 - 13:59	8.5	8.0	8.7	8.4	8.7	8.0	7.9	7.9	7.5	7.8	7.3	7.1	7.4	7.9	7.7	6 to 9	Compliant
14:00 - 14:59	8.4	8.7	8.4	8.4	8.5	8.0	7.9	7.8	7.8	7.9	7.3	7.1	7.4	7.9	7.5	6 to 9	Compliant
15:00 - 15:59	8.2	8.7	8.3	8.7	8.4	8.0	7.9	7.7	7.9	7.9	7.9	7.1	7.3	7.6	7.9	6 to 9	Compliant
16:00 - 16:59	8.6	8.4	8.3	8.7	8.8	8.0	7.9	7.6	7.8	7.9	8.0	7.9	7.5	7.9	7.9	6 to 9	Compliant
17:00 - 17:59	8.6	8.7	8.3	8.5	8.1	8.0	7.7	7.9	7.7	7.9	7.6	8.1	7.9	7.9	7.7	6 to 9	Compliant
18:00 - 18:59	8.5	8.7	8.7	8.7	8.1	8.1	7.7	7.8	7.5	7.9	8.0	7.9	7.8	7.7	7.6	6 to 9	Compliant
19:00 - 19:59	8.6	8.7	8.6	8.7	8.1	8.2	7.7	7.7	7.8	7.9	8.0	7.9	7.7	7.7	7.9	6 to 9	Compliant
20:00 - 20:59	8.6	8.6	8.6	8.6	8.0	7.8	7.7	7.9	7.8	7.6	7.7	8.0	7.9	7.9	7.9	6 to 9	Compliant
21:00 - 21:59	8.6	8.7	8.6	8.6	8.1	8.1	7.7	7.9	7.7	7.6	8.2	8.0	7.8	7.9	7.9	6 to 9	Compliant
22:00 - 22:59	8.5	8.7	8.6	8.7	8.1	8.1	7.7	7.7	7.6	7.6	8.1	7.8	7.6	7.7	7.9	6 to 9	Compliant
23:00 - 23:59	8.5	8.6	8.6	8.7	8.0	7.8	7.9	7.9	7.8	7.6	7.6	8.0	7.8	7.9	7.9	6 to 9	Compliant

Time	16-Mar	17-Mar	18-Mar	19-Mar	20-Mar	21-Mar	22-Mar	23-Mar	24-Mar	25-Mar	26-Mar	27-Mar	28-Mar	29-Mar	30-Mar	31-Mar	NEQE Limit	Remarks
00:00 - 00:59	7.8	7.7	7.8	7.5	7.6	7.8	7.7	7.8	7.9	7.7	7.5	7.9	7.8	7.8	7.5	7.8	6 to 9	Compliant
01:00 - 01:59	7.9	7.7	7.7	7.9	7.5	7.9	7.8	7.8	7.6	7.7	7.9	7.9	7.8	7.9	7.9	7.7	6 to 9	Compliant
02:00 - 02:59	7.9	7.7	7.9	7.6	7.9	7.8	7.6	7.8	8.0	7.7	7.9	7.7	7.5	7.9	7.5	7.7	6 to 9	Compliant
03:00 - 03:59	7.9	7.5	8.0	7.6	7.6	7.8	7.7	7.8	8.0	7.8	7.6	7.8	7.8	7.8	7.8	7.8	6 to 9	Compliant
04:00 - 04:59	7.9	8.0	7.5	7.8	7.6	7.9	7.7	7.8	7.6	7.8	7.9	8.0	7.8	7.9	7.8	7.7	6 to 9	Compliant
05:00 - 05:59	7.9	8.0	8.0	7.8	7.9	7.8	7.6	7.9	7.6	7.8	7.8	7.7	7.8	7.8	7.7	7.7	6 to 9	Compliant
06:00 - 06:59	7.9	7.7	7.8	7.6	7.7	7.7	7.5	7.8	8.0	8.0	7.7	7.7	7.5	7.7	7.6	7.6	6 to 9	Compliant
07:00 - 07:59	7.8	7.6	7.6	7.7	7.6	7.7	7.5	7.8	7.8	7.9	7.7	7.7	7.5	7.8	7.5	7.6	6 to 9	Compliant
08:00 - 08:59	7.8	7.6	7.5	7.8	7.6	7.6	7.6	7.8	7.8	7.6	7.8	7.8	7.5	7.7	7.7	7.6	6 to 9	Compliant
09:00 - 09:59	7.8	7.8	7.5	7.9	7.5	7.8	7.8	7.8	7.8	7.5	7.8	7.8	7.4	7.6	7.7	7.6	6 to 9	Compliant
10:00 - 10:59	7.8	7.6	7.5	7.9	7.4	7.8	7.7	7.8	7.8	7.5	7.8	7.8	7.5	7.5	7.7	7.5	6 to 9	Compliant
11:00 - 11:59	7.9	7.5	7.5	7.8	7.3	7.8	7.6	7.8	7.8	7.5	8.2	7.8	7.5	7.7	7.5	7.7	6 to 9	Compliant
12:00 - 12:59	7.9	7.8	7.5	7.9	7.8	7.7	7.4	7.8	7.8	7.5	7.4	7.5	7.6	7.8	7.5	7.8	6 to 9	Compliant
13:00 - 13:59	7.9	8.0	7.5	7.8	7.9	7.5	7.7	7.3	7.8	6.9	7.4	7.4	7.4	7.7	7.4	7.9	6 to 9	Compliant
14:00 - 14:59	7.9	7.7	7.5	7.6	7.5	7.7	7.8	7.3	7.8	8.0	7.4	7.6	7.6	7.5	7.3	7.5	6 to 9	Compliant
15:00 - 15:59	8.0	7.5	7.5	7.5	7.7	7.9	7.6	7.3	7.8	8.0	7.4	7.9	7.9	8.0	7.3	7.6	6 to 9	Compliant
16:00 - 16:59	8.1	7.6	7.5	7.9	7.9	7.7	7.6	7.3	7.8	8.0	7.6	7.6	7.6	7.9	7.2	7.9	6 to 9	Compliant
17:00 - 17:59	8.1	8.0	7.5	7.9	7.7	7.7	7.9	7.3	7.8	7.7	7.4	7.5	7.5	7.6	7.9	7.7	6 to 9	Compliant
18:00 - 18:59	8.1	8.0	8.0	7.6	7.7	7.9	7.8	7.3	7.8	7.7	8.0	7.8	7.9	7.8	7.8	7.5	6 to 9	Compliant
19:00 - 19:59	8.1	7.7	7.9	7.9	7.9	7.7	7.6	7.3	7.8	8.2	8.0	7.8	7.7	7.8	7.6	7.8	6 to 9	Compliant
20:00 - 20:59	8.1	7.9	7.7	7.9	7.7	7.5	7.9	8.0	7.8	7.5	7.6	7.8	7.6	7.6	7.8	7.8	6 to 9	Compliant
21:00 - 21:59	8.1	7.9	7.7	7.7	7.9	7.8	7.8	8.0	7.8	7.4	7.6	7.8	7.8	7.7	8.0	7.6	6 to 9	Compliant
22:00 - 22:59	8.1	7.7	7.7	7.7	7.9	7.8	7.8	7.9	7.8	8.0	7.9	7.8	7.8	7.7	7.6	7.6	6 to 9	Compliant
23:00 - 23:59	7.8	7.8	7.7	7.9	7.7	7.6	7.8	7.9	7.7	7.7	7.9	7.3	7.6	7.5	7.6	7.8	6 to 9	Compliant

Comparison of Air Quality and noise level: EMR 17th vs. EMR 18th

Air Quality

Parameter	Guidelines Value	Averaging Period	EMR 17th Air Quality report								EMR 18th Air Quality report							
			July-25				September-25				December-25				March-26			
			ASR4	ASR3	ASR5	ASR14	ASR4	ASR3	ASR5	ASR14	ASR4	ASR3	ASR5	ASR14	ASR4	ASR3	ASR5	ASR14
PM_{10}	50µg/m^3	24hrs	10.76	11.59	13.41	9.92	10.86	11	12.49	9.16	14.25	15.27	14.4	10.98	16.08	14.17	11.71	13.86
$PM_{2.5}$	25µg/m^3	24hrs	5.11	5.85	6.45	4.97	5.38	5.52	6.39	4.67	7.13	7.69	7.29	6.54	8.03	7.26	6.09	7.03
CO	9PPM	8hrs	0.00223	0.00337	0.00349	0.00272	0.0028	0.003	0.0029	0.0023	0.0026	0.0028	0.0021	0.0022	0.0023	0.0027	0.0023	0.0025
CO_2	5000PPM	8hrs	378.98	392.17	382.97	371.98	360.86	381.94	369.44	343.08	400.76	390.55	397.41	382.33	422.19	402.8	391.82	407.56
SO_2	20µg/m^3	24hrs	3.28	4.17	4.19	3.04	5.24	4.72	6.8	4.98	4.98	6.28	6.02	6.81	5.77	5.24	6.81	5.76
NO_2	200µg/m^3	1hrs	5.25	6.69	8.95	6.83	5.42	7.1	6.69	7.16	5.8	6.9	6.65	4.68	6.49	5.75	6.67	5.03

Noise Level

Monitoring Point	Guidelines Value		EMR 17th Noise level		EMR 18th Noise level	
			Jul 2025 Noise Value	Sept 2025 Noise Value	Dec 2025 Noise Value	Mar 2026 Noise Value
Sembcorp Myingyan Power Plant	Day	70dbA	55.58	52.27	57.1	55
	Night	70dbA	54.75	50.18	53.91	54.51
Sa Ka Village	Day	55dbA	53.36	49.44	55.74	56.22
	Night	45dbA	52.2	43.26	57.87	53.17

3rd party Service provider justified that, During the noise quality monitoring conducted, the measured daytime and nighttime noise levels at Sa Ka Village were found to be higher than the acceptable limits specified in the National Environmental Quality (Emission) Guidelines. This exceedance is attributable to the proximity of the Sa Ka North Monastery, which is located beside a roadway with frequent traffic from motorcycles and cars, as well as noise generated from the operation of a nearby factory during the monitoring period.

Sembcorp Myingyan Power Co., Limited.

Air Quality Monitoring Report
(Dec 2025)

Environmental Monitoring Report

(Air Quality Monitoring)



Prepared

Ref: 01.12.2025 to 05.12.2025 (Air Quality Report)

18th December 2025

E Guard Environmental Services

Report Review Form

Report Title: Environmental Quality Monitoring Report in December 2025 For Sembcorp Myingyan Power Plant	
Report Version:	
Proponent: **Sembcorp Myingyan Power Plant**	**Prepared by;** **E Guard Environmental Services Co., Ltd.** No. (145- A2- 3), Thiri Mingalar Street, Ward No. (4), 8th Mile, Mayangone Township, Yangon 11062, Myanmar. Tel: 01 667953, Fax: 01 6667953, info@eguardservices.com Mobile +959 797005199

Prepared by: U Aung Moe Oo	**Position: Assistant Consultant**
Submitted Date: 17/12/2025	**Signature:**
Checked by: U Aung Myint Myat	**Position: Consultant**
Checked Date: 17/12/2025	**Signature:**

Approved by:

Table of Contents

List of Figures ii

List of Tables iii

1. INTRODUCTION 1

2. METHODOLOGY 1

2.1 Ambient Air Quality 1

2.2 Ambient Noise 1

3. MONITORING LOCATIONS 3

4. ENVIRONMENTAL QUALITY MONITORING RESULTS 4

4.1 Ambient Air Quality Monitoring Results 4

4.2 Wind Speed and Direction 15

4.3 Ambient Noise 19

APPENDIX A 24

APPENDIX B 31

List of Figures

Figure 3. 1 Location of Monitoring Points 3

Figure 4. 1 PM Monitoring Results at Sa Ka Village 4

Figure 4. 2 PM Monitoring Results at Hnan Village 4

Figure 4. 3 PM Monitoring Results at Gyoke Pin Village 5

Figure 4. 4 PM Monitoring Results at Nyaung Kan Village 5

Figure 4. 5 Fluctuation of Air Pollutants during dial cycle (Sa Ka Village) 6

Figure 4. 6 Fluctuation of Air Pollutants during dial cycle (Hnan Village) 6

Figure 4. 7 Fluctuation of Air Pollutants during dial cycle (Gyoke Pin Village) 6

Figure 4. 8 Fluctuation of Air Pollutants during dial cycle (Nyaung Kan Village) 7

Figure 4. 9 Wind Speed and Wind Direction (Blowing From) at Sa Ka Village (ASR4) 15

Figure 4. 10 Wind Class Frequency Distribution at Sa Ka Village (ASR4) 15

Figure 4. 11 Wind Speed and Wind Direction (Blowing From) at Hnan Village (ASR3) 16

Figure 4. 12 Wind Class Frequency Distribution at Hnan Village (ASR3) 16

Figure 4. 13 Wind Speed and Wind Direction (Blowing From) at Gyoke Pin Village (ASR5) 17

Figure 4. 14 Wind Class Frequency Distribution at Gyoke Pin Village (ASR5) 17

Figure 4. 15 Wind Speed and Wind Direction (Blowing From) at Nyaung Kan Village (ASR14) 18

Figure 4. 16 Wind Class Frequency Distribution at Nyaung Kan Village (ASR14) 18

Figure 4. 17 Noise Level at near Sembcorp Myingyan Power Plant 20

Figure 4. 18 Noise Level at Sa Ka Village 21

List of Tables

Table 2. 1 Ambient Air Quality Parameters 1

Table 2. 2 Air Quality Guideline Values 1

Table 2. 3 Noise level monitoring 2

Table 2. 4 Equipment used to measure ambient air and noise measurement 2

Table 3. 1 Location of Monitoring Points 3

Table 4. 1 Observed Ambient Air Quality Results from Selected Points 4

Table 4. 2 Air Monitoring Results (Sa Ka Village) 8

Table 4. 3 Air Monitoring Results (Hnan Village) 10

Table 4. 4 Air Monitoring Results (Gyoke Pin Village) 12

Table 4. 5 Air Monitoring Results (Nyaung Kan Village) 14

Table 4. 6 Observed Values of Noise Level Measurement at near Sembcorp Myingyan Power Plant 19

Table 4. 7 Observed Values of Noise Level Measurement at Sa Ka Village 20

Table 4. 8 Observed Ambient Noise level Results from Myingyan Power Plant 21

Table 4. 9 Observed Ambient Noise level Results from Sa Ka Village 21

Table 4. 10 National Environmental Quality (Emission) Guidelines Values for Noise Level 23

1. INTRODUCTION

This report is environmental monitoring (only air and noise quality monitoring) for Sembcorp Myingyan Power Plant which is located beside of Myingyan – Nyaung-Oo Road, near the Sa Ka village in Mandalay Region.

2. METHODOLOGY

Baseline environmental parameters and sampling locations were defined according to the objectives for environmental monitoring purposes. Locations for sampling and analysis of ambient air quality of the project site were identified by Sembcorp Myingyan Power Co,ltd.

2.1 Ambient Air Quality

The emissions of dust particles and gases were measured for 24hrs continuously at the selected sites by using the Environmental Perimeter Air Station (EPAS), and EPAS provides direct readings in real time with data-logging capabilities. The monitoring results were compared with National Environmental Quality (Emission) Guideline (NEQG), World Health Organization (WHO) and American Conference of Governmental Industrial Hygienists (ACGIH) guidelines.

Table 2. 1 Ambient Air Quality Parameters

Ambient Air Quality (4 locations)	
Gas Emission	CO, CO_2, SO_2, NO_2
Dust Emission	PM_{10}, $PM_{2.5}$

Table 2. 2 Air Quality Guideline Values

Parameters	Guidelines Value	Unit	Organization	Averaging Period
PM_{10}	50	$\mu g/m^3$	NEQ	24hrs
$PM_{2.5}$	25	$\mu g/m^3$	NEQ	24hrs
CO	9	ppm	NAAQS	8hrs
CO_2	5000	ppm	ACGIH	8hrs
SO_2	20	$\mu g/m^3$	NEQ	24hrs
NO_2	200	$\mu g/m^3$	NEQ	24hrs

Source: Myanmar National Environmental Quality (Emission) Guidelines, December 2015 & Air quality guidelines global update. 2005. World Health Organization.

2.2 Ambient Noise

Noise level LAeq (dBA) will be measured at the selected locations that can reflect the exposure of the nearest local community and sensitive locations. Duration and frequency were measured for 24hrs continuously at the selected site using the Noise Meter.

The monitoring procedures, data analysis and interpretation were carried out in accordance with the instrument's manufacture and National Environmental Quality (Emission) Guidelines, World Health Organization (WHO) and International Finance Corporation (IFC guidelines in order to be in line with Environmental Conservation Department, Ministry of Natural Resources and Environment Conservation (MONREC). "National Environmental Quality

(Emission) Guidelines" for Myanmar was also presented the value of noise level as LAeq (dBA).

Table 2. 3 Noise level monitoring

Noise monitoring (2 locations)	
Noise Emission	LAeq (dBA) (1hrs, 24 hrs.)

Equipment used to measure ambient air and noise measurement are shown below (**Table 2. 4**).

Table 2. 4 Equipment used to measure ambient air and noise measurement

Davis Vantage Pro2 Wireless Weather Station Provides detailed current weather conditions and expanded forecasts - all at a glance! The Vantage Pro2 uses a frequency-hopping spread spectrum radio from 902 MHz to 928 MHz to transmit and receive data up to 1,000' (300m) line of sight. In addition, the weather station features a bubble level, improved anemometer base, redesigned wind cups, and factory-calibrated wind direction. The integrated sensor suite combines temperature and humidity sensors, rain collector with an aluminum-plated tipping bucket, and anemometer into one package for easy setup. Measure inside and outside temperature and humidity, heat index, barometric pressure, dew point, rainfall, wind direction and speed, and wind chill.	
Haz-Scanner EPAS PM_{10}, PM $_{2.5}$, NO_2, SO_2, CO, CO_2, Temperature, and Relative Humidity	
Digital Sound Level Meter Noise and Vibration	

3. MONITORING LOCATIONS

Locations of sampling sites were identified by Sembcorp Myingyan Power Co,ltd. Air quality was monitored at the four selected locations that are Sa Ka Village (ASR4), Hnan Village (ASR3), Gyoke Pin Village (ASR 5) and Nyaung Kan Village (ASR 14).

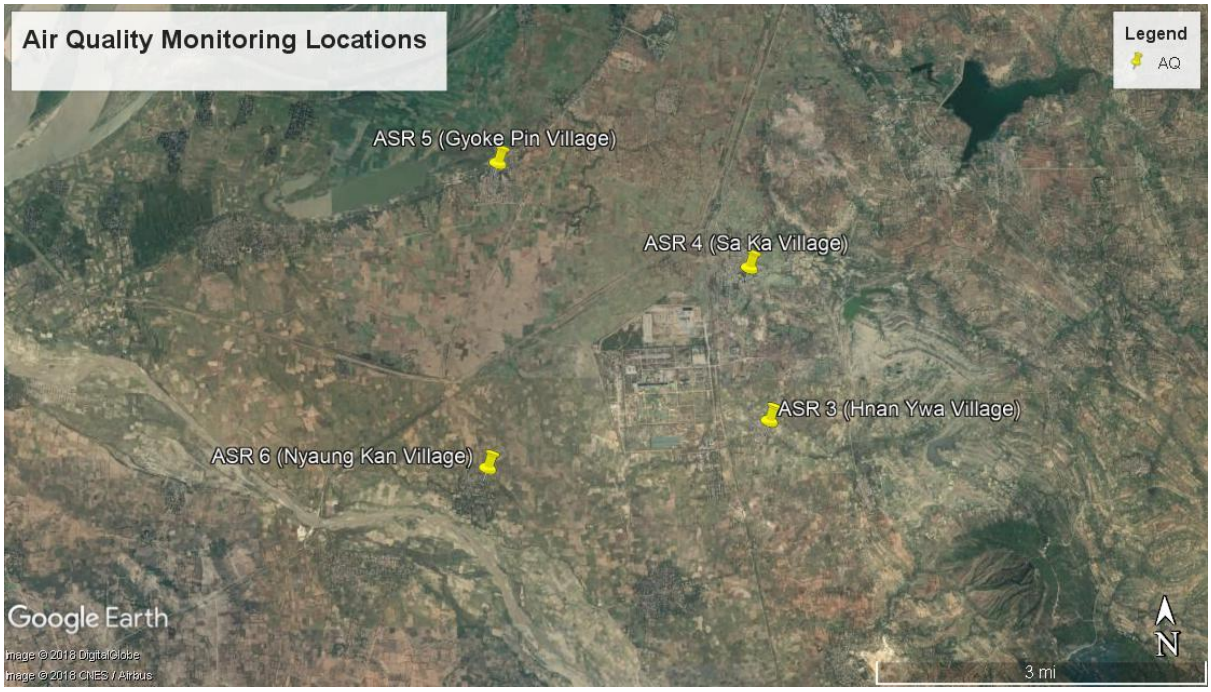


Figure 3. 1 Location of Monitoring Points

Table 3. 1 Location of Monitoring Points

Locations No.	Points	Coordinate	Locations
Ambient Air Quality and Noise Monitoring Locations			
1	ASR4	Lat- 21°23’48.591”, Long- 95°23’0.849”	Sa Ka Village
2	ASR3	Lat- 21°22’17.565”, Long- 95°23’18.116”	Hnan Village
3	ASR5	Lat- 21°24’21.888”, Long- 95°21’7.381”	Gyoke Pin Village
4	ASR14	Lat- 21°21’44.570”, Long- 95°20’55.035”	Nyaung Kan Village

4. ENVIRONMENTAL QUALITY MONITORING RESULTS

4.1 Ambient Air Quality Monitoring Results

24 hours air quality monitoring was done at each selected location from 1st December to 5th December 2025. The measured results are compared with national emission guidelines. Based on the results of air quality monitoring, all the parameters are within the guidelines.

Table 4. 1 Observed Ambient Air Quality Results from Selected Points

Parameters	Observed Value				Guidelines Value	Unit	Averaging Period
	ASR4	ASR3	ASR5	ASR14			
PM_{10}	14.25	15.27	14.40	10.98	50	$\mu g/m^3$	24hrs
$PM_{2.5}$	7.13	7.69	7.29	6.54	25	$\mu g/m^3$	24hrs
CO	0.0026	0.0028	0.0021	0.0022	9	ppm	8hrs
CO_2	400.76	390.55	397.41	382.33	5000	ppm	8hrs
SO_2	4.98	6.28	6.02	6.81	20	$\mu g/m^3$	24hrs
NO_2	5.80	6.90	6.65	4.68	200	$\mu g/m^3$	1hrs

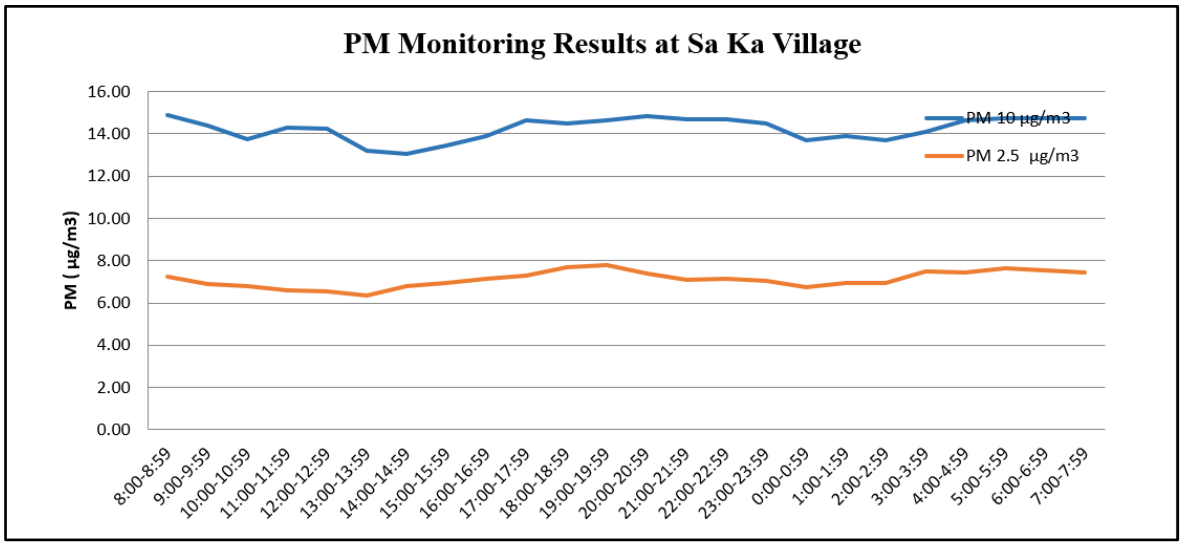


Figure 4. 1 PM Monitoring Results at Sa Ka Village

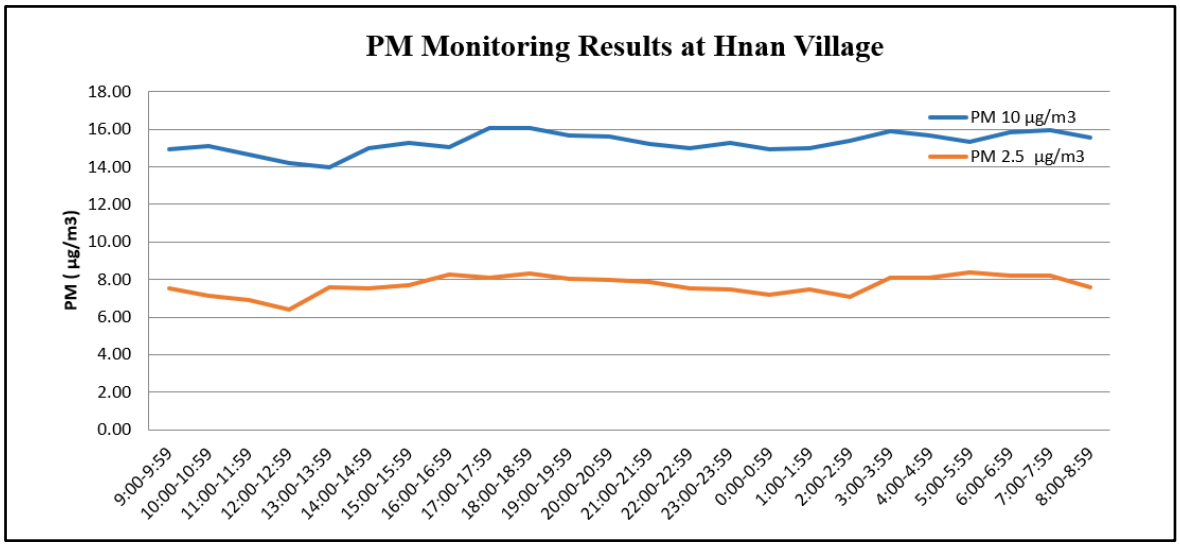


Figure 4. 2 PM Monitoring Results at Hnan Village

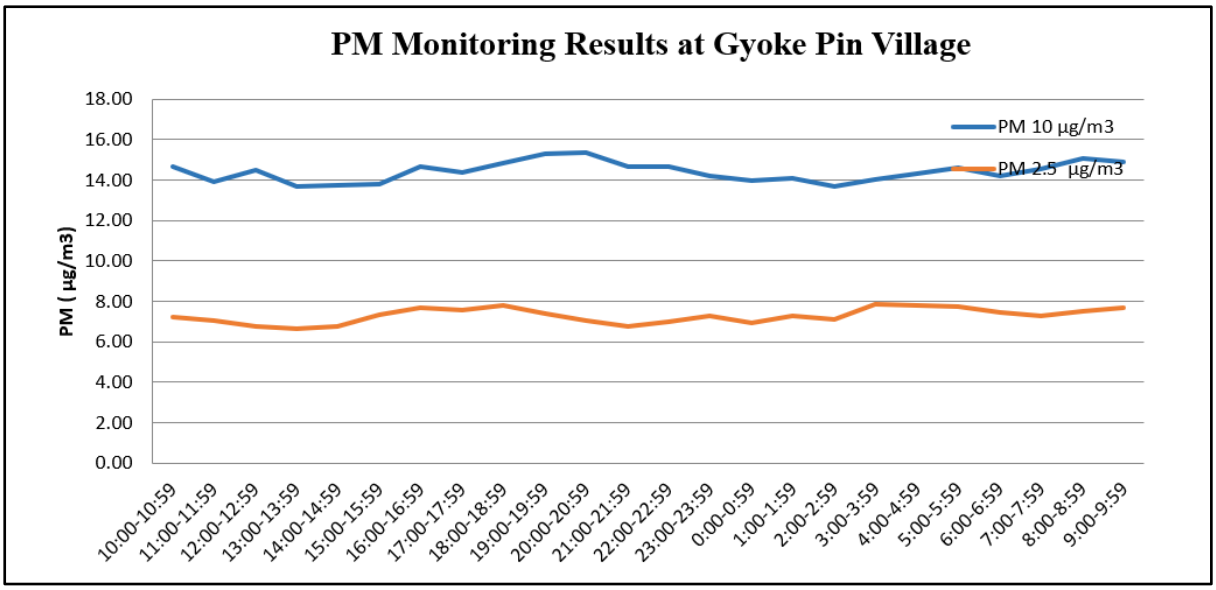


Figure 4. 3 PM Monitoring Results at Gyoke Pin Village

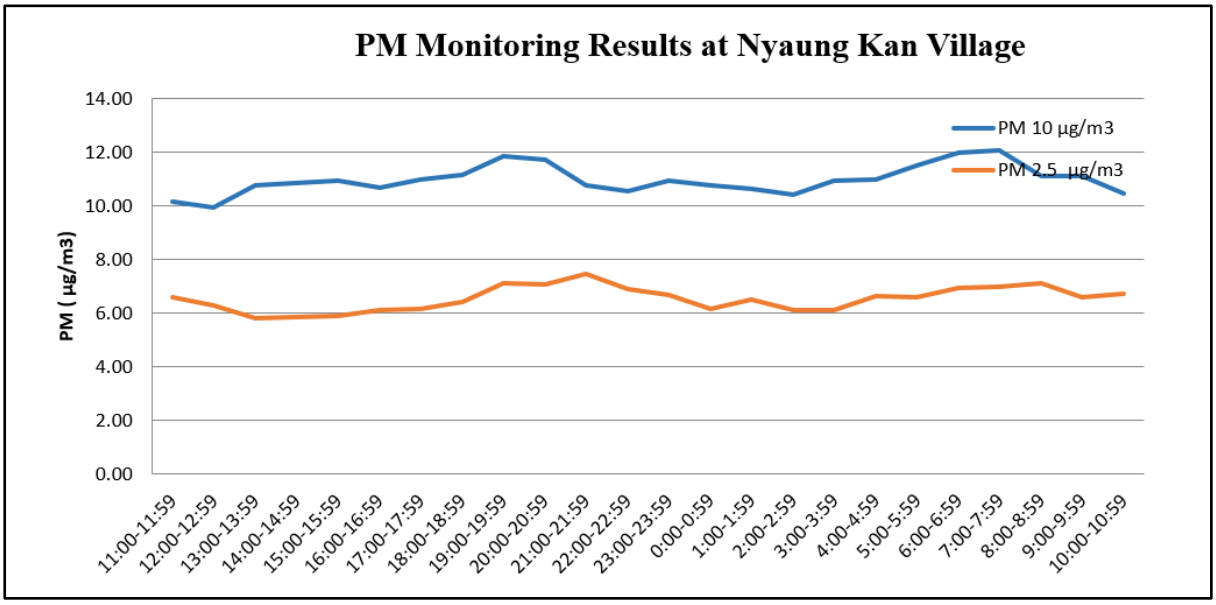


Figure 4. 4 PM Monitoring Results at Nyaung Kan Village

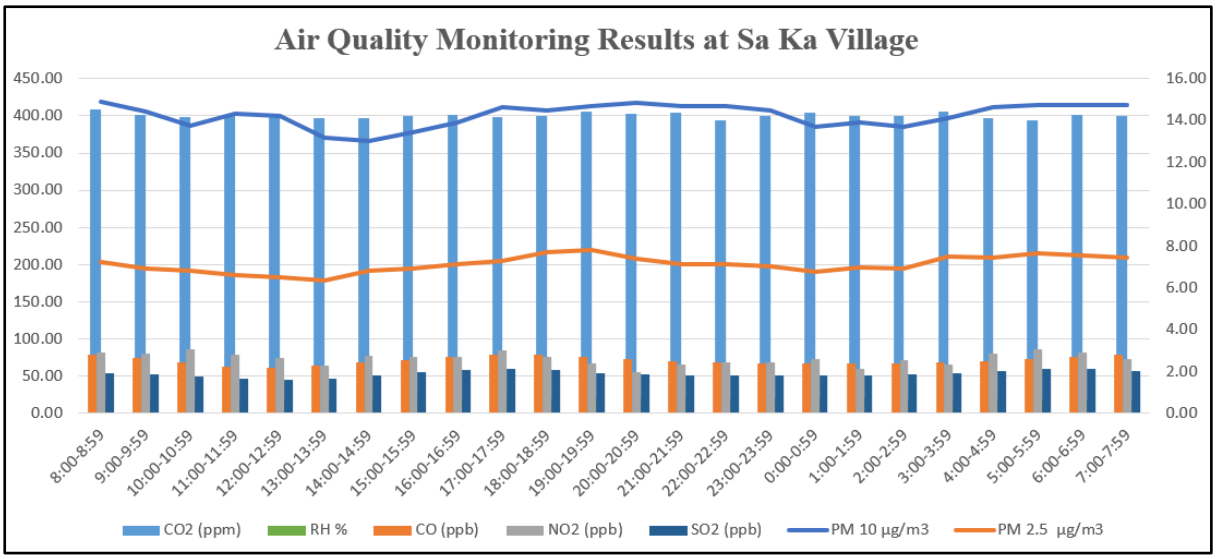


Figure 4. 5 Fluctuation of Air Pollutants during dial cycle (Sa Ka Village)

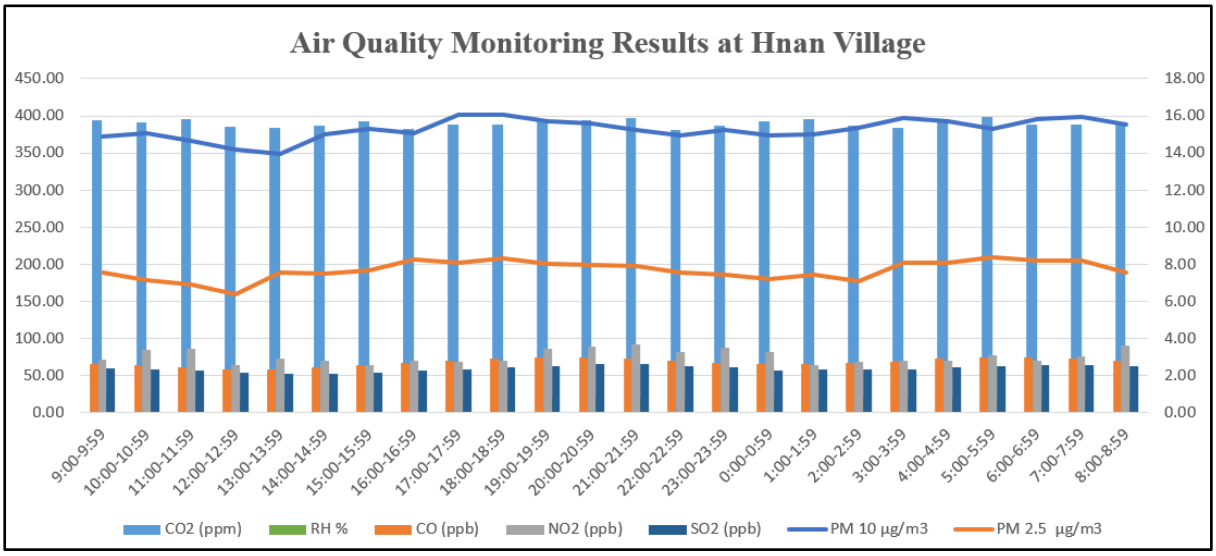


Figure 4. 6 Fluctuation of Air Pollutants during dial cycle (Hnan Village)

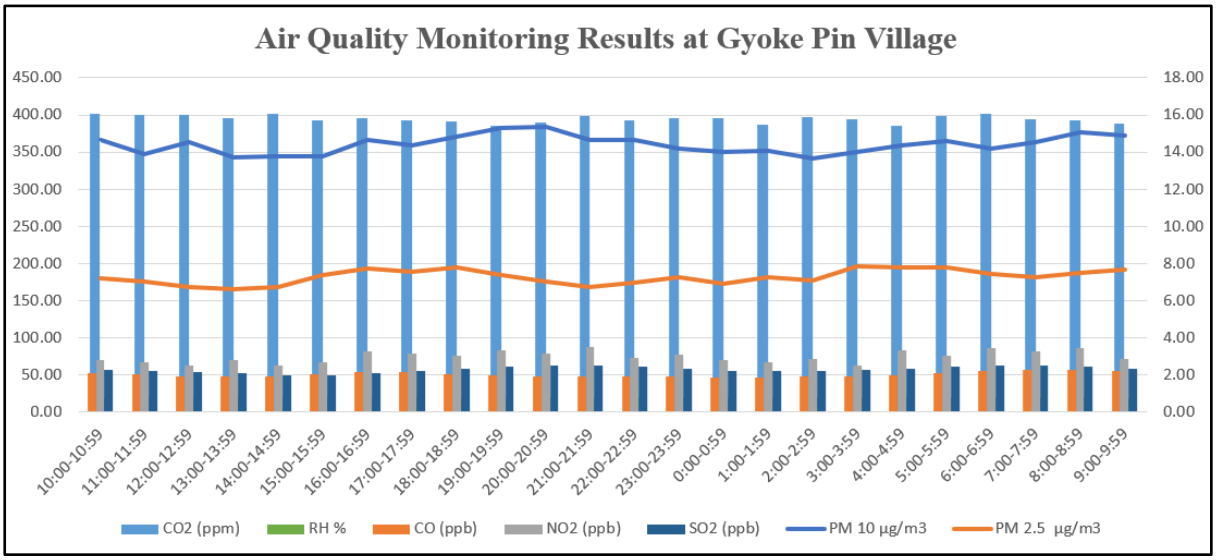


Figure 4. 7 Fluctuation of Air Pollutants during dial cycle (Gyoke Pin Village)

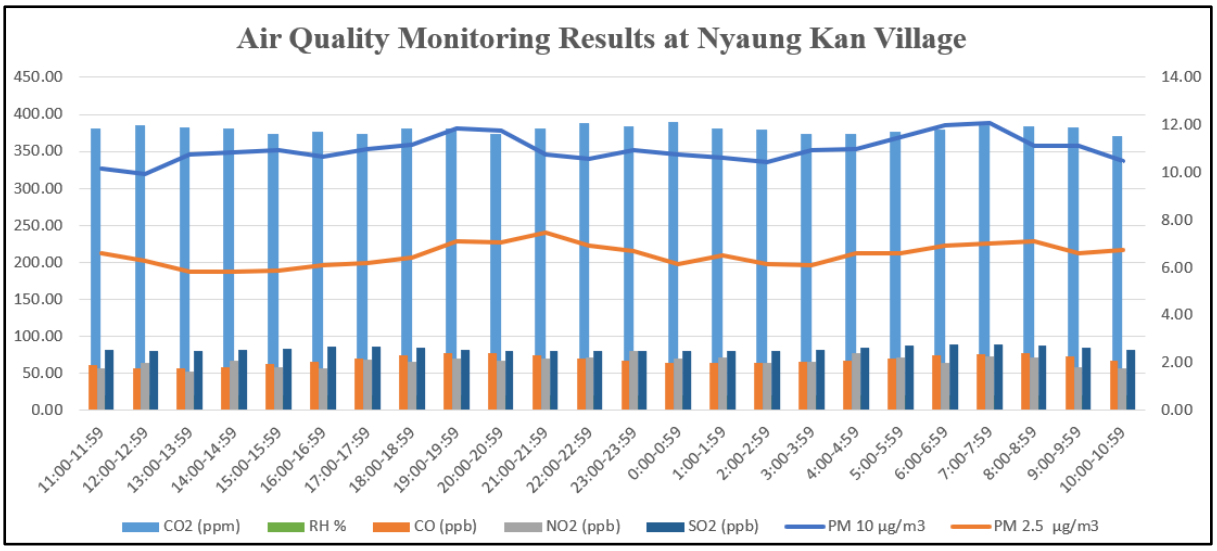


Figure 4. 8 Fluctuation of Air Pollutants during dial cycle (Nyaung Kan Village)

Detail results with one-hour interval of pollutants are shown in **Table 4. 2** to **Table 4. 5.** All results are under the Myanmar National Environmental Quality (emission) Guidelines. So, Sembcorp Myingyan Power Plant is acceptable for environment.

Table 4. 2 Air Monitoring Results (Sa Ka Village)

Date	Time		CO_2 (ppm)	CO (ppb)	NO_2 (ppb)	PM_{10} µg/m^3	$PM_{2.5}$ µg/m^3	RH %	SO_2 (ppb)
01.12.2025	8:00-8:59	Average	408.25	2.79	2.90	14.91	7.23	19.08	1.94
01.12.2025	9:00-9:59	Average	401.53	2.64	2.85	14.41	6.91	19.29	1.86
01.12.2025	10:00-10:59	Average	399.18	2.42	3.09	13.76	6.80	19.24	1.77
01.12.2025	11:00-11:59	Average	401.83	2.24	2.79	14.30	6.62	19.35	1.68
01.12.2025	12:00-12:59	Average	402.29	2.17	2.65	14.24	6.53	19.52	1.63
01.12.2025	13:00-13:59	Average	396.73	2.29	2.29	13.20	6.36	19.60	1.68
01.12.2025	14:00-14:59	Average	396.75	2.43	2.76	13.04	6.82	19.65	1.82
01.12.2025	15:00-15:59	Average	399.51	2.57	2.71	13.44	6.93	19.71	1.98
01.12.2025	16:00-16:59	Average	400.88	2.71	2.71	13.89	7.13	19.91	2.08
01.12.2025	17:00-17:59	Average	397.93	2.79	3.03	14.66	7.30	20.01	2.11
01.12.2025	18:00-18:59	Average	399.30	2.80	2.71	14.49	7.69	19.94	2.05
01.12.2025	19:00-19:59	Average	405.27	2.71	2.40	14.67	7.81	20.34	1.95
01.12.2025	20:00-20:59	Average	402.28	2.60	1.96	14.85	7.41	20.10	1.87
01.12.2025	21:00-21:59	Average	405.07	2.50	2.33	14.68	7.11	20.16	1.83
01.12.2025	22:00-22:59	Average	394.49	2.43	2.42	14.70	7.13	19.94	1.80
01.12.2025	23:00-23:59	Average	400.23	2.40	2.46	14.49	7.05	19.95	1.79
02.12.2025	0:00-0:59	Average	403.96	2.41	2.59	13.71	6.75	19.87	1.81
02.12.2025	1:00-1:59	Average	399.81	2.41	2.13	13.92	6.96	19.79	1.84
02.12.2025	2:00-2:59	Average	400.54	2.40	2.52	13.69	6.95	19.50	1.87
02.12.2025	3:00-3:59	Average	406.07	2.44	2.36	14.11	7.51	19.44	1.94
02.12.2025	4:00-4:59	Average	396.93	2.50	2.88	14.66	7.46	19.26	2.05
02.12.2025	5:00-5:59	Average	394.77	2.59	3.06	14.74	7.67	19.28	2.11
02.12.2025	6:00-6:59	Average	401.07	2.72	2.91	14.72	7.55	19.24	2.12
02.12.2025	7:00-7:59	Average	399.34	2.80	2.59	14.76	7.42	19.18	2.03
Average			**400.58**	**2.53**	**2.63**	**14.25**	**7.13**	**19.64**	**1.90**
1 hour Minimum			394.49	2.17	1.96	13.04	6.36	19.08	1.63
1 hour Maximum			408.25	2.80	3.09	14.91	7.81	20.34	2.12

Table 4. 3 Air Monitoring Results (Hnan Village)

Date	Time		CO_2 (ppm)	CO (ppb)	NO_2 (ppb)	PM_{10} µg/m^3	$PM_{2.5}$ µg/m^3	RH %	SO_2 (ppb)
02.12.2025	9:00-9:59	Average	393.51	2.66	2.88	14.91	7.55	20.09	2.43
02.12.2025	10:00-10:59	Average	391.14	2.56	3.42	15.09	7.12	20.25	2.35
02.12.2025	11:00-11:59	Average	395.20	2.45	3.44	14.67	6.90	20.15	2.26
02.12.2025	12:00-12:59	Average	386.17	2.35	2.58	14.20	6.41	20.12	2.18
02.12.2025	13:00-13:59	Average	383.68	2.34	2.93	13.95	7.57	19.95	2.10
02.12.2025	14:00-14:59	Average	386.35	2.43	2.81	14.98	7.53	20.01	2.12
02.12.2025	15:00-15:59	Average	392.39	2.57	2.58	15.28	7.69	19.96	2.17
02.12.2025	16:00-16:59	Average	382.22	2.67	2.80	15.05	8.25	20.01	2.26
02.12.2025	17:00-17:59	Average	388.89	2.80	2.73	16.06	8.09	20.03	2.36
02.12.2025	18:00-18:59	Average	388.27	2.92	2.81	16.07	8.34	19.85	2.44
02.12.2025	19:00-19:59	Average	393.59	2.99	3.48	15.69	8.01	19.78	2.55
02.12.2025	20:00-20:59	Average	394.91	3.01	3.60	15.60	8.00	19.86	2.61
02.12.2025	21:00-21:59	Average	396.85	2.91	3.67	15.23	7.89	19.86	2.61
02.12.2025	22:00-22:59	Average	381.38	2.80	3.29	14.97	7.54	19.87	2.54
02.12.2025	23:00-23:59	Average	386.80	2.69	3.52	15.25	7.47	19.87	2.46
03.12.2025	0:00-0:59	Average	392.82	2.62	3.27	14.94	7.19	19.99	2.31
03.12.2025	1:00-1:59	Average	394.98	2.63	2.56	14.99	7.46	19.98	2.33
03.12.2025	2:00-2:59	Average	387.51	2.70	2.75	15.38	7.06	19.93	2.32
03.12.2025	3:00-3:59	Average	383.50	2.78	2.81	15.91	8.08	19.89	2.37
03.12.2025	4:00-4:59	Average	392.16	2.91	2.83	15.68	8.09	20.07	2.44
03.12.2025	5:00-5:59	Average	398.35	2.99	3.08	15.31	8.39	20.11	2.55
03.12.2025	6:00-6:59	Average	387.87	3.00	2.83	15.83	8.19	19.99	2.59
03.12.2025	7:00-7:59	Average	388.48	2.92	3.02	15.95	8.21	20.05	2.60
03.12.2025	8:00-8:59	Average	391.57	2.79	3.61	15.56	7.58	20.23	2.54
Average			**389.94**	**2.73**	**3.05**	**15.27**	**7.69**	**20.00**	**2.40**
1 hour Minimum			381.38	2.34	2.56	13.95	6.41	19.78	2.10
1 hour Maximum			398.35	3.01	3.67	16.07	8.39	20.25	2.61

Table 4. 4 Air Monitoring Results (Gyoke Pin Village)

Date	Time		CO_2 (ppm)	CO (ppb)	NO_2 (ppb)	PM_{10} µg/m^3	$PM_{2.5}$ µg/m^3	RH %	SO_2 (ppb)
03.12.2025	10:00-10:59	Average	401.35	2.09	2.78	14.67	7.20	19.73	2.26
03.12.2025	11:00-11:59	Average	400.04	2.02	2.72	13.89	7.05	19.94	2.21
03.12.2025	12:00-12:59	Average	400.12	1.95	2.52	14.52	6.77	19.91	2.15
03.12.2025	13:00-13:59	Average	395.83	1.92	2.82	13.70	6.63	20.00	2.09
03.12.2025	14:00-14:59	Average	400.92	1.96	2.49	13.75	6.76	20.09	2.01
03.12.2025	15:00-15:59	Average	392.62	2.04	2.69	13.77	7.36	20.11	2.01
03.12.2025	16:00-16:59	Average	395.20	2.14	3.29	14.68	7.71	20.13	2.10
03.12.2025	17:00-17:59	Average	393.18	2.15	3.19	14.37	7.58	20.18	2.22
03.12.2025	18:00-18:59	Average	391.74	2.08	3.03	14.83	7.83	20.17	2.34
03.12.2025	19:00-19:59	Average	386.06	1.99	3.36	15.27	7.41	20.35	2.44
03.12.2025	20:00-20:59	Average	389.96	1.94	3.16	15.34	7.06	20.26	2.51
03.12.2025	21:00-21:59	Average	399.05	1.92	3.53	14.68	6.77	20.48	2.50
03.12.2025	22:00-22:59	Average	393.30	1.91	2.95	14.64	7.00	20.50	2.44
03.12.2025	23:00-23:59	Average	395.85	1.91	3.12	14.21	7.29	20.41	2.34
04.12.2025	0:00-0:59	Average	396.40	1.90	2.84	14.00	6.91	20.31	2.21
04.12.2025	1:00-1:59	Average	387.22	1.90	2.70	14.06	7.29	20.26	2.20
04.12.2025	2:00-2:59	Average	396.75	1.91	2.90	13.67	7.11	20.23	2.23
04.12.2025	3:00-3:59	Average	393.59	1.93	2.52	14.02	7.87	20.20	2.27
04.12.2025	4:00-4:59	Average	385.70	1.99	3.36	14.34	7.78	20.03	2.34
04.12.2025	5:00-5:59	Average	398.79	2.09	3.05	14.59	7.77	20.06	2.45
04.12.2025	6:00-6:59	Average	401.13	2.22	3.47	14.18	7.47	19.98	2.51
04.12.2025	7:00-7:59	Average	393.82	2.31	3.30	14.56	7.29	19.81	2.51
04.12.2025	8:00-8:59	Average	392.17	2.29	3.45	15.07	7.49	19.75	2.45
04.12.2025	9:00-9:59	Average	388.89	2.22	2.85	14.89	7.67	19.71	2.35
Average			**394.57**	**2.03**	**3.00**	**14.40**	**7.29**	**20.11**	**2.30**
1 hour Minimum			385.70	1.90	2.49	13.67	6.63	19.71	2.01
1 hour Maximum			401.35	2.31	3.53	15.34	7.87	20.50	2.51

Table 4. 5 Air Monitoring Results (Nyaung Kan Village)

Date	Time		CO_2 (ppm)	CO (ppb)	NO_2 (ppb)	PM_{10} µg/m3	$PM_{2.5}$ µg/m3	RH %	SO_2 (ppb)
04.12.2025	11:00-11:59	Average	381.23	1.92	1.76	10.18	6.60	19.87	2.53
04.12.2025	12:00-12:59	Average	385.61	1.77	1.99	9.94	6.30	20.04	2.53
04.12.2025	13:00-13:59	Average	382.92	1.76	1.66	10.77	5.84	20.03	2.51
04.12.2025	14:00-14:59	Average	380.40	1.84	2.09	10.84	5.85	20.21	2.54
04.12.2025	15:00-15:59	Average	373.78	1.97	1.81	10.96	5.89	20.13	2.62
04.12.2025	16:00-16:59	Average	377.38	2.07	1.79	10.68	6.11	20.38	2.68
04.12.2025	17:00-17:59	Average	373.16	2.20	2.14	11.01	6.18	20.46	2.68
04.12.2025	18:00-18:59	Average	381.75	2.31	2.06	11.18	6.41	20.55	2.65
04.12.2025	19:00-19:59	Average	381.57	2.40	2.20	11.84	7.11	20.57	2.57
04.12.2025	20:00-20:59	Average	374.43	2.40	2.09	11.74	7.08	20.57	2.53
04.12.2025	21:00-21:59	Average	380.47	2.32	2.18	10.76	7.48	20.66	2.51
04.12.2025	22:00-22:59	Average	388.42	2.20	2.23	10.57	6.93	20.91	2.49
04.12.2025	23:00-23:59	Average	384.33	2.09	2.49	10.93	6.70	20.71	2.50
05.12.2025	0:00-0:59	Average	389.88	2.01	2.20	10.77	6.17	20.68	2.52
05.12.2025	1:00-1:59	Average	380.61	2.01	2.25	10.64	6.51	20.57	2.52
05.12.2025	2:00-2:59	Average	378.96	2.02	2.00	10.44	6.14	20.64	2.53
05.12.2025	3:00-3:59	Average	374.10	2.03	2.05	10.95	6.13	20.42	2.57
05.12.2025	4:00-4:59	Average	374.35	2.09	2.41	10.99	6.63	20.29	2.65
05.12.2025	5:00-5:59	Average	375.98	2.20	2.23	11.51	6.60	20.33	2.74
05.12.2025	6:00-6:59	Average	380.12	2.31	2.02	12.00	6.94	20.30	2.80
05.12.2025	7:00-7:59	Average	385.41	2.39	2.27	12.08	7.01	20.16	2.80
05.12.2025	8:00-8:59	Average	383.60	2.40	2.24	11.12	7.12	20.06	2.74
05.12.2025	9:00-9:59	Average	382.65	2.29	1.82	11.11	6.60	19.90	2.66
05.12.2025	10:00-10:59	Average	370.57	2.12	1.76	10.49	6.73	19.93	2.57
Average			**380.07**	**2.13**	**2.07**	**10.98**	**6.54**	**20.35**	**2.60**
1 hour Minimum			370.57	1.76	1.66	9.94	5.84	19.87	2.49
1 hour Maximum			389.88	2.40	2.49	12.08	7.48	20.91	2.80

4.2 Wind Speed and Direction

The following figure describes the wind speed and wind direction of the proposed project site on 1st December to 5th December 2025 respectively. According to the data, the wind direction is following **Figure 4. 9 to Figure 4. 16.**

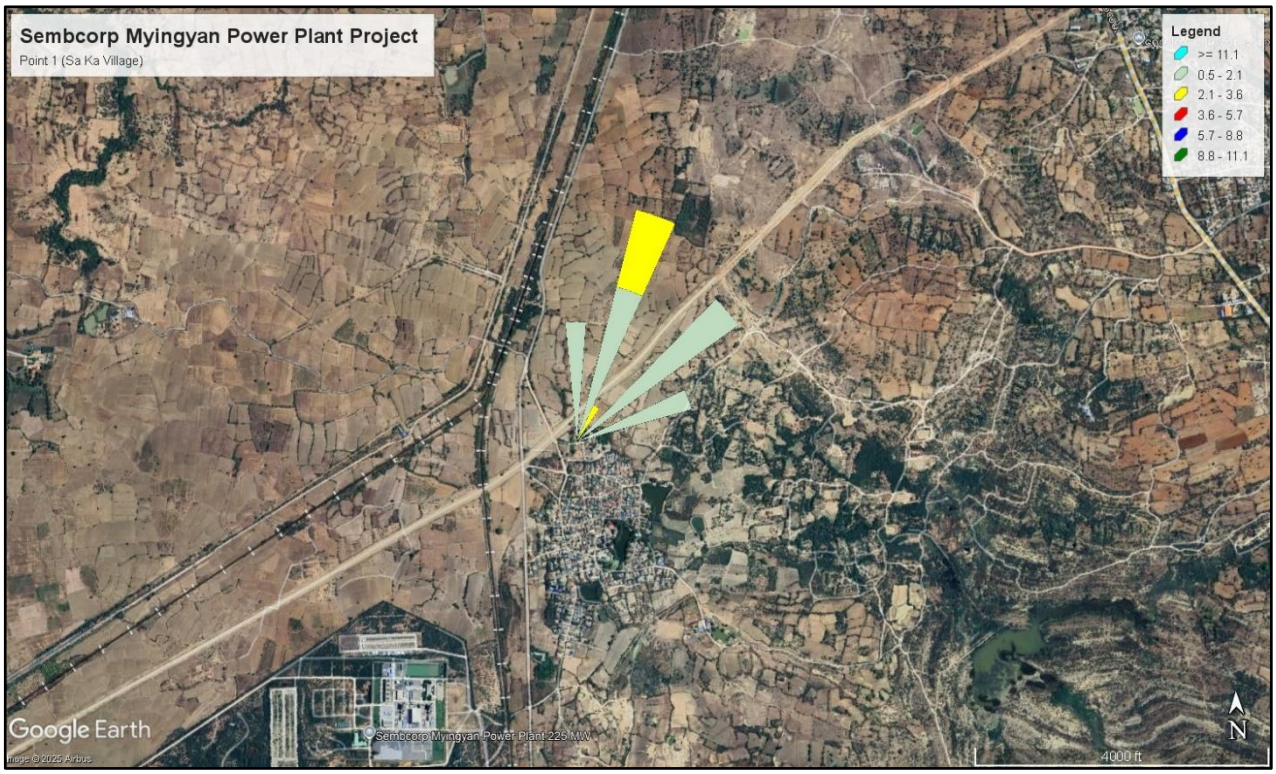


Figure 4. 9 Wind Speed and Wind Direction (Blowing From) at Sa Ka Village (ASR4)

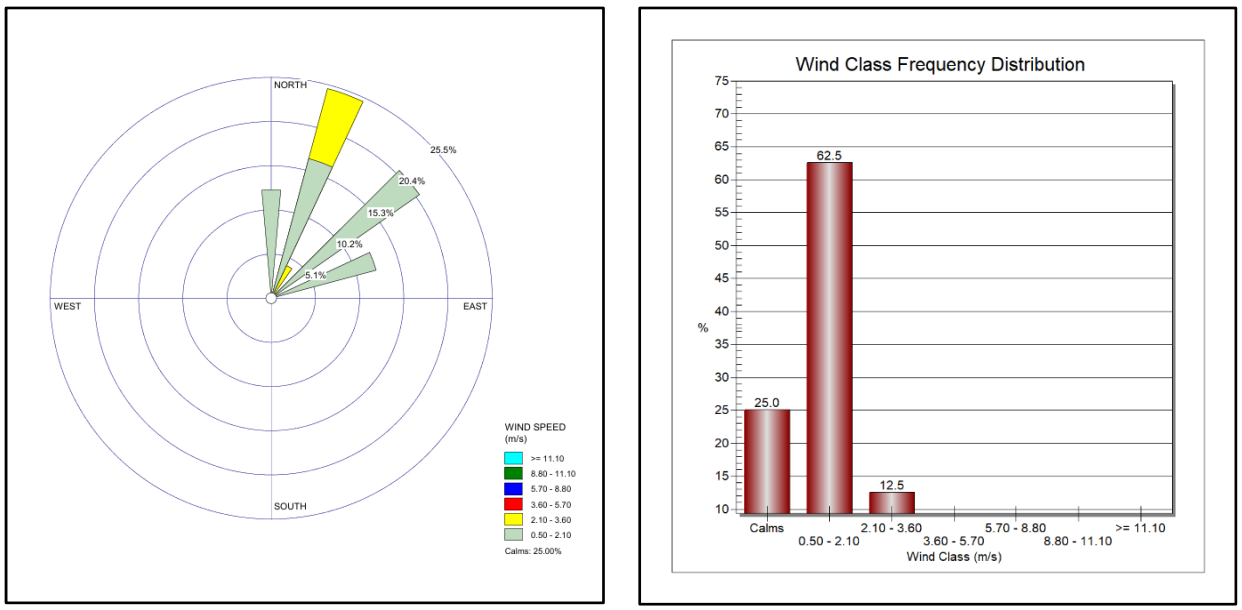


Figure 4. 10 Wind Class Frequency Distribution at Sa Ka Village (ASR4)

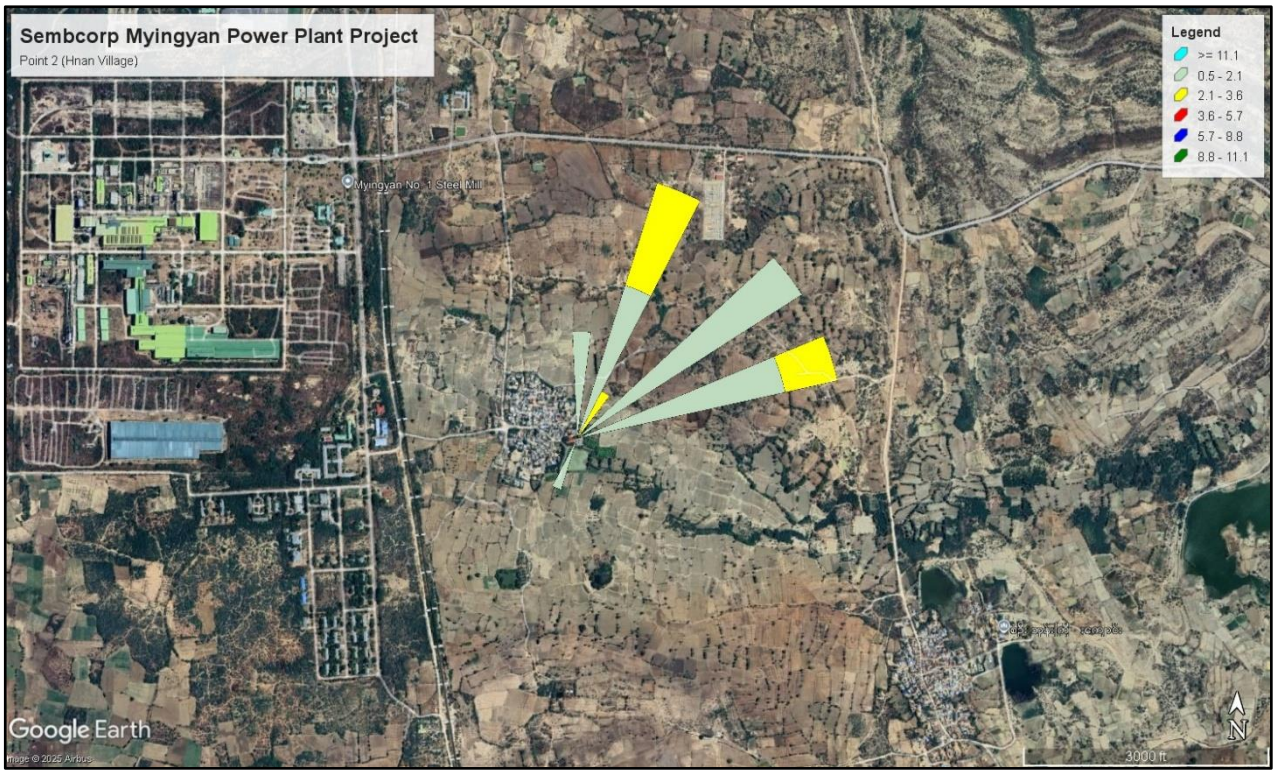
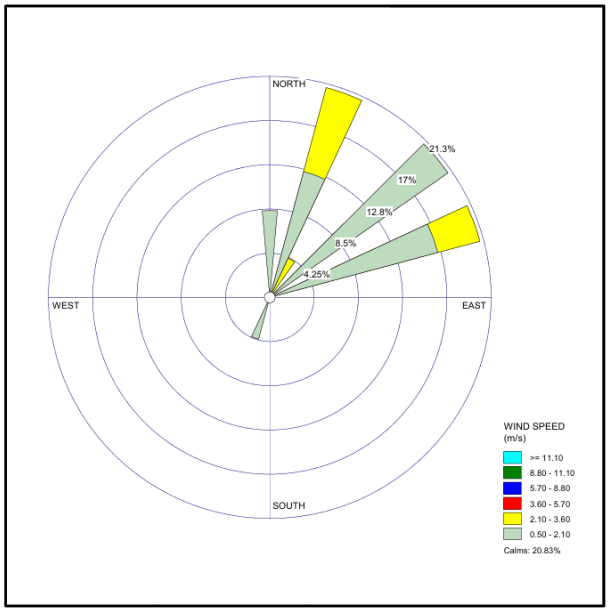


Figure 4. 11 Wind Speed and Wind Direction (Blowing From) at Hnan Village (ASR3)



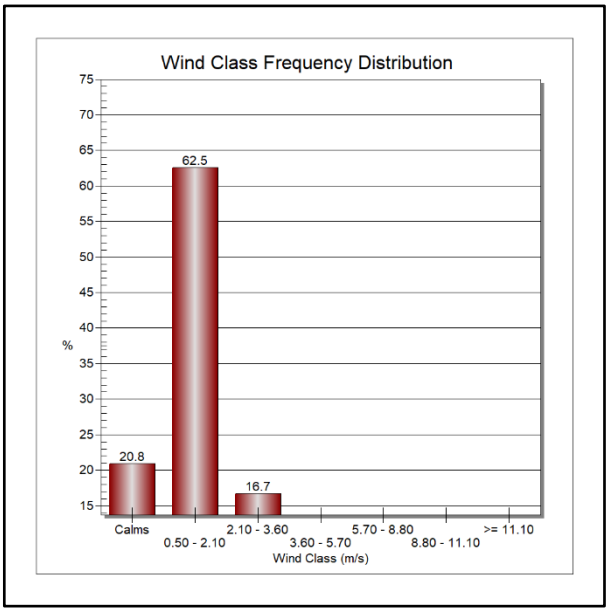


Figure 4. 12 Wind Class Frequency Distribution at Hnan Village (ASR3)

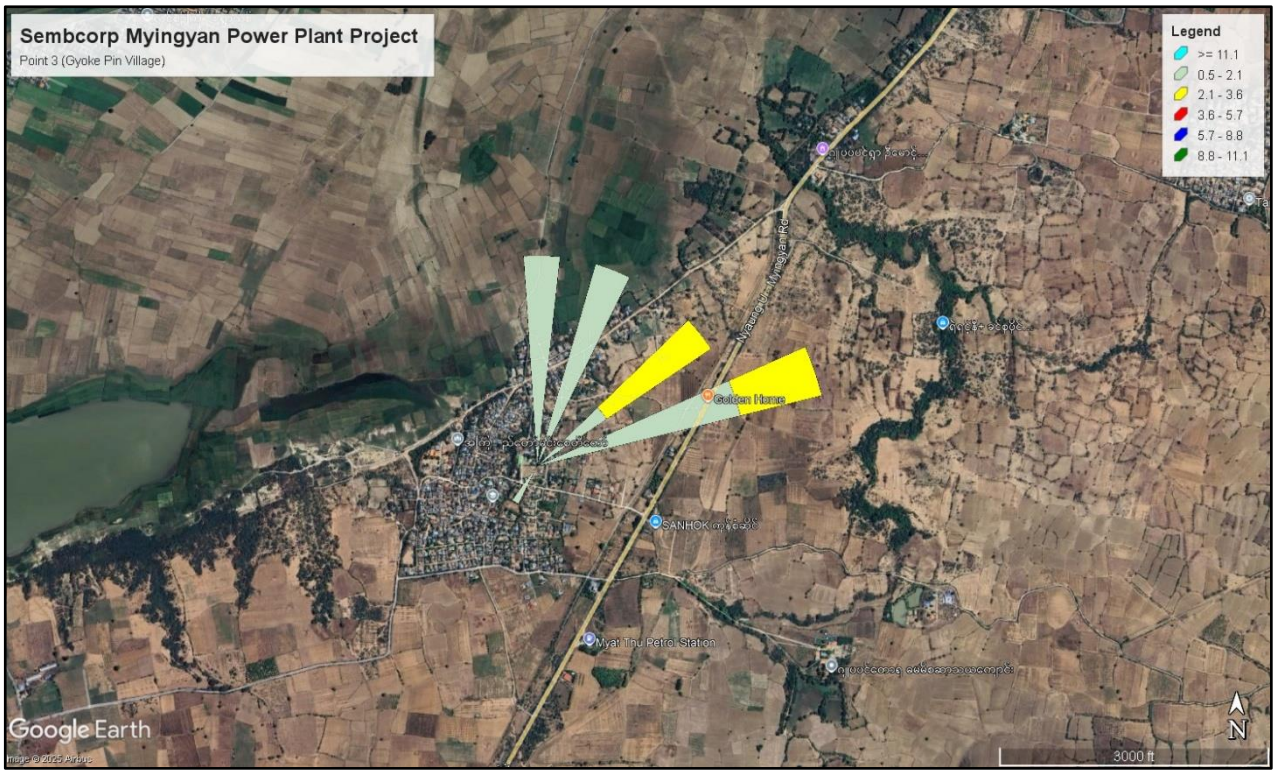


Figure 4. 13 Wind Speed and Wind Direction (Blowing From) at Gyoke Pin Village (ASR5)

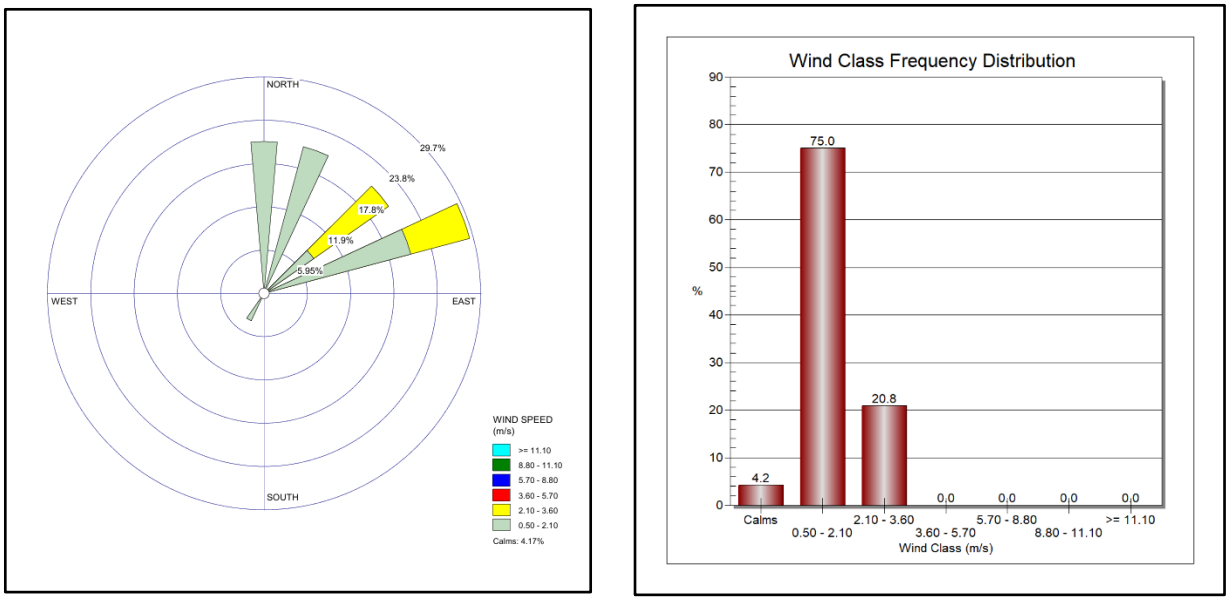


Figure 4. 14 Wind Class Frequency Distribution at Gyoke Pin Village (ASR5)

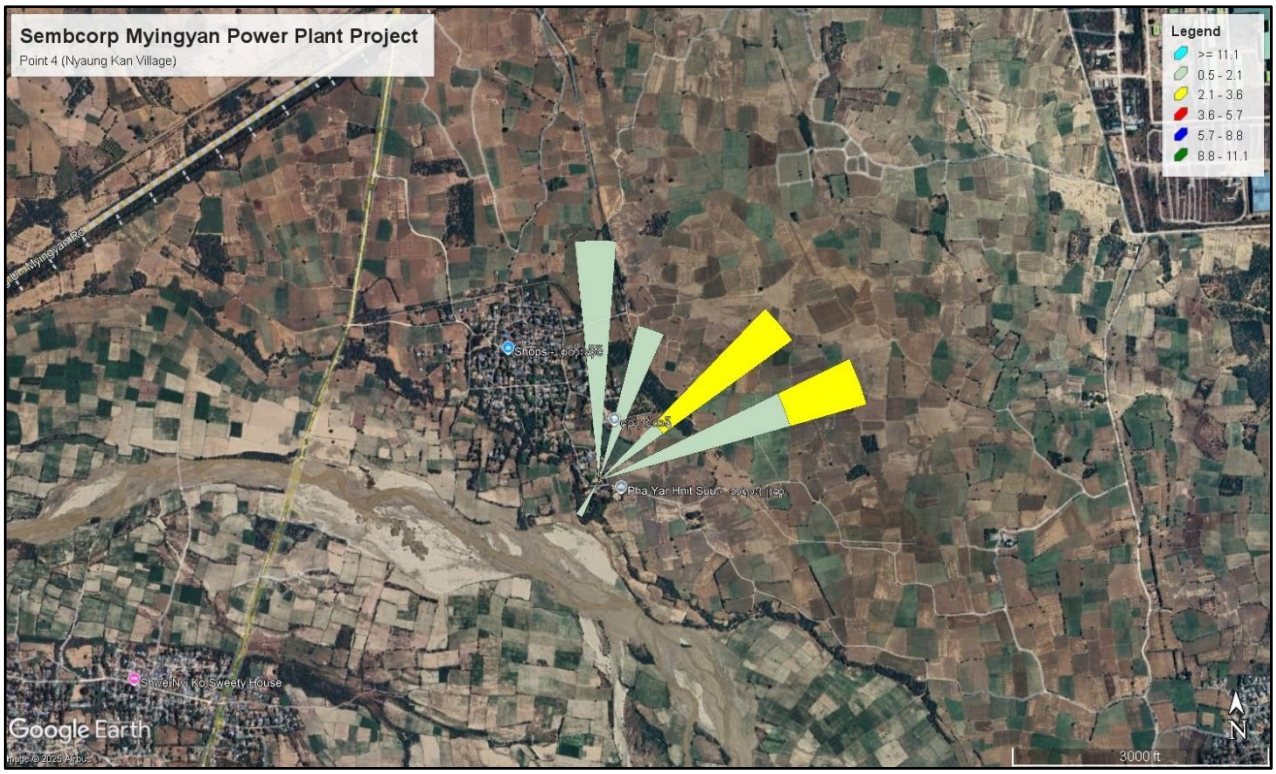
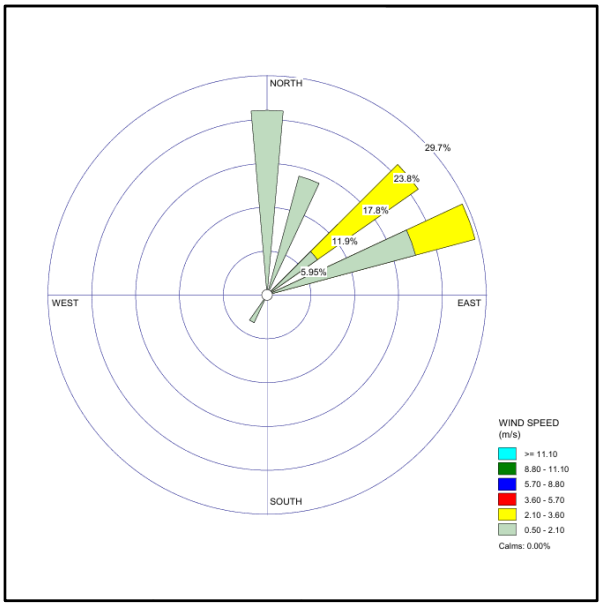


Figure 4. 15 Wind Speed and Wind Direction (Blowing From) at Nyaung Kan Village (ASR14)



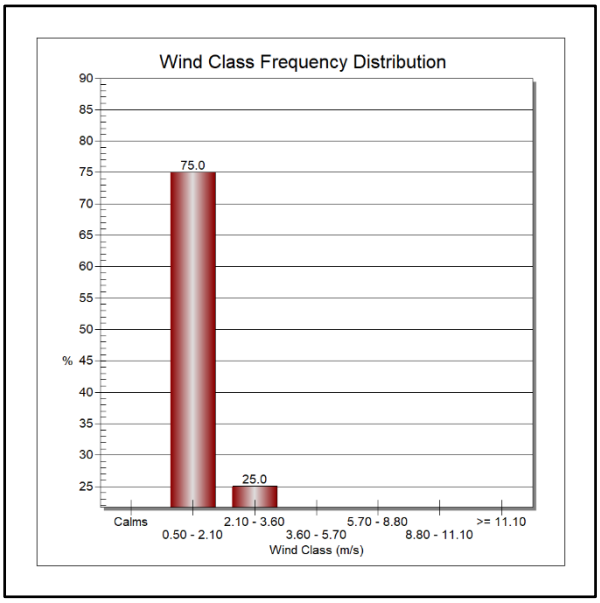


Figure 4. 16 Wind Class Frequency Distribution at Nyaung Kan Village (ASR14)

4.3 Ambient Noise

Ambient noise level for the proposed project was measured with Digital Sound Level Meter at the project site. The noise level measurement is conducted at Sembcorp Myingyan Power points: these points are nearly sembcorp myingyan power plant and air monitoring point at Sa Ka village on 1st December 2025 to 3rd December 2025. Measuring period is 24 hours continuously. The observed values are described in **Table 4. 6 to Table 4. 9** and the following figures are noise level measurements at the proposed project.

Table 4. 6 Observed Values of Noise Level Measurement at near Sembcorp Myingyan Power Plant

No.	Date	Time	Observed Mean Value (Source)	Weight	Day/Night	Average
1	03.12.2025	7:00:24-7:59:24	67.94	A	Day	57.10
2	03.12.2025	8:00:24-8:59:24	68.25	A	Day	
3	02.12.2025	9:00:24-9:59:24	64.82	A	Day	
4	02.12.2025	10:00:24-10:59:24	52.37	A	Day	
5	02.12.2025	11:00:24-11:59:24	51.89	A	Day	
6	02.12.2025	12:00:24-12:59:24	53.31	A	Day	
7	02.12.2025	13:00:24-13:59:24	53.40	A	Day	
8	02.12.2025	14:00:24-14:59:24	53.95	A	Day	
9	02.12.2025	15:00:24-15:59:24	56.49	A	Day	
10	02.12.2025	16:00:24-16:59:24	62.85	A	Day	
11	02.12.2025	17:00:24-17:59:24	66.63	A	Day	
12	02.12.2025	18:00:24-18:59:24	61.99	A	Day	
13	02.12.2025	19:00:24-19:59:24	47.79	A	Day	
14	02.12.2025	20:00:24-20:59:24	47.61	A	Day	
15	02.12.2025	21:00:24-21:59:24	47.17	A	Day	
16	02.12.2025	22:00:24-22:59:24	47.23	A	Night	53.91
17	02.12.2025	23:00:24-23:59:24	48.32	A	Night	
18	03.12.2025	0:00:24-0:59:24	47.86	A	Night	
19	03.12.2025	1:00:24-1:59:24	50.28	A	Night	
20	03.12.2025	2:00:24-2:59:24	55.87	A	Night	
21	03.12.2025	3:00:24-3:59:24	56.26	A	Night	
22	03.12.2025	4:00:24-4:59:24	55.65	A	Night	
23	03.12.2025	5:00:24-5:59:24	55.45	A	Night	
24	03.12.2025	6:00:24-6:59:24	68.23	A	Night	
Average			**55.90**			

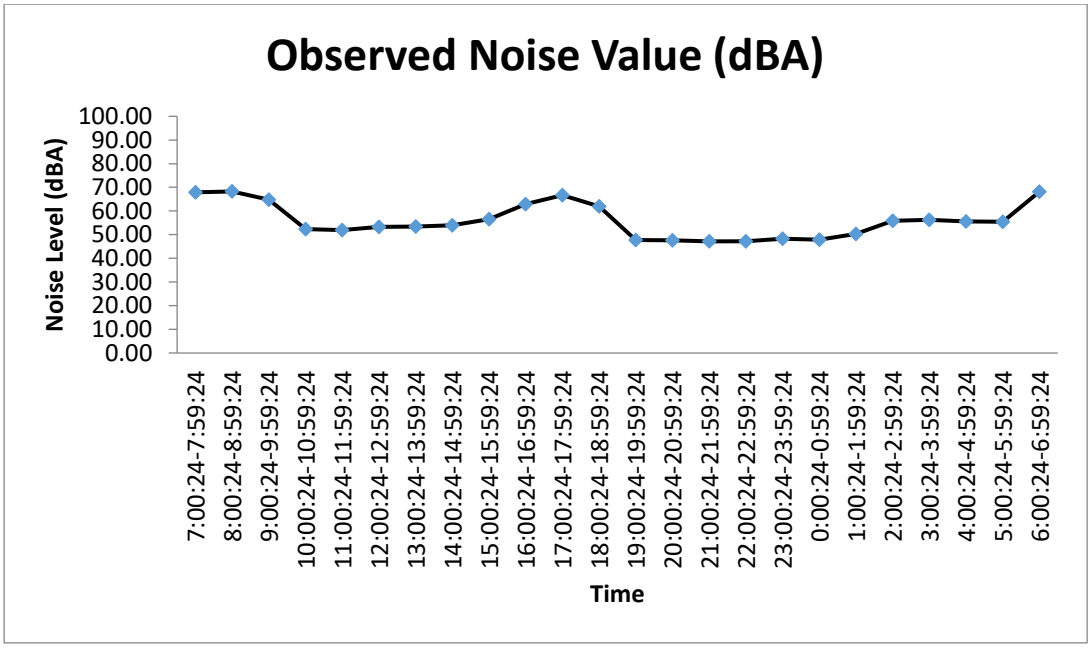


Figure 4. 17 Noise Level at near Sembcorp Myingyan Power Plant

Table 4. 7 Observed Values of Noise Level Measurement at Sa Ka Village

No.	Date	Time	Observed Mean Value (Source)	Weight	Day/Night	Average
1	02.12.2025	7:00:46-7:59:46	78.85	A	Day	55.74
2	01.12.2025	8:00:46-8:59:46	73.23	A	Day	
3	01.12.2025	9:00:46-9:59:46	57.34	A	Day	
4	01.12.2025	10:00:46-10:59:46	47.29	A	Day	
5	01.12.2025	11:00:46-11:59:46	48.21	A	Day	
6	01.12.2025	12:00:46-12:59:46	51.20	A	Day	
7	01.12.2025	13:00:46-13:59:46	54.98	A	Day	
8	01.12.2025	14:00:46-14:59:46	56.61	A	Day	
9	01.12.2025	15:00:46-15:59:46	60.44	A	Day	
10	01.12.2025	16:00:46-16:59:46	65.32	A	Day	
11	01.12.2025	17:00:46-17:59:46	48.55	A	Day	
12	01.12.2025	18:00:46-18:59:46	47.28	A	Day	
13	01.12.2025	19:00:46-19:59:46	55.10	A	Day	
14	01.12.2025	20:00:46-20:59:46	45.72	A	Day	
15	01.12.2025	21:00:46-21:59:46	45.98	A	Day	
16	01.12.2025	22:00:46-22:59:46	47.97	A	Night	57.87
17	01.12.2025	23:00:46-23:59:46	46.41	A	Night	
18	02.12.2025	0:00:46-0:59:46	45.81	A	Night	
19	02.12.2025	1:00:46-1:59:46	49.07	A	Night	
20	02.12.2025	2:00:46-2:59:46	63.16	A	Night	
21	02.12.2025	3:00:46-3:59:46	66.43	A	Night	

22	02.12.2025	4:00:46-4:59:46	58.26	A	Night	
23	02.12.2025	5:00:46-5:59:46	78.86	A	Night	
24	02.12.2025	6:00:46-6:59:46	64.86	A	Night	
Average			**56.54**			

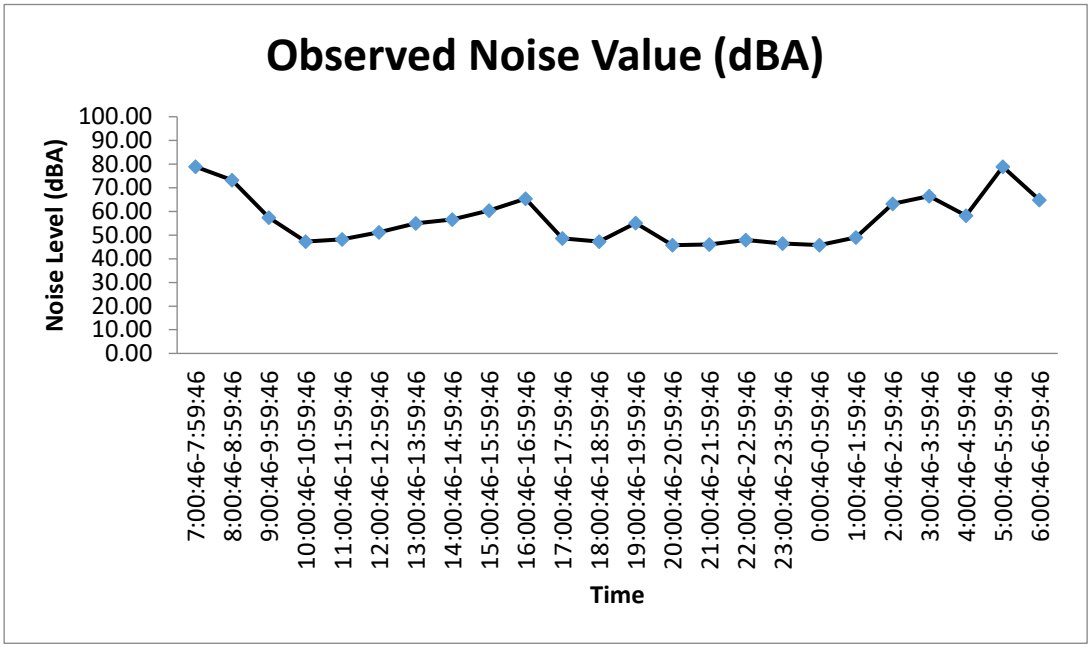


Figure 4. 18 Noise Level at Sa Ka Village

Table 4. 8 Observed Ambient Noise Level Results from Myingyan Power Plant

Point	**Sembcorp Myingyan Power Plant**	
	Day Time	**Nighttime**
Sembcorp Myingyan Power Plant	**57.10**	**53.91**
Guideline Values	70	70

Table 4. 9 Observed Ambient Noise Level Results from Sa Ka Village

Point	**Sembcorp Myingyan Power Plant**	
	Day Time	**Nighttime**
Sa Ka Village	**55.74**	**57.87**
Guideline Values	55	45

The observed values are compared with the National Environmental Quality (Emission) Guidelines as shown in

Table 4. 10 which indicates the separate level for residential and industrial points.

Table 4. 10 National Environmental Quality (Emission) Guidelines Values for Noise Level

Receptor	One Hour LAeq (dBA)	
	Daytime 07:00 - 22:00 (10:00 - 22:00 for Public Holidays)	Nighttime 22:00 - 07:00 (22:00 - 10:00 for Public Holidays)
Residential, institutional, educational	55	45
Industrial, commercial	70	70

The observed noise values of the proposed project for daytime at Sembcorp myingyan power plant and Sa Ka village are 57.10 dB (A) and 55.74 dB (A). The observed noise values of the proposed project for nighttime at Sembcorp myingyan power plant and Sa Ka village are 53.91 dB (A) and 57.87 dB (A). The proposed project is located adjacent to the residential and commercial area. The observed values of daytime and nighttime at Sembcorp myingyan power plant are within the acceptable values of the National Environmental Quality (Emission) Guidelines. The observed values of daytime and nighttime at Sa Ka village are upper the acceptable values of the National Environmental Quality (Emission) Guidelines because of the operation of near the factory and monitoring location, Sa Ka North Monastery which situated beside the road rang the wooden bell and passing through many motorcycles and cars and dog barking at the time of measurement. But Sa Ka Village is acceptable Applicable Operational Noise Criteria of 54 dB (A) from ESIA Report.

APPENDIX A

Description of Haz-scanner (EPAS)



Publication 1601 Rev 1405

HAZ-SCANNER EPAS

Wireless Environmental Perimeter Air Station



HAZ-SCANNER EPAS shown with optional solar panels

Performance Profile

The HAZ-SCANNER EPAS is optimized for ambient air applications; custom calibration for specific ranges or applications is available upon request.

Display	LCD real time
Operation	4-key splash-proof membrane switch
Power	12-V Absorption Glass Mat (AGM) rechargable battery, 100-240 V AC, or optional solar panel
Display Measurements	Max, Min, TWA, STEL
Recording Time	1 sec to 21 weeks
Sampling Rate	1 sec, 1 min, 10 min, 1 hr, adjustable
Data Storage	454,545 data points
Sampling Pump	1.0 to 3.0 L/min
Digital Output	RS-232 (PC), RS-423 (Mac)
Software	PC or Mac
Dimensions (weather-proof case)	8 x 14 x 10 in (19.2 x 35.6 x 25.4 cm)
Weight	12 lbs (5.4 kg)
Operating Temperature	23 to 122 F (-5 to 50 C)
Storage Temperature	-40 to 140 F (-40 to 60 C)
Humidity	95% non-condensing (use inlet heater)
Wireless Radio Modem	900 MHz (U.S.), 868 MHz (Euro) up to 5 miles - line of sight (optional)
Auxiliary Analog Input	0 to 2.5 VDC (1 channel for alternative meter)

Configure an EPAS for Up to 14 Simultaneous Measurements

The standard HAZ-SCANNER EPAS includes the monitor (calibrated for ambient air applications) with sensors/meters for PM10 or TSP, VOCs, temperature, humidity, and wind speed/direction in a NEMA 4 enclosure, acid gas scrubber, internal battery, universal 110-240 V AC battery charger, software, cables, and CD with instructions.

Configure the monitor with additional sensors/meters — up to 4 optional interchangable sensors with upgradable software and/or up to 4 EPAS-specific meters (listed below). See page 3 for specifications. ***Specify sensors and meters when ordering.***

- PM1.0, 2.5, or 4.0
- Ammonia (EC)
- Carbon Dioxide (NDIR)
- Carbon Monoxide (EC)
- Chlorine (EC)
- Ethylene Oxide (EL)
- Hydrocarbon (methane-specific, EC)
- Hydrocarbons (EC)
- Hydrogen Chloride (EL)
- Hydrogen Cyanide (EC)
- Hydrogen Sulfide (EC)
- Nitric Oxide (EC)
- Nitrogen Dioxide
- Oxygen
- Ozone
- Phosphine (EL)
- Sulfur Dioxide
- Rain
- Solar Radiance
- Sound and Noise
- Atomic Radiation
- ELF Radiation
- Barometric Pressure
- Dew Point Temperature
- Wet Bulb Temperature

Contact SKC to build an EPAS with available sensors/meters/calibration for your application!

SKC Limited Warranty and Return Policy

SKC products are subject to the SKC Limited Warranty and Return Policy, which provides SKC's sole liability and the buyer's exclusive remedy. To view the complete SKC Limited Warranty and Return Policy, go to http://www.skcinc.com/warranty.asp.

SKC Inc. 724-941-9701 SKC West 714-992-2780 SKC Gulf Coast 281-859-8050 SKC South 434-852-7149
www.skcinc.com

Publication 1801 Rev 1406

HAZ-SCANNER EPAS

Wireless Environmental Perimeter Air Station

HAZ-SCANNER EPAS Sensor/Meter Specifications

Parameter	Sensor*	Measurement/ Concentration Range	Accuracy	Minimum Resolution	Display Resolution	Additional Information
Particulates	90° infrared light scattering	0 to 5000 µg/m³	Greater of < ± 10% of reading or 0.2% full scale	10 µg/m³	1 µg/m³	Measures particle sizes: 10 µm or TSP (standard) or 1, 2.5, or 4 µm (optional) in the 0.1 to 100 µm size range
VOCs	PID (10.6 eV)	0 to 50,000 ppb (0 to 50 ppm)	Greater of < ± 10% of reading or 2% full scale	5 ppb	1 ppb	Minimum detection level is 0.01 ppm. Standard sensor
Toxic Gas: NH_3 - Ammonia	Gas-sensing semiconductor (GSS) technology	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: CO_2 - Carbon Dioxide	NDIR	0 to 5000 ppm	Greater of < ± 10% of reading or 2% full scale	50 ppm	1 ppm	Optional sensor
Toxic Gas: CO - Carbon Monoxide	Electrochemical	0 to 10,000 ppb (0 to 10 ppm)	Greater of < ± 10% of reading or 2% full scale	20 ppb	1 ppb	Optional sensor
Toxic Gas: Cl_2 - Chlorine	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: (C_2H_4O) - Ethylene Oxide	Electrochemical	0 to 1500 ppm	Greater of < ± 10% of reading or 2% full scale	8 ppm	1 ppm	Optional sensor
Toxic Gas: Hydrocarbon, CH_4 - Methane-specific	NDIR	0 to 1% Vol., 0 to 10,000 ppm, 0 to 20% LEL	Greater of < ± 10% of reading or 2% full scale	± 50 ppm or 0.1% LEL	50 ppm/ 0.1% LEL	Optional sensor
Toxic Gas: (Non-methane) Hydrocarbons (HC)	NDIR	Calibrated for 0 to 20% LEL of selected gas	Greater of < ± 10% of reading or 2% full scale	± 50 ppm/ 0.1% LEL	50 ppm/ 0.1% LEL	Optional sensor - specify gas type when ordering: ethane, propane, butane, hexane, ethanol, ethylene, or ethylene oxide
Toxic Gas: HCl - Hydrogen Chloride	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: HCN - Hydrogen Cyanide	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: H_2S - Hydrogen Sulfide	Electrochemical	0 to 25 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.15 ppm	0.1 ppm	Optional sensor
Toxic Gas: NO - Nitric Oxide	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: NO_2 - Nitrogen Dioxide	Electrochemical	0 to 5000 ppb (0 to 5 ppm)	Greater of < ± 10% of reading or 2% full scale	5 ppb	1 ppb	Optional sensor
Toxic Gas: O_2 - Oxygen	Electrochemical	0 to 30% Vol.	Greater of < ± 10% of reading or 2% full scale	0.6%	0.1%	Optional sensor
Toxic Gas: O_3 - Ozone	Gas-sensing semiconductor (GSS) technology	0 to 150 ppb (0 to 0.15 ppm), 0 to 500 ppb (0 to 0.5 ppm)	Greater of < ± 10% of reading or 2% full scale	1 ppb	1 ppb	Optional sensor
Toxic Gas: PH_3 - Phosphine	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: SO_2 - Sulfur Dioxide	Electrochemical	0 to 5000 ppb (0 to 5 ppm) for ambient applications	Greater of < ± 10% of reading or 2% full scale	5 ppb	1 ppb	Optional sensor

* Not approved for intrinsically safe applications; do not use in explosive gas environments.

Specifications continued on next page

SKC Inc. 724-941-9701 SKC West 714-992-2780 SKC Gulf Coast 281-859-8050 SKC South 434-852-7149
www.skcinc.com

HAZ-SCANNER EPAS

Wireless Environmental Perimeter Air Station

HAZ-SCANNER EPAS Sensor/Meter Specifications (con't)

Parameter	Sensor*	Measurement/ Concentration Range	Accuracy	Minimum Resolution	Display Resolution	Additional Information
Rain Fall/ Precipitation	Rain gauge (heated, tipping bucket)	0 to 5 inches daily	± 1% at 2 in/hr	0.01 in	0.01 in/tip	Optional meter
Temperature	NTC thermister	-4 to 140 F (-20 to 60 C)	Greater of ± 3% degree F or C of reading	1 degree F or C	1 degree F or C	Standard sensor
Relative Humidity (RH)	Thin-film capacitive	0 to 100% RH	± 2% RH	1% RH	1% RH	Standard sensor
Solar Radiance Intensity	Photodiode	1110 watts/ square meter (W/m^2)	± 5% of full scale (reference Eppley PSP at 1000 W/m^2)	1 W/m^2	1 W/m^2	Optional meter
Sound and Noise	Type 2 SLM	30 to 130 decibels (dB)	± 1.5 dB	0.1 dB	1 dB	Optional meter
Atomic Radiation	Geiger counter	1 to 19,999 counts per minute (cpm) or 0.001 to 100 milliRad/hr	± 10% Typical, ± 15% Max.	1 cpm or .001 mR/hr	1 cpm or .001 mR/hr	Optional meter
ELF Radiation	Sensor with single-axis probe	1 to 200 gauss (G)	± 10% or 5% FS	1 G	1 G	Optional meter
Wind Speed/ Direction	3-cup anemometer/ continuous rotation potentiometric wind direction vane	0 to 125 mph/ 5 to 355°	± 1 mph or ± 3%/± 3°	1 mph/1°	1 mph/1°	Standard sensor
Barometric Pressure	Piezo resistive	28.25 to 30.75 in Hg	± 0.09 in Hg	0.01 in Hg	0.01 in Hg	Optional sensor
Dew Point Temperature	Software calculation from RH and temperature	8.2 to 122 F (-15 to 50 C)	± 3 F	1 F	1 F	Optional meter - software calculated
Wet Bulb Temperature	Capsulated thermistor with wick	8.2 to 122 F (-15 to 50 C)	± 3 F	1 F	1 F	Optional meter - one meter

* Not approved for intrinsically safe applications; do not use in explosive gas environments.

SKC Inc. 724-941-9701 SKC-West 714-992-2780 SKC Gulf Coast 281-859-8050 SKC South 434-852-7149
www.skcinc.com

Calibration Certificate for Haz-scanner

NANOVA Co.,Ltd.
Medical Scientific Industrial

SYSTEM HEALTH CHECK REPORT

Information

Instrument	Hazscanner
Model	EPAS
Serial number	915081
Unit Sensor	CO, NO_2, CO_2, SO_2 PM_{10}, $PM_{2.5}$
Customer	Eguard
Date	2025 August 13th

Check List

Physical Check	OK
Supply Voltage Check	OK
PM 10 Air Flow Check	OK
PM2.5 Air Flow Check	OK
Internal Backup Battery Voltage Check	OK
NO2 Sensor Health Check	Moderate
CO2,SO2,CO Sensor Health Check	Still Good
Lithium Battery Voltage Check	Not OK
Data Logging Check	OK
Data Downloading Check	OK

Recommend

Need to replace Lithium battery.
Need to replace new acid gas scrubber (every 6 months).
Need to replace internal filters (every 6 months).
Need to perform factory calibration or in-field calibration (every 12 months).

Performed by

Phoe Saw Htoo
Technical Service Engineer
NANOVA CO., LTD

Approved by

Myo Oo
Technical Service Manager
NANOVA CO., LTD

Yangon 22-A, Shan Yeiktar Street, Sanchaung Township, Tel: +95 (1) 230 4901, 230 4902
Nay Pyi Taw Za /30, Ziwaka Say Sine Tan, Tha Phay Khone, Pyinmanar **Tel** 067 810 8083
Mandalay 153(B), 73rd Street, Bet 33x34 Street, ChanAye Tharzan Tsp. **Tel** 09 791 360000
Email contact@nanovapteltd.com Website: www.nanova-scientific.com
helpline 09 421 360000 , 09 451 360000

Calibration Certificate for Sound Level Meter

SCIENCE WORKSHOP
CALIBRATION CERTIFICATE

Submitted by	:	e guard Environmental Services No.(145-A2-3), Thiri Mingalar Street, Ward No.(4), 8th Mile, Mayangone Township, Yangon 11062, Myanmar.
Location	:	U Soe Min (Director)
Instrument	:	Digital Sound Level Meter (BENETECH, GM 1356) Sr No. GG: 2439187 (30dB – 130dB)
Instrument Reference No.:		eg – DSLM – 08
Test Equipment	:	Dual Trace Oscilloscope, Signal Generator and Digital Multimeter (7534-02, Yokogawa Japan)
Ambient Temperature	:	24°C
Permissible Error	:	± 1 % dB
Calibration Date	:	21th January 2025 Next due date 21th January 2026

We certified that this instrument has been calibrated to JAPAN standard under the condition stated above .

1. **Method of Calibration**

Measure and compare the Frequency Linearity and Sound Level with above instrument and test instrument same source, the effect which the hall has on sound at the same time so that people can hear.

2. **Result Calibration**

Measurement	Instrument	Test Equipment	Correction
Frequency	31.5 Hz	31.5 Hz	-
	150 Hz	150 Hz	-
	500 Hz	500 Hz	-
	1 KHz	1 KHz	-
	6 KHz	6 KHz	-
Level	30 dB	30 dB	-
	60 dB	60 dB	-
	90 dB	90 dB	-
	100 dB	100 dB	-
	120 dB	120 dB	-
	130 dB	130 dB	-

This instrument is suitable for use and comply with standard given by manufacture.

Calibrated by:

Ba Thein Sein
Senior Skilled Technician
SCIENCE EQUIPMENT (Lab) SERVICE

APPENDIX B

Field Photos

Air Monitoring Point at Sa Ka Village (ASR4) Lat- 21°23’48.591”, Long- 95°23’0.849” 01.12.2025 to 02.12.2025	
Air Monitoring Point at Hnan Village (ASR3) Lat- 21°22’17.565”, Long- 95°23’18.116” 02.12.2025 to 03.12.2025	

Air Monitoring Point at Gyoke Pin Village (ASR5) Lat- 21°24’21.888”, Long- 95°21’07.381” 03.12.2025 to 04.12.2025	
Air Monitoring Point at Nyaung Kan Village (ASR14) Lat- 21°21’58.048”, Long- 95°20’51.346” 04.12.2025 to 05.12.2025	

Sembcorp Myingyan Power Co., Ltd.

Environmental Monitoring Report

(Air Quality Monitoring)



Prepared

Ref: 01.12.2025 to 05.12.2025 (Air Quality Report)

18th December 2025

E Guard Environmental Services

Report Review Form

Report Title: Environmental Quality Monitoring Report in December 2025 For Sembcorp Myingyan Power Plant	
Report Version:	
Proponent: **Sembcorp Myingyan Power Plant**	**Prepared by;** **E Guard Environmental Services Co., Ltd.** No. (145- A2- 3), Thiri Mingalar Street, Ward No. (4), 8th Mile, Mayangone Township, Yangon 11062, Myanmar. Tel: 01 667953, Fax: 01 6667953, info@eguardservices.com Mobile +959 797005199

Prepared by: U Aung Moe Oo	**Position: Assistant Consultant**
Submitted Date: 17/12/2025	**Signature:**
Checked by: U Aung Myint Myat	**Position: Consultant**
Checked Date: 17/12/2025	**Signature:**

Approved by:

Table of Contents

List of Figures ii

List of Tables iii

1. INTRODUCTION 1

2. METHODOLOGY 1

2.1 Ambient Air Quality 1

2.2 Ambient Noise 1

3. MONITORING LOCATIONS 3

4. ENVIRONMENTAL QUALITY MONITORING RESULTS 4

4.1 Ambient Air Quality Monitoring Results 4

4.2 Wind Speed and Direction 12

4.3 Ambient Noise 16

APPENDIX A 20

APPENDIX B 27

List of Figures

Figure 3. 1 Location of Monitoring Points 3

Figure 4. 1 PM Monitoring Results at Sa Ka Village 4

Figure 4. 2 PM Monitoring Results at Hnan Village 4

Figure 4. 3 PM Monitoring Results at Gyoke Pin Village 5

Figure 4. 4 PM Monitoring Results at Nyaung Kan Village 5

Figure 4. 5 Fluctuation of Air Pollutants during dial cycle (Sa Ka Village) 6

Figure 4. 6 Fluctuation of Air Pollutants during dial cycle (Hnan Village) 6

Figure 4. 7 Fluctuation of Air Pollutants during dial cycle (Gyoke Pin Village) 6

Figure 4. 8 Fluctuation of Air Pollutants during dial cycle (Nyaung Kan Village) 7

Figure 4. 9 Wind Speed and Wind Direction (Blowing From) at Sa Ka Village (ASR4) 12

Figure 4. 10 Wind Class Frequency Distribution at Sa Ka Village (ASR4) 12

Figure 4. 11 Wind Speed and Wind Direction (Blowing From) at Hnan Village (ASR3) 13

Figure 4. 12 Wind Class Frequency Distribution at Hnan Village (ASR3) 13

Figure 4. 13 Wind Speed and Wind Direction (Blowing From) at Gyoke Pin Village (ASR5) 14

Figure 4. 14 Wind Class Frequency Distribution at Gyoke Pin Village (ASR5) 14

Figure 4. 15 Wind Speed and Wind Direction (Blowing From) at Nyaung Kan Village (ASR14) 15

Figure 4. 16 Wind Class Frequency Distribution at Nyaung Kan Village (ASR14) 15

Figure 4. 17 Noise Level at near Sembcorp Myingyan Power Plant 17

Figure 4. 18 Noise Level at Sa Ka Village 18

List of Tables

Table 2. 1 Ambient Air Quality Parameters 1

Table 2. 2 Air Quality Guideline Values 1

Table 2. 3 Noise level monitoring 2

Table 2. 4 Equipment used to measure ambient air and noise measurement 2

Table 3. 1 Location of Monitoring Points 3

Table 4. 1 Observed Ambient Air Quality Results from Selected Points 4

Table 4. 2 Air Monitoring Results (Sa Ka Village) 8

Table 4. 3 Air Monitoring Results (Hnan Village) 9

Table 4. 4 Air Monitoring Results (Gyoke Pin Village) 10

Table 4. 5 Air Monitoring Results (Nyaung Kan Village) 11

Table 4. 6 Observed Values of Noise Level Measurement at near Sembcorp Myingyan Power Plant 16

Table 4. 7 Observed Values of Noise Level Measurement at Sa Ka Village 17

Table 4. 8 Observed Ambient Noise level Results from Myingyan Power Plant 18

Table 4. 9 Observed Ambient Noise level Results from Sa Ka Village 18

Table 4. 10 National Environmental Quality (Emission) Guidelines Values for Noise Level 19

1. INTRODUCTION

This report is environmental monitoring (only air and noise quality monitoring) for Sembcorp Myingyan Power Plant which is located beside of Myingyan – Nyaung-Oo Road, near the Sa Ka village in Mandalay Region.

2. METHODOLOGY

Baseline environmental parameters and sampling locations were defined according to the objectives for environmental monitoring purposes. Locations for sampling and analysis of ambient air quality of the project site were identified by Sembcorp Myingyan Power Co,ltd.

2.1 Ambient Air Quality

The emissions of dust particles and gases were measured for 24hrs continuously at the selected sites by using the Environmental Perimeter Air Station (EPAS), and EPAS provides direct readings in real time with data-logging capabilities. The monitoring results were compared with National Environmental Quality (Emission) Guideline (NEQG), World Health Organization (WHO) and American Conference of Governmental Industrial Hygienists (ACGIH) guidelines.

Table 2. 1 Ambient Air Quality Parameters

Ambient Air Quality (4 locations)	
Gas Emission	CO, CO_2, SO_2, NO_2
Dust Emission	PM_{10}, $PM_{2.5}$

Table 2. 2 Air Quality Guideline Values

Parameters	Guidelines Value	Unit	Organization	Averaging Period
PM_{10}	50	$\mu g/m^3$	NEQ	24hrs
$PM_{2.5}$	25	$\mu g/m^3$	NEQ	24hrs
CO	9	ppm	NAAQS	8hrs
CO_2	5000	ppm	ACGIH	8hrs
SO_2	20	$\mu g/m^3$	NEQ	24hrs
NO_2	200	$\mu g/m^3$	NEQ	24hrs

Source: Myanmar National Environmental Quality (Emission) Guidelines, December 2015 & Air quality guidelines global update. 2005. World Health Organization.

2.2 Ambient Noise

Noise level LAeq (dBA) will be measured at the selected locations that can reflect the exposure of the nearest local community and sensitive locations. Duration and frequency were measured for 24hrs continuously at the selected site using the Noise Meter.

The monitoring procedures, data analysis and interpretation were carried out in accordance with the instrument's manufacture and National Environmental Quality (Emission) Guidelines, World Health Organization (WHO) and International Finance Corporation (IFC guidelines in order to be in line with Environmental Conservation Department, Ministry of Natural Resources and Environment Conservation (MONREC). "National Environmental Quality

(Emission) Guidelines" for Myanmar was also presented the value of noise level as LAeq (dBA).

Table 2. 3 Noise level monitoring

Noise monitoring (2 locations)	
Noise Emission	LAeq (dBA) (1hrs, 24 hrs.)

Equipment used to measure ambient air and noise measurement are shown below (**Table 2. 4**).

Table 2. 4 Equipment used to measure ambient air and noise measurement

Davis Vantage Pro2 Wireless Weather Station Provides detailed current weather conditions and expanded forecasts - all at a glance! The Vantage Pro2 uses a frequency-hopping spread spectrum radio from 902 MHz to 928 MHz to transmit and receive data up to 1,000' (300m) line of sight. In addition, the weather station features a bubble level, improved anemometer base, redesigned wind cups, and factory-calibrated wind direction. The integrated sensor suite combines temperature and humidity sensors, rain collector with an aluminum-plated tipping bucket, and anemometer into one package for easy setup. Measure inside and outside temperature and humidity, heat index, barometric pressure, dew point, rainfall, wind direction and speed, and wind chill.	
Haz-Scanner EPAS PM_{10}, PM $_{2.5}$, NO_2, SO_2, CO, CO_2, Temperature, and Relative Humidity	
Digital Sound Level Meter Noise and Vibration	

3. MONITORING LOCATIONS

Locations of sampling sites were identified by Sembcorp Myingyan Power Co,ltd. Air quality was monitored at the four selected locations that are Sa Ka Village (ASR4), Hnan Village (ASR3), Gyoke Pin Village (ASR 5) and Nyaung Kan Village (ASR 14).

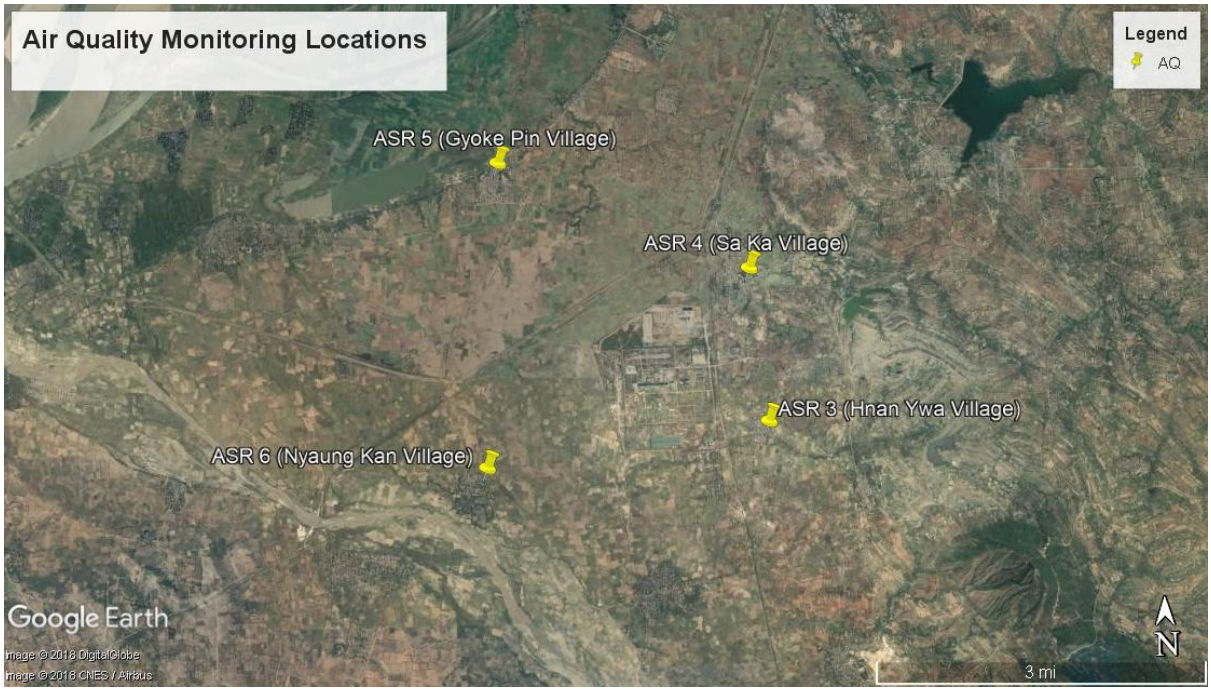


Figure 3. 1 Location of Monitoring Points

Table 3. 1 Location of Monitoring Points

Locations No.	Points	Coordinate	Locations
Ambient Air Quality and Noise Monitoring Locations			
1	ASR4	Lat- 21°23’48.591”, Long- 95°23’0.849”	Sa Ka Village
2	ASR3	Lat- 21°22’17.565”, Long- 95°23’18.116”	Hnan Village
3	ASR5	Lat- 21°24’21.888”, Long- 95°21’7.381”	Gyoke Pin Village
4	ASR14	Lat- 21°21’44.570”, Long- 95°20’55.035”	Nyaung Kan Village

4. ENVIRONMENTAL QUALITY MONITORING RESULTS

4.1 Ambient Air Quality Monitoring Results

24 hours air quality monitoring was done at each selected location from 1st December to 5th December 2025. The measured results are compared with national emission guidelines. Based on the results of air quality monitoring, all the parameters are within the guidelines.

Table 4. 1 Observed Ambient Air Quality Results from Selected Points

Parameters	Observed Value				Guidelines Value	Unit	Averaging Period
	ASR4	ASR3	ASR5	ASR14			
PM_{10}	14.25	15.27	14.40	10.98	50	$\mu g/m^3$	24hrs
$PM_{2.5}$	7.13	7.69	7.29	6.54	25	$\mu g/m^3$	24hrs
CO	0.0026	0.0028	0.0021	0.0022	9	ppm	8hrs
CO_2	400.76	390.55	397.41	382.33	5000	ppm	8hrs
SO_2	4.98	6.28	6.02	6.81	20	$\mu g/m^3$	24hrs
NO_2	5.80	6.90	6.65	4.68	200	$\mu g/m^3$	1hrs

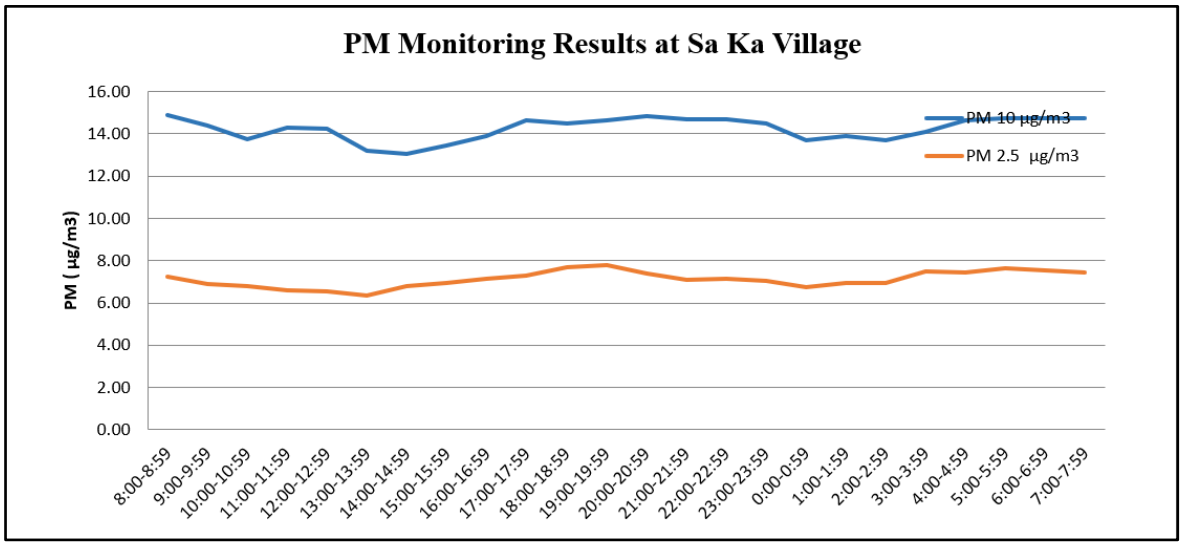


Figure 4. 1 PM Monitoring Results at Sa Ka Village

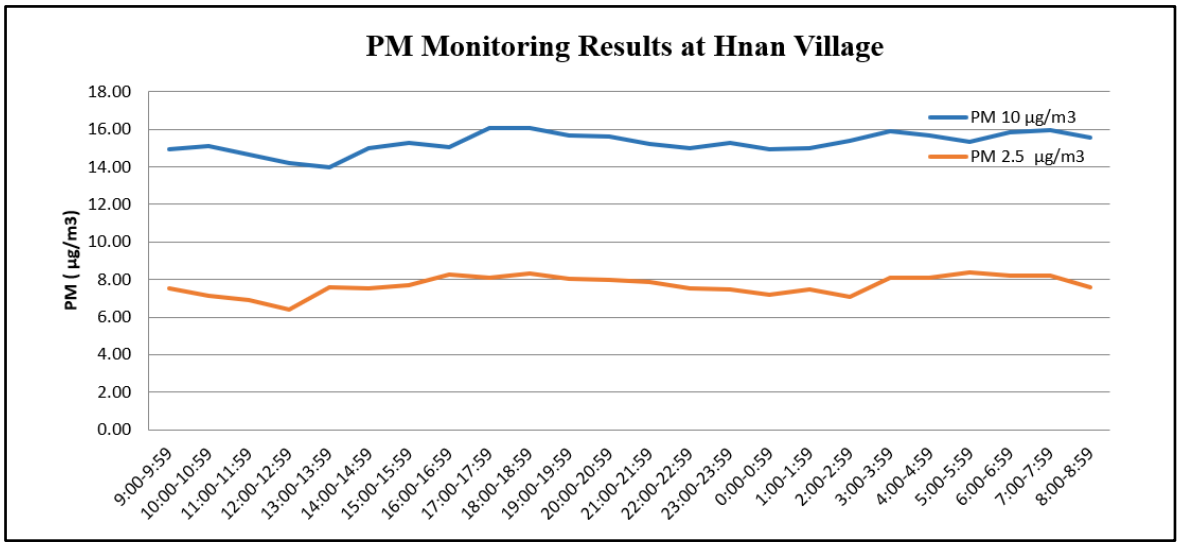


Figure 4. 2 PM Monitoring Results at Hnan Village

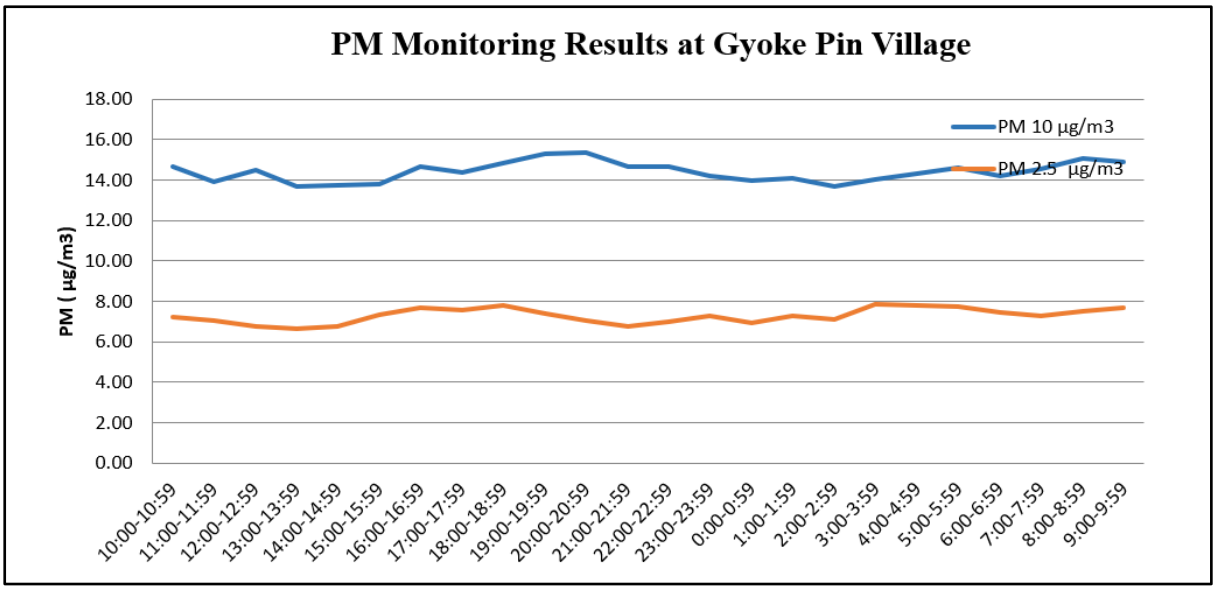


Figure 4. 3 PM Monitoring Results at Gyoke Pin Village

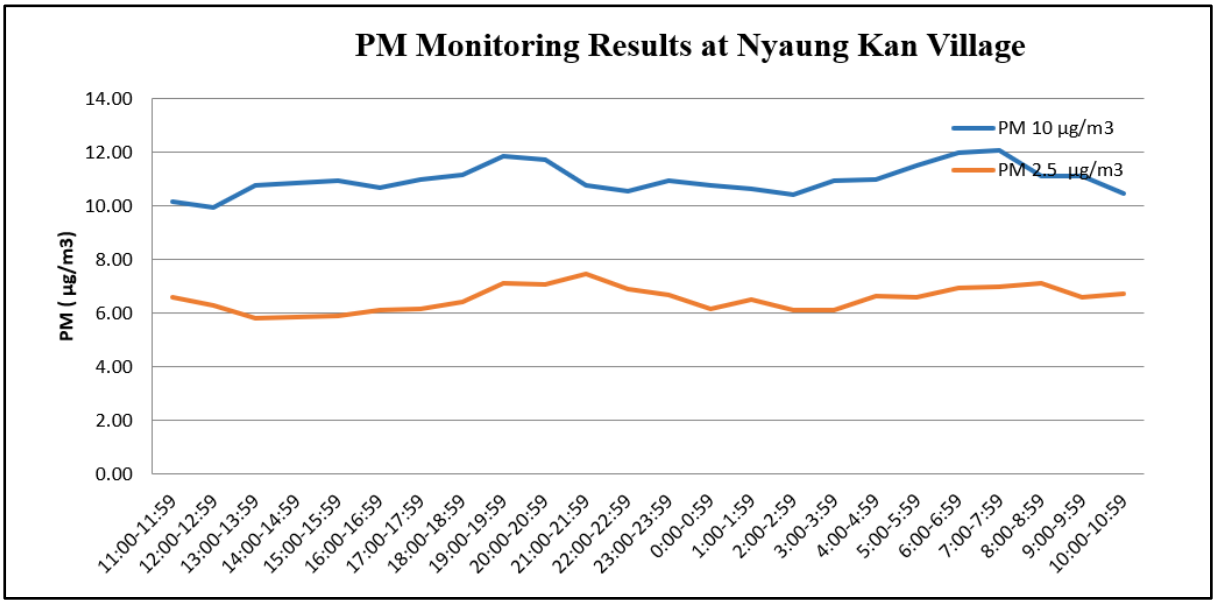


Figure 4. 4 PM Monitoring Results at Nyaung Kan Village

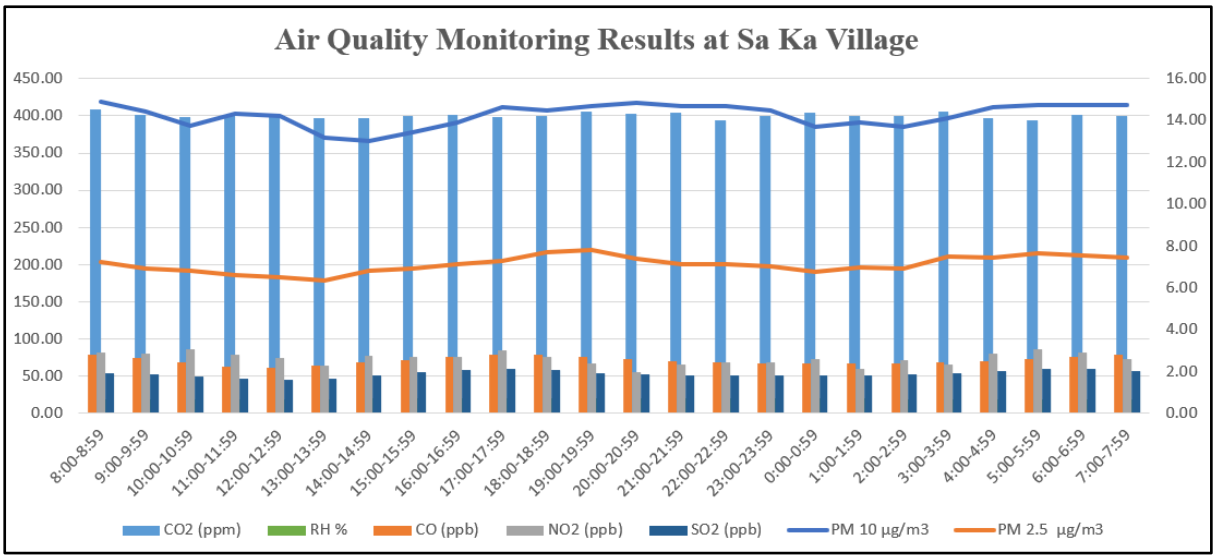


Figure 4. 5 Fluctuation of Air Pollutants during dial cycle (Sa Ka Village)

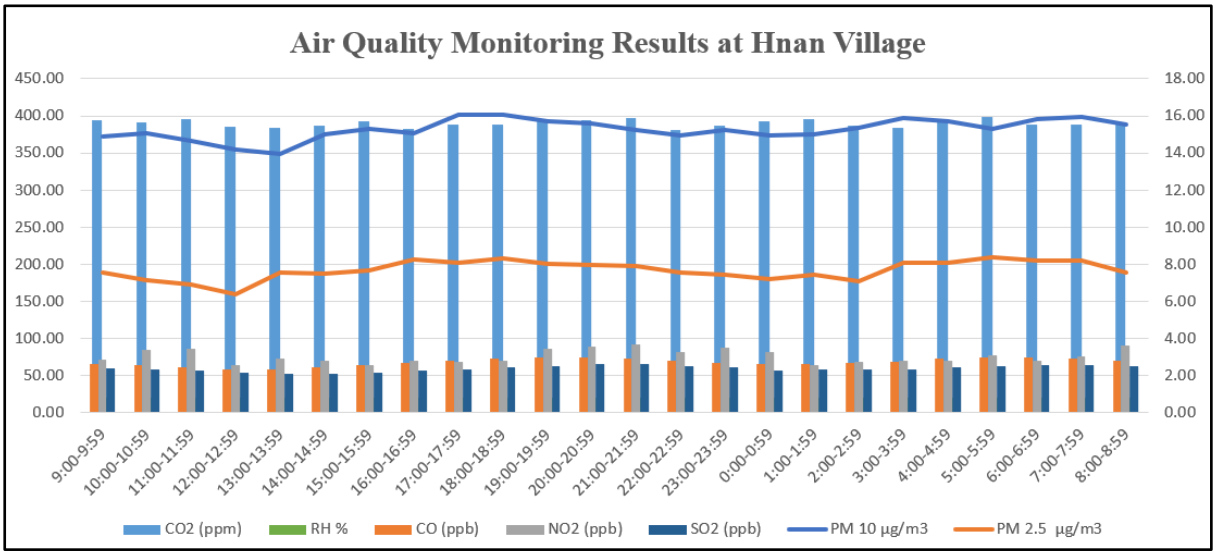


Figure 4. 6 Fluctuation of Air Pollutants during dial cycle (Hnan Village)

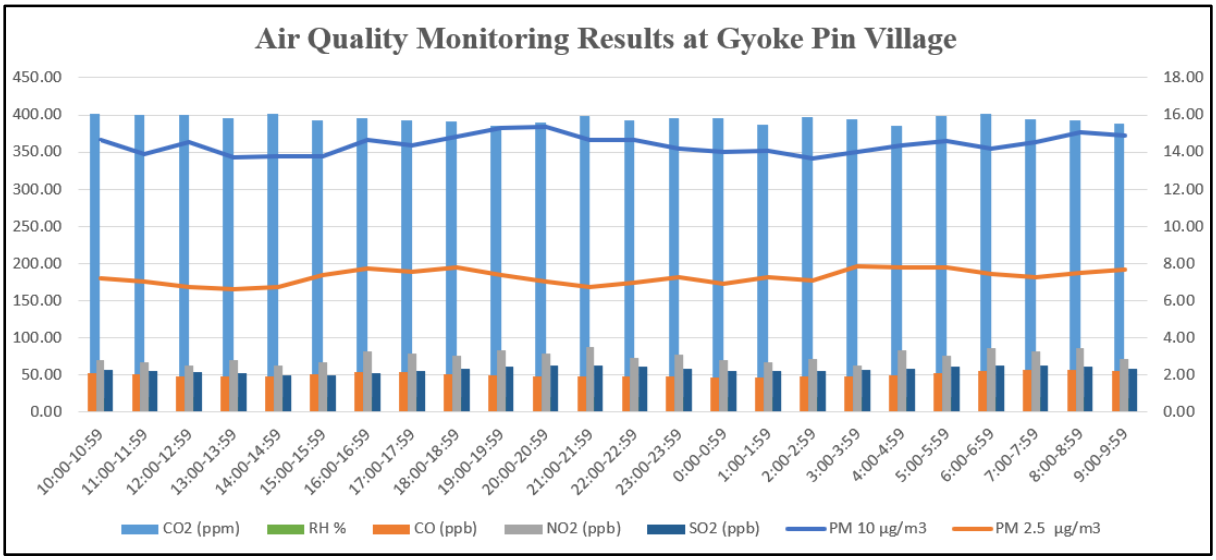


Figure 4. 7 Fluctuation of Air Pollutants during dial cycle (Gyoke Pin Village)

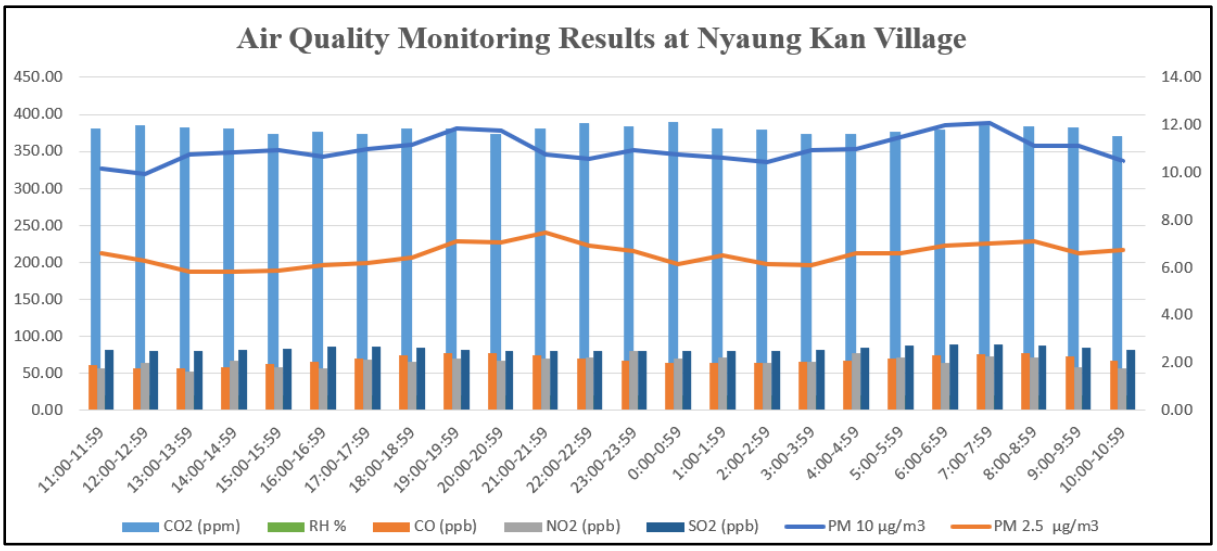


Figure 4. 8 Fluctuation of Air Pollutants during dial cycle (Nyaung Kan Village)

Detail results with one-hour interval of pollutants are shown in **Table 4. 2** to **Table 4. 5.** All results are under the Myanmar National Environmental Quality (emission) Guidelines. So, Sembcorp Myingyan Power Plant is acceptable for environment.

Table 4. 2 Air Monitoring Results (Sa Ka Village)

Date	Time		CO_2 (ppm)	CO (ppb)	NO_2 (ppb)	PM_{10} µg/m^3	$PM_{2.5}$ µg/m^3	RH %	SO_2 (ppb)
01.12.2025	8:00-8:59	Average	408.25	2.79	2.90	14.91	7.23	19.08	1.94
01.12.2025	9:00-9:59	Average	401.53	2.64	2.85	14.41	6.91	19.29	1.86
01.12.2025	10:00-10:59	Average	399.18	2.42	3.09	13.76	6.80	19.24	1.77
01.12.2025	11:00-11:59	Average	401.83	2.24	2.79	14.30	6.62	19.35	1.68
01.12.2025	12:00-12:59	Average	402.29	2.17	2.65	14.24	6.53	19.52	1.63
01.12.2025	13:00-13:59	Average	396.73	2.29	2.29	13.20	6.36	19.60	1.68
01.12.2025	14:00-14:59	Average	396.75	2.43	2.76	13.04	6.82	19.65	1.82
01.12.2025	15:00-15:59	Average	399.51	2.57	2.71	13.44	6.93	19.71	1.98
01.12.2025	16:00-16:59	Average	400.88	2.71	2.71	13.89	7.13	19.91	2.08
01.12.2025	17:00-17:59	Average	397.93	2.79	3.03	14.66	7.30	20.01	2.11
01.12.2025	18:00-18:59	Average	399.30	2.80	2.71	14.49	7.69	19.94	2.05
01.12.2025	19:00-19:59	Average	405.27	2.71	2.40	14.67	7.81	20.34	1.95
01.12.2025	20:00-20:59	Average	402.28	2.60	1.96	14.85	7.41	20.10	1.87
01.12.2025	21:00-21:59	Average	405.07	2.50	2.33	14.68	7.11	20.16	1.83
01.12.2025	22:00-22:59	Average	394.49	2.43	2.42	14.70	7.13	19.94	1.80
01.12.2025	23:00-23:59	Average	400.23	2.40	2.46	14.49	7.05	19.95	1.79
02.12.2025	0:00-0:59	Average	403.96	2.41	2.59	13.71	6.75	19.87	1.81
02.12.2025	1:00-1:59	Average	399.81	2.41	2.13	13.92	6.96	19.79	1.84
02.12.2025	2:00-2:59	Average	400.54	2.40	2.52	13.69	6.95	19.50	1.87
02.12.2025	3:00-3:59	Average	406.07	2.44	2.36	14.11	7.51	19.44	1.94
02.12.2025	4:00-4:59	Average	396.93	2.50	2.88	14.66	7.46	19.26	2.05
02.12.2025	5:00-5:59	Average	394.77	2.59	3.06	14.74	7.67	19.28	2.11
02.12.2025	6:00-6:59	Average	401.07	2.72	2.91	14.72	7.55	19.24	2.12
02.12.2025	7:00-7:59	Average	399.34	2.80	2.59	14.76	7.42	19.18	2.03
Average			**400.58**	**2.53**	**2.63**	**14.25**	**7.13**	**19.64**	**1.90**
1 hour Minimum			394.49	2.17	1.96	13.04	6.36	19.08	1.63
1 hour Maximum			408.25	2.80	3.09	14.91	7.81	20.34	2.12

Table 4. 3 Air Monitoring Results (Hnan Village)

Date	Time		CO_2 (ppm)	CO (ppb)	NO_2 (ppb)	PM_{10} µg/m³	$PM_{2.5}$ µg/m³	RH %	SO_2 (ppb)
02.12.2025	9:00-9:59	Average	393.51	2.66	2.88	14.91	7.55	20.09	2.43
02.12.2025	10:00-10:59	Average	391.14	2.56	3.42	15.09	7.12	20.25	2.35
02.12.2025	11:00-11:59	Average	395.20	2.45	3.44	14.67	6.90	20.15	2.26
02.12.2025	12:00-12:59	Average	386.17	2.35	2.58	14.20	6.41	20.12	2.18
02.12.2025	13:00-13:59	Average	383.68	2.34	2.93	13.95	7.57	19.95	2.10
02.12.2025	14:00-14:59	Average	386.35	2.43	2.81	14.98	7.53	20.01	2.12
02.12.2025	15:00-15:59	Average	392.39	2.57	2.58	15.28	7.69	19.96	2.17
02.12.2025	16:00-16:59	Average	382.22	2.67	2.80	15.05	8.25	20.01	2.26
02.12.2025	17:00-17:59	Average	388.89	2.80	2.73	16.06	8.09	20.03	2.36
02.12.2025	18:00-18:59	Average	388.27	2.92	2.81	16.07	8.34	19.85	2.44
02.12.2025	19:00-19:59	Average	393.59	2.99	3.48	15.69	8.01	19.78	2.55
02.12.2025	20:00-20:59	Average	394.91	3.01	3.60	15.60	8.00	19.86	2.61
02.12.2025	21:00-21:59	Average	396.85	2.91	3.67	15.23	7.89	19.86	2.61
02.12.2025	22:00-22:59	Average	381.38	2.80	3.29	14.97	7.54	19.87	2.54
02.12.2025	23:00-23:59	Average	386.80	2.69	3.52	15.25	7.47	19.87	2.46
03.12.2025	0:00-0:59	Average	392.82	2.62	3.27	14.94	7.19	19.99	2.31
03.12.2025	1:00-1:59	Average	394.98	2.63	2.56	14.99	7.46	19.98	2.33
03.12.2025	2:00-2:59	Average	387.51	2.70	2.75	15.38	7.06	19.93	2.32
03.12.2025	3:00-3:59	Average	383.50	2.78	2.81	15.91	8.08	19.89	2.37
03.12.2025	4:00-4:59	Average	392.16	2.91	2.83	15.68	8.09	20.07	2.44
03.12.2025	5:00-5:59	Average	398.35	2.99	3.08	15.31	8.39	20.11	2.55
03.12.2025	6:00-6:59	Average	387.87	3.00	2.83	15.83	8.19	19.99	2.59
03.12.2025	7:00-7:59	Average	388.48	2.92	3.02	15.95	8.21	20.05	2.60
03.12.2025	8:00-8:59	Average	391.57	2.79	3.61	15.56	7.58	20.23	2.54
Average			**389.94**	**2.73**	**3.05**	**15.27**	**7.69**	**20.00**	**2.40**
1 hour Minimum			381.38	2.34	2.56	13.95	6.41	19.78	2.10
1 hour Maximum			398.35	3.01	3.67	16.07	8.39	20.25	2.61

Table 4. 4 Air Monitoring Results (Gyoke Pin Village)

Date	Time		CO_2 (ppm)	CO (ppb)	NO_2 (ppb)	PM_{10} µg/m^3	$PM_{2.5}$ µg/m^3	RH %	SO_2 (ppb)
03.12.2025	10:00-10:59	Average	401.35	2.09	2.78	14.67	7.20	19.73	2.26
03.12.2025	11:00-11:59	Average	400.04	2.02	2.72	13.89	7.05	19.94	2.21
03.12.2025	12:00-12:59	Average	400.12	1.95	2.52	14.52	6.77	19.91	2.15
03.12.2025	13:00-13:59	Average	395.83	1.92	2.82	13.70	6.63	20.00	2.09
03.12.2025	14:00-14:59	Average	400.92	1.96	2.49	13.75	6.76	20.09	2.01
03.12.2025	15:00-15:59	Average	392.62	2.04	2.69	13.77	7.36	20.11	2.01
03.12.2025	16:00-16:59	Average	395.20	2.14	3.29	14.68	7.71	20.13	2.10
03.12.2025	17:00-17:59	Average	393.18	2.15	3.19	14.37	7.58	20.18	2.22
03.12.2025	18:00-18:59	Average	391.74	2.08	3.03	14.83	7.83	20.17	2.34
03.12.2025	19:00-19:59	Average	386.06	1.99	3.36	15.27	7.41	20.35	2.44
03.12.2025	20:00-20:59	Average	389.96	1.94	3.16	15.34	7.06	20.26	2.51
03.12.2025	21:00-21:59	Average	399.05	1.92	3.53	14.68	6.77	20.48	2.50
03.12.2025	22:00-22:59	Average	393.30	1.91	2.95	14.64	7.00	20.50	2.44
03.12.2025	23:00-23:59	Average	395.85	1.91	3.12	14.21	7.29	20.41	2.34
04.12.2025	0:00-0:59	Average	396.40	1.90	2.84	14.00	6.91	20.31	2.21
04.12.2025	1:00-1:59	Average	387.22	1.90	2.70	14.06	7.29	20.26	2.20
04.12.2025	2:00-2:59	Average	396.75	1.91	2.90	13.67	7.11	20.23	2.23
04.12.2025	3:00-3:59	Average	393.59	1.93	2.52	14.02	7.87	20.20	2.27
04.12.2025	4:00-4:59	Average	385.70	1.99	3.36	14.34	7.78	20.03	2.34
04.12.2025	5:00-5:59	Average	398.79	2.09	3.05	14.59	7.77	20.06	2.45
04.12.2025	6:00-6:59	Average	401.13	2.22	3.47	14.18	7.47	19.98	2.51
04.12.2025	7:00-7:59	Average	393.82	2.31	3.30	14.56	7.29	19.81	2.51
04.12.2025	8:00-8:59	Average	392.17	2.29	3.45	15.07	7.49	19.75	2.45
04.12.2025	9:00-9:59	Average	388.89	2.22	2.85	14.89	7.67	19.71	2.35
Average			**394.57**	**2.03**	**3.00**	**14.40**	**7.29**	**20.11**	**2.30**
1 hour Minimum			385.70	1.90	2.49	13.67	6.63	19.71	2.01
1 hour Maximum			401.35	2.31	3.53	15.34	7.87	20.50	2.51

Table 4. 5 Air Monitoring Results (Nyaung Kan Village)

Date	Time		CO_2 (ppm)	CO (ppb)	NO_2 (ppb)	PM_{10} µg/m3	$PM_{2.5}$ µg/m3	RH %	SO_2 (ppb)
04.12.2025	11:00-11:59	Average	381.23	1.92	1.76	10.18	6.60	19.87	2.53
04.12.2025	12:00-12:59	Average	385.61	1.77	1.99	9.94	6.30	20.04	2.53
04.12.2025	13:00-13:59	Average	382.92	1.76	1.66	10.77	5.84	20.03	2.51
04.12.2025	14:00-14:59	Average	380.40	1.84	2.09	10.84	5.85	20.21	2.54
04.12.2025	15:00-15:59	Average	373.78	1.97	1.81	10.96	5.89	20.13	2.62
04.12.2025	16:00-16:59	Average	377.38	2.07	1.79	10.68	6.11	20.38	2.68
04.12.2025	17:00-17:59	Average	373.16	2.20	2.14	11.01	6.18	20.46	2.68
04.12.2025	18:00-18:59	Average	381.75	2.31	2.06	11.18	6.41	20.55	2.65
04.12.2025	19:00-19:59	Average	381.57	2.40	2.20	11.84	7.11	20.57	2.57
04.12.2025	20:00-20:59	Average	374.43	2.40	2.09	11.74	7.08	20.57	2.53
04.12.2025	21:00-21:59	Average	380.47	2.32	2.18	10.76	7.48	20.66	2.51
04.12.2025	22:00-22:59	Average	388.42	2.20	2.23	10.57	6.93	20.91	2.49
04.12.2025	23:00-23:59	Average	384.33	2.09	2.49	10.93	6.70	20.71	2.50
05.12.2025	0:00-0:59	Average	389.88	2.01	2.20	10.77	6.17	20.68	2.52
05.12.2025	1:00-1:59	Average	380.61	2.01	2.25	10.64	6.51	20.57	2.52
05.12.2025	2:00-2:59	Average	378.96	2.02	2.00	10.44	6.14	20.64	2.53
05.12.2025	3:00-3:59	Average	374.10	2.03	2.05	10.95	6.13	20.42	2.57
05.12.2025	4:00-4:59	Average	374.35	2.09	2.41	10.99	6.63	20.29	2.65
05.12.2025	5:00-5:59	Average	375.98	2.20	2.23	11.51	6.60	20.33	2.74
05.12.2025	6:00-6:59	Average	380.12	2.31	2.02	12.00	6.94	20.30	2.80
05.12.2025	7:00-7:59	Average	385.41	2.39	2.27	12.08	7.01	20.16	2.80
05.12.2025	8:00-8:59	Average	383.60	2.40	2.24	11.12	7.12	20.06	2.74
05.12.2025	9:00-9:59	Average	382.65	2.29	1.82	11.11	6.60	19.90	2.66
05.12.2025	10:00-10:59	Average	370.57	2.12	1.76	10.49	6.73	19.93	2.57
Average			**380.07**	**2.13**	**2.07**	**10.98**	**6.54**	**20.35**	**2.60**
1 hour Minimum			370.57	1.76	1.66	9.94	5.84	19.87	2.49
1 hour Maximum			389.88	2.40	2.49	12.08	7.48	20.91	2.80

4.2 Wind Speed and Direction

The following figure describes the wind speed and wind direction of the proposed project site on 1st December to 5th December 2025 respectively. According to the data, the wind direction is following **Figure 4. 9 to Figure 4. 16.**

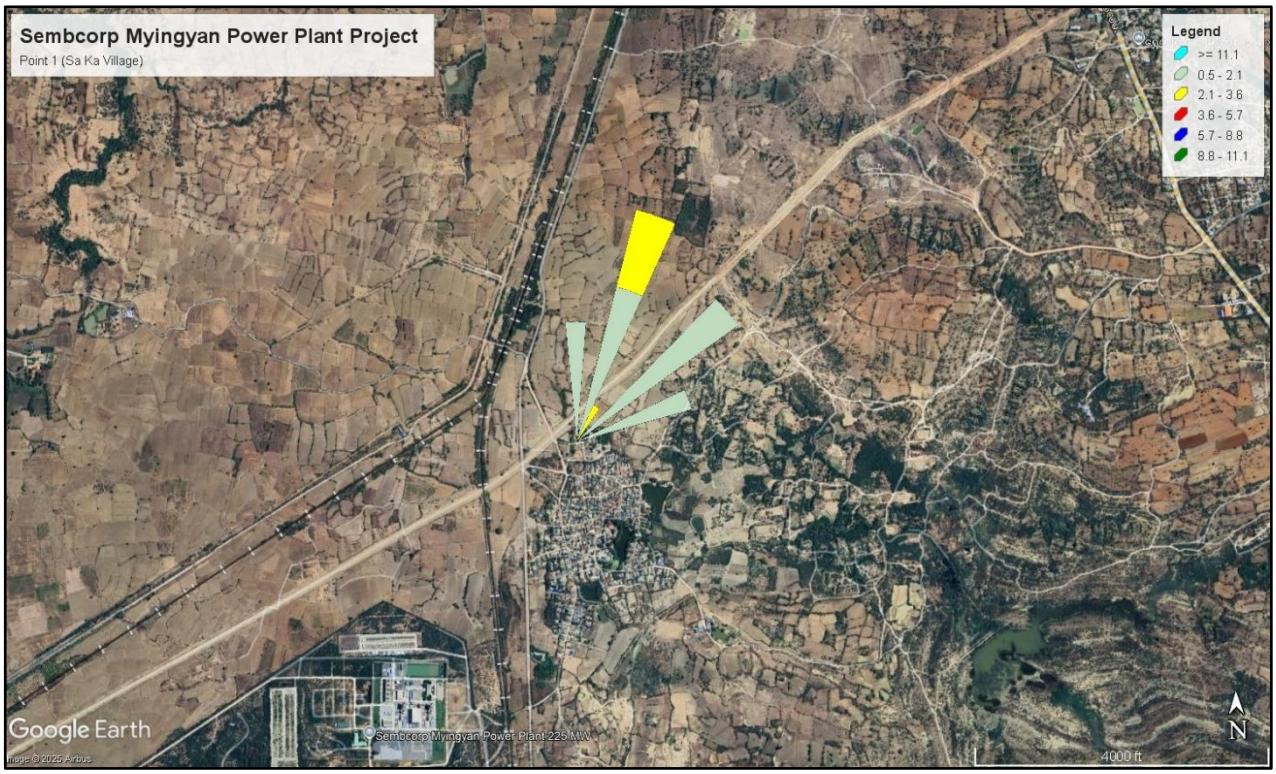


Figure 4. 9 Wind Speed and Wind Direction (Blowing From) at Sa Ka Village (ASR4)

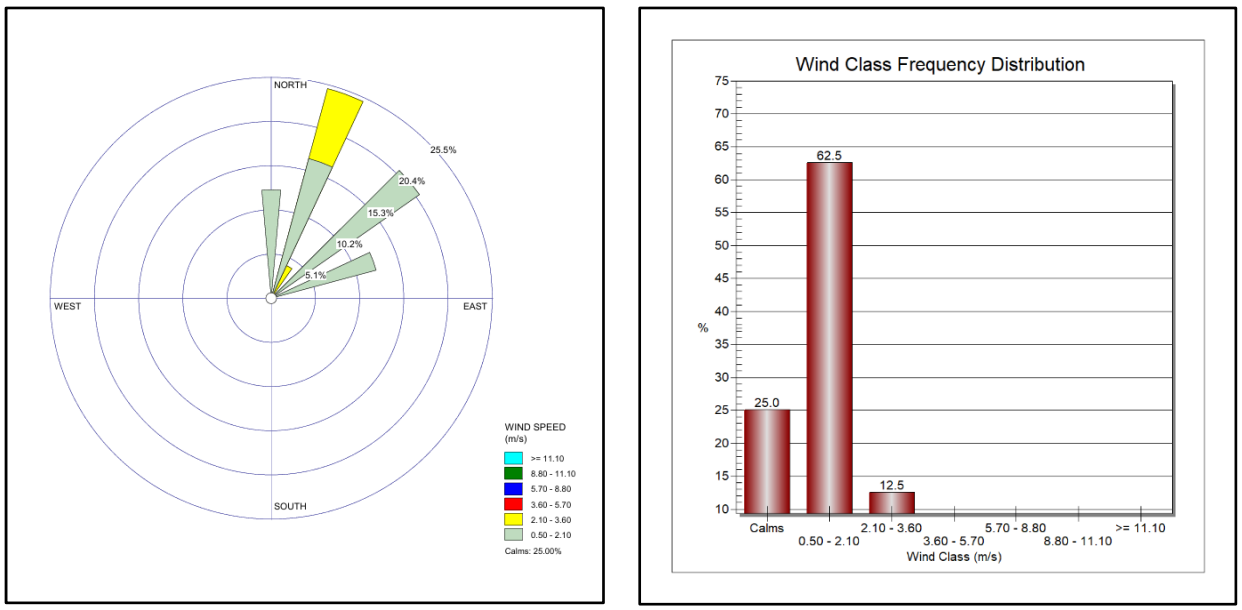


Figure 4. 10 Wind Class Frequency Distribution at Sa Ka Village (ASR4)

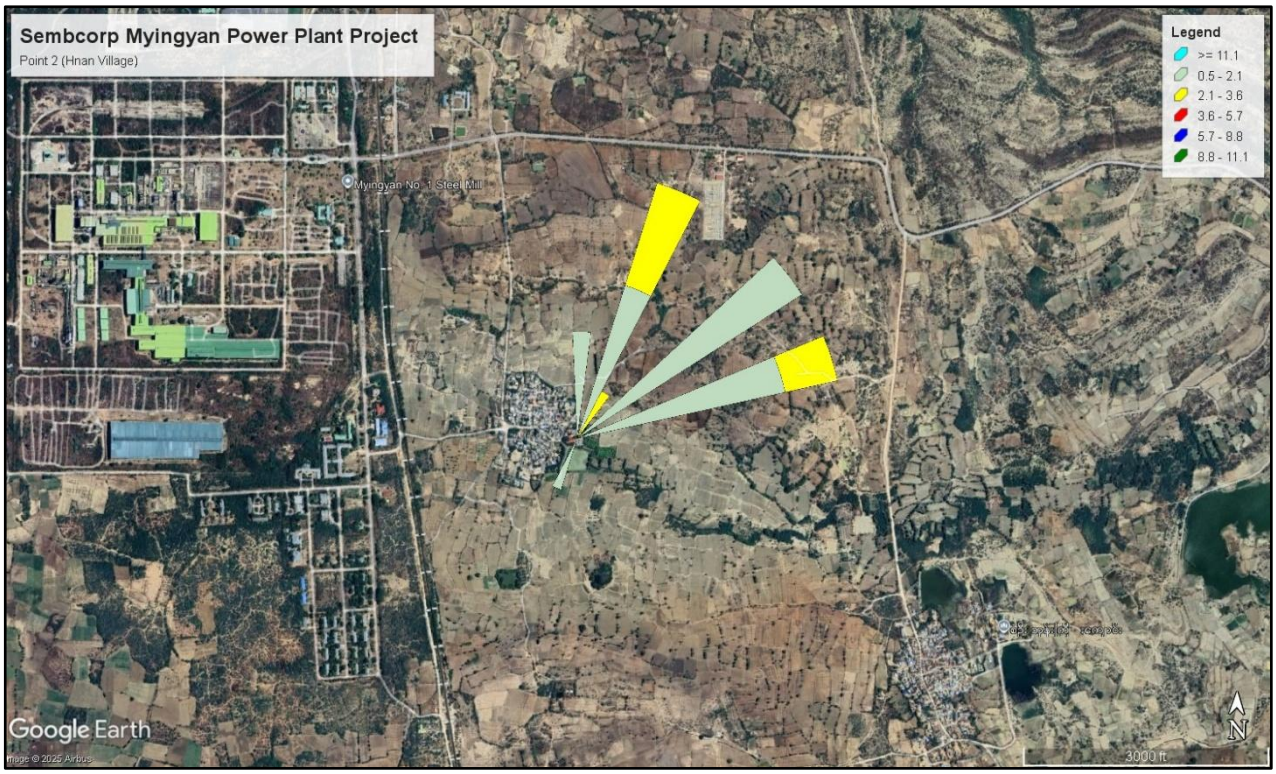
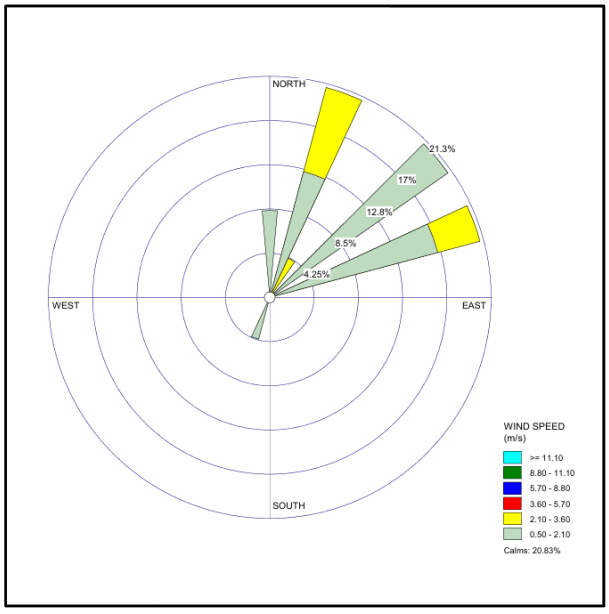


Figure 4. 11 Wind Speed and Wind Direction (Blowing From) at Hnan Village (ASR3)



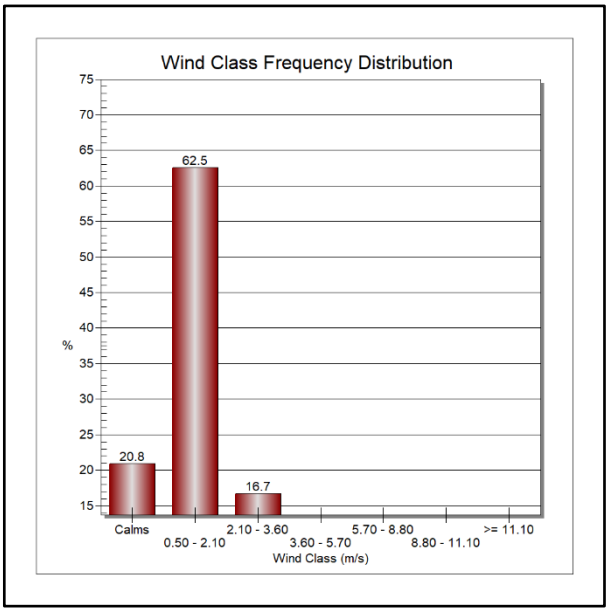


Figure 4. 12 Wind Class Frequency Distribution at Hnan Village (ASR3)

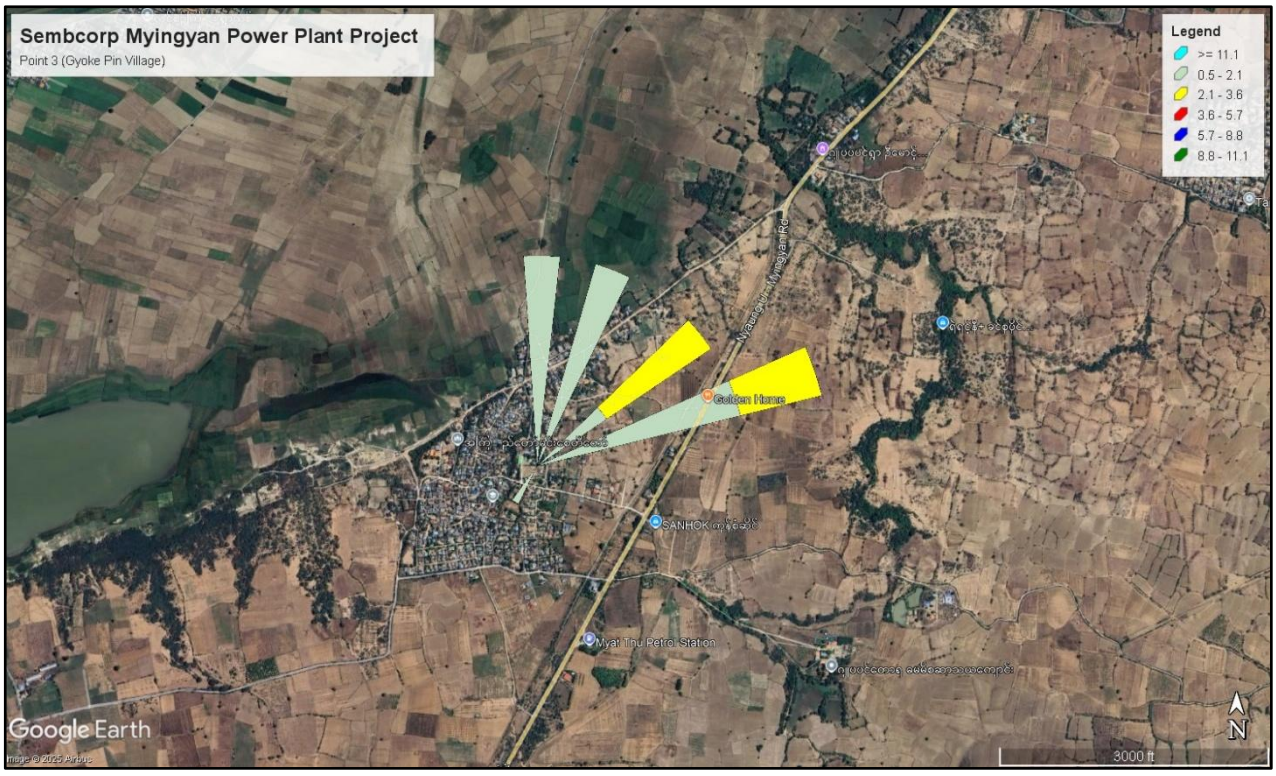


Figure 4. 13 Wind Speed and Wind Direction (Blowing From) at Gyoke Pin Village (ASR5)

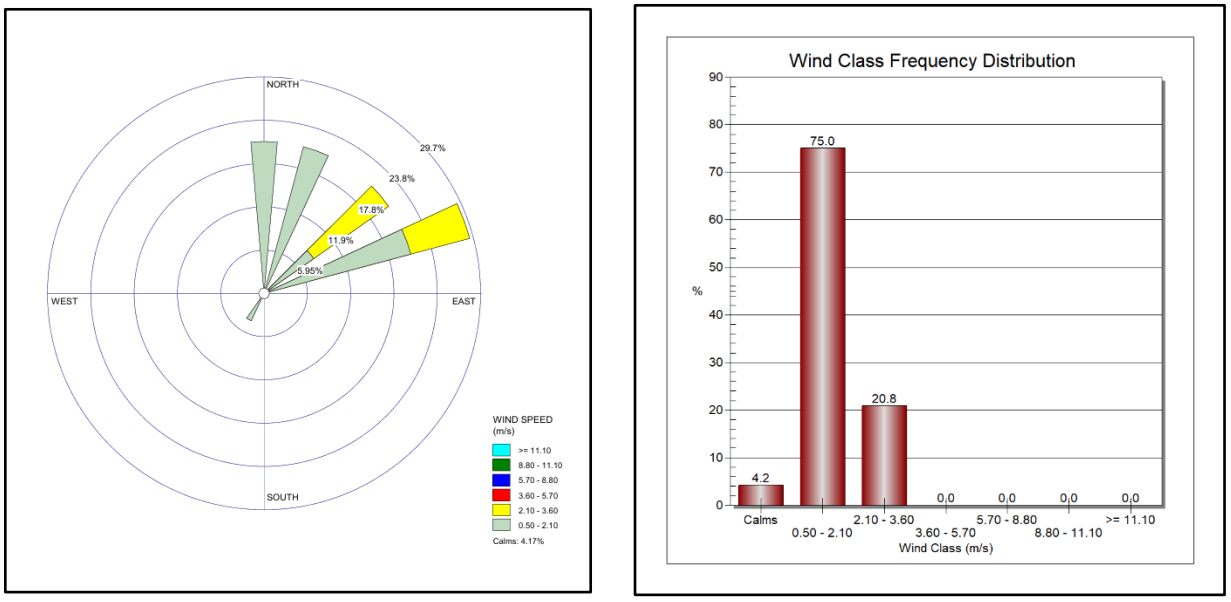


Figure 4. 14 Wind Class Frequency Distribution at Gyoke Pin Village (ASR5)

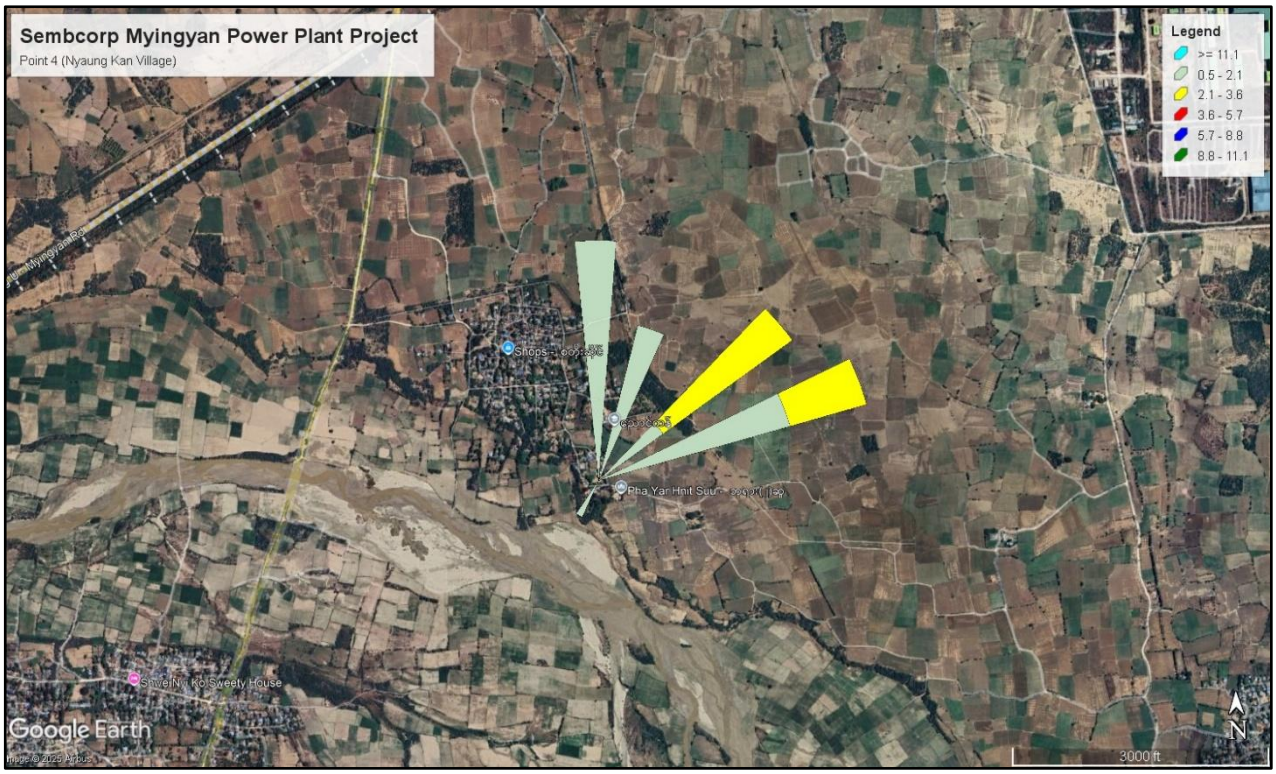
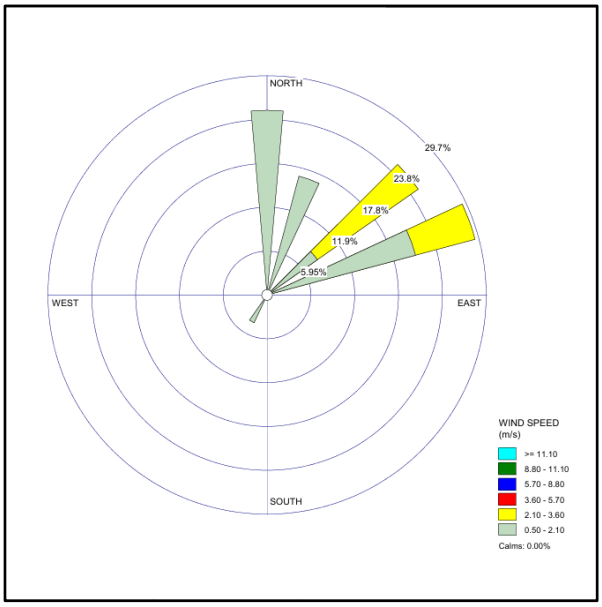


Figure 4. 15 Wind Speed and Wind Direction (Blowing From) at Nyaung Kan Village (ASR14)



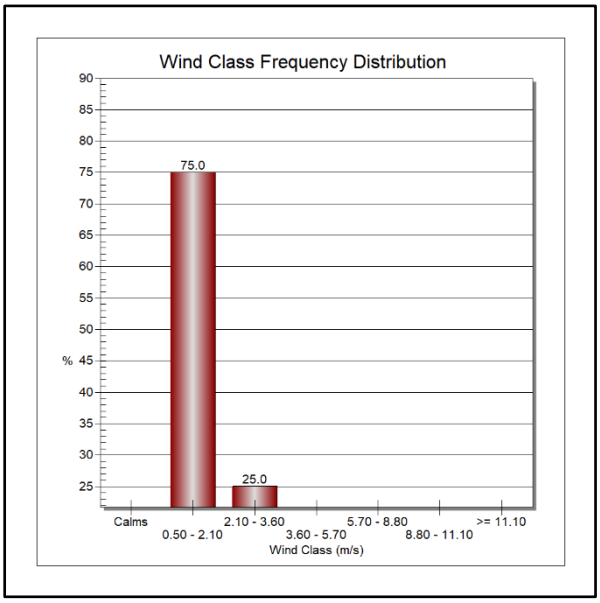


Figure 4. 16 Wind Class Frequency Distribution at Nyaung Kan Village (ASR14)

4.3 Ambient Noise

Ambient noise level for the proposed project was measured with Digital Sound Level Meter at the project site. The noise level measurement is conducted at Sembcorp Myingyan Power points: these points are nearly sembcorp myingyan power plant and air monitoring point at Sa Ka village on 1st December 2025 to 3rd December 2025. Measuring period is 24 hours continuously. The observed values are described in **Table 4. 6 to Table 4. 9** and the following figures are noise level measurements at the proposed project.

Table 4. 6 Observed Values of Noise Level Measurement at near Sembcorp Myingyan Power Plant

No.	Date	Time	Observed Mean Value (Source)	Weight	Day/Night	Average
1	03.12.2025	7:00:24-7:59:24	67.94	A	Day	57.10
2	03.12.2025	8:00:24-8:59:24	68.25	A	Day	
3	02.12.2025	9:00:24-9:59:24	64.82	A	Day	
4	02.12.2025	10:00:24-10:59:24	52.37	A	Day	
5	02.12.2025	11:00:24-11:59:24	51.89	A	Day	
6	02.12.2025	12:00:24-12:59:24	53.31	A	Day	
7	02.12.2025	13:00:24-13:59:24	53.40	A	Day	
8	02.12.2025	14:00:24-14:59:24	53.95	A	Day	
9	02.12.2025	15:00:24-15:59:24	56.49	A	Day	
10	02.12.2025	16:00:24-16:59:24	62.85	A	Day	
11	02.12.2025	17:00:24-17:59:24	66.63	A	Day	
12	02.12.2025	18:00:24-18:59:24	61.99	A	Day	
13	02.12.2025	19:00:24-19:59:24	47.79	A	Day	
14	02.12.2025	20:00:24-20:59:24	47.61	A	Day	
15	02.12.2025	21:00:24-21:59:24	47.17	A	Day	
16	02.12.2025	22:00:24-22:59:24	47.23	A	Night	53.91
17	02.12.2025	23:00:24-23:59:24	48.32	A	Night	
18	03.12.2025	0:00:24-0:59:24	47.86	A	Night	
19	03.12.2025	1:00:24-1:59:24	50.28	A	Night	
20	03.12.2025	2:00:24-2:59:24	55.87	A	Night	
21	03.12.2025	3:00:24-3:59:24	56.26	A	Night	
22	03.12.2025	4:00:24-4:59:24	55.65	A	Night	
23	03.12.2025	5:00:24-5:59:24	55.45	A	Night	
24	03.12.2025	6:00:24-6:59:24	68.23	A	Night	
Average			**55.90**			

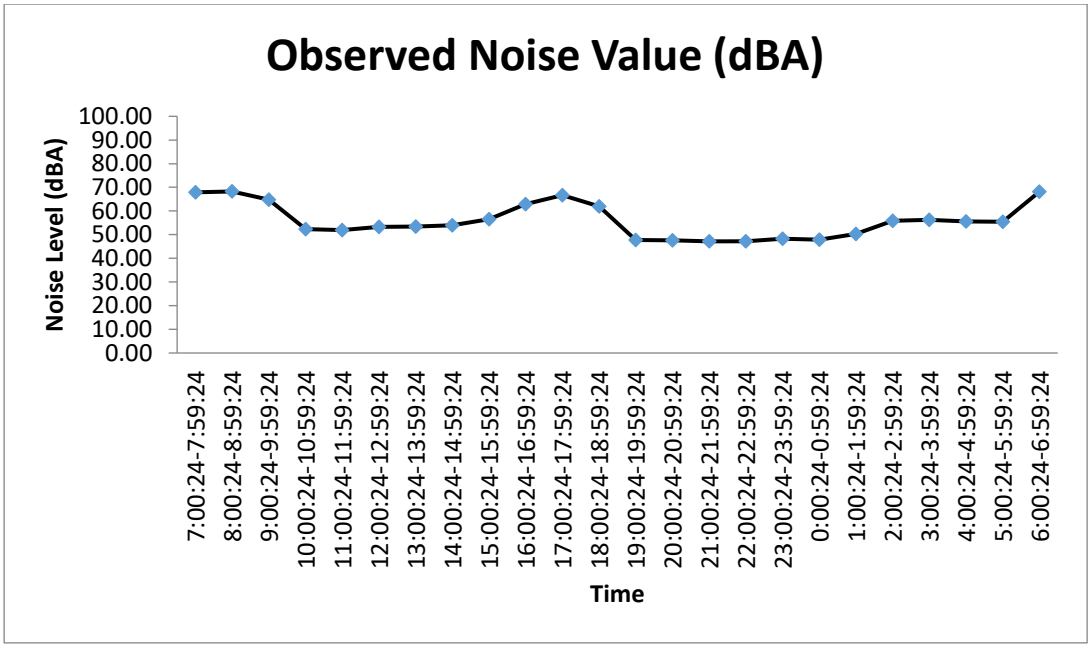


Figure 4. 17 Noise Level at near Sembcorp Myingyan Power Plant

Table 4. 7 Observed Values of Noise Level Measurement at Sa Ka Village

No.	Date	Time	Observed Mean Value (Source)	Weight	Day/Night	Average
1	02.12.2025	7:00:46-7:59:46	78.85	A	Day	55.74
2	01.12.2025	8:00:46-8:59:46	73.23	A	Day	
3	01.12.2025	9:00:46-9:59:46	57.34	A	Day	
4	01.12.2025	10:00:46-10:59:46	47.29	A	Day	
5	01.12.2025	11:00:46-11:59:46	48.21	A	Day	
6	01.12.2025	12:00:46-12:59:46	51.20	A	Day	
7	01.12.2025	13:00:46-13:59:46	54.98	A	Day	
8	01.12.2025	14:00:46-14:59:46	56.61	A	Day	
9	01.12.2025	15:00:46-15:59:46	60.44	A	Day	
10	01.12.2025	16:00:46-16:59:46	65.32	A	Day	
11	01.12.2025	17:00:46-17:59:46	48.55	A	Day	
12	01.12.2025	18:00:46-18:59:46	47.28	A	Day	
13	01.12.2025	19:00:46-19:59:46	55.10	A	Day	
14	01.12.2025	20:00:46-20:59:46	45.72	A	Day	
15	01.12.2025	21:00:46-21:59:46	45.98	A	Day	
16	01.12.2025	22:00:46-22:59:46	47.97	A	Night	57.87
17	01.12.2025	23:00:46-23:59:46	46.41	A	Night	
18	02.12.2025	0:00:46-0:59:46	45.81	A	Night	
19	02.12.2025	1:00:46-1:59:46	49.07	A	Night	
20	02.12.2025	2:00:46-2:59:46	63.16	A	Night	
21	02.12.2025	3:00:46-3:59:46	66.43	A	Night	

22	02.12.2025	4:00:46-4:59:46	58.26	A	Night	
23	02.12.2025	5:00:46-5:59:46	78.86	A	Night	
24	02.12.2025	6:00:46-6:59:46	64.86	A	Night	
Average			**56.54**			

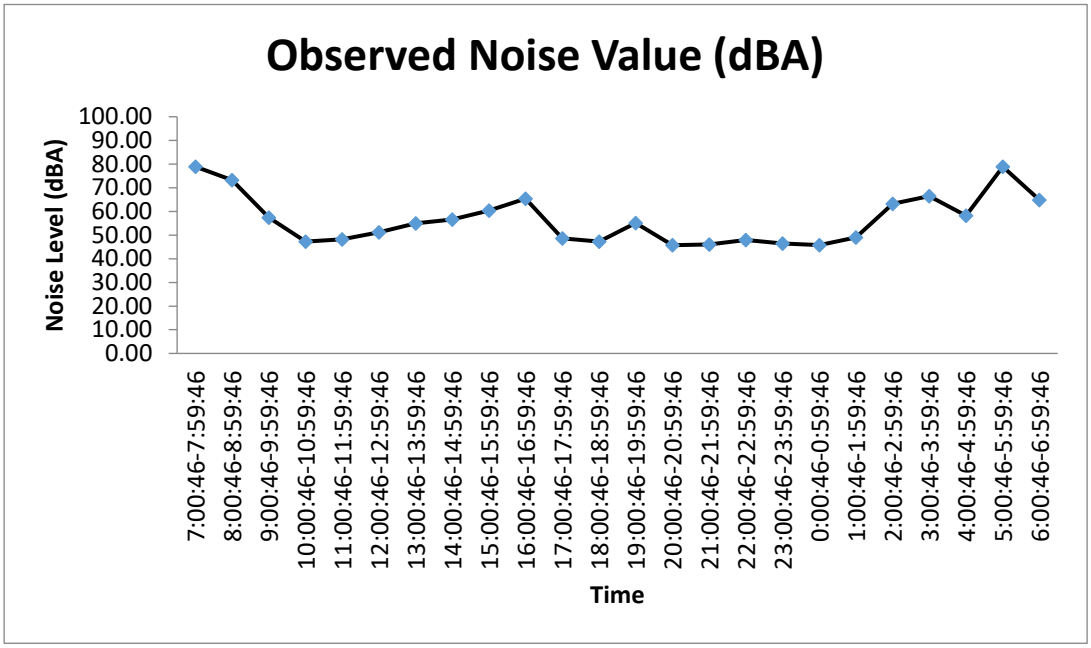


Figure 4. 18 Noise Level at Sa Ka Village

Table 4. 8 Observed Ambient Noise Level Results from Myingyan Power Plant

Point	**Sembcorp Myingyan Power Plant**	
	Day Time	**Nighttime**
Sembcorp Myingyan Power Plant	**57.10**	**53.91**
Guideline Values	70	70

Table 4. 9 Observed Ambient Noise Level Results from Sa Ka Village

Point	**Sembcorp Myingyan Power Plant**	
	Day Time	**Nighttime**
Sa Ka Village	**55.74**	**57.87**
Guideline Values	55	45

The observed values are compared with the National Environmental Quality (Emission) Guidelines as shown in

Table 4. 10 which indicates the separate level for residential and industrial points.

Table 4. 10 National Environmental Quality (Emission) Guidelines Values for Noise Level

Receptor	One Hour LAeq (dBA)	
	Daytime 07:00 - 22:00 (10:00 - 22:00 for Public Holidays)	Nighttime 22:00 - 07:00 (22:00 - 10:00 for Public Holidays)
Residential, institutional, educational	55	45
Industrial, commercial	70	70

The observed noise values of the proposed project for daytime at Sembcorp myingyan power plant and Sa Ka village are 57.10 dB (A) and 55.74 dB (A). The observed noise values of the proposed project for nighttime at Sembcorp myingyan power plant and Sa Ka village are 53.91 dB (A) and 57.87 dB (A). The proposed project is located adjacent to the residential and commercial area. The observed values of daytime and nighttime at Sembcorp myingyan power plant are within the acceptable values of the National Environmental Quality (Emission) Guidelines. The observed values of daytime and nighttime at Sa Ka village are upper the acceptable values of the National Environmental Quality (Emission) Guidelines because of the operation of near the factory and monitoring location, Sa Ka North Monastery which situated beside the road rang the wooden bell and passing through many motorcycles and cars and dog barking at the time of measurement. But Sa Ka Village is acceptable Applicable Operational Noise Criteria of 54 dB (A) from ESIA Report.

APPENDIX A

Description of Haz-scanner (EPAS)



Publication 1601 Rev 1405

HAZ-SCANNER EPAS

Wireless Environmental Perimeter Air Station



HAZ-SCANNER EPAS shown with optional solar panels

Performance Profile

The HAZ-SCANNER EPAS is optimized for ambient air applications; custom calibration for specific ranges or applications is available upon request.

Display	LCD real time
Operation	4-key splash-proof membrane switch
Power	12-V Absorption Glass Mat (AGM) rechargable battery, 100-240 V AC, or optional solar panel
Display Measurements	Max, Min, TWA, STEL
Recording Time	1 sec to 21 weeks
Sampling Rate	1 sec, 1 min, 10 min, 1 hr, adjustable
Data Storage	454,545 data points
Sampling Pump	1.0 to 3.0 L/min
Digital Output	RS-232 (PC), RS-423 (Mac)
Software	PC or Mac
Dimensions (weather-proof case)	6 x 14 x 10 in (15.2 x 35.6 x 25.4 cm)
Weight	12 lbs (5.4 kg)
Operating Temperature	23 to 122 F (-5 to 50 C)
Storage Temperature	-40 to 140 F (-40 to 60 C)
Humidity	95% non-condensing (use inlet heater)
Wireless Radio Modem	900 MHz (U.S.), 868 MHz (Euro) up to 5 miles - line of sight (optional)
Auxiliary Analog Input	0 to 2.5 VDC (1 channel for alternative meter)

Configure an EPAS for Up to 14 Simultaneous Measurements

The standard HAZ-SCANNER EPAS includes the monitor (calibrated for ambient air applications) with sensors/meters for PM10 or TSP, VOCs, temperature, humidity, and wind speed/direction in a NEMA 4 enclosure, acid gas scrubber, internal battery, universal 110-240 V AC battery charger, software, cables, and CD with instructions.

Configure the monitor with additional sensors/meters — up to 4 optional interchangable sensors with upgradable software and/or up to 4 EPAS-specific meters (listed below). See page 3 for specifications. ***Specify sensors and meters when ordering.***

- PM1.0, 2.5, or 4.0
- Ammonia (EC)
- Carbon Dioxide (NDIR)
- Carbon Monoxide (EC)
- Chlorine (EC)
- Ethylene Oxide (EL)
- Hydrocarbon (methane-specific, EC)
- Hydrocarbons (EC)
- Hydrogen Chloride (EL)
- Hydrogen Cyanide (EC)
- Hydrogen Sulfide (EC)
- Nitric Oxide (EC)
- Nitrogen Dioxide
- Oxygen
- Ozone
- Phosphine (EL)
- Sulfur Dioxide
- Rain
- Solar Radiance
- Sound and Noise
- Atomic Radiation
- ELF Radiation
- Barometric Pressure
- Dew Point Temperature
- Wet Bulb Temperature

Contact SKC to build an EPAS with available sensors/meters/calibration for your application!

SKC Limited Warranty and Return Policy

SKC products are subject to the SKC Limited Warranty and Return Policy, which provides SKC's sole liability and the buyer's exclusive remedy. To view the complete SKC Limited Warranty and Return Policy, go to http://www.skcinc.com/warranty.asp.

SKC Inc. 724-941-9701 SKC West 714-992-2780 SKC Gulf Coast 281-859-8050 SKC South 434-852-7149
www.skcinc.com

Publication 1801 Rev 1406

HAZ-SCANNER EPAS

Wireless Environmental Perimeter Air Station

HAZ-SCANNER EPAS Sensor/Meter Specifications

Parameter	Sensor*	Measurement/ Concentration Range	Accuracy	Minimum Resolution	Display Resolution	Additional Information
Particulates	90° infrared light scattering	0 to 5000 µg/m³	Greater of < ± 10% of reading or 0.2% full scale	10 µg/m³	1 µg/m³	Measures particle sizes: 10 µm or TSP (standard) or 1, 2.5, or 4 µm (optional) in the 0.1 to 100 µm size range
VOCs	PID (10.6 eV)	0 to 50,000 ppb (0 to 50 ppm)	Greater of < ± 10% of reading or 2% full scale	5 ppb	1 ppb	Minimum detection level is 0.01 ppm. Standard sensor
Toxic Gas: NH_3 - Ammonia	Gas-sensing semiconductor (GSS) technology	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: CO_2 - Carbon Dioxide	NDIR	0 to 5000 ppm	Greater of < ± 10% of reading or 2% full scale	50 ppm	1 ppm	Optional sensor
Toxic Gas: CO - Carbon Monoxide	Electrochemical	0 to 10,000 ppb (0 to 10 ppm)	Greater of < ± 10% of reading or 2% full scale	20 ppb	1 ppb	Optional sensor
Toxic Gas: Cl_2 - Chlorine	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: (C_2H_4O) - Ethylene Oxide	Electrochemical	0 to 1500 ppm	Greater of < ± 10% of reading or 2% full scale	8 ppm	1 ppm	Optional sensor
Toxic Gas: Hydrocarbon, CH_4 - Methane-specific	NDIR	0 to 1% Vol., 0 to 10,000 ppm, 0 to 20% LEL	Greater of < ± 10% of reading or 2% full scale	± 50 ppm or 0.1% LEL	50 ppm/ 0.1% LEL	Optional sensor
Toxic Gas: (Non-methane) Hydrocarbons (HC)	NDIR	Calibrated for 0 to 20% LEL of selected gas	Greater of < ± 10% of reading or 2% full scale	± 50 ppm/ 0.1% LEL	50 ppm/ 0.1% LEL	Optional sensor - specify gas type when ordering: ethane, propane, butane, hexane, ethanol, ethylene, or ethylene oxide
Toxic Gas: HCl - Hydrogen Chloride	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: HCN - Hydrogen Cyanide	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: H_2S - Hydrogen Sulfide	Electrochemical	0 to 25 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.15 ppm	0.1 ppm	Optional sensor
Toxic Gas: NO - Nitric Oxide	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: NO_2 - Nitrogen Dioxide	Electrochemical	0 to 5000 ppb (0 to 5 ppm)	Greater of < ± 10% of reading or 2% full scale	5 ppb	1 ppb	Optional sensor
Toxic Gas: O_2 - Oxygen	Electrochemical	0 to 30% Vol.	Greater of < ± 10% of reading or 2% full scale	0.6%	0.1%	Optional sensor
Toxic Gas: O_3 - Ozone	Gas-sensing semiconductor (GSS) technology	0 to 150 ppb (0 to 0.15 ppm), 0 to 500 ppb (0 to 0.5 ppm)	Greater of < ± 10% of reading or 2% full scale	1 ppb	1 ppb	Optional sensor
Toxic Gas: PH_3 - Phosphine	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: SO_2 - Sulfur Dioxide	Electrochemical	0 to 5000 ppb (0 to 5 ppm) for ambient applications	Greater of < ± 10% of reading or 2% full scale	5 ppb	1 ppb	Optional sensor

* Not approved for intrinsically safe applications; do not use in explosive gas environments.

Specifications continued on next page

SKC Inc. 724-941-9701 SKC West 714-992-2780 SKC Gulf Coast 281-859-8050 SKC South 434-852-7149
www.skcinc.com

HAZ-SCANNER EPAS

Wireless Environmental Perimeter Air Station

HAZ-SCANNER EPAS Sensor/Meter Specifications (con't)

Parameter	Sensor*	Measurement/ Concentration Range	Accuracy	Minimum Resolution	Display Resolution	Additional Information
Rain Fall/ Precipitation	Rain gauge (heated, tipping bucket)	0 to 5 inches daily	± 1% at 2 in/hr	0.01 in	0.01 in/tip	Optional meter
Temperature	NTC thermister	-4 to 140 F (-20 to 60 C)	Greater of ± 3% degree F or C of reading	1 degree F or C	1 degree F or C	Standard sensor
Relative Humidity (RH)	Thin-film capacitive	0 to 100% RH	± 2% RH	1% RH	1% RH	Standard sensor
Solar Radiance Intensity	Photodiode	1110 watts/ square meter (W/m^2)	± 5% of full scale (reference Eppley PSP at 1000 W/m^2)	1 W/m^2	1 W/m^2	Optional meter
Sound and Noise	Type 2 SLM	30 to 130 decibels (dB)	± 1.5 dB	0.1 dB	1 dB	Optional meter
Atomic Radiation	Geiger counter	1 to 19,999 counts per minute (cpm) or 0.001 to 100 milliRad/hr	± 10% Typical, ± 15% Max.	1 cpm or .001 mR/hr	1 cpm or .001 mR/hr	Optional meter
ELF Radiation	Sensor with single-axis probe	1 to 200 gauss (G)	± 10% or 5% FS	1 G	1 G	Optional meter
Wind Speed/ Direction	3-cup anemometer/ continuous rotation potentiometric wind direction vane	0 to 125 mph/ 5 to 355°	± 1 mph or ± 3%/± 3°	1 mph/1°	1 mph/1°	Standard sensor
Barometric Pressure	Piezo resistive	28.25 to 30.75 in Hg	± 0.09 in Hg	0.01 in Hg	0.01 in Hg	Optional sensor
Dew Point Temperature	Software calculation from RH and temperature	8.2 to 122 F (-15 to 50 C)	± 3 F	1 F	1 F	Optional meter - software calculated
Wet Bulb Temperature	Capsulated thermister with wick	8.2 to 122 F (-15 to 50 C)	± 3 F	1 F	1 F	Optional meter - one meter

* Not approved for intrinsically safe applications; do not use in explosive gas environments.

SKC Inc. 724-941-9701 SKC-West 714-992-2780 SKC Gulf Coast 281-859-8050 SKC South 434-852-7149
www.skcinc.com

Calibration Certificate for Haz-scanner

NANOVA Co.,Ltd.
Medical Scientific Industrial

SYSTEM HEALTH CHECK REPORT

Information

Instrument	Hazscanner
Model	EPAS
Serial number	915081
Unit Sensor	CO, NO_2, CO_2, SO_2 PM_{10}, $PM_{2.5}$
Customer	Eguard
Date	2025 August 13th

Check List

Physical Check	OK
Supply Voltage Check	OK
PM 10 Air Flow Check	OK
PM2.5 Air Flow Check	OK
Internal Backup Battery Voltage Check	OK
NO2 Sensor Health Check	Moderate
CO2,SO2,CO Sensor Health Check	Still Good
Lithium Battery Voltage Check	Not OK
Data Logging Check	OK
Data Downloading Check	OK

Recommend

Need to replace Lithium battery.
Need to replace new acid gas scrubber (every 6 months).
Need to replace internal filters (every 6 months).
Need to perform factory calibration or in-field calibration (every 12 months).

Performed by

Phoe Saw Htoo
Technical Service Engineer
NANOVA CO., LTD

Approved by

Myo Oo
Technical Service Manager
NANOVA CO., LTD

Yangon 22-A, Shan Yeiktar Street, Sanchaung Township, Tel: +95 (1) 230 4901, 230 4902
Nay Pyi Taw Za /30, Ziwaka Say Sine Tan, Tha Phay Khone, Pyinmanar **Tel** 067 810 8083
Mandalay 153(B), 73rd Street, Bet 33x34 Street, ChanAye Tharzan Tsp. **Tel** 09 791 360000
Email contact@nanovapteltd.com Website: www.nanova-scientific.com
helpline 09 421 360000 , 09 451 360000

Calibration Certificate for Sound Level Meter

SCIENCE WORKSHOP
CALIBRATION CERTIFICATE

Submitted by	:	e guard Environmental Services No.(145-A2-3), Thiri Mingalar Street, Ward No.(4), 8th Mile, Mayangone Township, Yangon 11062, Myanmar.
Location	:	U Soe Min (Director)
Instrument	:	Digital Sound Level Meter (BENETECH, GM 1356) Sr No. GG: 2439187 (30dB – 130dB)
Instrument Reference No.:		eg – DSLM – 08
Test Equipment	:	Dual Trace Oscilloscope, Signal Generator and Digital Multimeter (7534-02, Yokogawa Japan)
Ambient Temperature	:	24°C
Permissible Error	:	± 1 % dB
Calibration Date	:	21th January 2025 Next due date 21th January 2026

We certified that this instrument has been calibrated to JAPAN standard under the condition stated above .

1. **Method of Calibration**

Measure and compare the Frequency Linearity and Sound Level with above instrument and test instrument same source, the effect which the hall has on sound at the same time so that people can hear.

2. **Result Calibration**

Measurement	Instrument	Test Equipment	Correction
Frequency	31.5 Hz	31.5 Hz	-
	150 Hz	150 Hz	-
	500 Hz	500 Hz	-
	1 KHz	1 KHz	-
	6 KHz	6 KHz	-
Level	30 dB	30 dB	-
	60 dB	60 dB	-
	90 dB	90 dB	-
	100 dB	100 dB	-
	120 dB	120 dB	-
	130 dB	130 dB	-

This instrument is suitable for use and comply with standard given by manufacture.

Calibrated by:

Ba Thein Sein
Senior Skilled Technician
SCIENCE EQUIPMENT (Lab) SERVICE

APPENDIX B

Field Photos

Air Monitoring Point at Sa Ka Village (ASR4) Lat- 21°23’48.591”, Long- 95°23’0.849” 01.12.2025 to 02.12.2025	
Air Monitoring Point at Hnan Village (ASR3) Lat- 21°22’17.565”, Long- 95°23’18.116” 02.12.2025 to 03.12.2025	

Air Monitoring Point at Gyoke Pin Village (ASR5) Lat- 21°24’21.888”, Long- 95°21’07.381” 03.12.2025 to 04.12.2025	
Air Monitoring Point at Nyaung Kan Village (ASR14) Lat- 21°21’58.048”, Long- 95°20’51.346” 04.12.2025 to 05.12.2025	

Sembcorp Myingyan Power Co., Limited.

Air Quality Monitoring Report
(Mar 2026)

Environmental Monitoring Report

(Air Quality Monitoring)



Prepared

Ref: 01.12.2025 to 05.12.2025 (Air Quality Report)

18th December 2025

E Guard Environmental Services

Report Review Form

Report Title: Environmental Quality Monitoring Report in December 2025 For Sembcorp Myingyan Power Plant	
Report Version:	
Proponent: **Sembcorp Myingyan Power Plant**	**Prepared by;** **E Guard Environmental Services Co., Ltd.** No. (145- A2- 3), Thiri Mingalar Street, Ward No. (4), 8th Mile, Mayangone Township, Yangon 11062, Myanmar. Tel: 01 667953, Fax: 01 6667953, info@eguardservices.com Mobile +959 797005199

Prepared by: U Aung Moe Oo	**Position: Assistant Consultant**
Submitted Date: 17/12/2025	**Signature:**
Checked by: U Aung Myint Myat	**Position: Consultant**
Checked Date: 17/12/2025	**Signature:**

Approved by:

Table of Contents

List of Figures ii

List of Tables iii

1. INTRODUCTION 1

2. METHODOLOGY 1

2.1 Ambient Air Quality 1

2.2 Ambient Noise 1

3. MONITORING LOCATIONS 3

4. ENVIRONMENTAL QUALITY MONITORING RESULTS 4

4.1 Ambient Air Quality Monitoring Results 4

4.2 Wind Speed and Direction 15

4.3 Ambient Noise 19

APPENDIX A 24

APPENDIX B 31

List of Figures

Figure 3. 1 Location of Monitoring Points 3

Figure 4. 1 PM Monitoring Results at Sa Ka Village 4

Figure 4. 2 PM Monitoring Results at Hnan Village 5

Figure 4. 3 PM Monitoring Results at Gyoke Pin Village 5

Figure 4. 4 PM Monitoring Results at Nyaung Kan Village 5

Figure 4. 5 Fluctuation of Air Pollutants during dial cycle (Sa Ka Village) 6

Figure 4. 6 Fluctuation of Air Pollutants during dial cycle (Hnan Village) 6

Figure 4. 7 Fluctuation of Air Pollutants during dial cycle (Gyoke Pin Village) 7

Figure 4. 8 Fluctuation of Air Pollutants during dial cycle (Nyaung Kan Village) 7

Figure 4. 9 Wind Speed and Wind Direction (Blowing From) at Sa Ka Village (ASR4) 15

Figure 4. 10 Wind Class Frequency Distribution at Sa Ka Village (ASR4) 15

Figure 4. 11 Wind Speed and Wind Direction (Blowing From) at Hnan Village (ASR3) 16

Figure 4. 12 Wind Class Frequency Distribution at Hnan Village (ASR3) 16

Figure 4. 13 Wind Speed and Wind Direction (Blowing From) at Gyoke Pin Village (ASR5) 17

Figure 4. 14 Wind Class Frequency Distribution at Gyoke Pin Village (ASR5) 17

Figure 4. 15 Wind Speed and Wind Direction (Blowing From) at Nyaung Kan Village (ASR14) 18

Figure 4. 16 Wind Class Frequency Distribution at Nyaung Kan Village (ASR14) 18

Figure 4. 17 Noise Level at near Sembcorp Myingyan Power Plant 20

Figure 4. 18 Noise Level at Sa Ka Village 21

List of Tables

Table 2. 1 Ambient Air Quality Parameters 1

Table 2. 2 Air Quality Guideline Values 1

Table 2. 3 Noise level monitoring 2

Table 2. 4 Equipment used to measure ambient air and noise measurement 2

Table 3. 1 Location of Monitoring Points 3

Table 4. 1 Observed Ambient Air Quality Results from Selected Points 4

Table 4. 2 Air Monitoring Results (Sa Ka Village) 8

Table 4. 3 Air Monitoring Results (Hnan Village) 10

Table 4. 4 Air Monitoring Results (Gyoke Pin Village) 12

Table 4. 5 Air Monitoring Results (Nyaung Kan Village) 14

Table 4. 6 Observed Values of Noise Level Measurement at near Sembcorp Myingyan Power Plant 19

Table 4. 7 Observed Values of Noise Level Measurement at Sa Ka Village 20

Table 4. 8 Observed Ambient Noise level Results from Myingyan Power Plant 21

Table 4. 9 Observed Ambient Noise level Results from Sa Ka Village 21

Table 4. 10 National Environmental Quality (Emission) Guidelines Values for Noise Level 23

1. INTRODUCTION

This report is environmental monitoring (only air and noise quality monitoring) for Sembcorp Myingyan Power Plant which is located beside of Myingyan – Nyaung-Oo Road, near the Sa Ka village in Mandalay Region.

2. METHODOLOGY

Baseline environmental parameters and sampling locations were defined according to the objectives for environmental monitoring purposes. Locations for sampling and analysis of ambient air quality of the project site were identified by Sembcorp Myingyan Power Co,ltd.

2.1 Ambient Air Quality

The emissions of dust particles and gases were measured for 24hrs continuously at the selected sites by using the Environmental Perimeter Air Station (EPAS), and EPAS provides direct readings in real time with data-logging capabilities. The monitoring results were compared with National Environmental Quality (Emission) Guideline (NEQG), World Health Organization (WHO) and American Conference of Governmental Industrial Hygienists (ACGIH) guidelines.

Table 2. 1 Ambient Air Quality Parameters

Ambient Air Quality (4 locations)	
Gas Emission	CO, CO_2, SO_2, NO_2
Dust Emission	PM_{10}, $PM_{2.5}$

Table 2. 2 Air Quality Guideline Values

Parameters	Guidelines Value	Unit	Organization	Averaging Period
PM_{10}	50	$\mu g/m^3$	NEQ	24hrs
$PM_{2.5}$	25	$\mu g/m^3$	NEQ	24hrs
CO	9	ppm	NAAQS	8hrs
CO_2	5000	ppm	ACGIH	8hrs
SO_2	20	$\mu g/m^3$	NEQ	24hrs
NO_2	200	$\mu g/m^3$	NEQ	24hrs

Source: Myanmar National Environmental Quality (Emission) Guidelines, December 2015 & Air quality guidelines global update. 2005. World Health Organization.

2.2 Ambient Noise

Noise level LAeq (dBA) will be measured at the selected locations that can reflect the exposure of the nearest local community and sensitive locations. Duration and frequency were measured for 24hrs continuously at the selected site using the Noise Meter.

The monitoring procedures, data analysis and interpretation were carried out in accordance with the instrument's manufacture and National Environmental Quality (Emission) Guidelines, World Health Organization (WHO) and International Finance Corporation (IFC guidelines in order to be in line with Environmental Conservation Department, Ministry of Natural Resources and Environment Conservation (MONREC). "National Environmental Quality

(Emission) Guidelines" for Myanmar was also presented the value of noise level as LAeq (dBA).

Table 2. 3 Noise level monitoring

Noise monitoring (2 locations)	
Noise Emission	LAeq (dBA) (1hrs, 24 hrs.)

Equipment used to measure ambient air and noise measurement are shown below (**Table 2. 4**).

Table 2. 4 Equipment used to measure ambient air and noise measurement

Davis Vantage Pro2 Wireless Weather Station Provides detailed current weather conditions and expanded forecasts - all at a glance! The Vantage Pro2 uses a frequency-hopping spread spectrum radio from 902 MHz to 928 MHz to transmit and receive data up to 1,000' (300m) line of sight. In addition, the weather station features a bubble level, improved anemometer base, redesigned wind cups, and factory-calibrated wind direction. The integrated sensor suite combines temperature and humidity sensors, rain collector with an aluminum-plated tipping bucket, and anemometer into one package for easy setup. Measure inside and outside temperature and humidity, heat index, barometric pressure, dew point, rainfall, wind direction and speed, and wind chill.	
Haz-Scanner EPAS PM_{10}, PM $_{2.5}$, NO_2, SO_2, CO, CO_2, Temperature, and Relative Humidity	
Digital Sound Level Meter Noise and Vibration	

3. MONITORING LOCATIONS

Locations of sampling sites were identified by Sembcorp Myingyan Power Co,ltd. Air quality was monitored at the four selected locations that are Sa Ka Village (ASR4), Hnan Village (ASR3), Gyoke Pin Village (ASR 5) and Nyaung Kan Village (ASR 14).

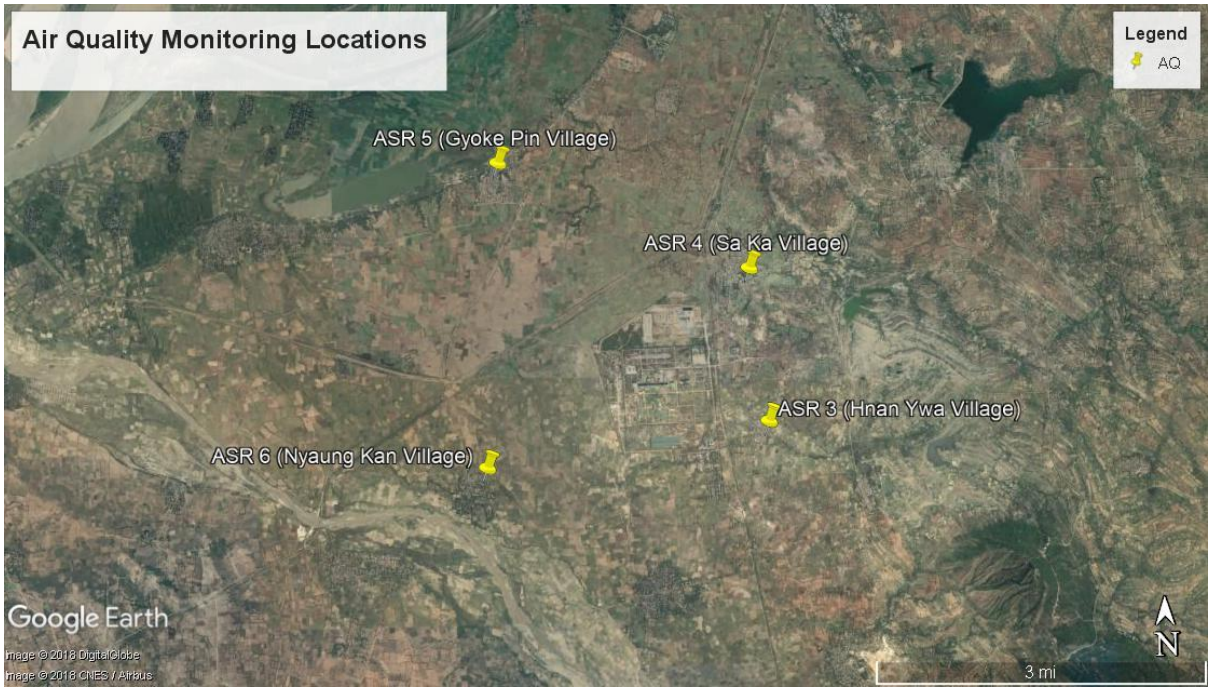


Figure 3. 1 Location of Monitoring Points

Table 3. 1 Location of Monitoring Points

Locations No.	Points	Coordinate	Locations
Ambient Air Quality and Noise Monitoring Locations			
1	ASR4	Lat- 21°23’48.591”, Long- 95°23’0.849”	Sa Ka Village
2	ASR3	Lat- 21°22’17.565”, Long- 95°23’18.116”	Hnan Village
3	ASR5	Lat- 21°24’21.888”, Long- 95°21’7.381”	Gyoke Pin Village
4	ASR14	Lat- 21°21’44.570”, Long- 95°20’55.035”	Nyaung Kan Village

4. ENVIRONMENTAL QUALITY MONITORING RESULTS

4.1 Ambient Air Quality Monitoring Results

24 hours air quality monitoring was done at each selected location from 1st December to 5th December 2025. The measured results are compared with national emission guidelines. Based on the results of air quality monitoring, all the parameters are within the guidelines.

Table 4. 1 Observed Ambient Air Quality Results from Selected Points

Parameters	Observed Value				Guidelines Value	Unit	Averaging Period
	ASR4	ASR3	ASR5	ASR14			
PM_{10}	14.25	15.27	14.40	10.98	50	$\mu g/m^3$	24hrs
$PM_{2.5}$	7.13	7.69	7.29	6.54	25	$\mu g/m^3$	24hrs
CO	0.0026	0.0028	0.0021	0.0022	9	ppm	8hrs
CO_2	400.76	390.55	397.41	382.33	5000	ppm	8hrs
SO_2	4.98	6.28	6.02	6.81	20	$\mu g/m^3$	24hrs
NO_2	5.80	6.90	6.65	4.68	200	$\mu g/m^3$	1hrs

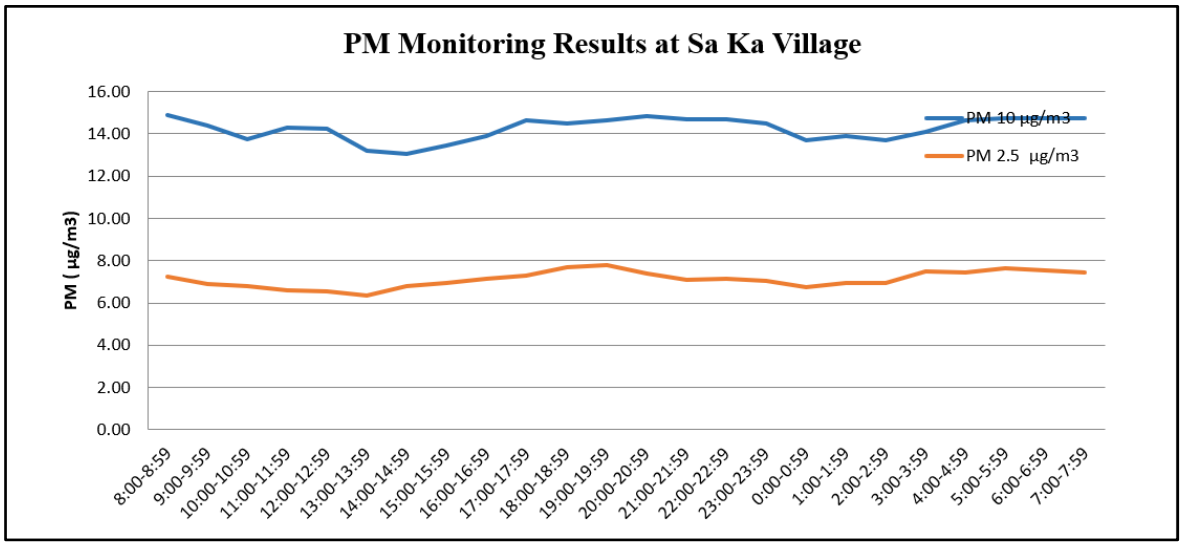


Figure 4. 1 PM Monitoring Results at Sa Ka Village

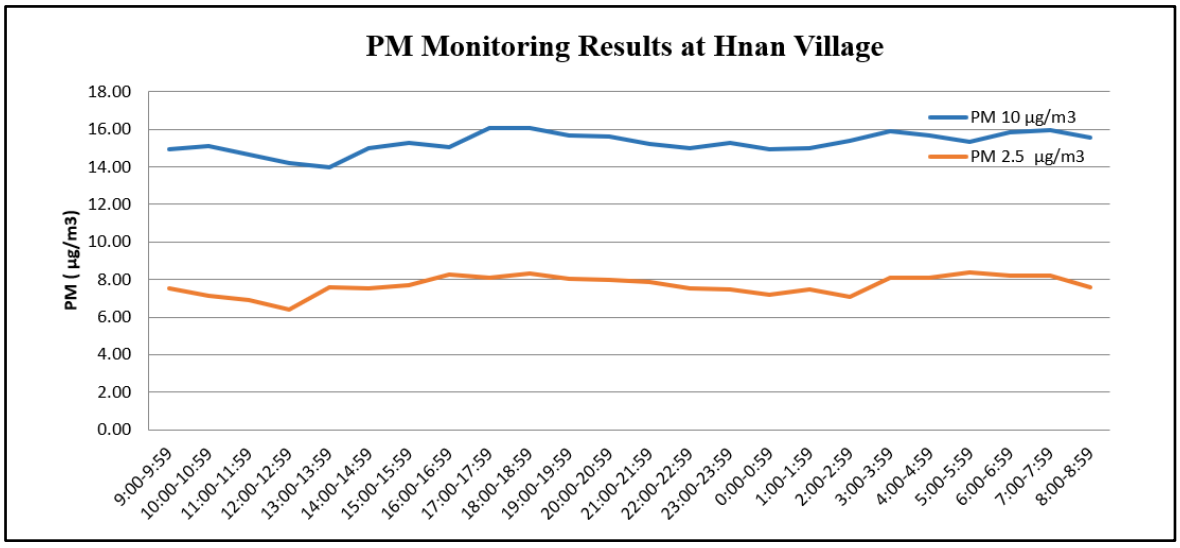


Figure 4. 2 PM Monitoring Results at Hnan Village

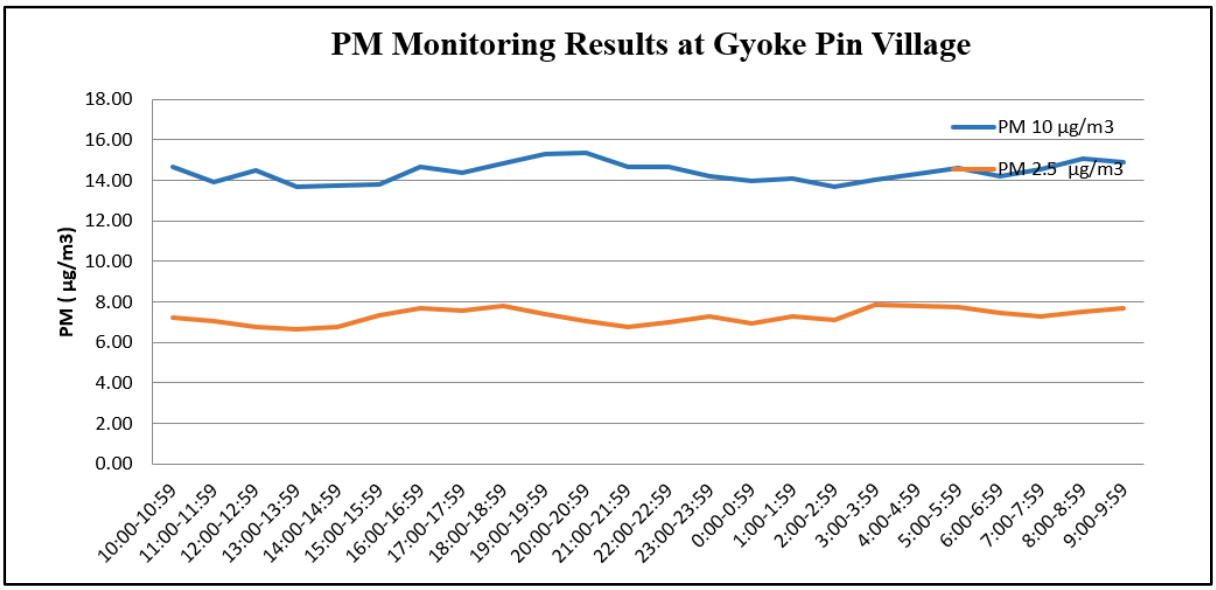


Figure 4. 3 PM Monitoring Results at Gyoke Pin Village

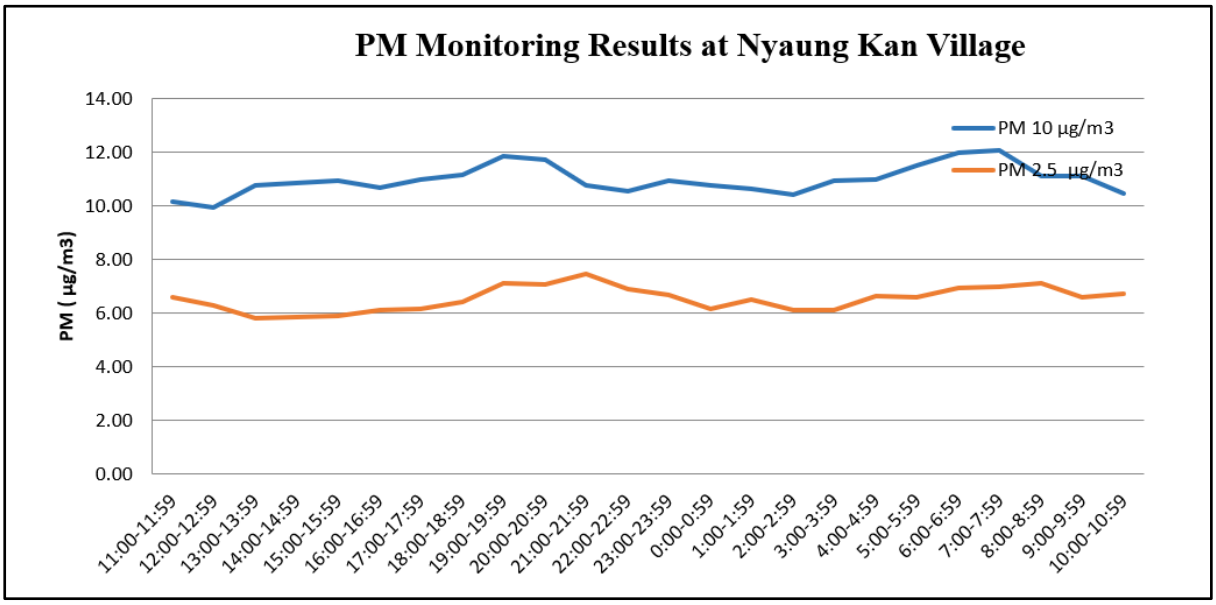


Figure 4. 4 PM Monitoring Results at Nyaung Kan Village

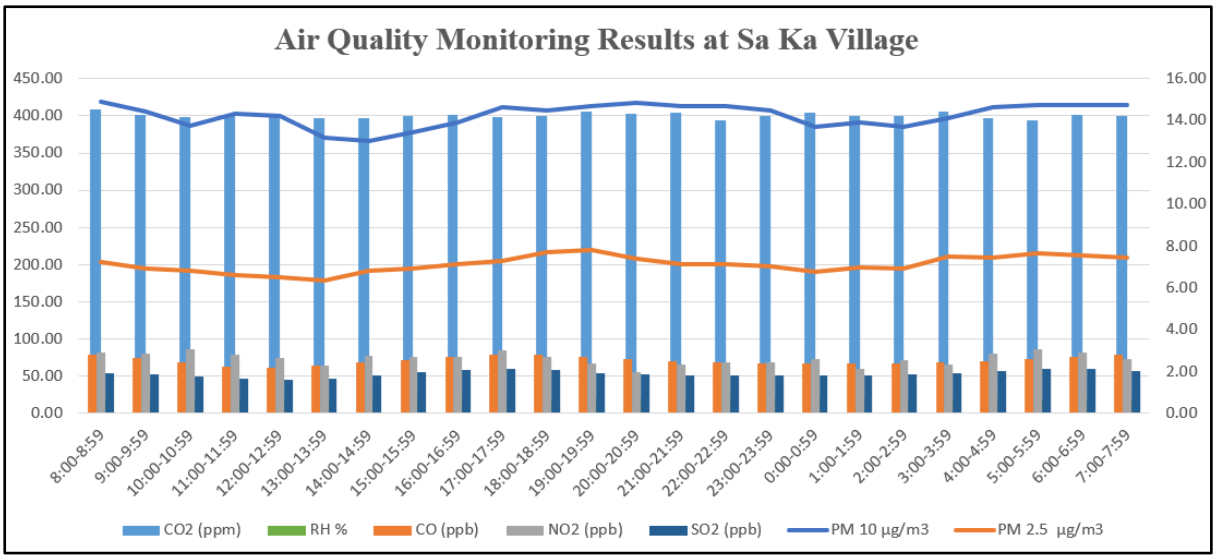


Figure 4. 5 Fluctuation of Air Pollutants during dial cycle (Sa Ka Village)

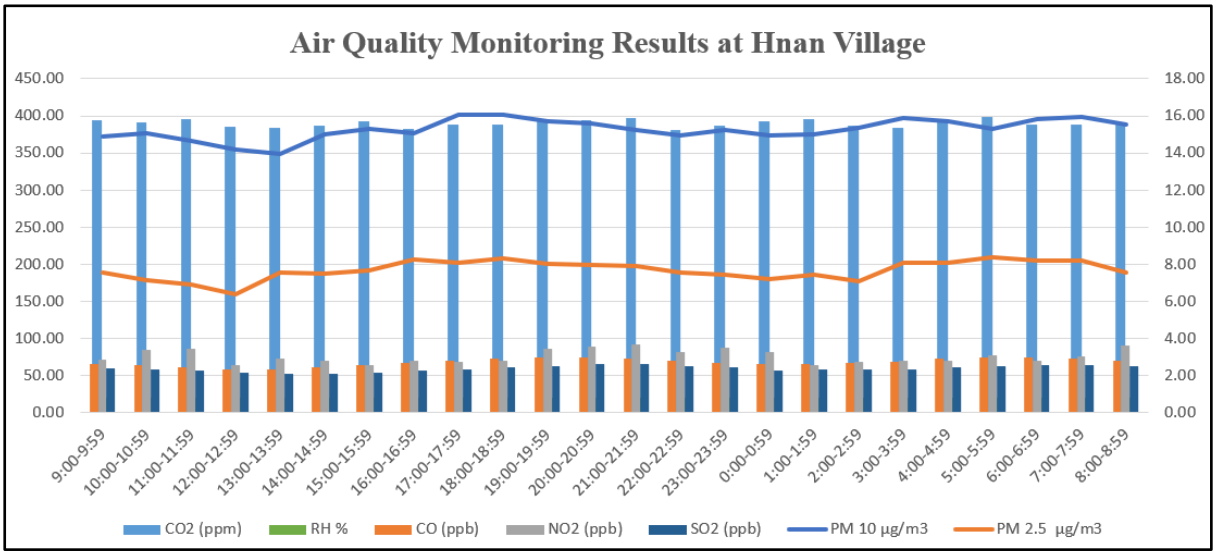


Figure 4. 6 Fluctuation of Air Pollutants during dial cycle (Hnan Village)

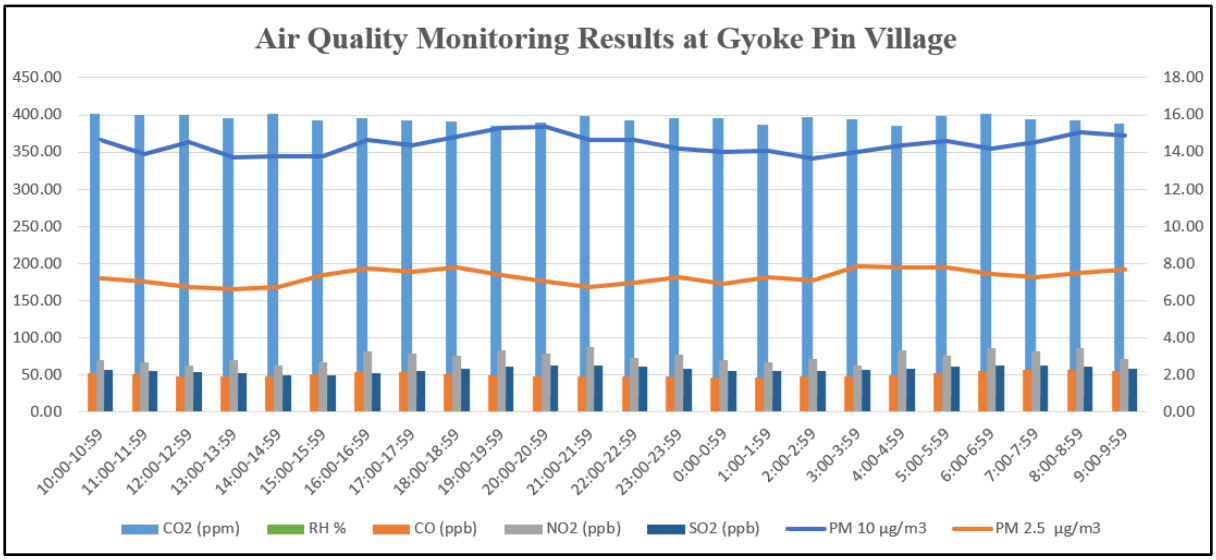


Figure 4. 7 Fluctuation of Air Pollutants during dial cycle (Gyoke Pin Village)

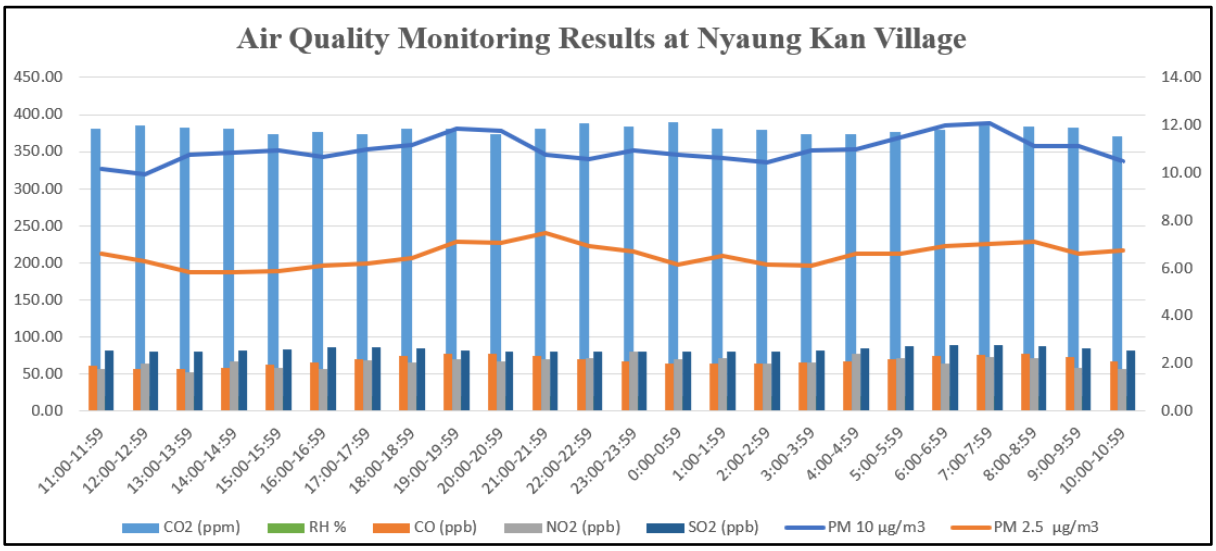


Figure 4. 8 Fluctuation of Air Pollutants during dial cycle (Nyaung Kan Village)

Detail results with one-hour interval of pollutants are shown in **Table 4. 2** to **Table 4. 5.** All results are under the Myanmar National Environmental Quality (emission) Guidelines. So, Sembcorp Myingyan Power Plant is acceptable for environment.

Table 4. 2 Air Monitoring Results (Sa Ka Village)

Date	Time		CO_2 (ppm)	CO (ppb)	NO_2 (ppb)	PM_{10} µg/m^3	$PM_{2.5}$ µg/m^3	RH %	SO_2 (ppb)
01.12.2025	8:00-8:59	Average	408.25	2.79	2.90	14.91	7.23	19.08	1.94
01.12.2025	9:00-9:59	Average	401.53	2.64	2.85	14.41	6.91	19.29	1.86
01.12.2025	10:00-10:59	Average	399.18	2.42	3.09	13.76	6.80	19.24	1.77
01.12.2025	11:00-11:59	Average	401.83	2.24	2.79	14.30	6.62	19.35	1.68
01.12.2025	12:00-12:59	Average	402.29	2.17	2.65	14.24	6.53	19.52	1.63
01.12.2025	13:00-13:59	Average	396.73	2.29	2.29	13.20	6.36	19.60	1.68
01.12.2025	14:00-14:59	Average	396.75	2.43	2.76	13.04	6.82	19.65	1.82
01.12.2025	15:00-15:59	Average	399.51	2.57	2.71	13.44	6.93	19.71	1.98
01.12.2025	16:00-16:59	Average	400.88	2.71	2.71	13.89	7.13	19.91	2.08
01.12.2025	17:00-17:59	Average	397.93	2.79	3.03	14.66	7.30	20.01	2.11
01.12.2025	18:00-18:59	Average	399.30	2.80	2.71	14.49	7.69	19.94	2.05
01.12.2025	19:00-19:59	Average	405.27	2.71	2.40	14.67	7.81	20.34	1.95
01.12.2025	20:00-20:59	Average	402.28	2.60	1.96	14.85	7.41	20.10	1.87
01.12.2025	21:00-21:59	Average	405.07	2.50	2.33	14.68	7.11	20.16	1.83
01.12.2025	22:00-22:59	Average	394.49	2.43	2.42	14.70	7.13	19.94	1.80
01.12.2025	23:00-23:59	Average	400.23	2.40	2.46	14.49	7.05	19.95	1.79
02.12.2025	0:00-0:59	Average	403.96	2.41	2.59	13.71	6.75	19.87	1.81
02.12.2025	1:00-1:59	Average	399.81	2.41	2.13	13.92	6.96	19.79	1.84
02.12.2025	2:00-2:59	Average	400.54	2.40	2.52	13.69	6.95	19.50	1.87
02.12.2025	3:00-3:59	Average	406.07	2.44	2.36	14.11	7.51	19.44	1.94
02.12.2025	4:00-4:59	Average	396.93	2.50	2.88	14.66	7.46	19.26	2.05
02.12.2025	5:00-5:59	Average	394.77	2.59	3.06	14.74	7.67	19.28	2.11
02.12.2025	6:00-6:59	Average	401.07	2.72	2.91	14.72	7.55	19.24	2.12
02.12.2025	7:00-7:59	Average	399.34	2.80	2.59	14.76	7.42	19.18	2.03
Average			**400.58**	**2.53**	**2.63**	**14.25**	**7.13**	**19.64**	**1.90**
1 hour Minimum			394.49	2.17	1.96	13.04	6.36	19.08	1.63
1 hour Maximum			408.25	2.80	3.09	14.91	7.81	20.34	2.12

Table 4. 3 Air Monitoring Results (Hnan Village)

Date	Time		CO_2 (ppm)	CO (ppb)	NO_2 (ppb)	PM_{10} µg/m^3	$PM_{2.5}$ µg/m^3	RH %	SO_2 (ppb)
02.12.2025	9:00-9:59	Average	393.51	2.66	2.88	14.91	7.55	20.09	2.43
02.12.2025	10:00-10:59	Average	391.14	2.56	3.42	15.09	7.12	20.25	2.35
02.12.2025	11:00-11:59	Average	395.20	2.45	3.44	14.67	6.90	20.15	2.26
02.12.2025	12:00-12:59	Average	386.17	2.35	2.58	14.20	6.41	20.12	2.18
02.12.2025	13:00-13:59	Average	383.68	2.34	2.93	13.95	7.57	19.95	2.10
02.12.2025	14:00-14:59	Average	386.35	2.43	2.81	14.98	7.53	20.01	2.12
02.12.2025	15:00-15:59	Average	392.39	2.57	2.58	15.28	7.69	19.96	2.17
02.12.2025	16:00-16:59	Average	382.22	2.67	2.80	15.05	8.25	20.01	2.26
02.12.2025	17:00-17:59	Average	388.89	2.80	2.73	16.06	8.09	20.03	2.36
02.12.2025	18:00-18:59	Average	388.27	2.92	2.81	16.07	8.34	19.85	2.44
02.12.2025	19:00-19:59	Average	393.59	2.99	3.48	15.69	8.01	19.78	2.55
02.12.2025	20:00-20:59	Average	394.91	3.01	3.60	15.60	8.00	19.86	2.61
02.12.2025	21:00-21:59	Average	396.85	2.91	3.67	15.23	7.89	19.86	2.61
02.12.2025	22:00-22:59	Average	381.38	2.80	3.29	14.97	7.54	19.87	2.54
02.12.2025	23:00-23:59	Average	386.80	2.69	3.52	15.25	7.47	19.87	2.46
03.12.2025	0:00-0:59	Average	392.82	2.62	3.27	14.94	7.19	19.99	2.31
03.12.2025	1:00-1:59	Average	394.98	2.63	2.56	14.99	7.46	19.98	2.33
03.12.2025	2:00-2:59	Average	387.51	2.70	2.75	15.38	7.06	19.93	2.32
03.12.2025	3:00-3:59	Average	383.50	2.78	2.81	15.91	8.08	19.89	2.37
03.12.2025	4:00-4:59	Average	392.16	2.91	2.83	15.68	8.09	20.07	2.44
03.12.2025	5:00-5:59	Average	398.35	2.99	3.08	15.31	8.39	20.11	2.55
03.12.2025	6:00-6:59	Average	387.87	3.00	2.83	15.83	8.19	19.99	2.59
03.12.2025	7:00-7:59	Average	388.48	2.92	3.02	15.95	8.21	20.05	2.60
03.12.2025	8:00-8:59	Average	391.57	2.79	3.61	15.56	7.58	20.23	2.54
Average			**389.94**	**2.73**	**3.05**	**15.27**	**7.69**	**20.00**	**2.40**
1 hour Minimum			381.38	2.34	2.56	13.95	6.41	19.78	2.10
1 hour Maximum			398.35	3.01	3.67	16.07	8.39	20.25	2.61

Table 4. 4 Air Monitoring Results (Gyoke Pin Village)

Date	Time		CO_2 (ppm)	CO (ppb)	NO_2 (ppb)	PM_{10} µg/m^3	$PM_{2.5}$ µg/m^3	RH %	SO_2 (ppb)
03.12.2025	10:00-10:59	Average	401.35	2.09	2.78	14.67	7.20	19.73	2.26
03.12.2025	11:00-11:59	Average	400.04	2.02	2.72	13.89	7.05	19.94	2.21
03.12.2025	12:00-12:59	Average	400.12	1.95	2.52	14.52	6.77	19.91	2.15
03.12.2025	13:00-13:59	Average	395.83	1.92	2.82	13.70	6.63	20.00	2.09
03.12.2025	14:00-14:59	Average	400.92	1.96	2.49	13.75	6.76	20.09	2.01
03.12.2025	15:00-15:59	Average	392.62	2.04	2.69	13.77	7.36	20.11	2.01
03.12.2025	16:00-16:59	Average	395.20	2.14	3.29	14.68	7.71	20.13	2.10
03.12.2025	17:00-17:59	Average	393.18	2.15	3.19	14.37	7.58	20.18	2.22
03.12.2025	18:00-18:59	Average	391.74	2.08	3.03	14.83	7.83	20.17	2.34
03.12.2025	19:00-19:59	Average	386.06	1.99	3.36	15.27	7.41	20.35	2.44
03.12.2025	20:00-20:59	Average	389.96	1.94	3.16	15.34	7.06	20.26	2.51
03.12.2025	21:00-21:59	Average	399.05	1.92	3.53	14.68	6.77	20.48	2.50
03.12.2025	22:00-22:59	Average	393.30	1.91	2.95	14.64	7.00	20.50	2.44
03.12.2025	23:00-23:59	Average	395.85	1.91	3.12	14.21	7.29	20.41	2.34
04.12.2025	0:00-0:59	Average	396.40	1.90	2.84	14.00	6.91	20.31	2.21
04.12.2025	1:00-1:59	Average	387.22	1.90	2.70	14.06	7.29	20.26	2.20
04.12.2025	2:00-2:59	Average	396.75	1.91	2.90	13.67	7.11	20.23	2.23
04.12.2025	3:00-3:59	Average	393.59	1.93	2.52	14.02	7.87	20.20	2.27
04.12.2025	4:00-4:59	Average	385.70	1.99	3.36	14.34	7.78	20.03	2.34
04.12.2025	5:00-5:59	Average	398.79	2.09	3.05	14.59	7.77	20.06	2.45
04.12.2025	6:00-6:59	Average	401.13	2.22	3.47	14.18	7.47	19.98	2.51
04.12.2025	7:00-7:59	Average	393.82	2.31	3.30	14.56	7.29	19.81	2.51
04.12.2025	8:00-8:59	Average	392.17	2.29	3.45	15.07	7.49	19.75	2.45
04.12.2025	9:00-9:59	Average	388.89	2.22	2.85	14.89	7.67	19.71	2.35
Average			**394.57**	**2.03**	**3.00**	**14.40**	**7.29**	**20.11**	**2.30**
1 hour Minimum			385.70	1.90	2.49	13.67	6.63	19.71	2.01
1 hour Maximum			401.35	2.31	3.53	15.34	7.87	20.50	2.51

Table 4. 5 Air Monitoring Results (Nyaung Kan Village)

Date	Time		CO_2 (ppm)	CO (ppb)	NO_2 (ppb)	PM_{10} µg/m3	$PM_{2.5}$ µg/m3	RH %	SO_2 (ppb)
04.12.2025	11:00-11:59	Average	381.23	1.92	1.76	10.18	6.60	19.87	2.53
04.12.2025	12:00-12:59	Average	385.61	1.77	1.99	9.94	6.30	20.04	2.53
04.12.2025	13:00-13:59	Average	382.92	1.76	1.66	10.77	5.84	20.03	2.51
04.12.2025	14:00-14:59	Average	380.40	1.84	2.09	10.84	5.85	20.21	2.54
04.12.2025	15:00-15:59	Average	373.78	1.97	1.81	10.96	5.89	20.13	2.62
04.12.2025	16:00-16:59	Average	377.38	2.07	1.79	10.68	6.11	20.38	2.68
04.12.2025	17:00-17:59	Average	373.16	2.20	2.14	11.01	6.18	20.46	2.68
04.12.2025	18:00-18:59	Average	381.75	2.31	2.06	11.18	6.41	20.55	2.65
04.12.2025	19:00-19:59	Average	381.57	2.40	2.20	11.84	7.11	20.57	2.57
04.12.2025	20:00-20:59	Average	374.43	2.40	2.09	11.74	7.08	20.57	2.53
04.12.2025	21:00-21:59	Average	380.47	2.32	2.18	10.76	7.48	20.66	2.51
04.12.2025	22:00-22:59	Average	388.42	2.20	2.23	10.57	6.93	20.91	2.49
04.12.2025	23:00-23:59	Average	384.33	2.09	2.49	10.93	6.70	20.71	2.50
05.12.2025	0:00-0:59	Average	389.88	2.01	2.20	10.77	6.17	20.68	2.52
05.12.2025	1:00-1:59	Average	380.61	2.01	2.25	10.64	6.51	20.57	2.52
05.12.2025	2:00-2:59	Average	378.96	2.02	2.00	10.44	6.14	20.64	2.53
05.12.2025	3:00-3:59	Average	374.10	2.03	2.05	10.95	6.13	20.42	2.57
05.12.2025	4:00-4:59	Average	374.35	2.09	2.41	10.99	6.63	20.29	2.65
05.12.2025	5:00-5:59	Average	375.98	2.20	2.23	11.51	6.60	20.33	2.74
05.12.2025	6:00-6:59	Average	380.12	2.31	2.02	12.00	6.94	20.30	2.80
05.12.2025	7:00-7:59	Average	385.41	2.39	2.27	12.08	7.01	20.16	2.80
05.12.2025	8:00-8:59	Average	383.60	2.40	2.24	11.12	7.12	20.06	2.74
05.12.2025	9:00-9:59	Average	382.65	2.29	1.82	11.11	6.60	19.90	2.66
05.12.2025	10:00-10:59	Average	370.57	2.12	1.76	10.49	6.73	19.93	2.57
Average			**380.07**	**2.13**	**2.07**	**10.98**	**6.54**	**20.35**	**2.60**
1 hour Minimum			370.57	1.76	1.66	9.94	5.84	19.87	2.49
1 hour Maximum			389.88	2.40	2.49	12.08	7.48	20.91	2.80

4.2 Wind Speed and Direction

The following figure describes the wind speed and wind direction of the proposed project site on 1st December to 5th December 2025 respectively. According to the data, the wind direction is following **Figure 4. 9 to Figure 4. 16.**

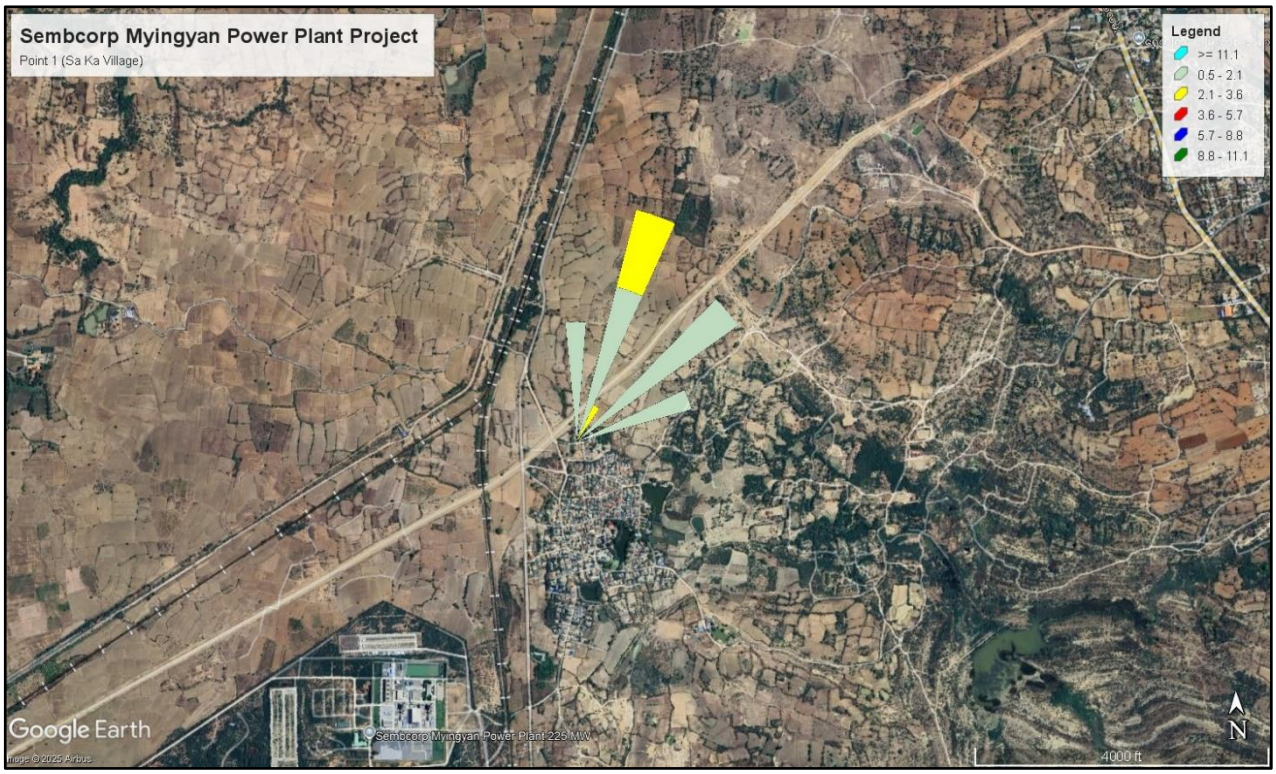


Figure 4. 9 Wind Speed and Wind Direction (Blowing From) at Sa Ka Village (ASR4)

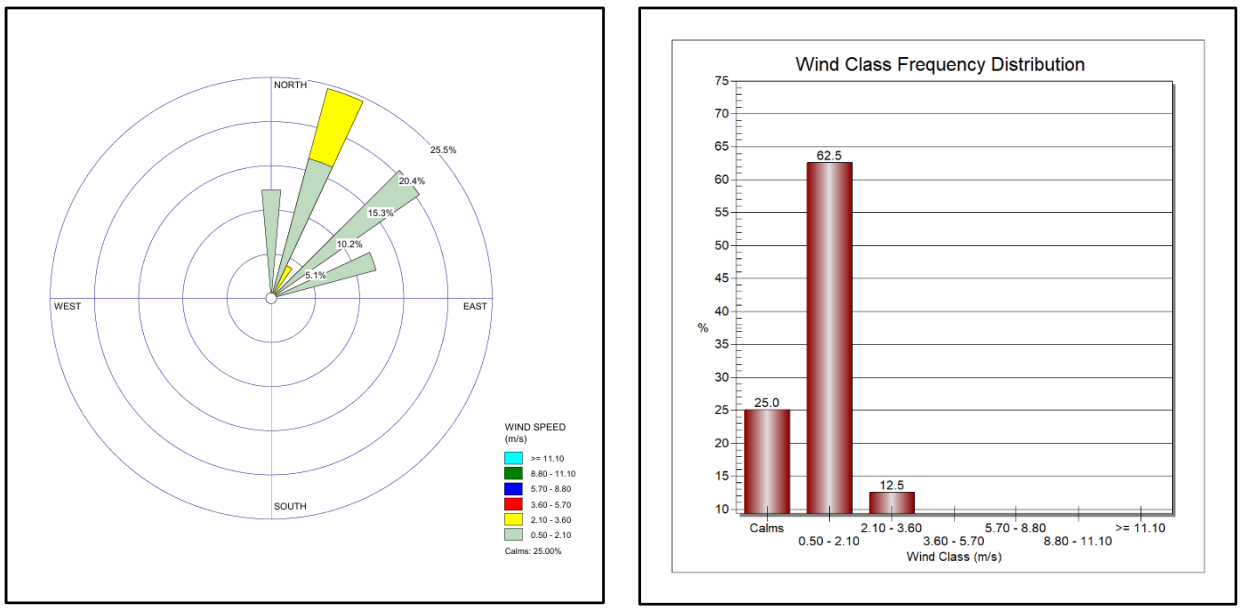


Figure 4. 10 Wind Class Frequency Distribution at Sa Ka Village (ASR4)

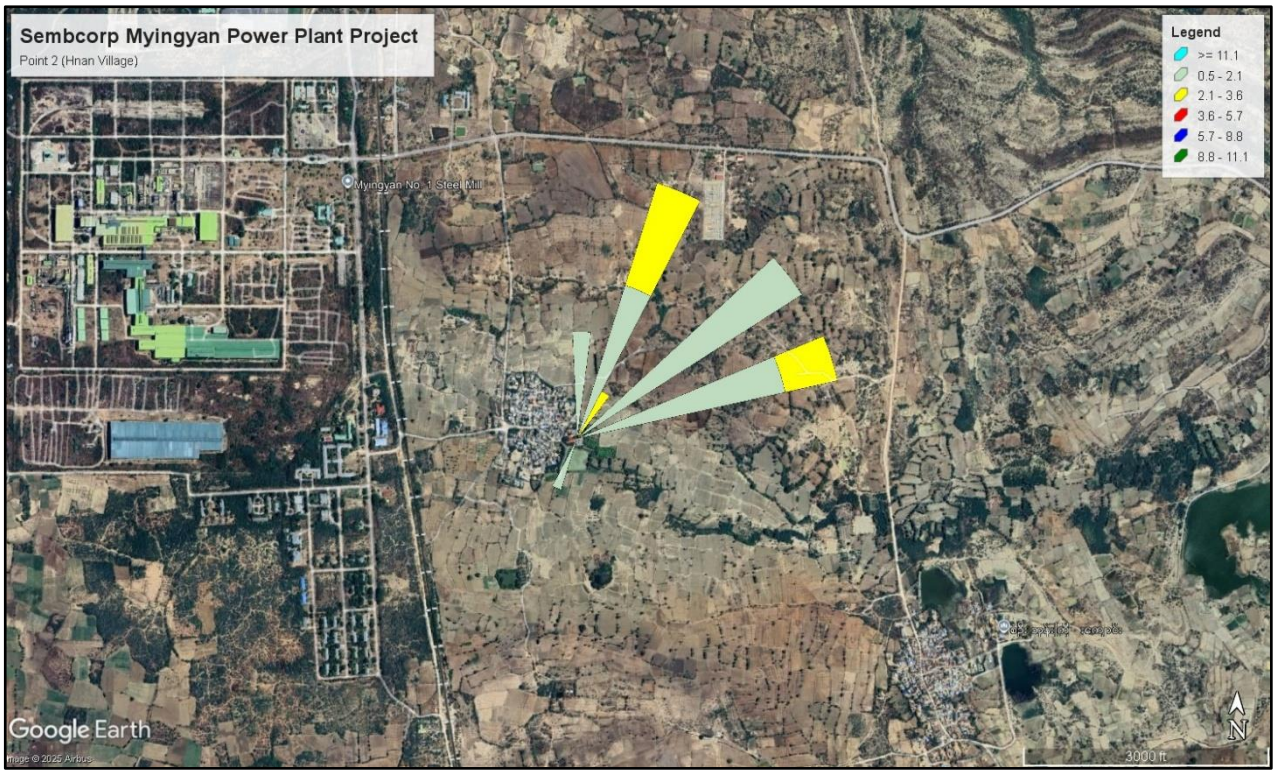
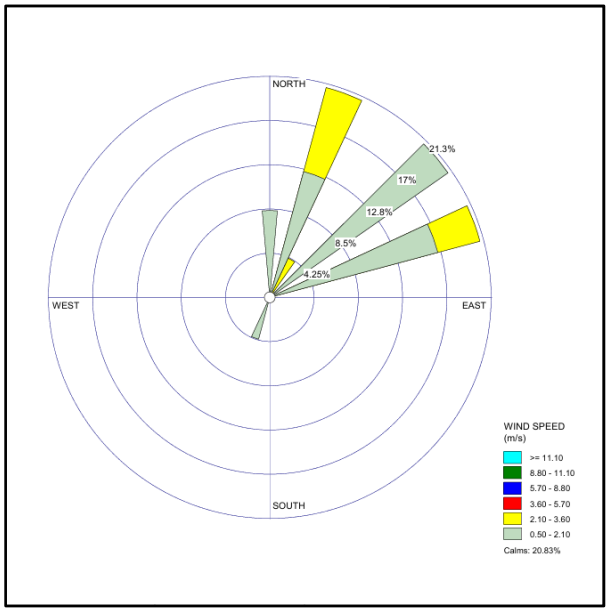


Figure 4. 11 Wind Speed and Wind Direction (Blowing From) at Hnan Village (ASR3)



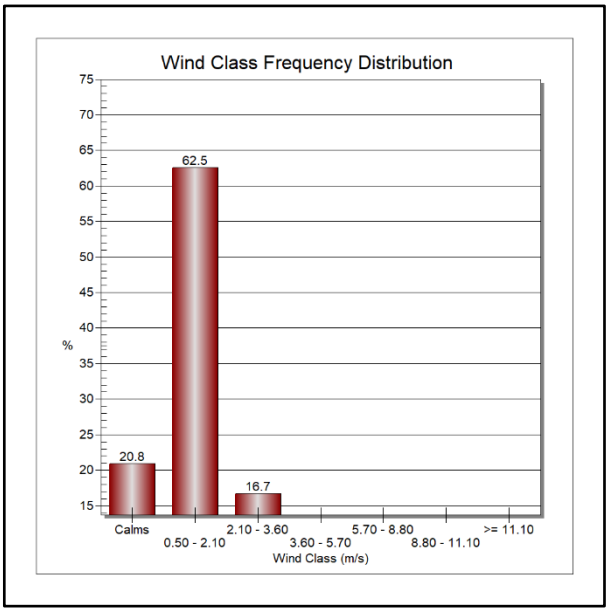


Figure 4. 12 Wind Class Frequency Distribution at Hnan Village (ASR3)

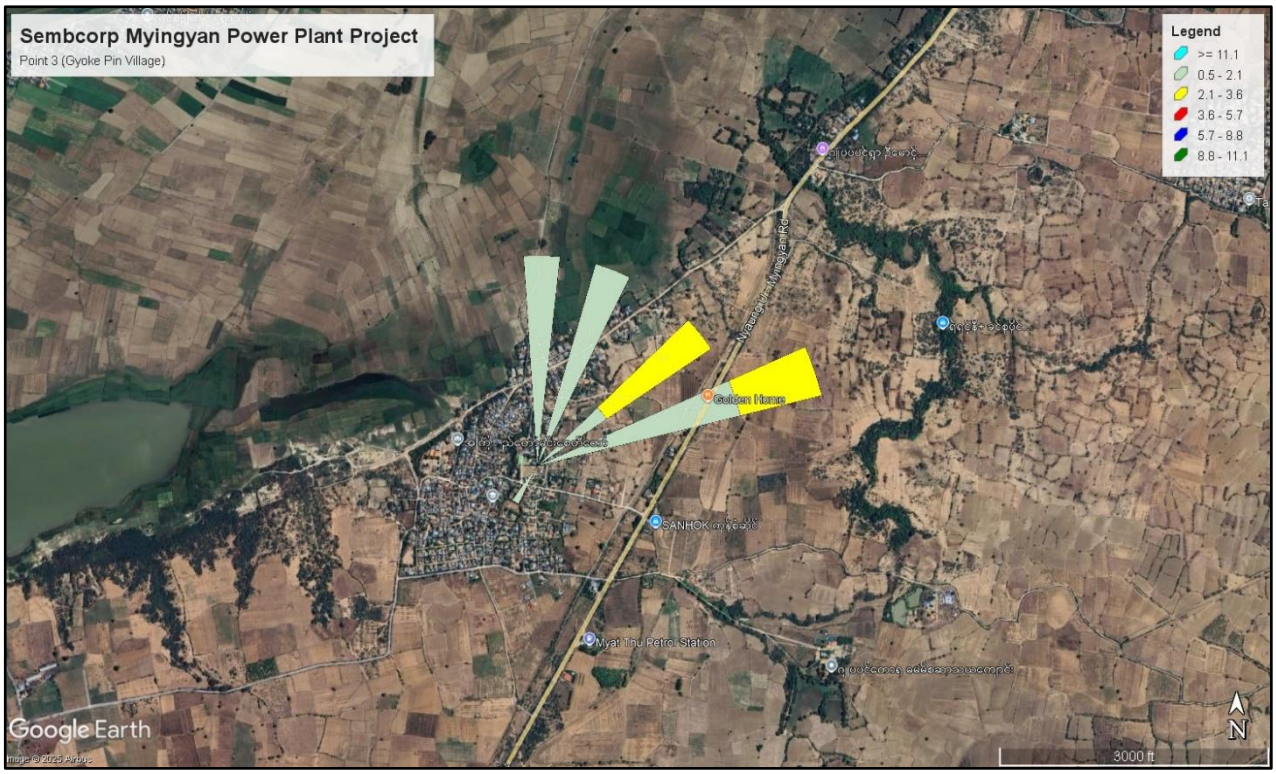


Figure 4. 13 Wind Speed and Wind Direction (Blowing From) at Gyoke Pin Village (ASR5)

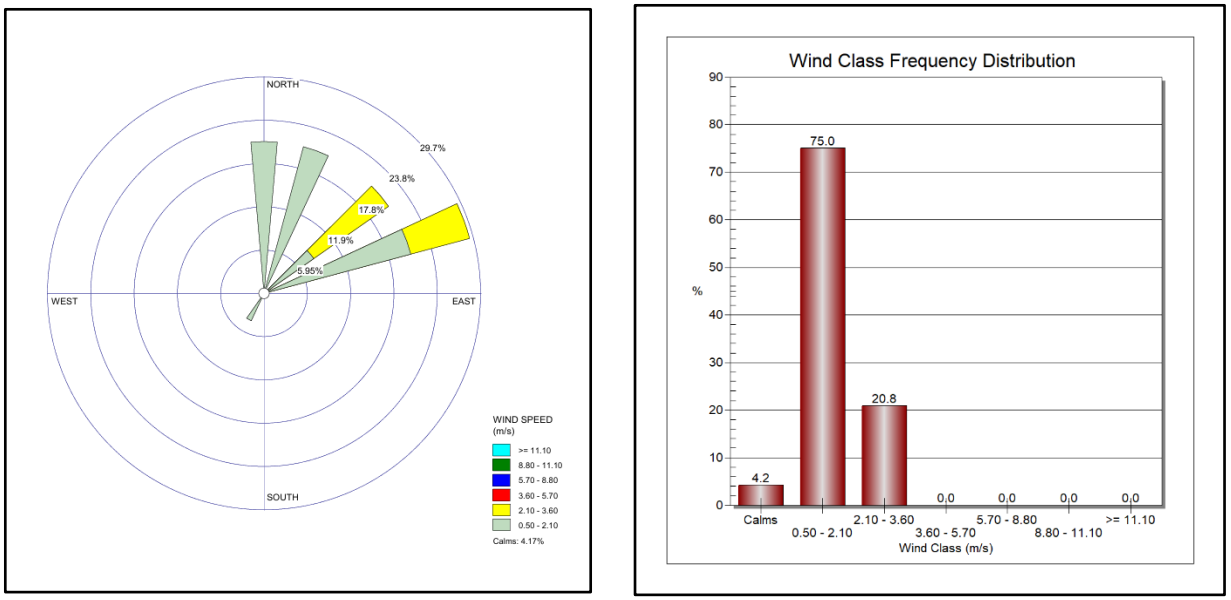


Figure 4. 14 Wind Class Frequency Distribution at Gyoke Pin Village (ASR5)

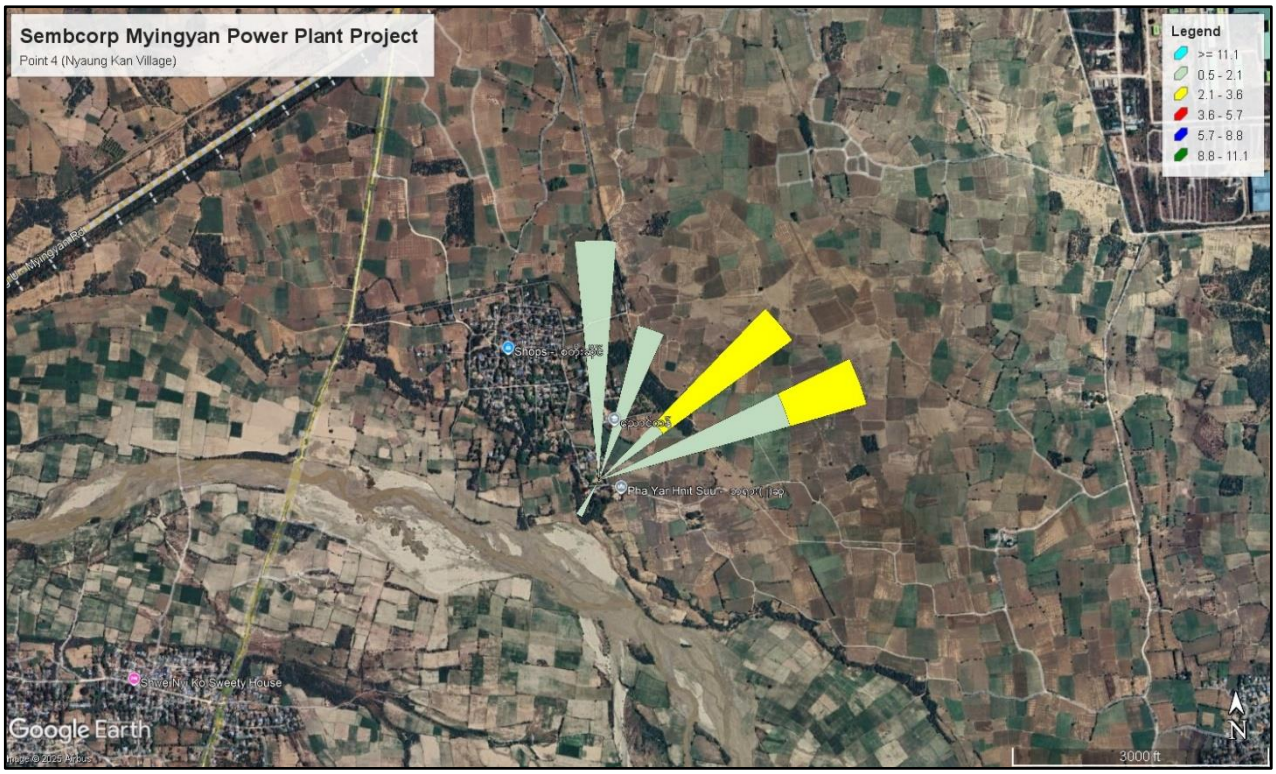
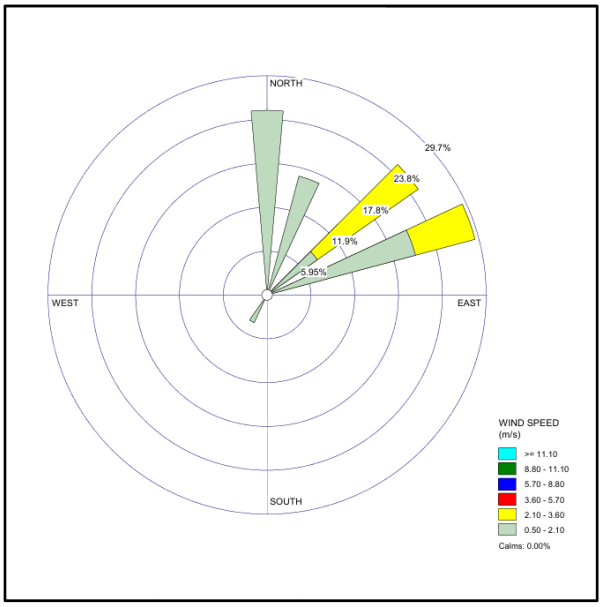


Figure 4. 15 Wind Speed and Wind Direction (Blowing From) at Nyaung Kan Village (ASR14)



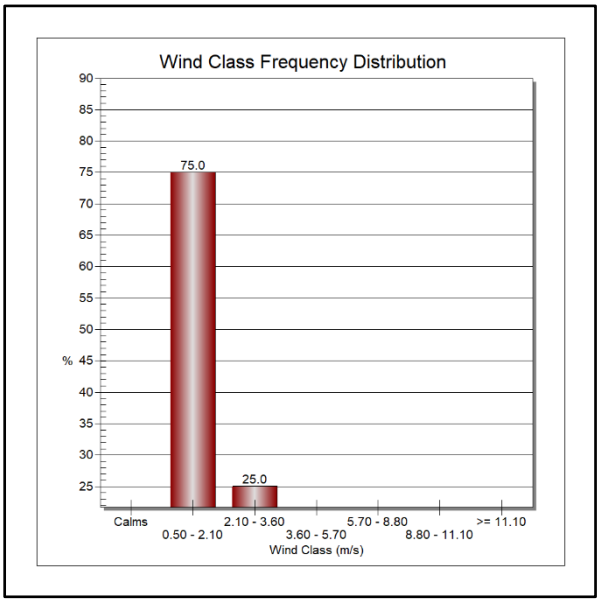


Figure 4. 16 Wind Class Frequency Distribution at Nyaung Kan Village (ASR14)

4.3 Ambient Noise

Ambient noise level for the proposed project was measured with Digital Sound Level Meter at the project site. The noise level measurement is conducted at Sembcorp Myingyan Power points: these points are nearly sembcorp myingyan power plant and air monitoring point at Sa Ka village on 1st December 2025 to 3rd December 2025. Measuring period is 24 hours continuously. The observed values are described in **Table 4. 6 to Table 4. 9** and the following figures are noise level measurements at the proposed project.

Table 4. 6 Observed Values of Noise Level Measurement at near Sembcorp Myingyan Power Plant

No.	Date	Time	Observed Mean Value (Source)	Weight	Day/Night	Average
1	03.12.2025	7:00:24-7:59:24	67.94	A	Day	57.10
2	03.12.2025	8:00:24-8:59:24	68.25	A	Day	
3	02.12.2025	9:00:24-9:59:24	64.82	A	Day	
4	02.12.2025	10:00:24-10:59:24	52.37	A	Day	
5	02.12.2025	11:00:24-11:59:24	51.89	A	Day	
6	02.12.2025	12:00:24-12:59:24	53.31	A	Day	
7	02.12.2025	13:00:24-13:59:24	53.40	A	Day	
8	02.12.2025	14:00:24-14:59:24	53.95	A	Day	
9	02.12.2025	15:00:24-15:59:24	56.49	A	Day	
10	02.12.2025	16:00:24-16:59:24	62.85	A	Day	
11	02.12.2025	17:00:24-17:59:24	66.63	A	Day	
12	02.12.2025	18:00:24-18:59:24	61.99	A	Day	
13	02.12.2025	19:00:24-19:59:24	47.79	A	Day	
14	02.12.2025	20:00:24-20:59:24	47.61	A	Day	
15	02.12.2025	21:00:24-21:59:24	47.17	A	Day	
16	02.12.2025	22:00:24-22:59:24	47.23	A	Night	53.91
17	02.12.2025	23:00:24-23:59:24	48.32	A	Night	
18	03.12.2025	0:00:24-0:59:24	47.86	A	Night	
19	03.12.2025	1:00:24-1:59:24	50.28	A	Night	
20	03.12.2025	2:00:24-2:59:24	55.87	A	Night	
21	03.12.2025	3:00:24-3:59:24	56.26	A	Night	
22	03.12.2025	4:00:24-4:59:24	55.65	A	Night	
23	03.12.2025	5:00:24-5:59:24	55.45	A	Night	
24	03.12.2025	6:00:24-6:59:24	68.23	A	Night	
Average			**55.90**			

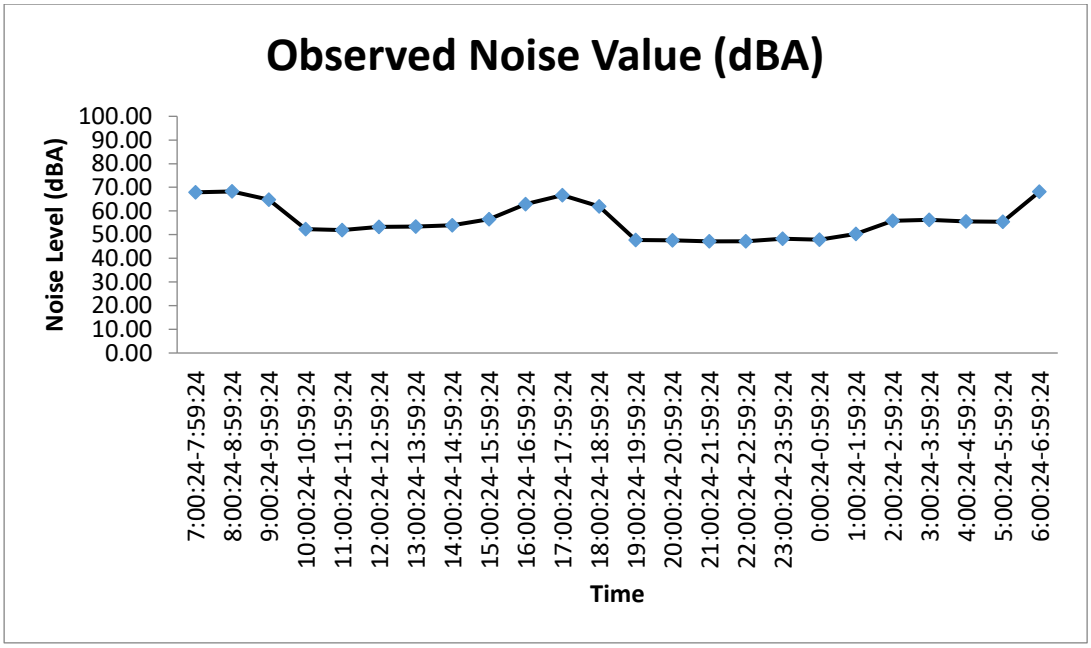


Figure 4. 17 Noise Level at near Sembcorp Myingyan Power Plant

Table 4. 7 Observed Values of Noise Level Measurement at Sa Ka Village

No.	Date	Time	Observed Mean Value (Source)	Weight	Day/Night	Average
1	02.12.2025	7:00:46-7:59:46	78.85	A	Day	55.74
2	01.12.2025	8:00:46-8:59:46	73.23	A	Day	
3	01.12.2025	9:00:46-9:59:46	57.34	A	Day	
4	01.12.2025	10:00:46-10:59:46	47.29	A	Day	
5	01.12.2025	11:00:46-11:59:46	48.21	A	Day	
6	01.12.2025	12:00:46-12:59:46	51.20	A	Day	
7	01.12.2025	13:00:46-13:59:46	54.98	A	Day	
8	01.12.2025	14:00:46-14:59:46	56.61	A	Day	
9	01.12.2025	15:00:46-15:59:46	60.44	A	Day	
10	01.12.2025	16:00:46-16:59:46	65.32	A	Day	
11	01.12.2025	17:00:46-17:59:46	48.55	A	Day	
12	01.12.2025	18:00:46-18:59:46	47.28	A	Day	
13	01.12.2025	19:00:46-19:59:46	55.10	A	Day	
14	01.12.2025	20:00:46-20:59:46	45.72	A	Day	
15	01.12.2025	21:00:46-21:59:46	45.98	A	Day	
16	01.12.2025	22:00:46-22:59:46	47.97	A	Night	57.87
17	01.12.2025	23:00:46-23:59:46	46.41	A	Night	
18	02.12.2025	0:00:46-0:59:46	45.81	A	Night	
19	02.12.2025	1:00:46-1:59:46	49.07	A	Night	
20	02.12.2025	2:00:46-2:59:46	63.16	A	Night	

21	02.12.2025	3:00:46-3:59:46	66.43	A	Night	
22	02.12.2025	4:00:46-4:59:46	58.26	A	Night	
23	02.12.2025	5:00:46-5:59:46	78.86	A	Night	
24	02.12.2025	6:00:46-6:59:46	64.86	A	Night	
Average			**56.54**			

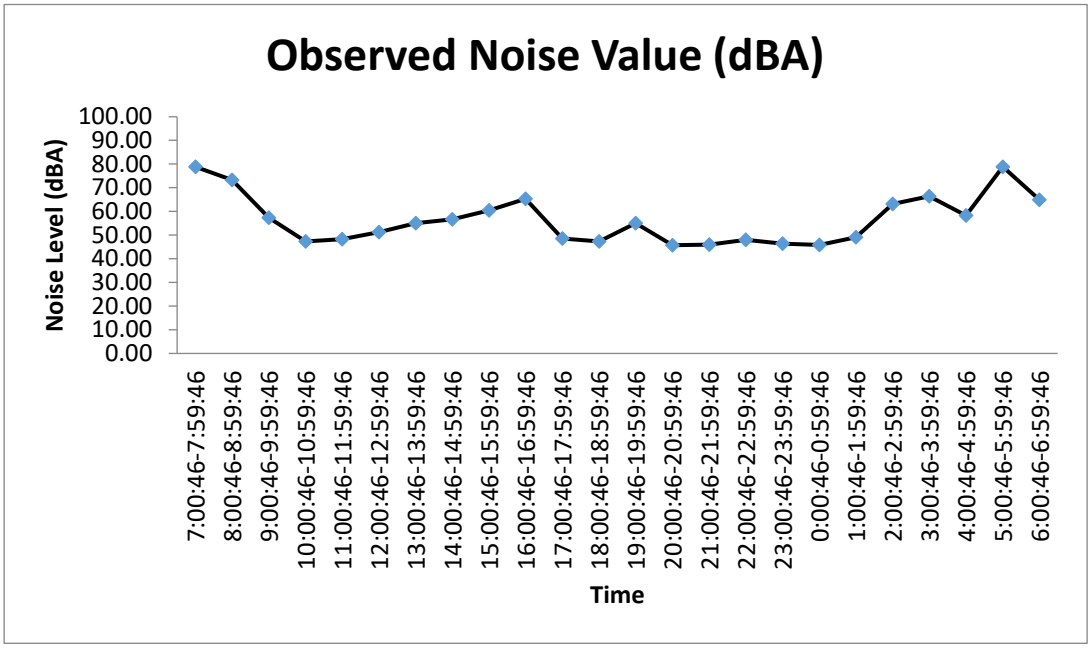


Figure 4. 18 Noise Level at Sa Ka Village

Table 4. 8 Observed Ambient Noise Level Results from Myingyan Power Plant

Point	**Sembcorp Myingyan Power Plant**	
	Day Time	**Nighttime**
Sembcorp Myingyan Power Plant	**57.10**	**53.91**
Guideline Values	70	70

Table 4. 9 Observed Ambient Noise Level Results from Sa Ka Village

Point	**Sembcorp Myingyan Power Plant**	
	Day Time	**Nighttime**
Sa Ka Village	**55.74**	**57.87**
Guideline Values	55	45

The observed values are compared with the National Environmental Quality (Emission) Guidelines as shown in

Table 4. 10 which indicates the separate level for residential and industrial points.

Table 4. 10 National Environmental Quality (Emission) Guidelines Values for Noise Level

Receptor	One Hour LAeq (dBA)	
	Daytime 07:00 - 22:00 (10:00 - 22:00 for Public Holidays)	Nighttime 22:00 - 07:00 (22:00 - 10:00 for Public Holidays)
Residential, institutional, educational	55	45
Industrial, commercial	70	70

The observed noise values of the proposed project for daytime at Sembcorp myingyan power plant and Sa Ka village are 57.10 dB (A) and 55.74 dB (A). The observed noise values of the proposed project for nighttime at Sembcorp myingyan power plant and Sa Ka village are 53.91 dB (A) and 57.87 dB (A). The proposed project is located adjacent to the residential and commercial area. The observed values of daytime and nighttime at Sembcorp myingyan power plant are within the acceptable values of the National Environmental Quality (Emission) Guidelines. The observed values of daytime and nighttime at Sa Ka village are upper the acceptable values of the National Environmental Quality (Emission) Guidelines because of the operation of near the factory and monitoring location, Sa Ka North Monastery which situated beside the road rang the wooden bell and passing through many motorcycles and cars and dog barking at the time of measurement. But Sa Ka Village is acceptable Applicable Operational Noise Criteria of 54 dB (A) from ESIA Report.

APPENDIX A

Description of Haz-scanner (EPAS)



Publication 1601 Rev 1405

HAZ-SCANNER EPAS

Wireless Environmental Perimeter Air Station



HAZ-SCANNER EPAS shown with optional solar panels

Performance Profile

The HAZ-SCANNER EPAS is optimized for ambient air applications; custom calibration for specific ranges or applications is available upon request.

Display	LCD real time
Operation	4-key splash-proof membrane switch
Power	12-V Absorption Glass Mat (AGM) rechargable battery, 100-240 V AC, or optional solar panel
Display Measurements	Max, Min, TWA, STEL
Recording Time	1 sec to 21 weeks
Sampling Rate	1 sec, 1 min, 10 min, 1 hr, adjustable
Data Storage	454,545 data points
Sampling Pump	1.0 to 3.0 L/min
Digital Output	RS-232 (PC), RS-423 (Mac)
Software	PC or Mac
Dimensions (weather-proof case)	8 x 14 x 10 in (19.2 x 35.6 x 25.4 cm)
Weight	12 lbs (5.4 kg)
Operating Temperature	23 to 122 F (-5 to 50 C)
Storage Temperature	-40 to 140 F (-40 to 60 C)
Humidity	95% non-condensing (use inlet heater)
Wireless Radio Modem	900 MHz (U.S.), 868 MHz (Euro) up to 5 miles - line of sight (optional)
Auxiliary Analog Input	0 to 2.5 VDC (1 channel for alternative meter)

Configure an EPAS for Up to 14 Simultaneous Measurements

The standard HAZ-SCANNER EPAS includes the monitor (calibrated for ambient air applications) with sensors/meters for PM10 or TSP, VOCs, temperature, humidity, and wind speed/direction in a NEMA 4 enclosure, acid gas scrubber, internal battery, universal 110-240 V AC battery charger, software, cables, and CD with instructions.

Configure the monitor with additional sensors/meters — up to 4 optional interchangable sensors with upgradable software and/or up to 4 EPAS-specific meters (listed below). See page 3 for specifications. ***Specify sensors and meters when ordering.***

- PM1.0, 2.5, or 4.0
- Ammonia (EC)
- Carbon Dioxide (NDIR)
- Carbon Monoxide (EC)
- Chlorine (EC)
- Ethylene Oxide (EL)
- Hydrocarbon (methane-specific, EC)
- Hydrocarbons (EC)
- Hydrogen Chloride (EL)
- Hydrogen Cyanide (EC)
- Hydrogen Sulfide (EC)
- Nitric Oxide (EC)
- Nitrogen Dioxide
- Oxygen
- Ozone
- Phosphine (EL)
- Sulfur Dioxide
- Rain
- Solar Radiance
- Sound and Noise
- Atomic Radiation
- ELF Radiation
- Barometric Pressure
- Dew Point Temperature
- Wet Bulb Temperature

Contact SKC to build an EPAS with available sensors/meters/calibration for your application!

SKC Limited Warranty and Return Policy

SKC products are subject to the SKC Limited Warranty and Return Policy, which provides SKC's sole liability and the buyer's exclusive remedy. To view the complete SKC Limited Warranty and Return Policy, go to http://www.skcinc.com/warranty.asp.

SKC Inc. 724-941-9701 SKC West 714-992-2780 SKC Gulf Coast 281-859-8050 SKC South 434-852-7149
www.skcinc.com

Publication 1801 Rev 1406

HAZ-SCANNER EPAS

Wireless Environmental Perimeter Air Station

HAZ-SCANNER EPAS Sensor/Meter Specifications

Parameter	Sensor*	Measurement/ Concentration Range	Accuracy	Minimum Resolution	Display Resolution	Additional Information
Particulates	90° infrared light scattering	0 to 5000 µg/m³	Greater of < ± 10% of reading or 0.2% full scale	10 µg/m³	1 µg/m³	Measures particle sizes: 10 µm or TSP (standard) or 1, 2.5, or 4 µm (optional) in the 0.1 to 100 µm size range
VOCs	PID (10.6 eV)	0 to 50,000 ppb (0 to 50 ppm)	Greater of < ± 10% of reading or 2% full scale	5 ppb	1 ppb	Minimum detection level is 0.01 ppm. Standard sensor
Toxic Gas: NH_3 - Ammonia	Gas-sensing semiconductor (GSS) technology	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: CO_2 - Carbon Dioxide	NDIR	0 to 5000 ppm	Greater of < ± 10% of reading or 2% full scale	50 ppm	1 ppm	Optional sensor
Toxic Gas: CO - Carbon Monoxide	Electrochemical	0 to 10,000 ppb (0 to 10 ppm)	Greater of < ± 10% of reading or 2% full scale	20 ppb	1 ppb	Optional sensor
Toxic Gas: Cl_2 - Chlorine	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: (C_2H_4O) - Ethylene Oxide	Electrochemical	0 to 1500 ppm	Greater of < ± 10% of reading or 2% full scale	8 ppm	1 ppm	Optional sensor
Toxic Gas: Hydrocarbon, CH_4 - Methane-specific	NDIR	0 to 1% Vol., 0 to 10,000 ppm, 0 to 20% LEL	Greater of < ± 10% of reading or 2% full scale	± 50 ppm or 0.1% LEL	50 ppm/ 0.1% LEL	Optional sensor
Toxic Gas: (Non-methane) Hydrocarbons (HC)	NDIR	Calibrated for 0 to 20% LEL of selected gas	Greater of < ± 10% of reading or 2% full scale	± 50 ppm/ 0.1% LEL	50 ppm/ 0.1% LEL	Optional sensor - specify gas type when ordering: ethane, propane, butane, hexane, ethanol, ethylene, or ethylene oxide
Toxic Gas: HCl - Hydrogen Chloride	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: HCN - Hydrogen Cyanide	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: H_2S - Hydrogen Sulfide	Electrochemical	0 to 25 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.15 ppm	0.1 ppm	Optional sensor
Toxic Gas: NO - Nitric Oxide	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: NO_2 - Nitrogen Dioxide	Electrochemical	0 to 5000 ppb (0 to 5 ppm)	Greater of < ± 10% of reading or 2% full scale	5 ppb	1 ppb	Optional sensor
Toxic Gas: O_2 - Oxygen	Electrochemical	0 to 30% Vol.	Greater of < ± 10% of reading or 2% full scale	0.6%	0.1%	Optional sensor
Toxic Gas: O_3 - Ozone	Gas-sensing semiconductor (GSS) technology	0 to 150 ppb (0 to 0.15 ppm), 0 to 500 ppb (0 to 0.5 ppm)	Greater of < ± 10% of reading or 2% full scale	1 ppb	1 ppb	Optional sensor
Toxic Gas: PH_3 - Phosphine	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: SO_2 - Sulfur Dioxide	Electrochemical	0 to 5000 ppb (0 to 5 ppm) for ambient applications	Greater of < ± 10% of reading or 2% full scale	5 ppb	1 ppb	Optional sensor

* Not approved for intrinsically safe applications; do not use in explosive gas environments.

Specifications continued on next page

SKC Inc. 724-941-9701 SKC West 714-992-2780 SKC Gulf Coast 281-859-8050 SKC South 434-852-7149
www.skcinc.com

HAZ-SCANNER EPAS

Wireless Environmental Perimeter Air Station

HAZ-SCANNER EPAS Sensor/Meter Specifications (con't)

Parameter	Sensor*	Measurement/ Concentration Range	Accuracy	Minimum Resolution	Display Resolution	Additional Information
Rain Fall/ Precipitation	Rain gauge (heated, tipping bucket)	0 to 5 inches daily	± 1% at 2 in/hr	0.01 in	0.01 in/tip	Optional meter
Temperature	NTC thermister	-4 to 140 F (-20 to 60 C)	Greater of ± 3% degree F or C of reading	1 degree F or C	1 degree F or C	Standard sensor
Relative Humidity (RH)	Thin-film capacitive	0 to 100% RH	± 2% RH	1% RH	1% RH	Standard sensor
Solar Radiance Intensity	Photodiode	1110 watts/ square meter (W/m^2)	± 5% of full scale (reference Eppley PSP at 1000 W/m^2)	1 W/m^2	1 W/m^2	Optional meter
Sound and Noise	Type 2 SLM	30 to 130 decibels (dB)	± 1.5 dB	0.1 dB	1 dB	Optional meter
Atomic Radiation	Geiger counter	1 to 19,999 counts per minute (cpm) or 0.001 to 100 milliRad/hr	± 10% Typical, ± 15% Max.	1 cpm or .001 mR/hr	1 cpm or .001 mR/hr	Optional meter
ELF Radiation	Sensor with single-axis probe	1 to 200 gauss (G)	± 10% or 5% FS	1 G	1 G	Optional meter
Wind Speed/ Direction	3-cup anemometer/ continuous rotation potentiometric wind direction vane	0 to 125 mph/ 5 to 355°	± 1 mph or ± 3%/± 3°	1 mph/1°	1 mph/1°	Standard sensor
Barometric Pressure	Piezo resistive	28.25 to 30.75 in Hg	± 0.09 in Hg	0.01 in Hg	0.01 in Hg	Optional sensor
Dew Point Temperature	Software calculation from RH and temperature	8.2 to 122 F (-15 to 50 C)	± 3 F	1 F	1 F	Optional meter - software calculated
Wet Bulb Temperature	Capsulated thermistor with wick	8.2 to 122 F (-15 to 50 C)	± 3 F	1 F	1 F	Optional meter - one meter

* Not approved for intrinsically safe applications; do not use in explosive gas environments.

SKC Inc. 724-941-9701 SKC-West 714-992-2780 SKC Gulf Coast 281-859-8050 SKC South 434-852-7149
www.skcinc.com

Calibration Certificate for Haz-scanner

NANOVA Co.,Ltd.
Medical Scientific Industrial

SYSTEM HEALTH CHECK REPORT

Information

Instrument	Hazscanner
Model	EPAS
Serial number	915081
Unit Sensor	CO, NO_2, CO_2, SO_2 PM_{10}, $PM_{2.5}$
Customer	Eguard
Date	2025 August 13th

Check List

Physical Check	OK
Supply Voltage Check	OK
PM 10 Air Flow Check	OK
PM2.5 Air Flow Check	OK
Internal Backup Battery Voltage Check	OK
NO2 Sensor Health Check	Moderate
CO2,SO2,CO Sensor Health Check	Still Good
Lithium Battery Voltage Check	Not OK
Data Logging Check	OK
Data Downloading Check	OK

Recommend

Need to replace Lithium battery.
Need to replace new acid gas scrubber (every 6 months).
Need to replace internal filters (every 6 months).
Need to perform factory calibration or in-field calibration (every 12 months).

Performed by

Phoe Saw Htoo
Technical Service Engineer
NANOVA CO., LTD

Approved by

Myo Oo
Technical Service Manager
NANOVA CO., LTD

Yangon 22-A, Shan Yeiktar Street, Sanchaung Township, Tel: +95 (1) 230 4901, 230 4902
Nay Pyi Taw Za /30, Ziwaka Say Sine Tan, Tha Phay Khone, Pyinmanar **Tel** 067 810 8083
Mandalay 153(B), 73rd Street, Bet 33x34 Street, ChanAye Tharzan Tsp. **Tel** 09 791 360000
Email contact@nanovapteltd.com Website: www.nanova-scientific.com
helpline 09 421 360000 , 09 451 360000

Calibration Certificate for Sound Level Meter

SCIENCE WORKSHOP
CALIBRATION CERTIFICATE

Submitted by	:	e guard Environmental Services No.(145-A2-3), Thiri Mingalar Street, Ward No.(4), 8th Mile, Mayangone Township, Yangon 11062, Myanmar.
Location	:	U Soe Min (Director)
Instrument	:	Digital Sound Level Meter (BENETECH, GM 1356) Sr No. GG: 2439187 (30dB – 130dB)
Instrument Reference No.:		eg – DSLM – 08
Test Equipment	:	Dual Trace Oscilloscope, Signal Generator and Digital Multimeter (7534-02, Yokogawa Japan)
Ambient Temperature	:	24°C
Permissible Error	:	± 1 % dB
Calibration Date	:	21th January 2025 Next due date 21th January 2026

We certified that this instrument has been calibrated to JAPAN standard under the condition stated above .

1. **Method of Calibration**

Measure and compare the Frequency Linearity and Sound Level with above instrument and test instrument same source, the effect which the hall has on sound at the same time so that people can hear.

2. **Result Calibration**

Measurement	Instrument	Test Equipment	Correction
Frequency	31.5 Hz	31.5 Hz	-
	150 Hz	150 Hz	-
	500 Hz	500 Hz	-
	1 KHz	1 KHz	-
	6 KHz	6 KHz	-
Level	30 dB	30 dB	-
	60 dB	60 dB	-
	90 dB	90 dB	-
	100 dB	100 dB	-
	120 dB	120 dB	-
	130 dB	130 dB	-

This instrument is suitable for use and comply with standard given by manufacture.

Calibrated by:

Ba Thein Sein
Senior Skilled Technician
SCIENCE EQUIPMENT (Lab) SERVICE

APPENDIX B

Field Photos

Air Monitoring Point at Sa Ka Village (ASR4) Lat- 21°23’48.591”, Long- 95°23’0.849” 01.12.2025 to 02.12.2025	
Air Monitoring Point at Hnan Village (ASR3) Lat- 21°22’17.565”, Long- 95°23’18.116” 02.12.2025 to 03.12.2025	

Air Monitoring Point at Gyoke Pin Village (ASR5) Lat- 21°24’21.888”, Long- 95°21’07.381” 03.12.2025 to 04.12.2025	
Air Monitoring Point at Nyaung Kan Village (ASR14) Lat- 21°21’58.048”, Long- 95°20’51.346” 04.12.2025 to 05.12.2025	

Sembcorp Myingyan Power Co., Ltd.

Environmental Monitoring Report

(Air Quality Monitoring)



Prepared

Ref: 10.03.2026 to 14.03.2026 (Air Quality Report)

30 March 2026

E Guard Environmental Services

Report Review Form

Report Title: Environmental Quality Monitoring Report in March 2026 For Sembcorp Myingyan Power Plant	
Report Version:	
Proponent: Sembcorp Myingyan Power Plant	**Prepared by;** **E Guard Environmental Services Co., Ltd.** No. (145- A2- 3), Thiri Mingalar Street, Ward No. (4), 8th Mile, Mayangone Township, Yangon 11062, Myanmar. Tel: 01 667953, Fax: 01 6667953, info@eguardservices.com Mobile +959 797005199

Prepared by: U Aung Moe Oo	**Position: Assistant Consultant**
Submitted Date: 30/03/2026	**Signature:**
Checked by: U Aung Myint Myat	**Position: Consultant**
Checked Date: 30/03/2026	**Signature:**

Approved by:

Table of Contents

List of Figures ii

List of Tables iii

1. INTRODUCTION 1

2. METHODOLOGY 1

2.1 Ambient Air Quality 1

2.2 Ambient Noise 1

3. MONITORING LOCATIONS 3

4. ENVIRONMENTAL QUALITY MONITORING RESULTS 5

4.1 Ambient Air Quality Monitoring Results 5

4.2 Wind Speed and Direction 13

4.3 Ambient Noise 17

APPENDIX A 21

APPENDIX B 28

List of Figures

Figure 3. 1 Location of Monitoring Points 3

Figure 4. 1 PM Monitoring Results at Sa Ka Village 5

Figure 4. 2 PM Monitoring Results at Hnan Village 5

Figure 4. 3 PM Monitoring Results at Gyoke Pin Village 6

Figure 4. 4 PM Monitoring Results at Nyaung Kan Village 6

Figure 4. 5 Fluctuation of Air Pollutants during dial cycle (Sa Ka Village) 6

Figure 4. 6 Fluctuation of Air Pollutants during dial cycle (Hnan Village) 7

Figure 4. 7 Fluctuation of Air Pollutants during dial cycle (Gyoke Pin Village) 7

Figure 4. 8 Fluctuation of Air Pollutants during dial cycle (Nyaung Kan Village) 7

Figure 4. 9 Wind Speed and Wind Direction (Blowing From) at Sa Ka Village (ASR4) 13

Figure 4. 10 Wind Class Frequency Distribution at Sa Ka Village (ASR4) 13

Figure 4. 11 Wind Speed and Wind Direction (Blowing From) at Hnan Village (ASR3) 14

Figure 4. 12 Wind Class Frequency Distribution at Hnan Village (ASR3) 14

Figure 4. 13 Wind Speed and Wind Direction (Blowing From) at Gyoke Pin Village (ASR5) 15

Figure 4. 14 Wind Class Frequency Distribution at Gyoke Pin Village (ASR5) 15

Figure 4. 15 Wind Speed and Wind Direction (Blowing From) at Nyaung Kan Village (ASR14) 16

Figure 4. 16 Wind Class Frequency Distribution at Nyaung Kan Village (ASR14) 16

Figure 4. 17 Noise Level at near Sembcorp Myingyan Power Plant 18

Figure 4. 18 Noise Level at Sa Ka Village 19

List of Tables

Table 2. 1 Ambient Air Quality Parameters 1

Table 2. 2 Air Quality Guideline Values 1

Table 2. 3 Noise level monitoring 2

Table 2. 4 Equipment used to measure ambient air and noise measurement 2

Table 3. 1 Location of Monitoring Points 4

Table 4. 1 Observed Ambient Air Quality Results from Selected Points 5

Table 4. 2 Air Monitoring Results (Sa Ka Village) 9

Table 4. 3 Air Monitoring Results (Hnan Village) 10

Table 4. 4 Air Monitoring Results (Gyoke Pin Village) 11

Table 4. 5 Air Monitoring Results (Nyaung Kan Village) 12

Table 4. 6 Observed Values of Noise Level Measurement at near Sembcorp Myingyan Power Plant 17

Table 4. 7 Observed Values of Noise Level Measurement at Sa Ka Village 18

Table 4. 8 Observed Ambient Noise level Results from Myingyan Power Plant 19

Table 4. 9 Observed Ambient Noise level Results from Sa Ka Village 19

Table 4. 10 National Environmental Quality (Emission) Guidelines Values for Noise Level 20

1. INTRODUCTION

This report is environmental monitoring (only air and noise quality monitoring) for Sembcorp Myingyan Power Plant which is located beside of Myingyan – Nyaung-Oo Road, near the Sa Ka village in Mandalay Region.

2. METHODOLOGY

Baseline environmental parameters and sampling locations were defined according to the objectives for environmental monitoring purposes. Locations for sampling and analysis of ambient air quality of the project site were identified by Sembcorp Myingyan Power Co,ltd.

2.1 Ambient Air Quality

The emissions of dust particles and gases were measured for 24hrs continuously at the selected sites by using the Environmental Perimeter Air Station (EPAS), and EPAS provides direct readings in real time with data-logging capabilities. The monitoring results were compared with National Environmental Quality (Emission) Guideline (NEQG), World Health Organization (WHO) and American Conference of Governmental Industrial Hygienists (ACGIH) guidelines.

Table 2. 1 Ambient Air Quality Parameters

Ambient Air Quality (4 locations)	
Gas Emission	CO, CO_2, SO_2, NO_2
Dust Emission	PM_{10}, $PM_{2.5}$

Table 2. 2 Air Quality Guideline Values

Parameters	Guidelines Value	Unit	Organization	Averaging Period
PM_{10}	50	$\mu g/m^3$	NEQ	24hrs
$PM_{2.5}$	25	$\mu g/m^3$	NEQ	24hrs
CO	9	ppm	NAAQS	8hrs
CO_2	5000	ppm	ACGIH	8hrs
SO_2	20	$\mu g/m^3$	NEQ	24hrs
NO_2	200	$\mu g/m^3$	NEQ	24hrs

Source: Myanmar National Environmental Quality (Emission) Guidelines, December 2015 & Air quality guidelines global update. 2005. World Health Organization.

2.2 Ambient Noise

Noise level LAeq (dBA) will be measured at the selected locations that can reflect the exposure of the nearest local community and sensitive locations. Duration and frequency were measured for 24hrs continuously at the selected site using the Noise Meter.

The monitoring procedures, data analysis and interpretation were carried out in accordance with the instrument's manufacture and National Environmental Quality (Emission) Guidelines, World Health Organization (WHO) and International Finance Corporation (IFC guidelines in order to be in line with Environmental Conservation Department, Ministry of Natural Resources and Environment Conservation (MONREC). "National Environmental Quality

(Emission) Guidelines" for Myanmar was also presented the value of noise level as LAeq (dBA).

Table 2. 3 Noise level monitoring

Noise monitoring (2 locations)	
Noise Emission	LAeq (dBA) (1hrs, 24 hrs.)

Equipment used to measure ambient air and noise measurement are shown below (**Table 2. 4**).

Table 2. 4 Equipment used to measure ambient air and noise measurement

Davis Vantage Pro2 Wireless Weather Station Provides detailed current weather conditions and expanded forecasts - all at a glance! The Vantage Pro2 uses a frequency-hopping spread spectrum radio from 902 MHz to 928 MHz to transmit and receive data up to 1,000' (300m) line of sight. In addition, the weather station features a bubble level, improved anemometer base, redesigned wind cups, and factory-calibrated wind direction. The integrated sensor suite combines temperature and humidity sensors, rain collector with an aluminum-plated tipping bucket, and anemometer into one package for easy setup. Measure inside and outside temperature and humidity, heat index, barometric pressure, dew point, rainfall, wind direction and speed, and wind chill.	
Haz-Scanner EPAS PM_{10}, PM $_{2.5}$, NO_2, SO_2, CO, CO_2, Temperature, and Relative Humidity	
Digital Sound Level Meter Noise and Vibration	

3. MONITORING LOCATIONS

Locations of sampling sites were identified by Sembcorp Myingyan Power Co,ltd. Air quality was monitored at the four selected locations that are Sa Ka Village (ASR4), Hnan Village (ASR3), Gyoke Pin Village (ASR 5) and Nyaung Kan Village (ASR 14).

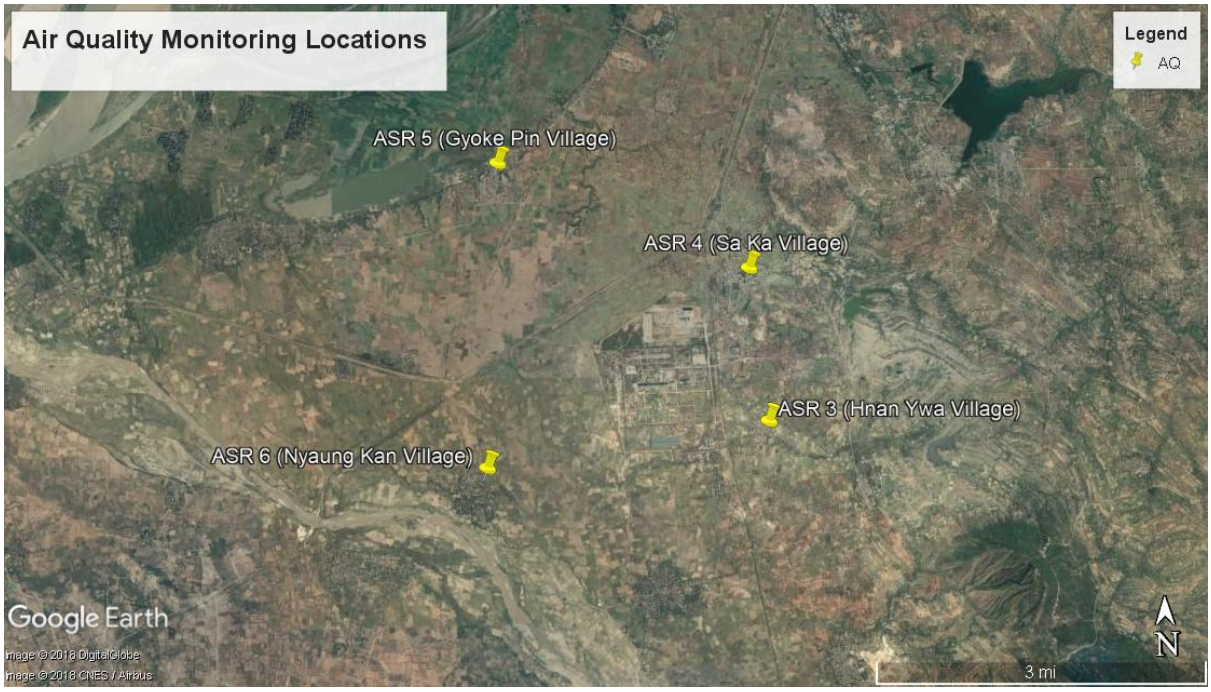


Figure 3. 1 Location of Monitoring Points for Air Quality

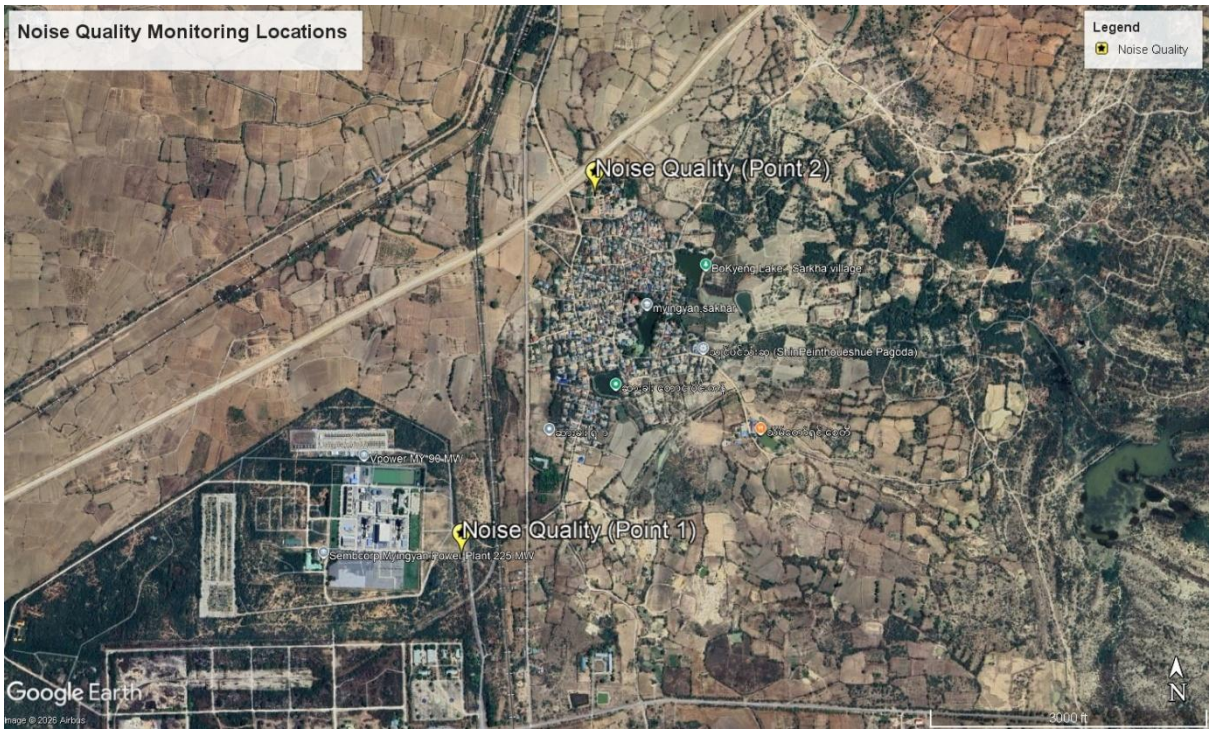


Figure 3. 2 Location of Monitoring Points for Noise Quality

Table 3. 1 Location of Monitoring Points

Locations No.	Points	Coordinate	Locations
Ambient Air Quality Monitoring Locations			
1	ASR4	Lat- 21°23’48.591”, Long- 95°23’0.849”	Sa Ka Village
2	ASR3	Lat- 21°22’17.565”, Long- 95°23’18.116”	Hnan Village
3	ASR5	Lat- 21°24’21.888”, Long- 95°21’7.381”	Gyoke Pin Village
4	ASR14	Lat- 21°21’44.570”, Long- 95°20’55.035”	Nyaung Kan Village
Noise Quality Monitoring Locations			
1	Noise 1	Lat- 21°23’48.591”, Long- 95°23’0.849”	Near Sembcorp Myingyan Power Plant
2	Noise 2	Lat- 21°23’48.591”, Long- 95°23’0.849”	Sa Ka Village

4. ENVIRONMENTAL QUALITY MONITORING RESULTS

4.1 Ambient Air Quality Monitoring Results

24 hours air quality monitoring were done at each selected location from 10th March 2026 to 14th March 2026. The measured results are compared with national emission guidelines. Based on the results of air quality monitoring, all of the parameters are within the guidelines.

Table 4. 1 Observed Ambient Air Quality Results from Selected Points

Parameters	Observed Value				Guidelines Value	Unit	Averaging Period
	ASR4	ASR3	ASR5	ASR14			
PM_{10}	16.08	14.17	11.71	13.86	50	$\mu g/m^3$	24hrs
$PM_{2.5}$	8.03	7.26	6.09	7.03	25	$\mu g/m^3$	24hrs
CO	0.0023	0.0027	0.0023	0.0025	9	ppm	8hrs
CO_2	422.19	402.80	391.82	407.56	5000	ppm	8hrs
SO_2	5.77	5.24	6.81	5.76	20	$\mu g/m^3$	24hrs
NO_2	6.49	5.75	6.67	5.03	200	$\mu g/m^3$	1hrs

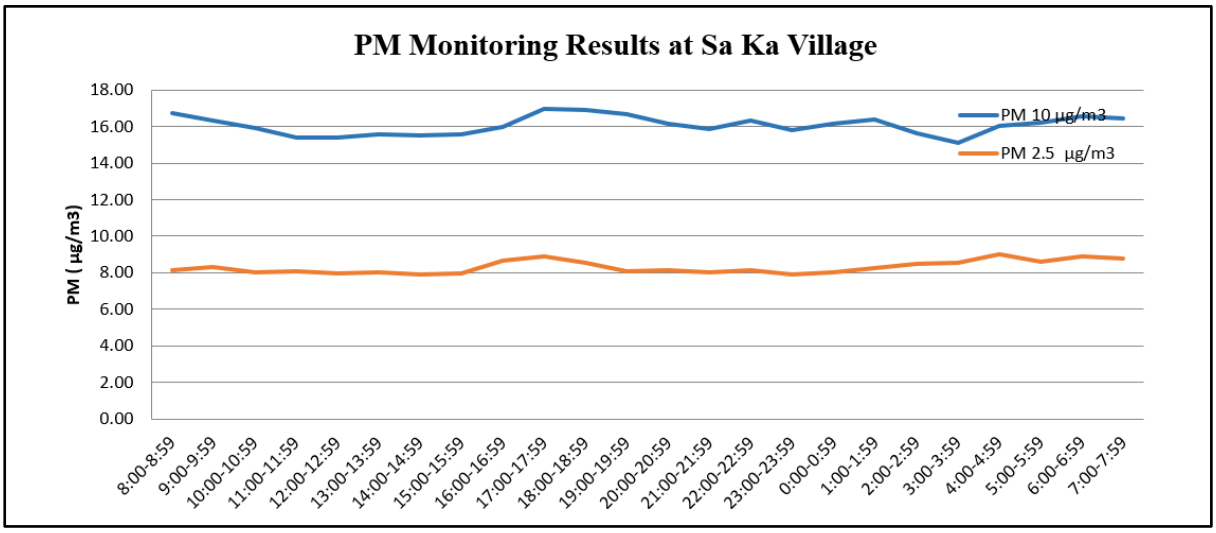


Figure 4. 1 PM Monitoring Results at Sa Ka Village

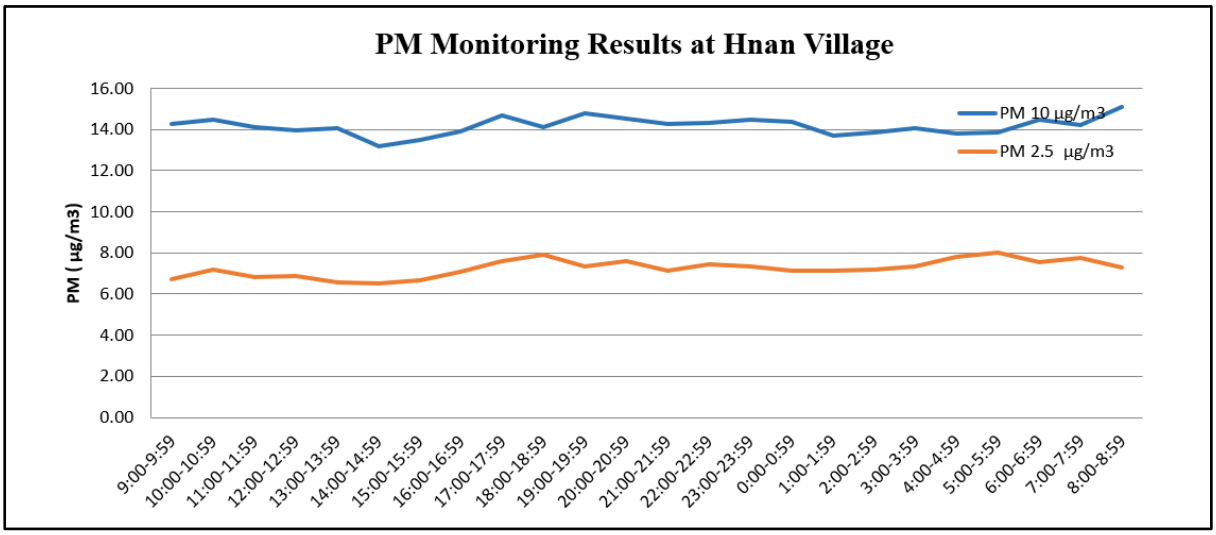


Figure 4. 2 PM Monitoring Results at Hnan Village

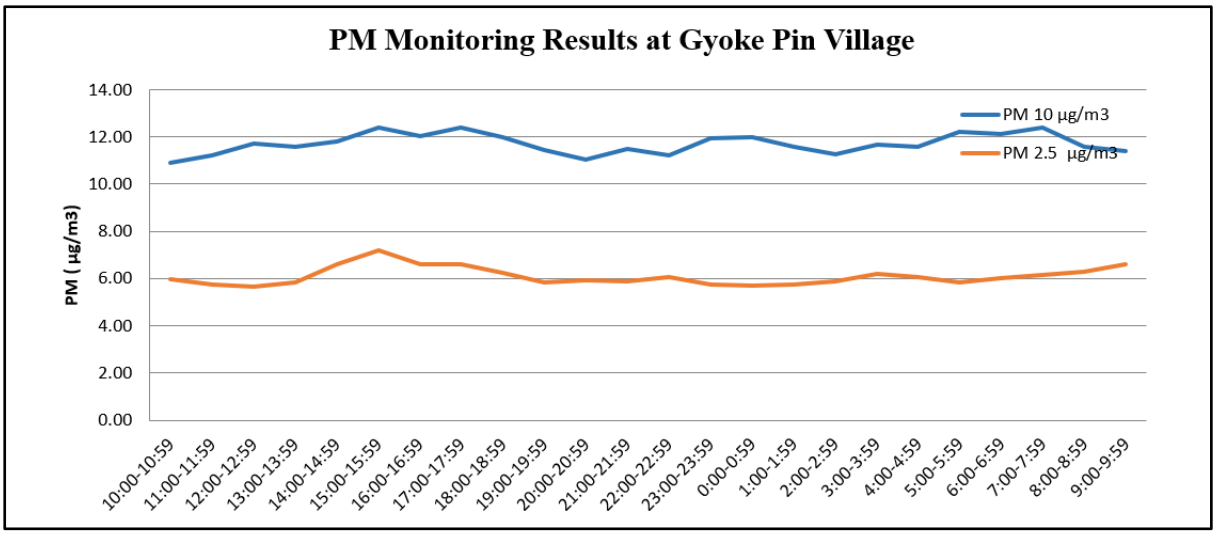


Figure 4. 3 PM Monitoring Results at Gyoke Pin Village

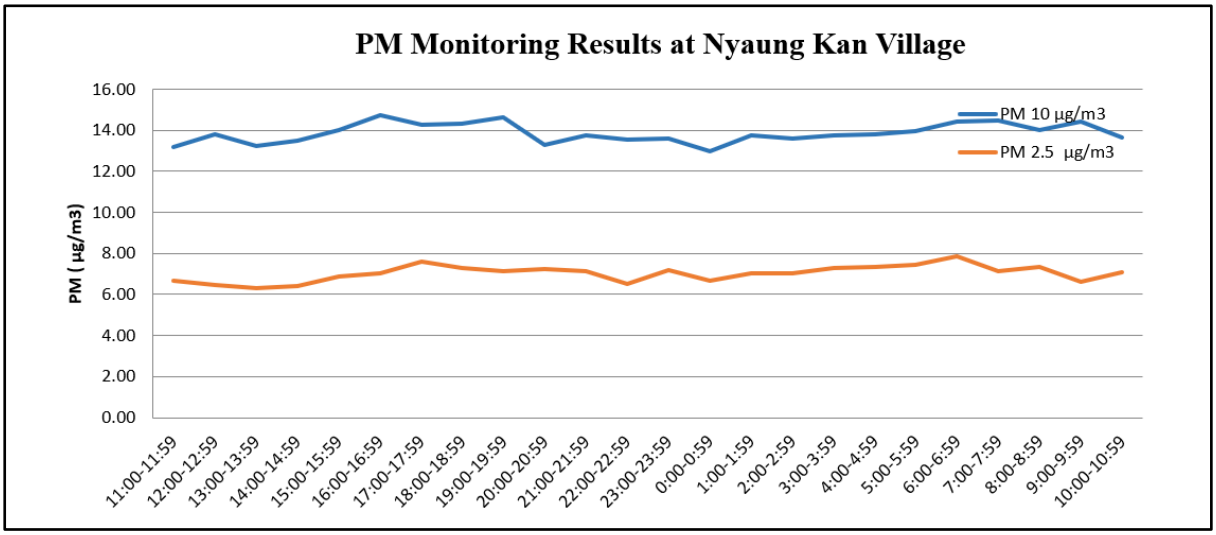


Figure 4. 4 PM Monitoring Results at Nyaung Kan Village

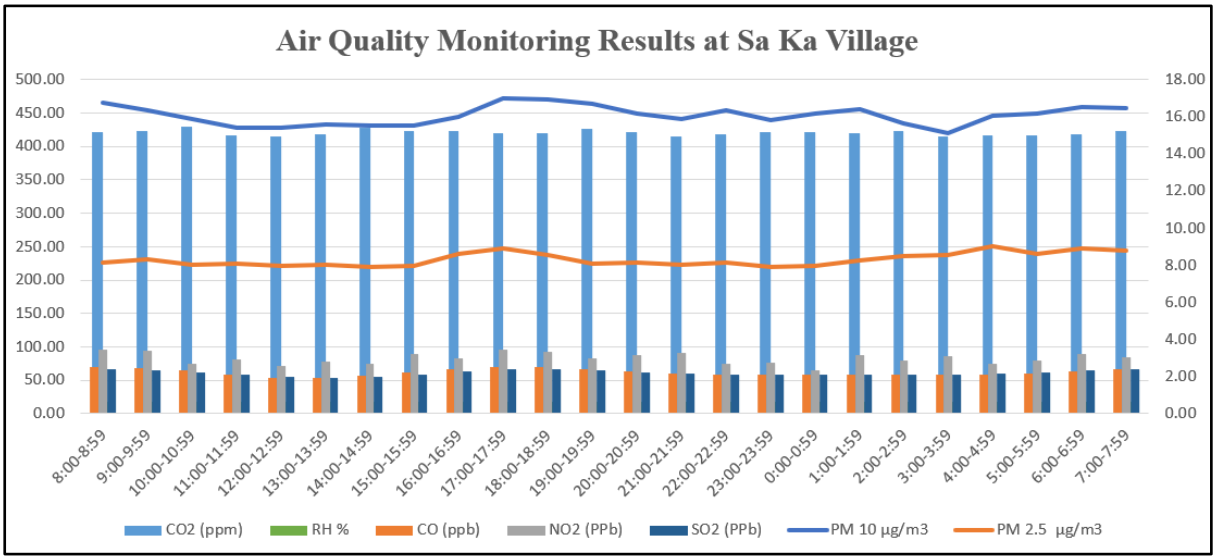


Figure 4. 5 Fluctuation of Air Pollutants during dial cycle (Sa Ka Village)

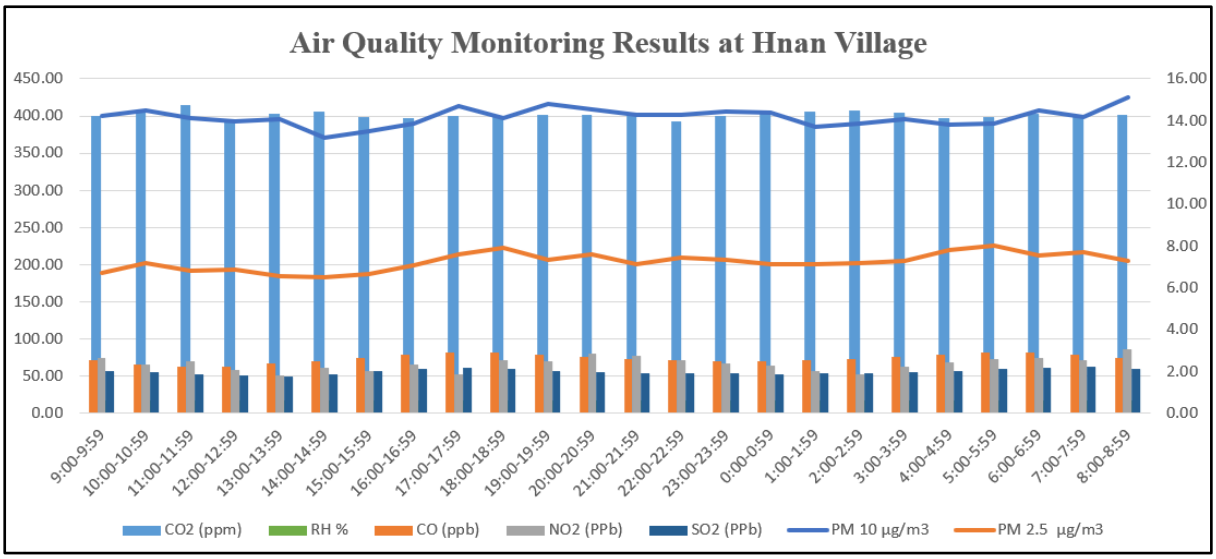


Figure 4. 6 Fluctuation of Air Pollutants during dial cycle (Hnan Village)

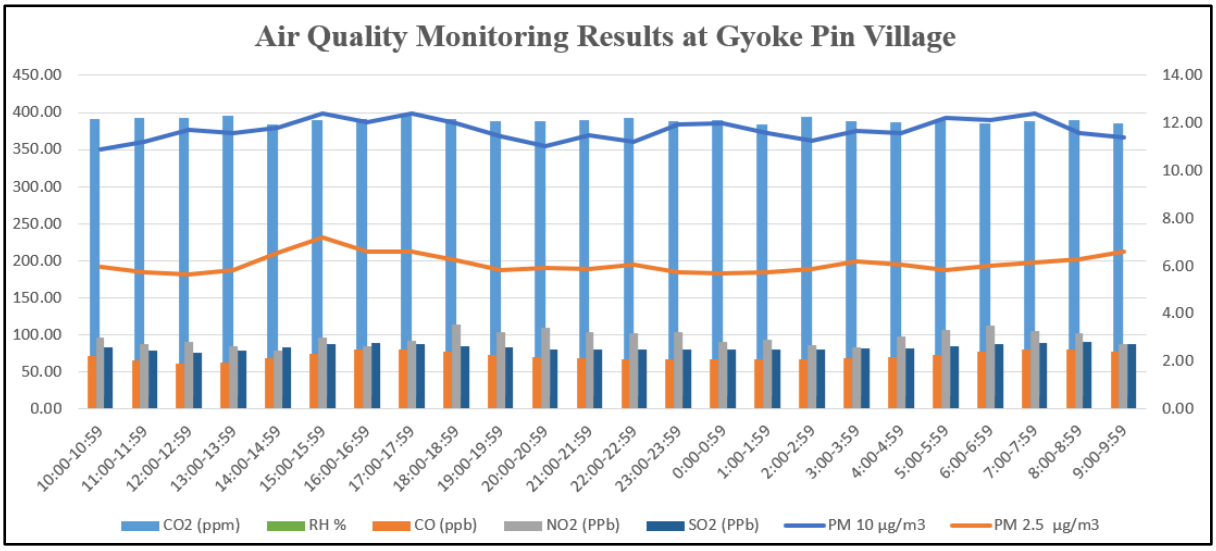


Figure 4. 7 Fluctuation of Air Pollutants during dial cycle (Gyoke Pin Village)

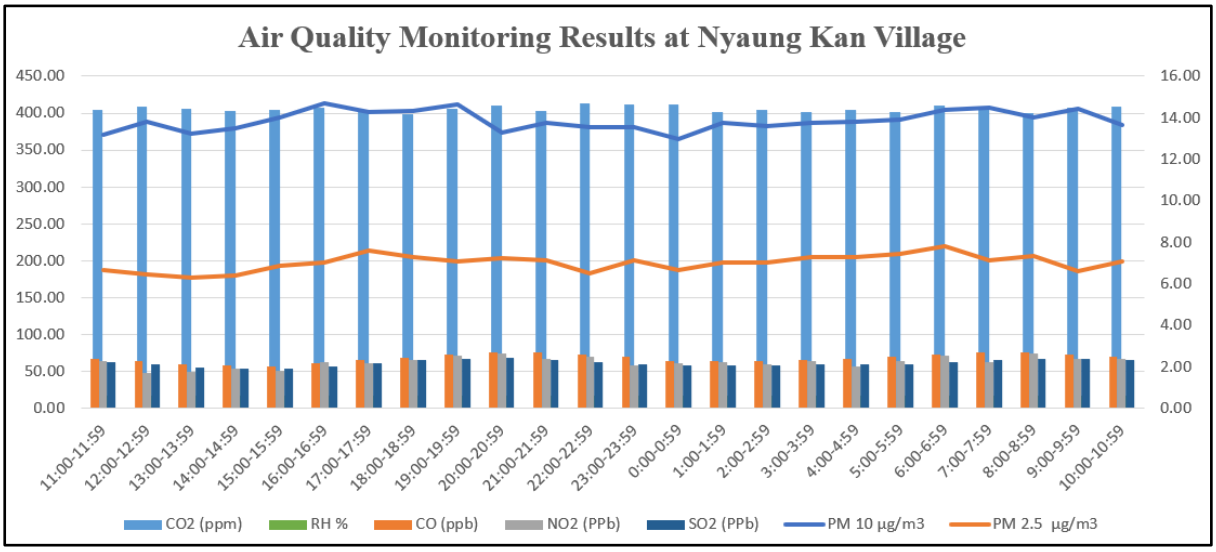


Figure 4. 8 Fluctuation of Air Pollutants during dial cycle (Nyaung Kan Village)

Detail results with one-hour interval of pollutants are shown in **Table 4. 2** to **Table 4. 5.** All results are under the Myanmar National Environmental Quality (emission) Guidelines. So, Sembcorp Myingyan Power Plant is acceptable for environment.

Table 4. 2 Air Monitoring Results (Sa Ka Village)

Date	Time		CO_2 (ppm)	CO (ppb)	NO_2 (ppb)	PM_{10} µg/m^3	$PM_{2.5}$ µg/m^3	RH %	SO_2 (ppb)
10.03.2026	8:00-8:59	Average	421.85	2.49	3.43	16.73	8.17	17.50	2.43
10.03.2026	9:00-9:59	Average	422.80	2.47	3.39	16.35	8.32	17.58	2.34
10.03.2026	10:00-10:59	Average	429.19	2.34	2.69	15.90	8.01	17.69	2.24
10.03.2026	11:00-11:59	Average	417.18	2.12	2.92	15.42	8.07	17.61	2.12
10.03.2026	12:00-12:59	Average	415.18	1.95	2.56	15.41	7.95	17.70	2.00
10.03.2026	13:00-13:59	Average	418.86	1.92	2.81	15.60	8.03	17.72	1.94
10.03.2026	14:00-14:59	Average	428.60	2.03	2.67	15.53	7.90	17.74	1.96
10.03.2026	15:00-15:59	Average	423.88	2.22	3.22	15.55	7.97	17.85	2.11
10.03.2026	16:00-16:59	Average	422.74	2.39	2.99	16.00	8.64	17.82	2.27
10.03.2026	17:00-17:59	Average	419.95	2.50	3.45	16.97	8.91	17.91	2.39
10.03.2026	18:00-18:59	Average	420.07	2.50	3.34	16.93	8.56	17.97	2.41
10.03.2026	19:00-19:59	Average	427.14	2.42	2.99	16.71	8.08	17.99	2.34
10.03.2026	20:00-20:59	Average	421.05	2.31	3.14	16.17	8.12	17.99	2.25
10.03.2026	21:00-21:59	Average	414.66	2.18	3.26	15.88	8.01	18.06	2.18
10.03.2026	22:00-22:59	Average	418.40	2.12	2.70	16.34	8.12	17.96	2.13
10.03.2026	23:00-23:59	Average	422.18	2.11	2.74	15.81	7.88	17.77	2.10
11.03.2026	0:00-0:59	Average	421.43	2.09	2.32	16.18	8.00	17.97	2.10
11.03.2026	1:00-1:59	Average	419.33	2.12	3.13	16.40	8.28	17.75	2.11
11.03.2026	2:00-2:59	Average	423.65	2.11	2.85	15.67	8.49	17.74	2.12
11.03.2026	3:00-3:59	Average	415.56	2.11	3.13	15.14	8.54	17.81	2.13
11.03.2026	4:00-4:59	Average	416.80	2.13	2.70	16.05	9.01	17.66	2.17
11.03.2026	5:00-5:59	Average	416.52	2.18	2.85	16.19	8.59	17.69	2.24
11.03.2026	6:00-6:59	Average	418.04	2.29	3.21	16.55	8.89	17.47	2.34
11.03.2026	7:00-7:59	Average	423.83	2.42	3.05	16.48	8.76	17.54	2.40
Average			**420.79**	**2.23**	**2.98**	**16.08**	**8.30**	**17.77**	**2.20**
1 hour Minimum			414.66	1.92	2.32	15.14	7.88	17.47	1.94
1 hour Maximum			429.19	2.50	3.45	16.97	9.01	18.06	2.43

Table 4. 3 Air Monitoring Results (Hnan Village)

Date	Time		CO_2 (ppm)	CO (ppb)	NO_2 (ppb)	PM_{10} µg/m^3	$PM_{2.5}$ µg/m^3	RH %	SO_2 (ppb)
11.03.2026	9:00-9:59	Average	400.56	2.53	2.67	14.25	6.73	17.24	2.05
11.03.2026	10:00-10:59	Average	405.63	2.37	2.32	14.46	7.17	17.35	1.96
11.03.2026	11:00-11:59	Average	415.32	2.24	2.48	14.14	6.83	17.32	1.88
11.03.2026	12:00-12:59	Average	396.44	2.26	2.09	13.94	6.86	17.50	1.80
11.03.2026	13:00-13:59	Average	403.17	2.38	1.85	14.08	6.59	17.50	1.77
11.03.2026	14:00-14:59	Average	406.36	2.51	2.17	13.17	6.53	17.44	1.85
11.03.2026	15:00-15:59	Average	398.42	2.66	2.04	13.49	6.69	17.68	2.01
11.03.2026	16:00-16:59	Average	396.51	2.83	2.34	13.88	7.10	17.63	2.15
11.03.2026	17:00-17:59	Average	399.79	2.90	1.89	14.70	7.60	17.63	2.18
11.03.2026	18:00-18:59	Average	398.60	2.91	2.55	14.11	7.93	17.87	2.14
11.03.2026	19:00-19:59	Average	401.67	2.82	2.50	14.78	7.34	17.82	2.04
11.03.2026	20:00-20:59	Average	402.11	2.70	2.88	14.55	7.58	17.90	1.97
11.03.2026	21:00-21:59	Average	404.45	2.60	2.77	14.28	7.16	17.88	1.93
11.03.2026	22:00-22:59	Average	392.85	2.53	2.57	14.29	7.44	17.91	1.91
11.03.2026	23:00-23:59	Average	400.61	2.51	2.40	14.46	7.35	17.79	1.92
12.03.2026	0:00-0:59	Average	403.98	2.50	2.30	14.37	7.16	17.77	1.89
12.03.2026	1:00-1:59	Average	406.59	2.54	2.04	13.69	7.15	17.69	1.91
12.03.2026	2:00-2:59	Average	407.14	2.59	1.85	13.87	7.21	17.65	1.93
12.03.2026	3:00-3:59	Average	404.52	2.69	2.22	14.05	7.32	17.70	1.97
12.03.2026	4:00-4:59	Average	397.11	2.81	2.43	13.80	7.80	17.62	2.05
12.03.2026	5:00-5:59	Average	399.28	2.90	2.58	13.86	8.03	17.51	2.14
12.03.2026	6:00-6:59	Average	402.82	2.90	2.68	14.49	7.55	17.37	2.21
12.03.2026	7:00-7:59	Average	401.58	2.82	2.56	14.19	7.73	17.41	2.22
12.03.2026	8:00-8:59	Average	402.06	2.67	3.06	15.11	7.31	17.38	2.13
Average			**401.98**	**2.63**	**2.38**	**14.17**	**7.26**	**17.61**	**2.00**
1 hour Minimum			392.85	2.24	1.85	13.17	6.53	17.24	1.77
1 hour Maximum			415.32	2.91	3.06	15.11	8.03	17.91	2.22

Table 4. 4 Air Monitoring Results (Gyoke Pin Village)

Date	Time		CO_2 (ppm)	CO (ppb)	NO_2 (ppb)	PM_{10} µg/m^3	$PM_{2.5}$ µg/m^3	RH %	SO_2 (ppb)
12.03.2026	10:00-10:59	Average	390.65	2.23	3.01	10.90	5.96	17.50	2.60
12.03.2026	11:00-11:59	Average	392.47	2.04	2.75	11.22	5.74	17.58	2.47
12.03.2026	12:00-12:59	Average	393.48	1.91	2.81	11.71	5.64	17.69	2.38
12.03.2026	13:00-13:59	Average	395.77	1.95	2.66	11.56	5.85	17.61	2.46
12.03.2026	14:00-14:59	Average	384.62	2.12	2.44	11.80	6.58	17.70	2.61
12.03.2026	15:00-15:59	Average	390.44	2.34	2.99	12.38	7.21	17.72	2.75
12.03.2026	16:00-16:59	Average	390.85	2.49	2.65	12.04	6.59	17.74	2.80
12.03.2026	17:00-17:59	Average	396.30	2.50	2.89	12.40	6.60	17.85	2.74
12.03.2026	18:00-18:59	Average	391.61	2.41	3.55	12.00	6.23	17.82	2.65
12.03.2026	19:00-19:59	Average	388.63	2.29	3.25	11.47	5.84	17.91	2.59
12.03.2026	20:00-20:59	Average	388.47	2.20	3.44	11.04	5.91	17.97	2.53
12.03.2026	21:00-21:59	Average	389.98	2.14	3.24	11.49	5.87	17.99	2.50
12.03.2026	22:00-22:59	Average	392.16	2.11	3.18	11.22	6.06	17.99	2.51
12.03.2026	23:00-23:59	Average	388.14	2.10	3.23	11.93	5.73	18.06	2.50
13.03.2026	0:00-0:59	Average	390.29	2.10	2.81	12.00	5.71	17.96	2.49
13.03.2026	1:00-1:59	Average	384.30	2.10	2.92	11.56	5.75	17.77	2.49
13.03.2026	2:00-2:59	Average	394.31	2.11	2.71	11.25	5.86	17.97	2.52
13.03.2026	3:00-3:59	Average	388.66	2.13	2.61	11.67	6.20	17.75	2.54
13.03.2026	4:00-4:59	Average	387.12	2.20	3.07	11.60	6.05	17.74	2.55
13.03.2026	5:00-5:59	Average	389.91	2.29	3.34	12.21	5.86	17.81	2.65
13.03.2026	6:00-6:59	Average	385.83	2.40	3.53	12.11	6.04	17.66	2.72
13.03.2026	7:00-7:59	Average	388.88	2.49	3.30	12.39	6.14	17.69	2.79
13.03.2026	8:00-8:59	Average	390.15	2.51	3.19	11.59	6.27	17.47	2.81
13.03.2026	9:00-9:59	Average	386.00	2.40	2.74	11.41	6.62	17.54	2.72
Average			**389.96**	**2.23**	**3.01**	**11.71**	**6.09**	**17.77**	**2.60**
1 hour Minimum			384.30	1.91	2.44	10.90	5.64	17.47	2.38
1 hour Maximum			396.30	2.51	3.55	12.40	7.21	18.06	2.81

Table 4. 5 Air Monitoring Results (Nyaung Kan Village)

Date	Time		CO_2 (ppm)	CO (ppb)	NO_2 (ppb)	PM_{10} µg/m3	$PM_{2.5}$ µg/m3	RH %	SO_2 (ppb)
13.03.2026	11:00-11:59	Average	404.77	2.37	2.28	13.17	6.65	17.26	2.23
13.03.2026	12:00-12:59	Average	408.18	2.27	1.71	13.82	6.48	17.33	2.12
13.03.2026	13:00-13:59	Average	405.87	2.13	1.80	13.26	6.32	17.35	2.00
13.03.2026	14:00-14:59	Average	403.15	2.07	1.91	13.49	6.39	17.42	1.92
13.03.2026	15:00-15:59	Average	404.08	2.06	1.80	14.02	6.89	17.34	1.93
13.03.2026	16:00-16:59	Average	407.86	2.16	2.25	14.71	7.06	17.47	2.03
13.03.2026	17:00-17:59	Average	402.37	2.32	2.21	14.26	7.59	17.44	2.18
13.03.2026	18:00-18:59	Average	398.28	2.47	2.34	14.34	7.28	17.58	2.32
13.03.2026	19:00-19:59	Average	405.83	2.63	2.57	14.63	7.11	17.65	2.41
13.03.2026	20:00-20:59	Average	410.06	2.71	2.68	13.31	7.23	17.66	2.42
13.03.2026	21:00-21:59	Average	402.80	2.70	2.39	13.77	7.11	17.89	2.34
13.03.2026	22:00-22:59	Average	412.71	2.62	2.48	13.55	6.54	17.74	2.25
13.03.2026	23:00-23:59	Average	411.72	2.49	2.07	13.57	7.16	17.69	2.16
14.03.2026	0:00-0:59	Average	411.45	2.30	2.16	12.99	6.68	17.72	2.09
14.03.2026	1:00-1:59	Average	401.41	2.30	2.22	13.76	7.03	17.59	2.09
14.03.2026	2:00-2:59	Average	404.53	2.31	2.12	13.58	7.04	17.54	2.11
14.03.2026	3:00-3:59	Average	402.15	2.35	2.28	13.76	7.29	17.63	2.11
14.03.2026	4:00-4:59	Average	404.58	2.39	2.05	13.79	7.32	17.44	2.13
14.03.2026	5:00-5:59	Average	400.87	2.50	2.28	13.94	7.47	17.46	2.16
14.03.2026	6:00-6:59	Average	409.70	2.62	2.54	14.41	7.84	17.36	2.25
14.03.2026	7:00-7:59	Average	405.25	2.70	2.23	14.49	7.12	17.36	2.34
14.03.2026	8:00-8:59	Average	400.59	2.70	2.63	14.03	7.36	17.37	2.41
14.03.2026	9:00-9:59	Average	407.82	2.61	2.41	14.41	6.63	17.36	2.39
14.03.2026	10:00-10:59	Average	408.67	2.48	2.41	13.63	7.10	17.32	2.33
Average			**405.61**	**2.43**	**2.24**	**13.86**	**7.03**	**17.50**	**2.20**
1 hour Minimum			398.28	2.06	1.71	12.99	6.32	17.26	1.92
1 hour Maximum			412.71	2.71	2.68	14.71	7.84	17.89	2.42

4.2 Wind Speed and Direction

The following figure describes the wind speed and wind direction of the proposed project site on, 10th March 2026 to 14th March 2026 respectively. According to the data, the wind direction is following **Figure 4. 9 to Figure 4. 16.**

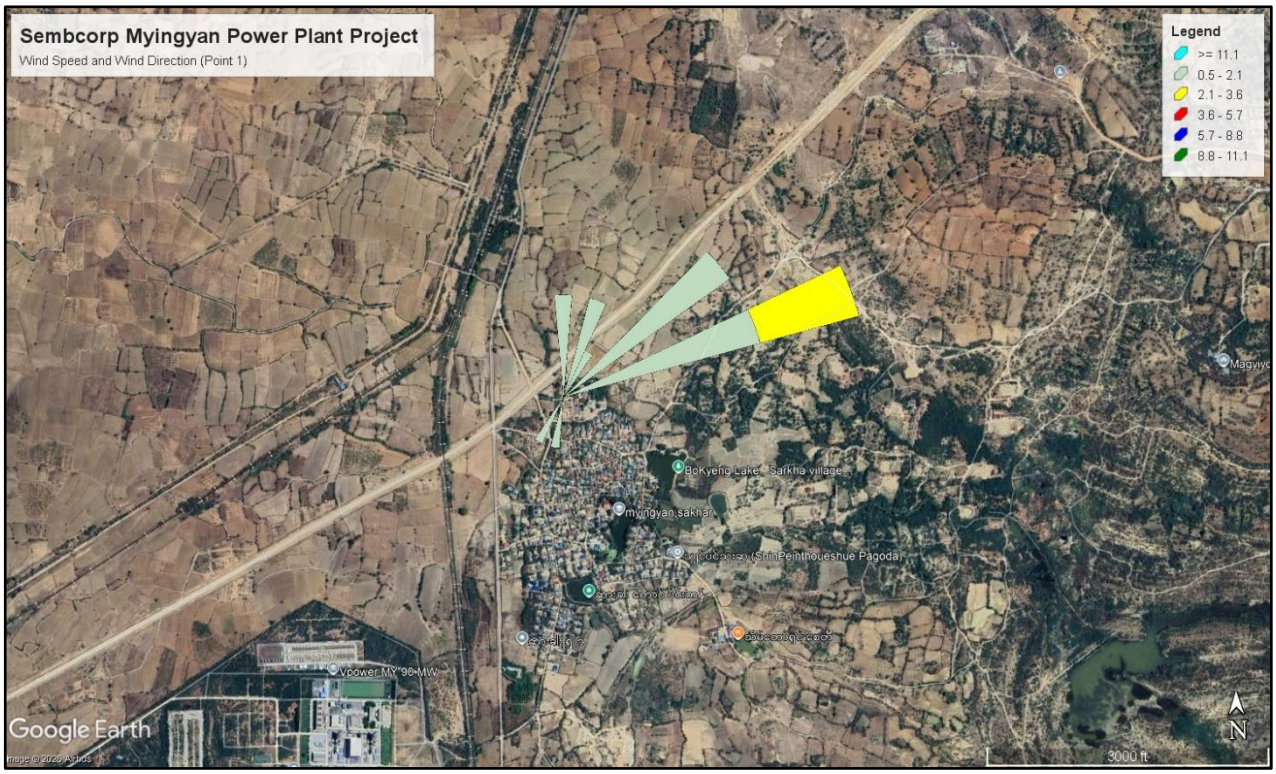


Figure 4. 9 Wind Speed and Wind Direction (Blowing From) at Sa Ka Village (ASR4)

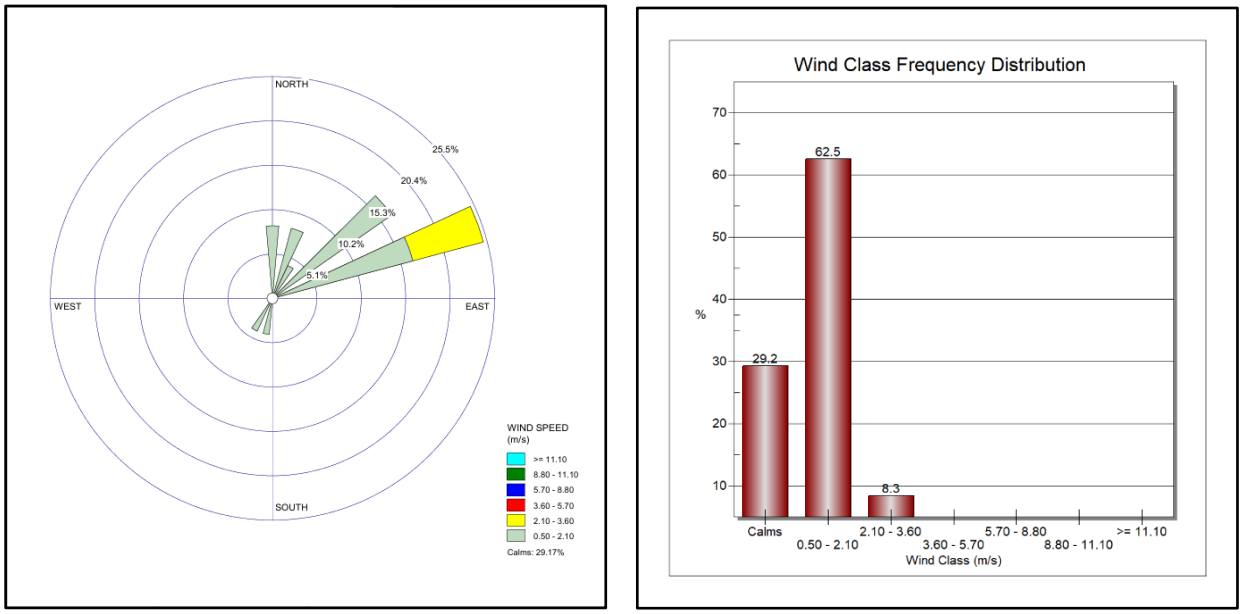


Figure 4. 10 Wind Class Frequency Distribution at Sa Ka Village (ASR4)

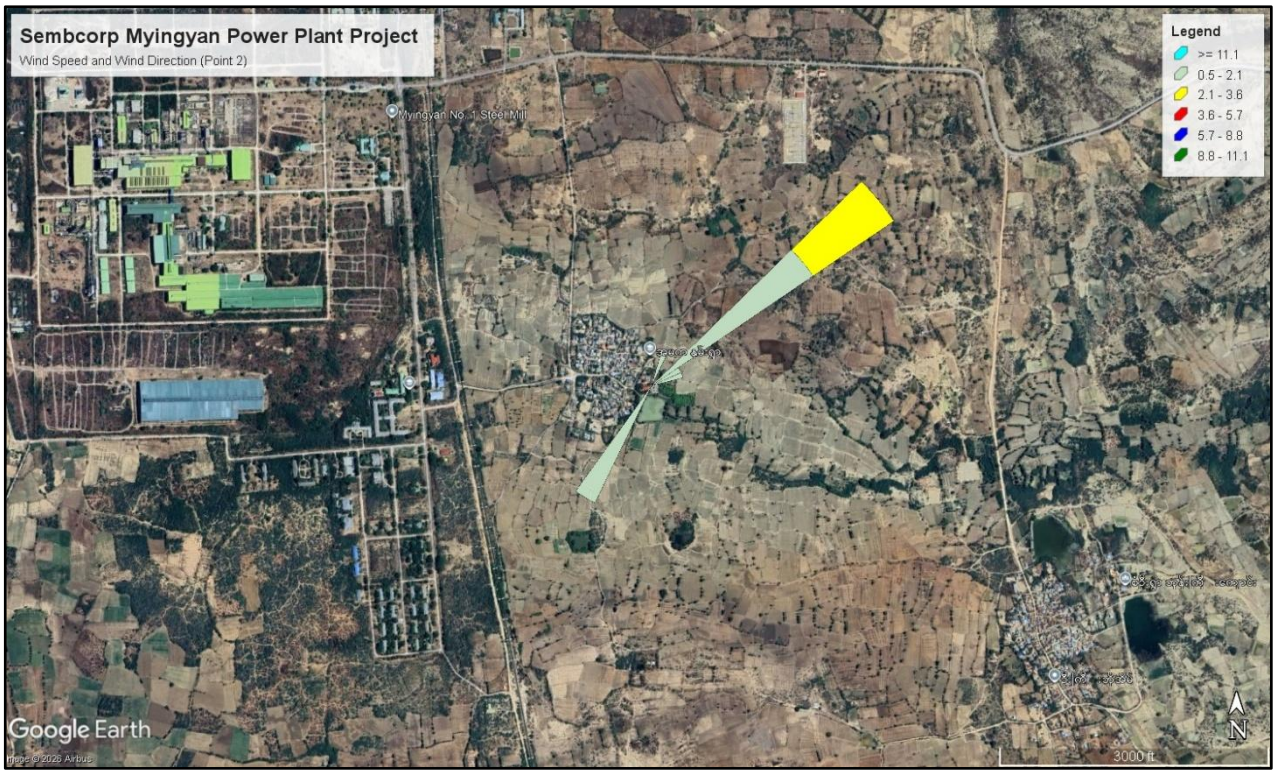
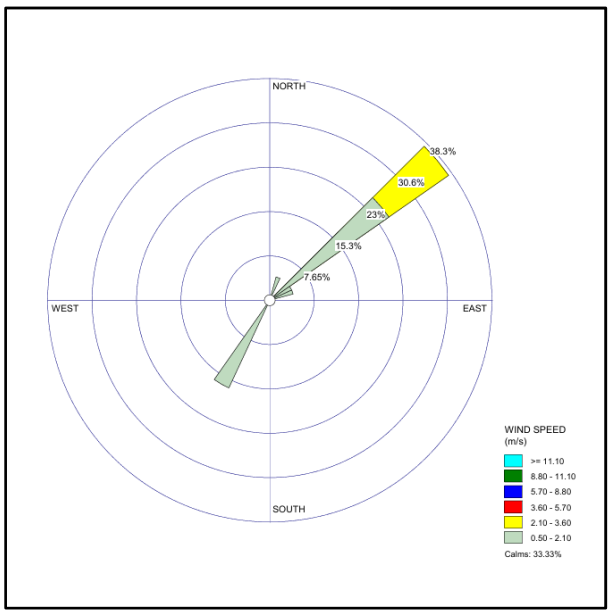


Figure 4. 11 Wind Speed and Wind Direction (Blowing From) at Hnan Village (ASR3)



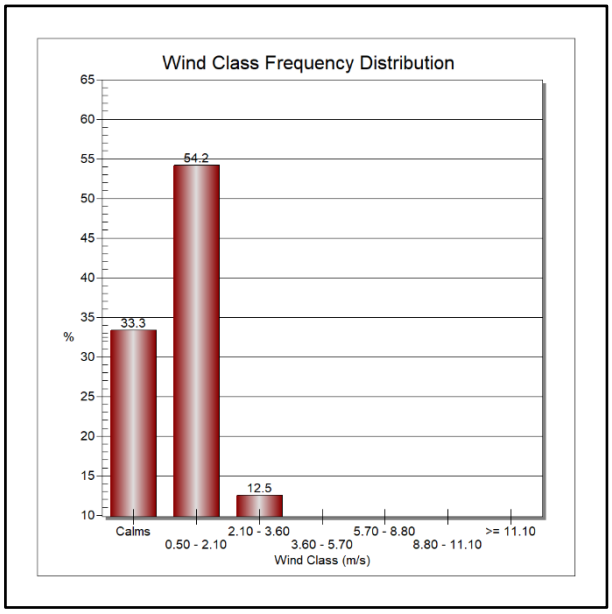


Figure 4. 12 Wind Class Frequency Distribution at Hnan Village (ASR3)

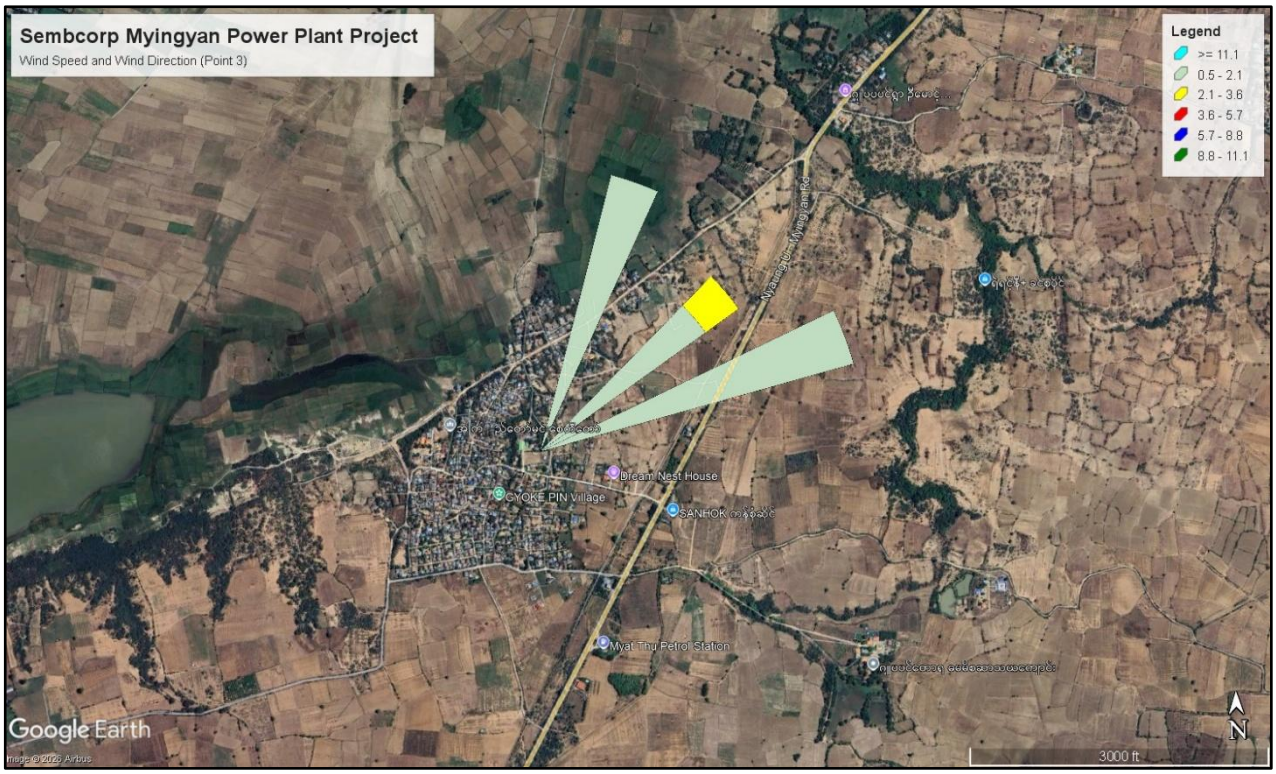


Figure 4. 13 Wind Speed and Wind Direction (Blowing From) at Gyoke Pin Village (ASR5)

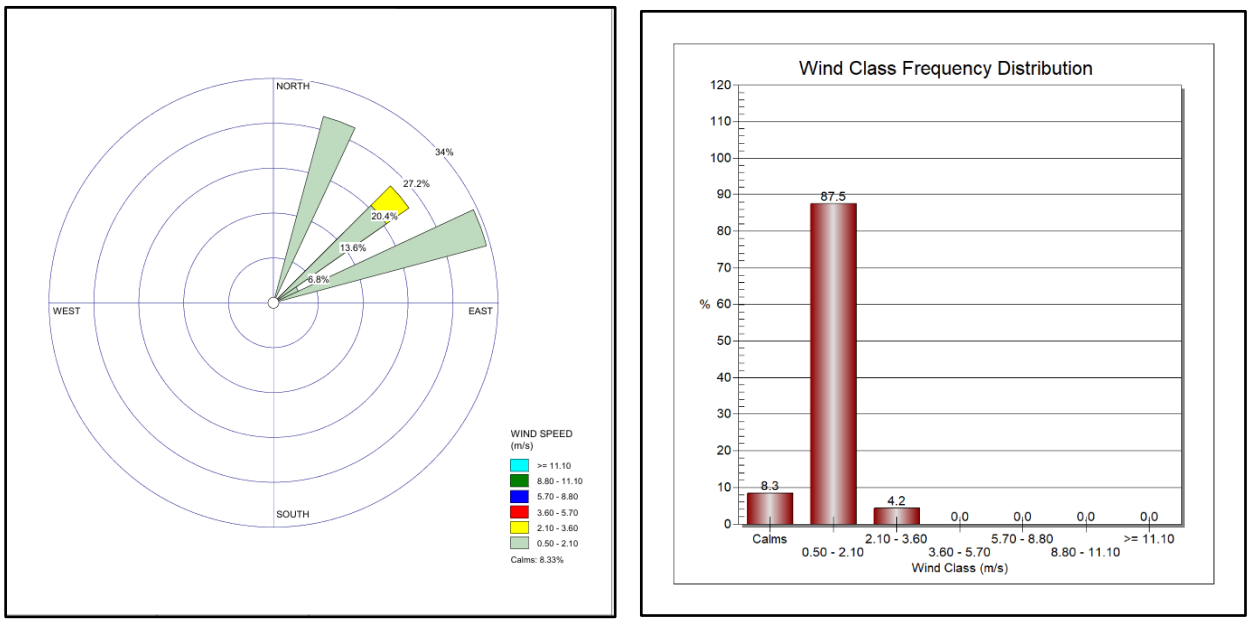


Figure 4. 14 Wind Class Frequency Distribution at Gyoke Pin Village (ASR5)

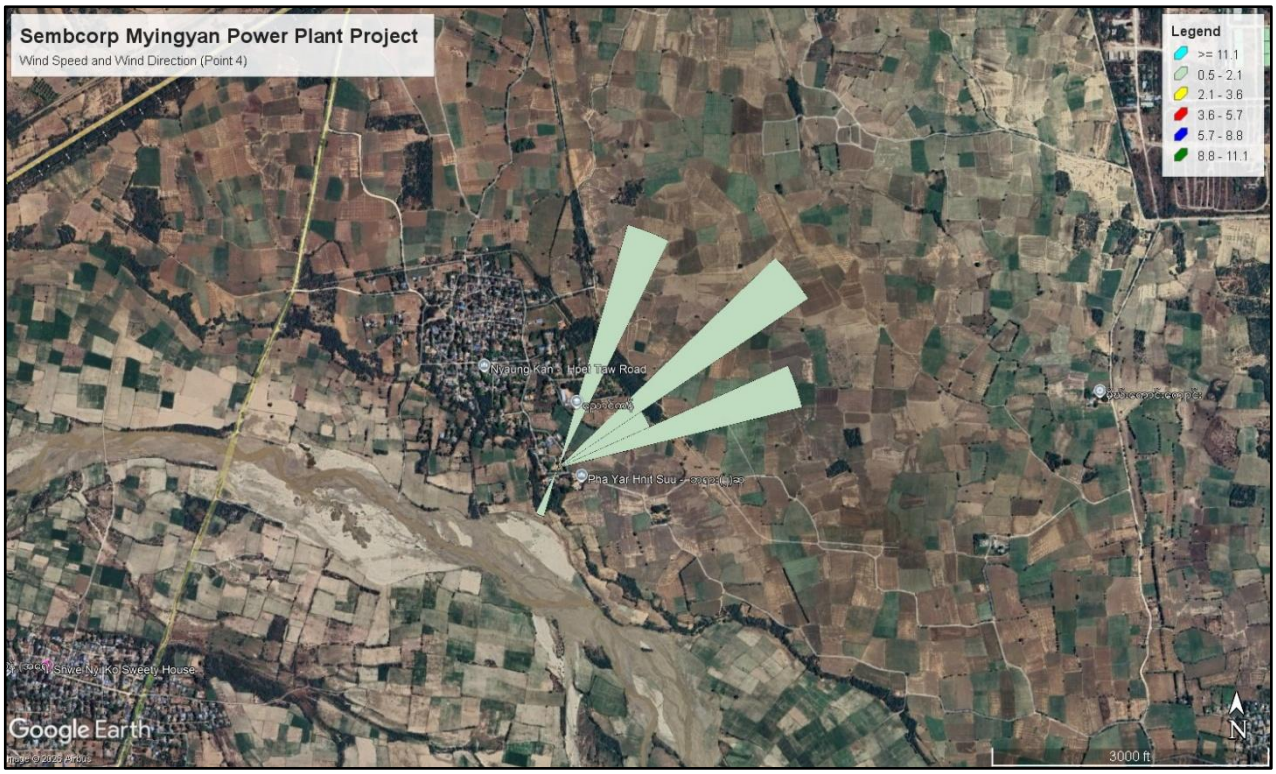


Figure 4. 15 Wind Speed and Wind Direction (Blowing From) at Nyaung Kan Village (ASR14)

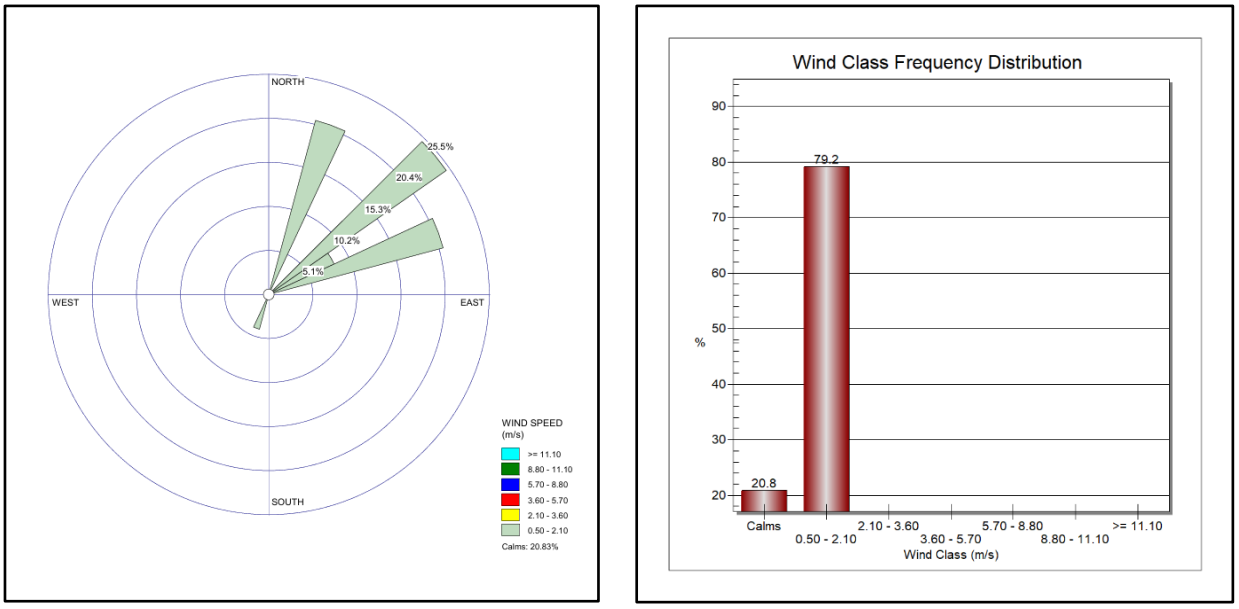


Figure 4. 16 Wind Class Frequency Distribution at Nyaung Kan Village (ASR14)

4.3 Ambient Noise

Ambient noise level for the proposed project was measured with Digital Sound Level Meter at the project site. The noise level measurement is conducted at Sembcorp Myingyan Power points: these points are nearly sembcorp myingyan power plant and air monitoring point at Sa Ka village on 10th March 2026 to 12th March 2026. Measuring period is 24 hours continuously. The observed values are described in **Table 4. 6 to Table 4. 9** and the following figures are noise level measurements at the proposed project.

Table 4. 6 Observed Values of Noise Level Measurement at near Sembcorp Myingyan Power Plant

No.	Date	Time	Observed Mean Value (Source)	Weight	Day/Night	Average
1	11.03.2026	7:00:41-7:59:41	59.34	A	Day	55.00
2	10.03.2026	8:00:41-8:59:41	59.08	A	Day	
3	10.03.2026	9:00:41-9:59:41	56.76	A	Day	
4	10.03.2026	10:00:41-10:59:41	56.44	A	Day	
5	10.03.2026	11:00:41-11:59:41	53.60	A	Day	
6	10.03.2026	12:00:41-12:59:41	57.40	A	Day	
7	10.03.2026	13:00:41-13:59:41	52.06	A	Day	
8	10.03.2026	14:00:41-14:59:41	52.46	A	Day	
9	10.03.2026	15:00:41-15:59:41	58.51	A	Day	
10	10.03.2026	16:00:41-16:59:41	57.70	A	Day	
11	10.03.2026	17:00:41-17:59:41	54.96	A	Day	
12	10.03.2026	18:00:41-18:59:41	51.83	A	Day	
13	10.03.2026	19:00:41-19:59:41	50.36	A	Day	
14	10.03.2026	20:00:41-20:59:41	52.15	A	Day	
15	10.03.2026	21:00:41-21:59:41	52.34	A	Day	
16	10.03.2026	22:00:41-22:59:41	51.30	A	Night	54.51
17	10.03.2026	23:00:41-23:59:41	51.97	A	Night	
18	11.03.2026	0:00:41-0:59:41	49.87	A	Night	
19	11.03.2026	1:00:41-1:59:41	52.72	A	Night	
20	11.03.2026	2:00:41-2:59:41	55.33	A	Night	
21	11.03.2026	3:00:41-3:59:41	56.43	A	Night	
22	11.03.2026	4:00:41-4:59:41	58.49	A	Night	
23	11.03.2026	5:00:41-5:59:41	57.30	A	Night	
24	11.03.2026	6:00:41-6:59:41	57.15	A	Night	
Average			**54.81**			

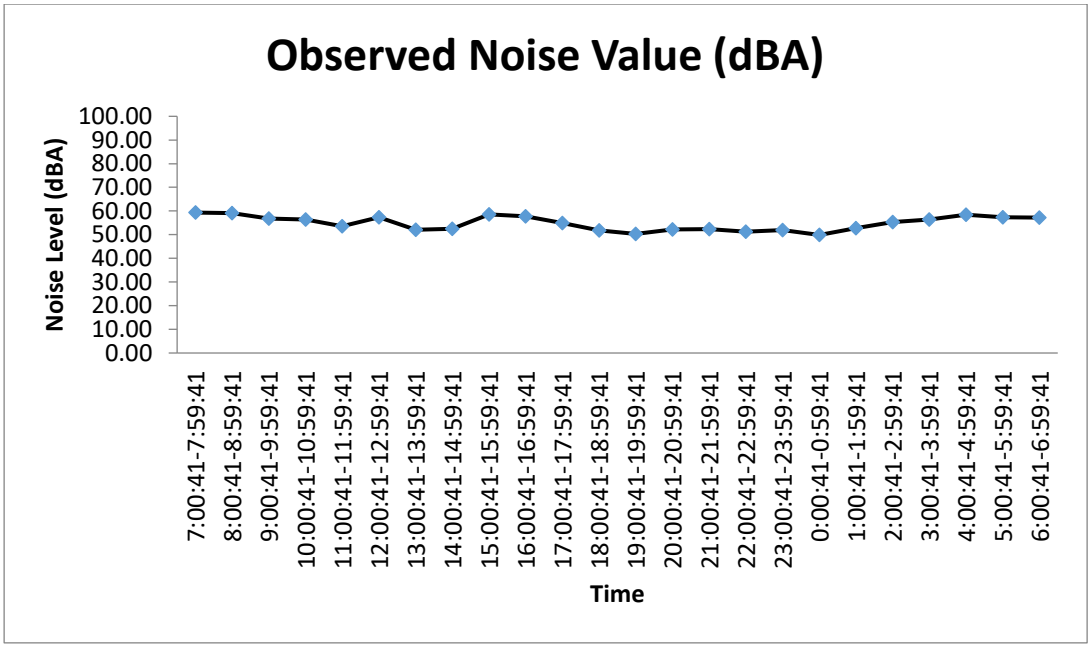


Figure 4. 17 Noise Level at near Sembcorp Myingyan Power Plant

Table 4. 7 Observed Values of Noise Level Measurement at Sa Ka Village

No.	Date	Time	Observed Mean Value (Source)	Weight	Day/Night	Average
1	12.03.2026	7:00:41-7:59:41	67.71	A	Day	56.22
2	12.03.2026	8:00:41-8:59:41	68.97	A	Day	
3	11.03.2026	9:00:41-9:59:41	54.18	A	Day	
4	11.03.2026	10:00:41-10:59:41	59.75	A	Day	
5	11.03.2026	11:00:41-11:59:41	56.68	A	Day	
6	11.03.2026	12:00:41-12:59:41	54.22	A	Day	
7	11.03.2026	13:00:41-13:59:41	61.61	A	Day	
8	11.03.2026	14:00:41-14:59:41	54.55	A	Day	
9	11.03.2026	15:00:41-15:59:41	54.37	A	Day	
10	11.03.2026	16:00:41-16:59:41	55.02	A	Day	
11	11.03.2026	17:00:41-17:59:41	54.53	A	Day	
12	11.03.2026	18:00:41-18:59:41	53.62	A	Day	
13	11.03.2026	19:00:41-19:59:41	50.39	A	Day	
14	11.03.2026	20:00:41-20:59:41	48.26	A	Day	
15	11.03.2026	21:00:41-21:59:41	49.47	A	Day	
16	11.03.2026	22:00:41-22:59:41	48.90	A	Night	53.17
17	11.03.2026	23:00:41-23:59:41	48.78	A	Night	
18	12.03.2026	0:00:41-0:59:41	48.86	A	Night	
19	12.03.2026	1:00:41-1:59:41	48.49	A	Night	
20	12.03.2026	2:00:41-2:59:41	48.62	A	Night	

21	12.03.2026	3:00:41-3:59:41	51.24	A	Night	
22	12.03.2026	4:00:41-4:59:41	51.59	A	Night	
23	12.03.2026	5:00:41-5:59:41	64.08	A	Night	
24	12.03.2026	6:00:41-6:59:41	67.95	A	Night	
Average			**55.08**			

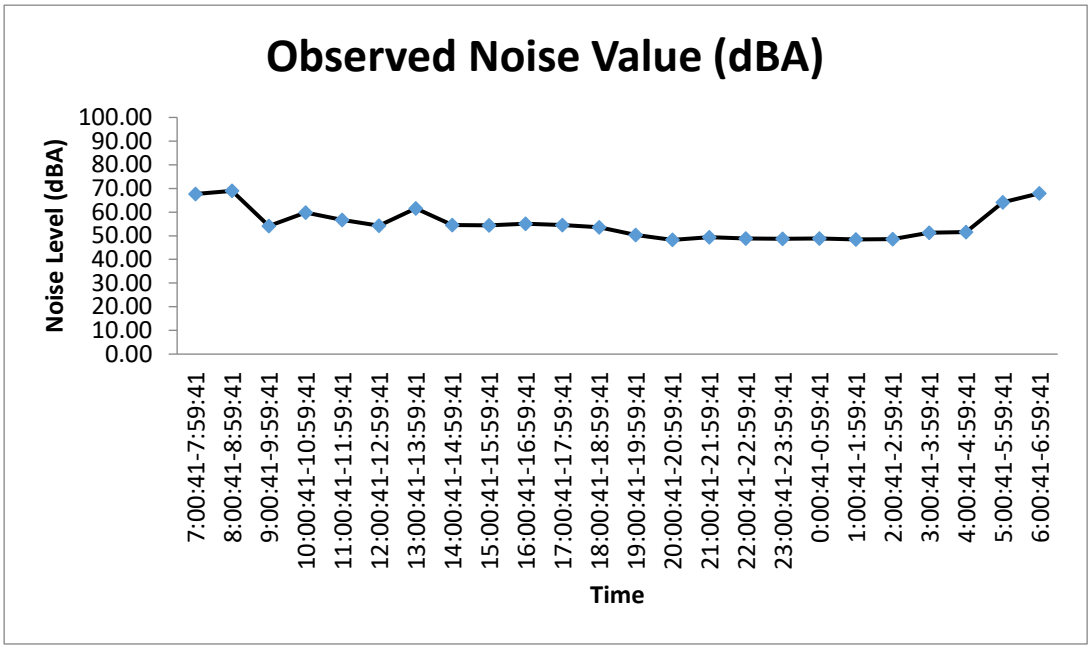


Figure 4. 18 Noise Level at Sa Ka Village

Table 4. 8 Observed Ambient Noise level Results from Myingyan Power Plant

Point	**Sembcorp Myingyan Power Plant**	
	Day Time	**Night Time**
Sembcorp Myingyan Power Plant	55.00	54.51
Guideline Values	70	70

Table 4. 9 Observed Ambient Noise level Results from Sa Ka Village

Point	**Sembcorp Myingyan Power Plant**	
	Day Time	**Night Time**
Sa Ka Village	56.22	53.17
Guideline Values	55	45

The observed values are compared with the National Environmental Quality (Emission) Guidelines as shown in **Table 4. 10** which indicates the separate level for residential and industrial points.

Table 4. 10 National Environmental Quality (Emission) Guidelines Values for Noise Level

Receptor	One Hour LAeq (dBA)	
	Daytime 07:00 - 22:00 (10:00 - 22:00 for Public Holidays)	**Nighttime 22:00 - 07:00 (22:00 - 10:00 for Public Holidays)**
Residential, institutional, educational	55	45
Industrial, commercial	70	70

The observed noise values of the proposed project for daytime at Sembcorp myingyan power plant and Sa Ka village are 55.00 dB (A) and 56.22 dB (A). The observed noise values of the proposed project for nighttime at Sembcorp myingyan power plant and Sa Ka village are 54.51 dB (A) and 53.17 dB (A). The proposed project is located adjacent to the residential and commercial area. The observed values of daytime and nighttime at Sa Ka village are higher than the acceptable values of the National Environmental Quality (Emission) Guidelines. At this time of noise quality measurement on 11th March to 12th March 2026, the observed values of daytime and nighttime at Sa Ka village is higher than the acceptable values of National Environmental Quality (Emission) Guidelines because of the operation of near the factory and monitoring location, Sa Ka North Monastery which situated beside the road, rang the wooden bell and passing through many motor cycle and cars at the time of measurement. But, Sa Ka Village is acceptable Applicable Operational Noise Criteria of 54 dB (A) from ESIA Report.

APPENDIX A

Description of Haz-scanner (EPAS)



Publication 1601 Rev 1405

HAZ-SCANNER EPAS

Wireless Environmental Perimeter Air Station



HAZ-SCANNER EPAS shown with optional solar panels

Performance Profile

The HAZ-SCANNER EPAS is optimized for ambient air applications; custom calibration for specific ranges or applications is available upon request.

Display	LCD real time
Operation	4-key splash-proof membrane switch
Power	12-V Absorption Glass Mat (AGM) rechargable battery, 100-240 V AC, or optional solar panel
Display Measurements	Max, Min, TWA, STEL
Recording Time	1 sec to 21 weeks
Sampling Rate	1 sec, 1 min, 10 min, 1 hr, adjustable
Data Storage	454,545 data points
Sampling Pump	1.0 to 3.0 L/min
Digital Output	RS-232 (PC), RS-423 (Mac)
Software	PC or Mac
Dimensions (weather-proof case)	6 x 14 x 10 in (15.2 x 35.6 x 25.4 cm)
Weight	12 lbs (5.4 kg)
Operating Temperature	23 to 122 F (-5 to 50 C)
Storage Temperature	-40 to 140 F (-40 to 60 C)
Humidity	95% non-condensing (use inlet heater)
Wireless Radio Modem	900 MHz (U.S.), 868 MHz (Euro) up to 5 miles - line of sight (optional)
Auxiliary Analog Input	0 to 2.5 VDC (1 channel for alternative meter)

Configure an EPAS for Up to 14 Simultaneous Measurements

The standard HAZ-SCANNER EPAS includes the monitor (calibrated for ambient air applications) with sensors/meters for PM10 or TSP, VOCs, temperature, humidity, and wind speed/direction in a NEMA 4 enclosure, acid gas scrubber, internal battery, universal 110-240 V AC battery charger, software, cables, and CD with instructions.

Configure the monitor with additional sensors/meters — up to 4 optional interchangable sensors with upgradable software and/or up to 4 EPAS-specific meters (listed below). See page 3 for specifications. ***Specify sensors and meters when ordering.***

- PM1.0, 2.5, or 4.0
- Ammonia (EC)
- Carbon Dioxide (NDIR)
- Carbon Monoxide (EC)
- Chlorine (EC)
- Ethylene Oxide (EL)
- Hydrocarbon (methane-specific, EC)
- Hydrocarbons (EC)
- Hydrogen Chloride (EL)
- Hydrogen Cyanide (EC)
- Hydrogen Sulfide (EC)
- Nitric Oxide (EC)
- Nitrogen Dioxide
- Oxygen
- Ozone
- Phosphine (EL)
- Sulfur Dioxide
- Rain
- Solar Radiance
- Sound and Noise
- Atomic Radiation
- ELF Radiation
- Barometric Pressure
- Dew Point Temperature
- Wet Bulb Temperature

Contact SKC to build an EPAS with available sensors/meters/calibration for your application!

SKC Limited Warranty and Return Policy

SKC products are subject to the SKC Limited Warranty and Return Policy, which provides SKC's sole liability and the buyer's exclusive remedy. To view the complete SKC Limited Warranty and Return Policy, go to http://www.skcinc.com/warranty.asp.

SKC Inc. 724-941-9701 SKC West 714-992-2780 SKC Gulf Coast 281-859-8050 SKC South 434-852-7149
www.skcinc.com

Publication 1801 Rev 1406

HAZ-SCANNER EPAS

Wireless Environmental Perimeter Air Station

HAZ-SCANNER EPAS Sensor/Meter Specifications

Parameter	Sensor*	Measurement/ Concentration Range	Accuracy	Minimum Resolution	Display Resolution	Additional Information
Particulates	90° infrared light scattering	0 to 5000 µg/m³	Greater of < ± 10% of reading or 0.2% full scale	10 µg/m³	1 µg/m³	Measures particle sizes: 10 µm or TSP (standard) or 1, 2.5, or 4 µm (optional) in the 0.1 to 100 µm size range
VOCs	PID (10.6 eV)	0 to 50,000 ppb (0 to 50 ppm)	Greater of < ± 10% of reading or 2% full scale	5 ppb	1 ppb	Minimum detection level is 0.01 ppm. Standard sensor
Toxic Gas: NH_3 - Ammonia	Gas-sensing semiconductor (GSS) technology	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: CO_2 - Carbon Dioxide	NDIR	0 to 5000 ppm	Greater of < ± 10% of reading or 2% full scale	50 ppm	1 ppm	Optional sensor
Toxic Gas: CO - Carbon Monoxide	Electrochemical	0 to 10,000 ppb (0 to 10 ppm)	Greater of < ± 10% of reading or 2% full scale	20 ppb	1 ppb	Optional sensor
Toxic Gas: Cl_2 - Chlorine	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: (C_2H_4O) - Ethylene Oxide	Electrochemical	0 to 1500 ppm	Greater of < ± 10% of reading or 2% full scale	8 ppm	1 ppm	Optional sensor
Toxic Gas: Hydrocarbon, CH_4 - Methane-specific	NDIR	0 to 1% Vol., 0 to 10,000 ppm, 0 to 20% LEL	Greater of < ± 10% of reading or 2% full scale	± 50 ppm or 0.1% LEL	50 ppm/ 0.1% LEL	Optional sensor
Toxic Gas: (Non-methane) Hydrocarbons (HC)	NDIR	Calibrated for 0 to 20% LEL of selected gas	Greater of < ± 10% of reading or 2% full scale	± 50 ppm/ 0.1% LEL	50 ppm/ 0.1% LEL	Optional sensor - specify gas type when ordering: ethane, propane, butane, hexane, ethanol, ethylene, or ethylene oxide
Toxic Gas: HCl - Hydrogen Chloride	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: HCN - Hydrogen Cyanide	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: H_2S - Hydrogen Sulfide	Electrochemical	0 to 25 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.15 ppm	0.1 ppm	Optional sensor
Toxic Gas: NO - Nitric Oxide	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: NO_2 - Nitrogen Dioxide	Electrochemical	0 to 5000 ppb (0 to 5 ppm)	Greater of < ± 10% of reading or 2% full scale	5 ppb	1 ppb	Optional sensor
Toxic Gas: O_2 - Oxygen	Electrochemical	0 to 30% Vol.	Greater of < ± 10% of reading or 2% full scale	0.6%	0.1%	Optional sensor
Toxic Gas: O_3 - Ozone	Gas-sensing semiconductor (GSS) technology	0 to 150 ppb (0 to 0.15 ppm), 0 to 500 ppb (0 to 0.5 ppm)	Greater of < ± 10% of reading or 2% full scale	1 ppb	1 ppb	Optional sensor
Toxic Gas: PH_3 - Phosphine	Electrochemical	0 to 100 ppm	Greater of < ± 10% of reading or 2% full scale	< 0.2 ppm	0.1 ppm	Optional sensor
Toxic Gas: SO_2 - Sulfur Dioxide	Electrochemical	0 to 5000 ppb (0 to 5 ppm) for ambient applications	Greater of < ± 10% of reading or 2% full scale	5 ppb	1 ppb	Optional sensor

* Not approved for intrinsically safe applications; do not use in explosive gas environments.

Specifications continued on next page

SKC Inc. 724-941-9701 SKC West 714-992-2780 SKC Gulf Coast 281-859-8050 SKC South 434-852-7149
www.skcinc.com

HAZ-SCANNER EPAS

Wireless Environmental Perimeter Air Station

HAZ-SCANNER EPAS Sensor/Meter Specifications (con't)

Parameter	Sensor*	Measurement/ Concentration Range	Accuracy	Minimum Resolution	Display Resolution	Additional Information
Rain Fall/ Precipitation	Rain gauge (heated, tipping bucket)	0 to 5 inches daily	± 1% at 2 in/hr	0.01 in	0.01 in/tip	Optional meter
Temperature	NTC thermister	-4 to 140 F (-20 to 60 C)	Greater of ± 3% degree F or C of reading	1 degree F or C	1 degree F or C	Standard sensor
Relative Humidity (RH)	Thin-film capacitive	0 to 100% RH	± 2% RH	1% RH	1% RH	Standard sensor
Solar Radiance Intensity	Photodiode	1110 watts/ square meter (W/m^2)	± 5% of full scale (reference Eppley PSP at 1000 W/m^2)	1 W/m^2	1 W/m^2	Optional meter
Sound and Noise	Type 2 SLM	30 to 130 decibels (dB)	± 1.5 dB	0.1 dB	1 dB	Optional meter
Atomic Radiation	Geiger counter	1 to 19,999 counts per minute (cpm) or 0.001 to 100 milliRad/hr	± 10% Typical, ± 15% Max.	1 cpm or .001 mR/hr	1 cpm or .001 mR/hr	Optional meter
ELF Radiation	Sensor with single-axis probe	1 to 200 gauss (G)	± 10% or 5% FS	1 G	1 G	Optional meter
Wind Speed/ Direction	3-cup anemometer/ continuous rotation potentiometric wind direction vane	0 to 125 mph/ 5 to 355°	± 1 mph or ± 3%/± 3°	1 mph/1°	1 mph/1°	Standard sensor
Barometric Pressure	Piezo resistive	28.25 to 30.75 in Hg	± 0.09 in Hg	0.01 in Hg	0.01 in Hg	Optional sensor
Dew Point Temperature	Software calculation from RH and temperature	8.2 to 122 F (-15 to 50 C)	± 3 F	1 F	1 F	Optional meter - software calculated
Wet Bulb Temperature	Capsulated thermister with wick	8.2 to 122 F (-15 to 50 C)	± 3 F	1 F	1 F	Optional meter - one meter

* Not approved for intrinsically safe applications; do not use in explosive gas environments.

SKC Inc. 724-941-9701 SKC-West 714-992-2780 SKC Gulf Coast 281-859-8050 SKC South 434-852-7149
www.skcinc.com

Calibration Certificate for Haz-scanner

NANOVA Co.,Ltd.
Medical Scientific Industrial

SYSTEM HEALTH CHECK REPORT

Information

Instrument	Hazscanner
Model	EPAS
Serial number	915096
Unit Sensor	CO_2, CO, H_2S, CH_4, NO_2, O_3, SO_2, PM_{10}, $PM_{2.5}$
Customer	Eguard
Date	2026 January 21th

Check List

Physical Check	OK
Supply Voltage Check	OK
PM 10 Air Flow Check	OK
PM 2.5 Air Flow Check	OK
Internal Backup Battery Voltage Check	OK
NO2 Sensor Health Check	Moderate
CO2,SO2,CO Sensor Health Check	Still Good
Lithium Battery Voltage Check	Not OK
Data Logging Check	OK
Data Downloading Check	OK

Recommend

Need to replace Lithium battery.
Need to replace new acid gas scrubber (every 6 months).
Need to replace internal filters (every 6 months).
Need to perform factory calibration or in-field calibration (every 12 months).

Performed by

Phoe Saw Htoo
Technical Service Engineer
NANOVA CO.,LTD

Approved by

Myo Oo
Technical Service Manager
NANOVA CO.,LTD

Yangon 22-A, Shan Yeiktar Street, Sanchaung Township, Tel: +95 (1) 230 4901, 230 4902
Nay Pyi Taw Za /30, Ziwaka Say Sine Tan, Tha Phay Khone, Pyinmanar **Tel** 067 810 8083
Mandalay 153(B), 73rd Street, Bet 33x34 Street, ChanAye Tharzan Tsp. **Tel** 09 791 360000
Email contact@nanovapteltd.com Website: www.nanova-scientific.com
helpline 09 421 360000 , 09 451 360000

Calibration Certificate for Sound Level Meter

SCIENCE WORKSHOP
CALIBRATION CERTIFICATE

Submitted by	:	e guard Environmental Services No.(145-A2-3), Thiri Mingalar Street, Ward No.(4), 8th Mile, Mayangone Township, Yangon 11062, Myanmar.
Location	:	U Soe Min (Director)
Instrument	:	Digital Sound Level Meter (BENETECH, GM 1356) Sr No. GG: 2439187 (30dB – 130dB)
Instrument Reference No.:		eg – DSLM – 08
Test Equipment	:	Dual Trace Oscilloscope, Signal Generator and Digital Multimeter (7534-02, Yokogawa Japan)
Ambient Temperature	:	24°C
Permissible Error	:	± 1 % dB
Calibration Date	:	21th January 2026 Next due date 21th January 2027

We certified that this instrument has been calibrated to JAPAN standard under the condition stated above .

1. **Method of Calibration**

Measure and compare the Frequency Linearity and Sound Level with above instrument and test instrument same source, the effect which the hall has on sound at the same time so that people can hear.

2. **Result Calibration**

Measurement	Instrument	Test Equipment	Correction
Frequency	31.5 Hz	31.5 Hz	-
	150 Hz	150 Hz	-
	500 Hz	500 Hz	-
	1 KHz	1 KHz	-
	6 KHz	6 KHz	-
Level	30 dB	30 dB	-
	60 dB	60 dB	-
	90 dB	90 dB	-
	100 dB	100 dB	-
	120 dB	120 dB	-
	130 dB	130 dB	-

This instrument is suitable for use and comply with standard given by manufacture.

Calibrated by:

Ba Thein Sein
Senior Skilled Technician
SCIENCE EQUIPMENT (Lab) SERVICE

APPENDIX B

Field Photos

Air Monitoring Point at Sa Ka Village (ASR4) Lat- 21°23’48.591”, Long- 95°23’0.849” 10.03.2026 to 11.03.2026	
Air Monitoring Point at Hnan Village (ASR3) Lat- 21°22’17.565”, Long- 95°23’18.116” 11.03.2026 to 12.03.2026	

Air Monitoring Point at Gyoke Pin Village (ASR5) Lat- 21°24’21.888”, Long- 95°21’07.381” 12.03.2026 to 13.03.2026	
Air Monitoring Point at Nyaung Kan Village (ASR14) Lat- 21°21’58.048”, Long- 95°20’51.346” 13.03.2026 to 14.03.2026	

Comparative Analysis of Surface Water Quality for EMR 17th and EMR 18th

			EMR 17th		EMR 18th	
Parameters	**Unit**	**Guideline Value**	**Jun-25**	**Sep-25**	**Dec-25**	**Mar-26**
Wastewater Discharge (pH)	S.U.	6~9	7.53	7.39	7.88	7.2
TSS[1]	mg/l	50	16	20	6	6.0
COD	mg/l	125	23.6	14.9	20.8	11.1
Oil & Grease[1]	mg/l	10	<3.1	<3.1	<3.1	<3.1
Total Nitrogen	mg/l	10	2.9	1.4	<0.5	5.0
Total Phosphorus	mg/l	2	1.5	1.33	1.85	0.85
Mercury[1]	mg/l	0.005	≤0.002	≤0.002	≤0.002	≤0.002
Zinc[1]	mg/l	1	0.318	0.238	.925	0.302
Arsenic[1]	mg/l	0.5	≤0.010	≤0.010	≤0.010	≤0.010
Total Chromium[1]	mg/l	0.5	≤0.002	≤0.002	≤0.002	≤0.002
Cadmium[1]	mg/l	0.1	≤0.002	≤0.002	≤0.002	≤0.002
Copper[1]	mg/l	0.5	≤0.002	≤0.002	≤0.002	≤0.002
Lead[1]	mg/l	0.5	≤0.002	≤0.002	≤0.002	≤0.002
Iron	mg/l	1	0.039	0.242	.111	0.034
Total Chlorine	mg/l	0.2	<0.1	<0.1	<0.1	<0.1
Temperature Increase	°C	< 3	-0.7	-1.1	-1.5	-2.5

Sembcorp Myingyan Power Co., Limited.

Water Quality Monitoring Report
(Dec 2025)

GOLDEN DOWA ECO-SYSTEM MYANMAR CO., LTD.
Lot No E1. Thilawa SEZ Zone A, Yangon Region, Myanmar.
Phone No Fax No: (+95) 1 2309051

motivate our planet

Report No. : GEM-LAB-202512102
Revision No. : 1
Report Date : 31 December, 2025
Application No. : 0299-C001

Test Report

Client Name : Sembcorp Myingyan Power Company Limited
Address : Beside of No.1 Steel Mill , Sa Khar Village, Myingyan.
Project Name :
Sample Description
Sample Name : CMB Discharge sampling skid
Sample No. : W-2512083
Waste Profile No. : -

Sampling Date : 15 December, 2025
Sampling By : Withdraw GEM
Sample Received Date : 15 December, 2025
Analytical Date : 15-31/12/2025

No.	Parameter	Method	Unit	Result	LOQ
1	pH	APHA 4500 H+ B (Electrometric Method)	_	7.88	0.00
2	SS	APHA 2540D (Dry at 103-105'C Method)	mg/l	6	_
3	COD (Cr)	APHA 5220D (Close Reflux Colorimetric Method)	mg/l	20.8	0.7
4	Oil and Grease	APHA 5520B (Partition-Gravimetric Method)	mg/l	<3.1	3.1
5	Total Nitrogen	HACH Method 10072 (TNT Persulfate Digestion Method)	mg/l	<0.5	0.5
6	Total Phosphorous	APHA 4500-P E (Ascorbic Acid Method)	mg/l	1.85	0.05
7	Mercury	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	≤0.002	0.002
8	Zinc	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	0.925	0.002
9	Arsenic	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	≤0.010	0.010
10	Chromium	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	≤0.002	0.002
11	Cadmium	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	≤0.002	0.002
12	Copper	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	≤0.002	0.002
13	Lead	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	≤0.002	0.002
14	Iron	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	0.111	0.002
15	Free Chlorine	APHA 4500 CL G (DPD Colorimetric Method)	mg/l	<0.1	0.1

Remark : LOQ - Limit of Quantitation
APHA - American Public Health Association (APHA), the American Water Works Association (AWWA), and the Water Environment Federation (WEF), Standard Methods for the Examination of Water and Wastewater, 22nd edition

Analysed By :

Cherry Myint Thein
Manager

LAB
31 Dec, 2025
GEM

Approved By :

Ni Ni Aye Lwin
Senior Manager
31 Dec, 2025

*** End of Document ***

REPORT RESULT IS ONLY OF THE SAMPLE SUBMITTED FOR ANALYSIS.
THIS ANALYSIS REPORT SHALL NOT BE REPRODUCED EXCEPT IN FULL, WITHOUT WRITTEN APPROVAL OF THE LABORATORY OF GOLDEN DOWA ECO-SYSTEM MYANMAR CO.,LTD.

GOLDEN DOWA ECO-SYSTEM MYANMAR CO., LTD
Lot No E1, Thilawa SEZ Zone A, Yangon Region, Myanmar
Phone No & Fax No. (+95) 1 2309051

< Analysis Application Form >

Date: 15-12-25

Client's information (to be described in the tax invoice)	Client's information to be described in the analysis report (if it should be specified)
Client name: Sembcorp Myingyan Power Company Limited	Client name: Sembcorp Myingyan Power Company Limited
Address of client: Beside of No. 1 Steel Mill, Sa Khar Village, Myingyan	Address of client: Beside of No. 1 Steel
PO Number:	PO Number:
Project name:	Project name:
Tel No. / Email: (95) 19345233, thandar.win@sembcorp.com	Tel No. / Email: Zaw Moe Aung <zaw.moeaung@sembcorp.com>
Contact person/Position: Thandar Win	Contact person/Position: Mr. Zaw Moe Aung (HSE)
Sample information: Sampling date: 15-12-25	Sample bottle(s): ☐Need to be returned, ■ Not need
Sampling by: *Customer*	Expected analysis report due date :
*To be filled by GEM Lab: Sampling Service; ■ No Use, ☐Use (Sampling date:	Sampling by:)

		No.	Example	1	2	3
Sample details		Sample name	WW-1	CMB Discharge sampling skid		
Sample information	Type of water		■Drinking water	☐Drinking water	☐Drinking water	☐Drinking water
			☐Surface water (river, lake etc.)	☐Surface water (river, lake etc.)	☐Surface water (river, lake etc.)	☐Surface water (river, lake etc.)
			☐Ground water	☐Ground water	☐Ground water	☐Ground water
			☐Saline/sea water	☐Saline/sea water	☐Saline/sea water	☐Saline/sea water
			☐Wastewater	☐Wastewater	☐Wastewater	☐Wastewater
			☐Others ( )	☐Others (Soil)	☐Others ( )	☐Others ( )
	Volume of sample container		500 mL/bottle			
	Q'ty of container		Total 2 bottles			
Analysis parameter	pH		■	■	☐	☐
	O&G		■	■	☐	☐
	Total Suspended Solid		☐	■	☐	☐
	Total Nirogen		■	■	☐	☐
	Total Phosphorous		■	■	☐	☐
	CODcr		■	■	☐	☐
	Free Chlorine		☐	■	☐	☐
	Chromium (Total)		☐	■	☐	☐
	Copper		☐	■	☐	☐
	Iron		☐	■	☐	☐
	Zinc		☐	■	☐	☐
	Lead		☐	■	☐	☐
	Cadmium		☐	■	☐	☐
	Mercury		☐	■	☐	☐
	Arsenic		☐	■	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
	Other request (if any)		-Nitrate, -Fluoride -Total Alkalinity			
*To be filled by GEM Lab	Sample No.		*******	W-2512083		

LAB GEM

Remark(if any),June(2025),September(2025),December(2025),March(2025)

*To be filled by GEM lab		
Application Received by:	Sample Received by:	Application No: (*our administration section)
Date: 15-12-25	Date: 15-12-25	02999-C001

Sembcorp Myingyan Power Co., Limited.

Water Quality Monitoring Report
(Mar 2026)

GOLDEN DOWA ECO-SYSTEM MYANMAR CO., LTD.
Lot No E1, Thilawa SEZ Zone A, Yangon Region, Myanmar.
Phone No Fax No: (+95) 1 2309051

motivate our planet

Report No. : GEM-LAB-202603155
Revision No. : 1
Report Date : 31 March, 2026
Application No. : 0299-C001

Test Report

Client Name : Sembcorp Myingyan Power Company Limited
Address : Beside of No.1 Steel Mill , Sa Khar Village, Myingyan.
Project Name :
Sample Description
Sample Name : CMB Discharge sampling skid
Sample No. : W-2603095
Waste Profile No. : -

Sampling Date : 12 March, 2026
Sampling By : Withdraw GEM
Sample Received Date : 12 March, 2026
Analytical Date : 12-31/03/2026

No.	Parameter	Method	Unit	Result	LOQ
1	pH	APHA 4500 H+ B (Electrometric Method)	_	7.20	0.00
2	SS	APHA 2540D (Dry at 103-105'C Method)	mg/l	6	_
3	COD (Cr)	APHA 5220D (Close Reflux Colorimetric Method)	mg/l	11.1	0.7
4	Oil and Grease	APHA 5520B (Partition-Gravimetric Method)	mg/l	<3.1	3.1
5	Total Nitrogen	HACH Method 10072 (TNT Persulfate Digestion Method)	mg/l	5.0	0.5
6	Total Phosphorous	APHA 4500-P E (Ascorbic Acid Method)	mg/l	0.85	0.05
7	Mercury	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	≤0.002	0.002
8	Zinc	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	0.302	0.002
9	Arsenic	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	≤0.010	0.010
10	Chromium	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	≤0.002	0.002
11	Cadmium	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	≤0.002	0.002
12	Copper	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	≤0.002	0.002
13	Lead	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	≤0.002	0.002
14	Iron	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	0.034	0.002
15	Free Chlorine	APHA 4500 CL G (DPD Colorimetric Method)	mg/l	<0.1	0.1

Remark : LOQ - Limit of Quantitation
APHA - American Public Health Association (APHA), the American Water Works Association (AWWA), and the Water Environment Federation (WEF), Standard Methods for the Examination of Water and Wastewater, 22nd edition

Analysed By :

Cherry Myint Thein
Manager

LAB
March 31, 2026
GEM

Approved By :

Ni Ni Aye Lwin March 31, 2026
Senior Manager

*** End of Document ***

REPORT RESULT IS ONLY OF THE SAMPLE SUBMITTED FOR ANALYSIS.
THIS ANALYSIS REPORT SHALL NOT BE REPRODUCED EXCEPT IN FULL, WITHOUT WRITTEN APPROVAL OF THE LABORATORY OF GOLDEN DOWA ECO-SYSTEM MYANMAR CO.,LTD.

< Analysis Application Form >

Date: 12-03-26

Client's information (to be described in the tax invoice)	Client's information to be described in the analysis report (if it should be specified)
Client name: Sembcorp Myingyan Power Company Limited	Client name: Sembcorp Myingyan Power Company Limited
Address of client: Beside of No. 1 Steel Mill, Sa Khar Village, Myingyan	Address of client: Beside of No. 1 Steel Mill, Sa Khar Village, Myingyan
PO Number:	PO Number:
Project name:	Project name:
Tel No. / Email: (95) 19345233, thandar.win@sembcorp.com	Tel No. / Email: Zaw Moe Aung <zaw.moeaung@sembcorp.com>
Contact person/Position: Thandar Win	Contact person/Position: Mr. Zaw Moe Aung (HSE)

Sample information	Sampling date: 12-03-26	Sample bottle(s): ☐Need to be returned, ■ Not need
	Sampling by: *Customer*	Expected analysis report due date :
*To be filled by GEM Lab	Sampling Service; ■ No Use, ☐Use (Sampling date:	Sampling by:)

Sample details		No.	Example	1	2	3
		Sample name	WW-1	CMB Discharge sampling skid		
Sample information	Type of water		■Drinking water	☐Drinking water	☐Drinking water	☐Drinking water
			☐Surface water (river, lake etc)	☐Surface water (river, lake etc)	☐Surface water (river, lake etc)	☐Surface water (river, lake etc)
			☐Ground water	☐Ground water	☐Ground water	☐Ground water
			☐Saline/sea water	☐Saline/sea water	☐Saline/sea water	☐Saline/sea water
			☐Wastewater	☐Wastewater	☐Wastewater	☐Wastewater
			☐Others ( )	☐Others (Soil)	☐Others ( )	☐Others ( )
	Volume of sample container		500 mL/bottle			
	Q'ty of container		Total 2 bottles			
Analysis parameter	pH		■	■	☐	☐
	O&G		■	■	☐	☐
	Total Suspended Solid		☐	■	☐	☐
	Total Nirogen		■	■	☐	☐
	Total Phosphorous		■	■	☐	☐
	CODcr		■	■	☐	☐
	Free Chlorine		☐	■	☐	☐
	Chromium (Total)		☐	■	☐	☐
	Copper		☐	■	☐	☐
	Iron		☐	■	☐	☐
	Zinc		☐	■	☐	☐
	Lead		☐	■	☐	☐
	Cadmium		☐	■	☐	☐
	Mercury		☐	■	☐	☐
	Arsenic		☐	■	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
	Other request (if any)		-Nitrate, -Fluoride -Total Alkalinity			
*To be filled by GEM Lab		Sample No.	*******	W-2603095		

LAB GEM

Remark(if:any),June(2025),September(2025),December(2025),March(2026)

03155

*To be filled by GEM lab			
Application Received by:	Sample Received by:	Application No: (*our administration section)	
Date: 12-03-26	Date: 12-03-26	0299 - 0011	

GOLDEN DOWA ECO-SYSTEM MYANMAR CO., LTD.
Lot No E1, Thilawa SEZ Zone A, Yangon Region, Myanmar.
Phone No Fax No: (+95) 1 2309051

motivate our planet

Report No. : GEM-LAB-202603155
Revision No. : 1
Report Date : 31 March, 2026
Application No. : 0299-C001

Test Report

Client Name : Sembcorp Myingyan Power Company Limited
Address : Beside of No.1 Steel Mill , Sa Khar Village, Myingyan.
Project Name :
Sample Description
Sample Name : CMB Discharge sampling skid
Sample No. : W-2603095
Waste Profile No. : -

Sampling Date : 12 March, 2026
Sampling By : Withdraw GEM
Sample Received Date : 12 March, 2026
Analytical Date : 12-31/03/2026

No.	Parameter	Method	Unit	Result	LOQ
1	pH	APHA 4500 H+ B (Electrometric Method)	_	7.20	0.00
2	SS	APHA 2540D (Dry at 103-105'C Method)	mg/l	6	_
3	COD (Cr)	APHA 5220D (Close Reflux Colorimetric Method)	mg/l	11.1	0.7
4	Oil and Grease	APHA 5520B (Partition-Gravimetric Method)	mg/l	<3.1	3.1
5	Total Nitrogen	HACH Method 10072 (TNT Persulfate Digestion Method)	mg/l	5.0	0.5
6	Total Phosphorous	APHA 4500-P E (Ascorbic Acid Method)	mg/l	0.85	0.05
7	Mercury	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	≤0.002	0.002
8	Zinc	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	0.302	0.002
9	Arsenic	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	≤0.010	0.010
10	Chromium	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	≤0.002	0.002
11	Cadmium	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	≤0.002	0.002
12	Copper	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	≤0.002	0.002
13	Lead	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	≤0.002	0.002
14	Iron	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/l	0.034	0.002
15	Free Chlorine	APHA 4500 CL G (DPD Colorimetric Method)	mg/l	<0.1	0.1

Remark : LOQ - Limit of Quantitation
APHA - American Public Health Association (APHA), the American Water Works Association (AWWA), and the Water Environment Federation (WEF), Standard Methods for the Examination of Water and Wastewater, 22nd edition

Analysed By :

Cherry Myint Thein
Manager

LAB
March 31, 2026
GEM

Approved By :

Ni Ni Aye Lwin March 31, 2026
Senior Manager

*** End of Document ***

REPORT RESULT IS ONLY OF THE SAMPLE SUBMITTED FOR ANALYSIS.
THIS ANALYSIS REPORT SHALL NOT BE REPRODUCED EXCEPT IN FULL, WITHOUT WRITTEN APPROVAL OF THE LABORATORY OF GOLDEN DOWA ECO-SYSTEM MYANMAR CO.,LTD.

< Analysis Application Form >

Date: 12-03-26

Client's information (to be described in the tax invoice)	Client's information to be described in the analysis report (if it should be specified)
Client name: Sembcorp Myingyan Power Company Limited	Client name: Sembcorp Myingyan Power Company Limited
Address of client: Beside of No. 1 Steel Mill, Sa Khar Village, Myingyan	Address of client: Beside of No. 1 Steel Mill, Sa Khar Village, Myingyan
PO Number:	PO Number:
Project name:	Project name:
Tel No. / Email: (95) 19345233, thandar.win@sembcorp.com	Tel No. / Email: Zaw Moe Aung <zaw.moeaung@sembcorp.com>
Contact person/Position: Thandar Win	Contact person/Position: Mr. Zaw Moe Aung (HSE)

Sample information	Sampling date: 12-03-26	Sample bottle(s): ☐Need to be returned, ■ Not need
	Sampling by: *Customer*	Expected analysis report due date :
*To be filled by GEM Lab	Sampling Service; ■ No Use, ☐Use (Sampling date:	Sampling by:)

Sample details		No.	Example	1	2	3
		Sample name	WW-1	CMB Discharge sampling skid		
Sample information	Type of water		■Drinking water	☐Drinking water	☐Drinking water	☐Drinking water
			☐Surface water (river, lake etc)	☐Surface water (river, lake etc)	☐Surface water (river, lake etc)	☐Surface water (river, lake etc)
			☐Ground water	☐Ground water	☐Ground water	☐Ground water
			☐Saline/sea water	☐Saline/sea water	☐Saline/sea water	☐Saline/sea water
			☐Wastewater	☐Wastewater	☐Wastewater	☐Wastewater
			☐Others ( )	☐Others (Soil)	☐Others ( )	☐Others ( )
	Volume of sample container		500 mL/bottle			
	Q'ty of container		Total 2 bottles			
Analysis parameter	pH		■	■	☐	☐
	O&G		■	■	☐	☐
	Total Suspended Solid		☐	■	☐	☐
	Total Nirogen		■	■	☐	☐
	Total Phosphorous		■	■	☐	☐
	CODcr		■	■	☐	☐
	Free Chlorine		☐	■	☐	☐
	Chromium (Total)		☐	■	☐	☐
	Copper		☐	■	☐	☐
	Iron		☐	■	☐	☐
	Zinc		☐	■	☐	☐
	Lead		☐	■	☐	☐
	Cadmium		☐	■	☐	☐
	Mercury		☐	■	☐	☐
	Arsenic		☐	■	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
			☐	☐	☐	☐
	Other request (if any)		-Nitrate, -Fluoride -Total Alkalinity			
*To be filled by GEM Lab		Sample No.	*******	W-2603095		

LAB GEM

Remark(if:any),June(2025),September(2025),December(2025),March(2026)

03155

*To be filled by GEM lab			
Application Received by:	Sample Received by:	Application No: (*our administration section)	
Date: 12-03-26	Date: 12-03-26	0299 - 0011	

Sembcorp Myingyan Power Co., Limited.

Soil Quality Monitoring Report
(Mar 2026)

GOLDEN DOWA ECO-SYSTEM MYANMAR CO., LTD.
Lot No E1. Thilawa SEZ Zone A, Yangon Region, Myanmar.
Phone No Fax No: (+95) 1 2309051

motivate our planet

Report No.: GEM-LAB-202603156
Revision No.: 1
Report Date: 31 March, 2026
Application No.: 0299-C002

Test Report

Client Name : Sembcorp Myingyan Power Company Limited
Address : Beside of No.1 Steel Mill , Sa Khar Village, Myingyan.
Project Name :
Sample Description
Sample Name : Soil, March 2026
Sample No. : S-2603096
Waste Profile No. : -

Sampling Date : 12 March, 2026
Sampling By : Withdraw GEM
Sample Received Date : 12 March, 2026
Analytical Date : 12-31/03/2026

No.	Parameter	Method For Liquid Sample Preparation	Method of Measurement	Unit	Result	LOQ
1	Cadmium	Content test in soil pollution countermeasures Act (No.19 of the Ministry of Environment notification in Japan (2003)	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/kg	≤0.068	0.068
2	Arsenic			mg/kg	8.160	0.340
3	Lead			mg/kg	17.000	0.068
4	Selenium			mg/kg	≤0.340	0.340
5	Chromium			mg/kg	5.780	0.068
6	Mercury			mg/kg	≤0.068	0.068
7	pH (soil pH measured in water at 25'C)	–	USEPA Method 9045D (Soil and Waste pH)	–	7.27	–

Remark : LOQ - Limit of Quantitation
APHA - American Public Health Association (APHA), the American Water Works Association (AWWA), and the Water Environment Federation (WEF), Standard Methods for the Examination of Water and Wastewater, 22nd edition
Method for Liquid sample Preparation - Content test in soil pollution countermeasures Act (No.19 of the Ministry of Environment notification in Japan (2003)

Analysed By :

Cherry Myint Thein
Manager

LAB
March 31, 2026
GEM

Approved By :

Ni Ni Aye Lwin
Senior Manager
March 31, 2026

*** End of Document ***

REPORT RESULT IS ONLY OF THE SAMPLE SUBMITTED FOR ANALYSIS.
THIS ANALYSIS REPORT SHALL NOT BE REPRODUCED EXCEPT IN FULL, WITHOUT WRITTEN APPROVAL OF THE LABORATORY OF
GOLDEN DOWA ECO-SYSTEM MYANMAR CO.,LTD.

DOWA

GOLDEN DOWA ECO-SYSTEM MYANMAR CO., LTD.
Lot No E1, Thilawa SEZ Zone A, Yangon Region, Myanmar.
Phone No & Fax No: (+95) 1 2309051

< Analysis Application Form >

Date: 12-03-26

Client's information (to be described in the tax invoice)	Client's information to be described in the analysis report (if it should be specified)
Client name: Sembcorp Myingyan Power Company	Client name: Sembcorp Myingyan Power Company
Address of client: Beside of No. 1 Steel Mill, Sa Khar Village, Myingyan	Address of client: Beside of No. 1 Steel Mill, Sa Khar Village, Myingyan
PO Number:	PO Number:
Project name:	Project name:
Tel No. / Email: (95) 19345233, thandar.win@sembcorp.com	Tel No. / Email: Zaw Moe Aung <zaw.moeaung@sembcorp.com>
Contact person/Position: Thandar Win	Contact person/Position: Mr. Zaw Moe Aung (HSE)
Sample information: Sampling date: 12-03-26	Sample bottle(s): ☐Need to be returned, ■ Not need
Sampling by: *Customer*	Expected analysis report due date :
*To be filled by GEM Lab: Sampling Service; ■ No Use, ☐Use (Sampling date:	Sampling by:)

Sample details		No.	Example	1	2	3
		Sample name	WW-1	Soil, March 2026		
Sample information	Type of water		■Drinking water	☐Drinking water	☐Drinking water	☐Drinking water
			☐Surface water (river, lake etc)	☐Surface water (river, lake etc)	☐Surface water (river, lake etc)	☐Surface water (river, lake etc)
			☐Ground water	☐Ground water	☐Ground water	☐Ground water
			☐Saline/sea water	☐Saline/sea water	☐Saline/sea water	☐Saline/sea water
			☐Wastewater	☐Wastewater	☐Wastewater	☐Wastewater
			☐Others ( )	■Others (Soil)	☐Others ( )	☐Others ( )
	Volume of sample container		500 mL/bottle			
	Q'ty of container		Total 2 bottles			
Analysis parameter	Cadmium		■	■	☐	☐
	Lead		■	■	☐	☐
	Chromium		☐	■	☐	☐
	Arsenic		■	■	☐	☐
	Mercury		■	■	☐	☐
	Selenium		■	■	☐	☐
	pH		☐	■	☐	☐
	Other request (if any)		-Nitrate, -Fluoride -Total Alkalinity			
*To be filled by GEM Lab	Sample No.		*******	S-2603096		

Remark(if any): Analyze with soil contents method.
March 2026, December 2026

0315

LAB GEM

*To be filled by GEM lab		
Application Received by:	Sample Received by:	Application No: (*our administration section)
Date. 12-03-26	Date. 12-03-26	0299 - C002

GOLDEN DOWA ECO-SYSTEM MYANMAR CO., LTD.
Lot No E1. Thilawa SEZ Zone A, Yangon Region, Myanmar.
Phone No Fax No: (+95) 1 2309051

motivate our planet

Report No.: GEM-LAB-202603156
Revision No.: 1
Report Date: 31 March, 2026
Application No.: 0299-C002

Test Report

Client Name : Sembcorp Myingyan Power Company Limited
Address : Beside of No.1 Steel Mill , Sa Khar Village, Myingyan.
Project Name :
Sample Description
Sample Name : Soil, March 2026
Sample No. : S-2603096
Waste Profile No. : -

Sampling Date : 12 March, 2026
Sampling By : Withdraw GEM
Sample Received Date : 12 March, 2026
Analytical Date : 12-31/03/2026

No.	Parameter	Method For Liquid Sample Preparation	Method of Measurement	Unit	Result	LOQ
1	Cadmium	Content test in soil pollution countermeasures Act (No.19 of the Ministry of Environment notification in Japan (2003)	APHA 3120 B (Inductively Coupled Plasma (ICP) Method)	mg/kg	≤0.068	0.068
2	Arsenic			mg/kg	8.160	0.340
3	Lead			mg/kg	17.000	0.068
4	Selenium			mg/kg	≤0.340	0.340
5	Chromium			mg/kg	5.780	0.068
6	Mercury			mg/kg	≤0.068	0.068
7	pH (soil pH measured in water at 25'C)	–	USEPA Method 9045D (Soil and Waste pH)	–	7.27	–

Remark : LOQ - Limit of Quantitation
APHA - American Public Health Association (APHA), the American Water Works Association (AWWA), and the Water Environment Federation (WEF), Standard Methods for the Examination of Water and Wastewater, 22nd edition
Method for Liquid sample Preparation - Content test in soil pollution countermeasures Act (No.19 of the Ministry of Environment notification in Japan (2003)

Analysed By :

Cherry Myint Thein
Manager

LAB
March 31, 2026
GEM

Approved By :

Ni Ni Aye Lwin
Senior Manager
March 31, 2026

*** End of Document ***

REPORT RESULT IS ONLY OF THE SAMPLE SUBMITTED FOR ANALYSIS.
THIS ANALYSIS REPORT SHALL NOT BE REPRODUCED EXCEPT IN FULL, WITHOUT WRITTEN APPROVAL OF THE LABORATORY OF
GOLDEN DOWA ECO-SYSTEM MYANMAR CO.,LTD.

DOWA

GOLDEN DOWA ECO-SYSTEM MYANMAR CO., LTD.
Lot No E1, Thilawa SEZ Zone A, Yangon Region, Myanmar.
Phone No & Fax No: (+95) 1 2309051

< Analysis Application Form >

Date: 12-03-26

Client's information (to be described in the tax invoice)	Client's information to be described in the analysis report (if it should be specified)
Client name: Sembcorp Myingyan Power Company	Client name: Sembcorp Myingyan Power Company
Address of client: Beside of No. 1 Steel Mill, Sa Khar Village, Myingyan	Address of client: Beside of No. 1 Steel Mill, Sa Khar Village, Myingyan
PO Number:	PO Number:
Project name:	Project name:
Tel No. / Email: (95) 19345233, thandar.win@sembcorp.com	Tel No. / Email: Zaw Moe Aung <zaw.moeaung@sembcorp.com>
Contact person/Position: Thandar Win	Contact person/Position: Mr. Zaw Moe Aung (HSE)
Sample information: Sampling date: 12-03-26	Sample bottle(s): ☐Need to be returned, ■ Not need
Sampling by: *Customer*	Expected analysis report due date :
*To be filled by GEM Lab: Sampling Service; ■ No Use, ☐Use (Sampling date:	Sampling by:)

Sample details		No.	Example	1	2	3
		Sample name	WW-1	Soil, March 2026		
Sample information	Type of water		■Drinking water	☐Drinking water	☐Drinking water	☐Drinking water
			☐Surface water (river, lake etc)	☐Surface water (river, lake etc)	☐Surface water (river, lake etc)	☐Surface water (river, lake etc)
			☐Ground water	☐Ground water	☐Ground water	☐Ground water
			☐Saline/sea water	☐Saline/sea water	☐Saline/sea water	☐Saline/sea water
			☐Wastewater	☐Wastewater	☐Wastewater	☐Wastewater
			☐Others ( )	■Others (Soil)	☐Others ( )	☐Others ( )
	Volume of sample container		500 mL/bottle			
	Q'ty of container		Total 2 bottles			
Analysis parameter	Cadmium		■	■	☐	☐
	Lead		■	■	☐	☐
	Chromium		☐	■	☐	☐
	Arsenic		■	■	☐	☐
	Mercury		■	■	☐	☐
	Selenium		■	■	☐	☐
	pH		☐	■	☐	☐
	Other request (if any)		-Nitrate, -Fluoride -Total Alkalinity			
*To be filled by GEM Lab	Sample No.		*******	S-2603096		

Remark(if any): Analyze with soil contents method.
March 2026, December 2026

0315

LAB GEM

*To be filled by GEM lab		
Application Received by:	Sample Received by:	Application No: (*our administration section)
Date. 12-03-26	Date. 12-03-26	0299 - C002

Sembcorp Myingyan Power Co., Limited.

ESMP- Air Quality Management Monitoring Check List
(Oct 2025 ~ Mar 2026)

Sembcorp Myingyan Power Company Limited
ESMP Checklist for October 2025

Air Quality Management Monitoring Monthly Checklist Form (Operational Phase)

S/No	Description	Yes	No	Details of Observation / Location	Corrective Action to be Taken	Action taken Date	Verified by
1	Built-in dry low NOx burners to reduce NOx emission at stack to below 25ppm at all times?	Yes		Installed build-in Dry Low NOx to reduce NOx emission at both gas turbines. Regular maintenance has been carrying out by maintenance team.	Nil	Done	Zaw/Tin/Thet
2	Monitor ambient air quality in and around the Project site as per the Environment Monitoring Program formulated for the Project.	Yes		Instrument team is carrying out daily monitoring and results are recorded daily.	Nil	Done	Zaw/Tin/Thet
3	Continuous emission monitoring (CEMS) systems installed common for both main stack and bypass stack for real-time data collection on emission status from the Plant monitoring emission concentrations of NOx as NO2, PM, SO2, O2, moisture content?	Yes		Monitoring by Continuous emissions monitoring system (CEMS) at sites.	Nil	Done	Zaw/Tin/Thet
4	Monitor ambient air quality monitoring as per ESIA Monitoring Programmer formulated for the Plant.	Yes		Will be conducted by 3rd Party Surveyor in June 2025 as per planned schedule.	Nil	Ongoing	Zaw/Tin/Thet
5	Annual CEMS validation for NOx, CO, PM2.5 and O2 at Main Stack and Bypass Stack by using standard methods?	Yes		Weekly calibration is conducted by I&C team.	Nil	Done	Zaw/Tin/Thet
6	Are there any emission of dark smoke from equipment and machinery?		No	No emission of dark smoke from the equipment and machinery was found during the month.	Nil	Done	Zaw/Tin/Thet
7	Are there evidence of open burning of waste carried out?		No	No evidence of open burning of waste was carried out during the month.	Nil	Done	Zaw/Tin/Thet
8	Are there operational & maintenance activities to create high dust emission on site and taken adequate control measures?		No	No operation and maintenance activity observed during the month.	Nil	Done	Zaw/Tin/Thet

Date / Time of inspection: 30 October 2025

Location: Designated points

Role of Individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Thet Nyi Nyi Shwe (HSSE Officer), Zaw Moe Aung (HSSE Manager)

Sembcorp Myingyan Power Company Limited

ESMP Checklist for November 2025

Air Quality Management Monitoring Monthly Checklist Form (Operational Phase)

S/No	Description	Yes	No	Details of Observation / Location	Corrective Action to be Taken	Action taken Date	Verified by
1	Built-in dry low NOx burners to reduce NOx emission at stack to below 25 ppm at all times?	Yes		Installed build-in Dry Low NOx to reduce NOx emission at both gas turbines. Regular maintenance has been carrying out by maintenance team.	Nil	Done	Zaw/Tin/Thet
2	Monitor ambient air quality in and around the Project site as per the Environment Monitoring Program formulated for the Project.	Yes		Instrument team is carrying out daily monitoring and results are recorded daily.	Nil	Done	Zaw/Tin/Thet
3	Continuous emission monitoring (CEMS) systems installed common for both main stack and bypass stack for real-time data collection on emission status from the Plant monitoring emission concentrations of NOx as NO2, PM, SO2, O2, moisture content?	Yes		Monitoring by Continuous emissions monitoring system (CEMS) at sites.	Nil	Done	Zaw/Tin/Thet
4	Monitor ambient air quality monitoring as per ESIA Monitoring Programmer formulated for the Plant.	Yes		Will be conducted by 3rd Party Surveyor in June 2025 as per planned schedule.	Nil	Ongoing	Zaw/Tin/Thet
5	Annual CEMS validation for NOx, CO, PM2.5 and O2 at Main Stack and Bypass Stack by using standard methods?	Yes		Weekly calibration is conducted by I&C team.	Nil	Done	Zaw/Tin/Thet
6	Are there any emission of dark smoke from equipment and machinery?		No	No emission of dark smoke from the equipment and machinery was found during the month.	NIL	Done	Zaw/Tin/Thet
7	Are there evidences of open burning of waste carried out?		No	No evidence of open burning of waste was carried out during the month.	NIL	Done	Zaw/Tin/Thet
8	Are there operational & maintenance activities to create high dust emission on site and taken adequate control measures?		No	No operation and maintenance activity observed during the month.	NIL	Done	Zaw/Tin/Thet

Date / Time of inspection: 30 November 2025

Location: Designated points

Role of Individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Thet e (HSSE Officer), Zaw Moe Aung (HSSE Manager)

Sembcorp Myingyan Power Company Limited

ESMP Checklist for December 2025

Air Quality Management Monitoring Monthly Checklist Form (Operational Phase)

S/No	Description	Yes	No	Details of Observation / Location	Corrective Action to be Taken	Action taken Date	Verified by
1	Built-in dry low NOx burners to reduce NOx emission at stack to below 25ppm at all times?	Yes		Installed build-in Dry Low NOx to reduce NOx emission at both gas turbines. Regular maintenance has been carrying out by maintenance team.	Nil	Done	Zaw/Tin/Thet
2	Monitor ambient air quality in and around the Project site as per the Environment Monitoring Program formulated for the Project.	Yes		Instrument team is carrying out daily monitoring and results are recorded daily.	Nil	Done	Zaw/Tin/Thet
3	Continuous emission monitoring (CEMS) systems installed common for both main stack and bypass stack for real-time data collection on emission status from the Plant monitoring emission concentrations of NOx as NO2, PM, SO2, O2, moisture content?	Yes		Monitoring by Continuous emissions monitoring system (CEMS) at sites.	Nil	Done	Zaw/Tin/Thet
4	Monitor ambient air quality monitoring as per ESIA Monitoring Programmer formulated for the Plant.	Yes		Quarterly Monitoring has been conducted by 3rd Party Surveyor in June 2025. Will be conducted again in September 2025.	Nil	Done	Zaw/Tin/Thet
5	Annual CEMS validation for NOx, CO, PM2.5 and O2 at Main Stack and Bypass Stack by using standard methods?	Yes		Weekly calibration is conducted by I&C team.	Nil	Done	Zaw/Tin/Thet
6	Are there any emission of dark smoke from equipment and machinery?		No	No emission of dark smoke from the equipment and machinery was found during the month.	NIL	Done	Zaw/Tin/Thet
7	Are there evidences of open burning of waste carried out?		No	No evidence of open burning of waste was carried out during the month.	NIL	Done	Zaw/Tin/Thet
8	Are there operational & maintenance activities to create high dust emission on site and taken adequate control measures?		No	No operation and maintenance activity observed during the month.	NIL	Done	Zaw/Tin/Thet

Date / Time of inspection: 30 December 2025

Location: Designated points

Role of Individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Thet Ni (HSSE Officer), ,Zaw Moe Aung (HSSE Manager) and 3rd Party Surveyor.

Sembcorp Myingyan Power Company Limited

ESMP Checklist for January 2026

Air Quality Management Monitoring Monthly Checklist Form (Operational Phase)

S/No	Description	Yes	No	Details of Observation / Location	Corrective Action to be Taken	Action taken Date	Verified by
1	Built-in dry low NOx burners to reduce NOx emission at stack to below 25ppm at all times?	Yes		Installed build-in Dry Low NOx to reduce NOx emission at both gas turbines. Regular maintenance has been carrying out by maintenance team.	Nil	Done	Zaw/Tin/ Kaung
2	Monitor ambient air quality in and around the Project site as per the Environment Monitoring Program formulated for the Project.	Yes		Instrument team is carrying out daily monitoring and results are recorded daily.	Nil	Done	Zaw/Tin/ Kaung
3	Continuous emission monitoring (CEMS) systems installed common for both main stack and bypass stack for real-time data collection on emission status from the Plant monitoring emission concentrations of NOx as NO2, PM, SO2, O2, moisture content?	Yes		Monitoring by Continuous emissions monitoring system (CEMS) at sites.	Nil	Done	Zaw/Tin/ Kaung
4	Monitor ambient air quality monitoring as per ESIA Monitoring Programmer formulated for the Plant.	Yes		Quarterly Monitoring was conducted by 3rd Party Surveyor in June 2025. Will be conducted again in September 2025.	Nil	Done	Zaw/Tin/ Kaung
5	Annual CEMS validation for NOx, CO, PM2.5 and O2 at Main Stack and Bypass Stack by using standard methods?	Yes		Weekly calibration is conducted by I&C team.	Nil	Done	Zaw/Tin/ Kaung
6	Are there any emission of dark smoke from equipment and machinery?		No	No emission of dark smoke from the equipment and machinery was found during the month.	NIL	Done	Zaw/Tin/ Kaung
7	Are there evidences of open burning of waste carried out?		No	No evidence of open burning of waste was carried out during the month.	NIL	Done	Zaw/Tin/ Kaung
8	Are there operational & maintenance activities to create high dust emission on site and taken adequate control measures?		No	No operation and maintenance activity observed during the month.	NIL	Done	Zaw/Tin/ Kaung

Date / Time of inspection: 30 January 2026

Location: Designated points

Role of Individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), KaunSSE Officer), Zaw Moe Aung (HSSE Manager)

Sembcorp Myingyan Power Company Limited

ESMP Checklist for February 2026

Air Quality Management Monitoring Monthly Checklist Form (Operational Phase)

S/No	Description	Yes	No	Details of Observation / Location	Corrective Action to be Taken	Action taken Date	Verified by
1	Built-in dry low NOx burners to reduce NOx emission at stack to below 25ppm at all times?	Yes		Installed build-in Dry Low NOx to reduce NOx emission at both gas turbines. Regular maintenance has been carrying out by maintenance team.	Nil	Done	Zaw/Tin/ Kaung
2	Monitor ambient air quality in and around the Project site as per the Environment Monitoring Program formulated for the Project.	Yes		Instrument team is carrying out daily monitoring and results are recorded daily.	Nil	Done	Zaw/Tin/ Kaung
3	Continuous emission monitoring (CEMS) systems installed common for both main stack and bypass stack for real-time data collection on emission status from the Plant monitoring emission concentrations of NOx as NO2, PM, SO2, O2, moisture content?	Yes		Monitoring by Continuous emissions monitoring system (CEMS) at sites.	Nil	Done	Zaw/Tin/ Kaung
4	Monitor ambient air quality monitoring as per ESIA Monitoring Programmer formulated for the Plant.	Yes		Quarterly Monitoring was conducted by 3rd Party Surveyor in June 2025. Will be conducted again in September 2025.	Nil	Done	Zaw/Tin/ Kaung
5	Annual CEMS validation for NOx, CO, PM2.5 and O2 at Main Stack and Bypass Stack by using standard methods?	Yes		Weekly calibration is conducted by I&C team.	Nil	Done	Zaw/Tin/ Kaung
6	Are there any emission of dark smoke from equipment and machinery?		No	No emission of dark smoke from the equipment and machinery was found during the month.	NIL	Done	Zaw/Tin/ Kaung
7	Are there evidences of open burning of waste carried out?		No	No evidence of open burning of waste was carried out during the month.	NIL	Done	Zaw/Tin/ Kaung
8	Are there operational & maintenance activities to create high dust emission on site and taken adequate control measures?		No	No operation and maintenance activity observed during the month.	NIL	Done	Zaw/Tin/ Kaung

Date / Time of inspection: 28 February 2026

Location: Designated points, Role of Individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Kaung Zayar (HSSE Officer), Zaw Moe Aung (HSSE Manager).

Sembcorp Myingyan Power Company Limited
ESMP Checklist for March 2026

Air Quality Management Monitoring Monthly Checklist Form (Operational Phase)

S/No	Description	Yes	No	Details of Observation / Location	Corrective Action to be Taken	Action taken Date	Verified by
1	Built-in dry low NOx burners to reduce NOx emission at stack to below 25ppm at all times?	Yes		Installed build-in Dry Low NOx to reduce NOx emission at both gas turbines. Regular maintenance has been carrying out by maintenance team.	Nil	Done	Zaw/Tin/ Kaung
2	Monitor ambient air quality in and around the Project site as per the Environment Monitoring Program formulated for the Project.	Yes		Instrument team is carrying out daily monitoring and results are recorded daily.	Nil	Done	Zaw/Tin/ Kaung
3	Continuous emission monitoring (CEMS) systems installed common for both main stack and bypass stack for real-time data collection on emission status from the Plant monitoring emission concentrations of NOx as NO2, PM, SO2, O2, moisture content?	Yes		Monitoring by Continuous emissions monitoring system (CEMS) at sites.	Nil	Done	Zaw/Tin/ Kaung
4	Monitor ambient air quality monitoring as per ESIA Monitoring Programmer formulated for the Plant.	Yes		Quarterly Monitoring was conducted by 3rd Party Surveyor in September 2025. Will be conducted again in December 2025.	Nil	Done	Zaw/Tin/ Kaung
5	Annual CEMS validation for NOx, CO, PM2.5 and O2 at Main Stack and Bypass Stack by using standard methods?	Yes		Weekly calibration is conducted by I&C team.	Nil	Done	Zaw/Tin/ Kaung
6	Are there any emission of dark smoke from equipment and machinery?		No	No emission of dark smoke from the equipment and machinery was found during the month.	NIL	Done	Zaw/Tin/ Kaung
7	Are there evidences of open burning of waste carried out?		No	No evidence of open burning of waste was carried out during the month.	NIL	Done	Zaw/Tin/ Kaung
8	Are there operational & maintenance activities to create high dust emission on site and taken adequate control measures?		No	No operation and maintenance activity observed during the month.	NIL	Done	Zaw/Tin/ Kaung

Date / Time of inspection: 30 March 2026

Location: Designated points

Role of Individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Kaung Zayar (HSSE Officer), Zaw Moe Aung (HSSE Manager) and 3rd Party Surveyor.

Sembcorp Myingyan Power Co., Limited.

ESMP- Emergency Preparedness & Response Management Monitoring Checklist (Oct 2025 ~ Mar 2026)

ESMP Checklist for October 2025
Emergency Preparedness & Response Management Monitoring Checklist Form (Operational Phase)

No	Description	Yes	No	Details of Observation	Corrective Action to be Taken	Action taken date	Verified by
1	Emergency contact list displayed in prominent area, such as, notice board, resting shelters?	Yes		Displayed at offices notice boards, security guard house, and canteen and updating regularly.	Nil	Done	Zaw/Tin/Thet
2	Emergency evacuation route is pasted on prominent location?	Yes		Posted in major buildings.	Nil	Done	Zaw/Tin/Thet
3	Regular inspection on emergency resources?	Yes		Monthly inspection is conducted by appointed person.	Nil	Done	Zaw/Tin/Thet
4	Emergency drill exercise was conducted regularly?	Yes		Conducting monthly Emergency response drill.	Nil	Done	Zaw/Tin/Thet
5	Regular inspection on clearance of emergency evacuation route, for emergency vehicle access?	Yes		Monthly inspection conducted by appointed person.	Nil	Done	Zaw/Tin/Thet
6	Emergency response team was trained to deal with emergency situation? - First Aid - Firefighting - Rescue	Yes		Plant Emergency Response team is trained to fight fire, practice basic first aid and search & rescue.	Nil	Done	Zaw/Tin/Thet
7	Adequate number of emergency response team in place?	Yes		Plant emergency response team is established in accordance with Emergency Response Plan.	Nil	Done	Zaw/Tin/Thet

Date: 30 October 2025

Location: Myingyan 225MW CCPP

Name of individual undertaking the monitoring: Tin Ko Ko (HSSE Officer), Thet Nyi Nyi Shwe (HSSE Officer), Zaw Moe Aung (HSSE Manager), Kyaw Myo Htet (Security)

IED Threat Emergency Drill_ Oct 2025

Scenario

Security guard found a suspected IED on an entering car.


Date: 28/ 10/ 2025

Time: 12:30 pm

Location: Gate 1, security check point.



Response Flow

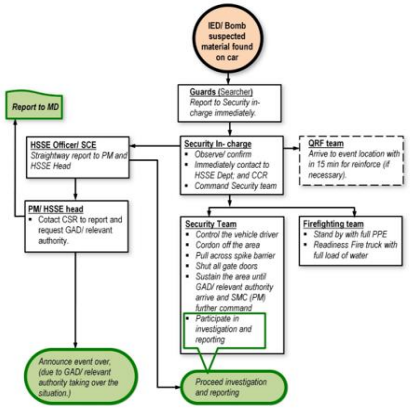

Regular Inspections for Emergency Preparedness, Oct 2025

Fire hose reel Inspection and Testing



Emergency Eye Wash testing



Testing Emergency Phone System



Sembcorp Myingyan Power Company Limited

ESMP Checklist for November 2025

Emergency Preparedness & Response Management Monitoring Checklist Form (Operational Phase)

No	Description	Yes	No	Details of Observation	Corrective Action to be Taken	Action taken date	Verified by
1	Emergency contact list displayed in prominent area, such as, notice board, resting shelters?	Yes		Displayed at offices notice boards, security guard house, and canteen and updating regularly.	Nil	Done	Zaw/Tin/Thet
2	Emergency evacuation route is pasted on prominent location?	Yes		Posted in major buildings.	Nil	Done	Zaw/Tin/Thet
3	Regular inspection on emergency resources?	Yes		Monthly inspection is conducted by appointed person.	Nil	Done	Zaw/Tin/Thet
4	Emergency drill exercise was conducted regularly?	Yes		Conducting monthly Emergency response drill.	Nil	Done	Zaw/Tin/Thet
5	Regular inspection on clearance of emergency evacuation route, for emergency vehicle access?	Yes		Monthly inspection conducted by appointed person.	Nil	Done	Zaw/Tin/Thet
6	Emergency response team was trained to deal with emergency situation? - First Aid - Firefighting - Rescue	Yes		Plant Emergency Response team is trained to fight fire, practice basic first aid and search & rescue.	Nil	Done	Zaw/Tin/Thet
7	Adequate number of emergency response team in place?	Yes		Plant emergency response team is established in accordance with Emergency Response Plan.	Nil	Done	Zaw/Tin/Thet

Date: 30 November 2025

Location: Myingyan 225MW CCPP

Name of individual undertaking the monitoring: Tin Ko Ko (HSSE Officer), Thet Nyi Nyi Shwe (HSSE Officer), Zaw Moe Aung (HSSE Manager), Kyaw Myo Htet (Security)

Electrical Shock EMERGENCY RESPONSE (Table-Top Exercise) Nov-2025


Scenario

Discovered one employee got electrical Shock in electrical building,

Time: 10:30 am
Location: 2nd story of Electrical building
Voltage: High voltage
Event: One technician got sudden onset of electrical shock and collapsed
Discoverer: Another technician near by the Switching Assistant (SA) with Rescue Hook.


History of event and response process will be presented on ELECTROCUTION RESCUE PLAN and response flow chart.

Response Flow

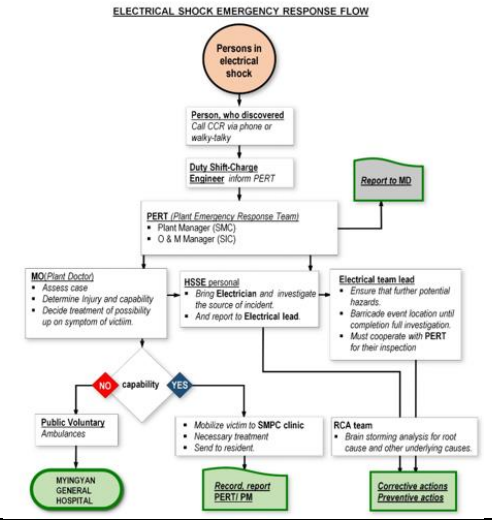


Regular Inspections for Emergency Preparedness, November-2025


Fire hose & nozzle inspection

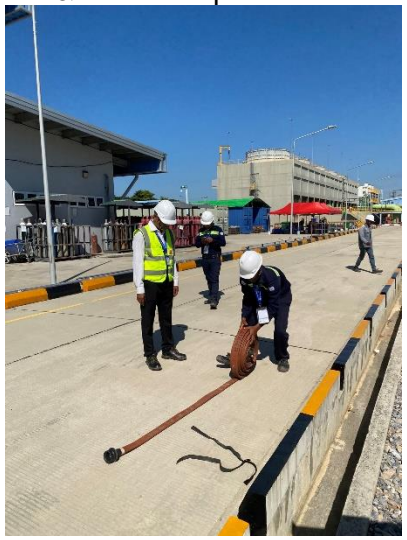

Fire hose nozzle inspection

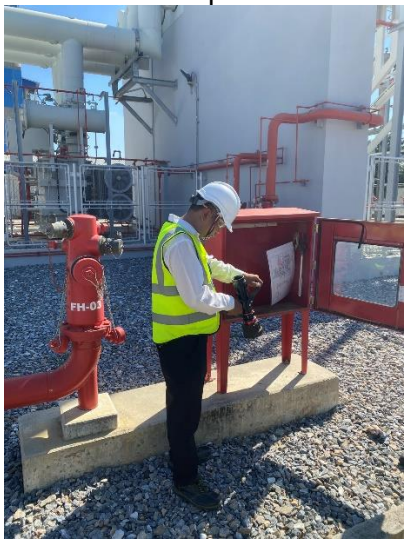

Emergency Shower Testing

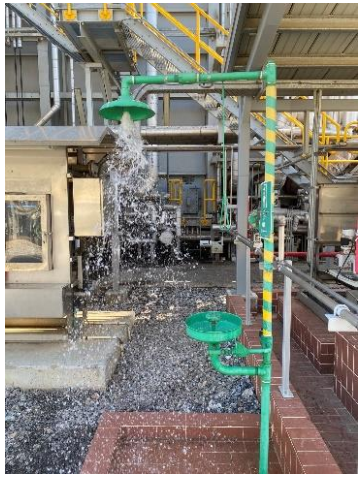

Sembcorp Myingyan Power Company Limited

ESMP Checklist for December 2025

Emergency Preparedness & Response Management Monitoring Checklist Form (Operational Phase)

No	Description	Yes	No	Details of Observation	Corrective Action to be Taken	Action taken date	Verified by
1	Emergency contact list displayed in prominent area, such as, notice board, resting shelters?	Yes		Displayed at offices notice boards, security guard house and canteen and updating regularly.	Nil	Done	Zaw/Tin/Thet
2	Emergency evacuation route is pasted on prominent location?	Yes		Posted in major buildings.	Nil	Done	Zaw/Tin/Thet
3	Regular inspection on emergency resources?	Yes		Monthly inspection is conducted by appointed person.	Nil	Done	Zaw/Tin/Thet
4	Emergency drill exercise was conducted regularly?	Yes		Conducting monthly Emergency response drill.	Nil	Done	Zaw/Tin/Thet
5	Regular inspection on clearance of emergency evacuation route, for emergency vehicle access?	Yes		Monthly inspection conducted by appointed person.	Nil	Done	Zaw/Tin/Thet
6	Emergency response team was trained to deal with emergency situation? - First Aid - Firefighting - Rescue	Yes		Plant Emergency Response team is trained to fight fire, practice basic first aid and search & rescue.	Nil	Done	Zaw/Tin/Thet
7	Adequate number of emergency response team in place?	Yes		Plant emergency response team is established in accordance with Emergency Response Plan.	Nil	Done	Zaw/Tin/Thet

Date: 30 December 2025

Location: Myingyan 225MW CCPP

Name of individual undertaking the monitoring: Tin Ko Ko (HSSE Officer), Thet Nyi Nyi Shwe (HSSE Officer), Zaw Moe Aung (HSSE Manager), Kyaw Myo Htet (Security)

Chemical Burn & First Aid Table Talk Exercise – Dec 2025

Exercise description scenario



Details of Table-Top Exercise are as follow: Occur an Chemical Burn


Date: 30/ Dec/ 2025

Time: 2:30 pm


Location: Cooling Tower Chemical Dosing Area

Event: On 30 Dec 2025 at 02:30 PM, SMPC a field technician and contractor 2 supply workers were tasked to carry out chemical filling at Cooling Tower Chemical Dosing area (opposite the Demin MCC area).
A contractor worker chemical burn accident case happened while chemical top up and leak from top up line.
They were accompanied with a field technician to supervise the works.
(Response process will be presented on response flow chart)

Response Flow

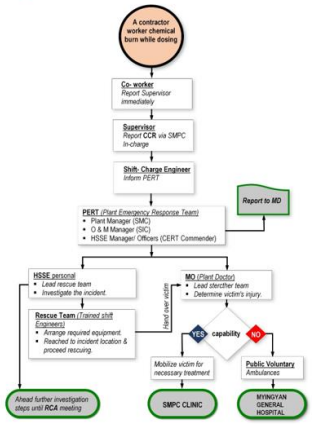

Regular Inspections for Emergency Preparedness, December 2025

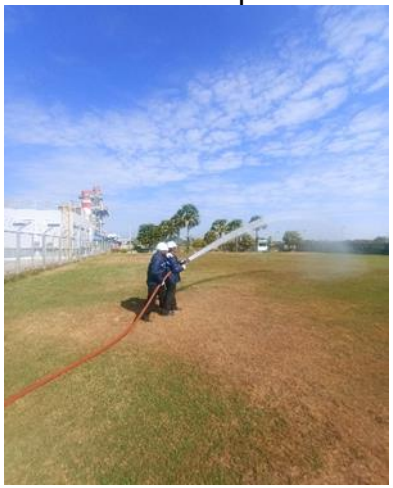Fire hydrant and hose inspection and testing	Eyewash station inspection and testing.	Checking AED and first-aid box.
		

ESMP Checklist for January 2026

Emergency Preparedness & Response Management Monitoring Checklist Form (Operational Phase)

No	Description	Yes	No	Details of Observation	Corrective Action to be Taken	Action taken date	Verified by
1	Emergency contact list displayed in prominent area, such as, notice board, resting shelters?	Yes		Displayed at offices notice boards, security guard house and canteen and updating regularly.	Nil	Done	Zaw/Tin/ Kaung
2	Emergency evacuation route is pasted on prominent location?	Yes		Posted in major buildings.	Nil	Done	Zaw/Tin/ Kaung
3	Regular inspection on emergency resources?	Yes		Monthly inspection is conducted by appointed person.	Nil	Done	Zaw/Tin/ Kaung
4	Emergency drill exercise was conducted regularly?	Yes		Conducting monthly Emergency response drill.	Nil	Done	Zaw/Tin/ Kaung
5	Regular inspection on clearance of emergency evacuation route, for emergency vehicle access?	Yes		Monthly inspection conducted by appointed person.	Nil	Done	Zaw/Tin/ Kaung
6	Emergency response team was trained to deal with emergency situation? - First Aid - Firefighting - Rescue	Yes		Plant Emergency Response team is trained to fight fire, practice basic first aid and search & rescue.	Nil	Done	Zaw/Tin/ Kaung
7	Adequate number of emergency response team in place?	Yes		Plant emergency response team is established in accordance with Emergency Response Plan.	Nil	Done	Zaw/Tin/ Kaung

Date: 31 January 2026

Location: Myingyan 225MW CCPP

Name of individual undertaking the monitoring: Tin Ko Ko (HSSE Officer), Kaung Zayar (HSSE Officer), Zaw Moe Aung (HSSE Manager), Kyaw Myo Htet (Security)

IED response (Security) Physical (Local) – Jan 2026

Scenario.

Security guard found a suspected IED on an entering car.

Date: 27/ 01/ 2026

Time: 01:15PM

Location: Gate 3, security check point.





Regular Inspections for Emergency Preparedness, Jan 2026

Fire hydrant and hose inspection and testing 	Eyewash shower station inspection and testing. 	Checking and testing of inter-com system. 

Sembcorp Myingyan Power Company Limited

ESMP Checklist for February 2026

Emergency Preparedness & Response Management Monitoring Checklist Form (Operational Phase)

No	Description	Yes	No	Details of Observation	Corrective Action to be Taken	Action taken date	Verified by
1	Emergency contact list displayed in prominent area, such as, notice board, resting shelters?	Yes		Displayed at offices notice boards, security guard house and canteen and updating regularly.	Nil	Done	Zaw/Tin/ Kaung
2	Emergency evacuation route is pasted on prominent location?	Yes		Posted in major buildings.	Nil	Done	Zaw/Tin/ Kaung
3	Regular inspection on emergency resources?	Yes		Monthly inspection is conducted by appointed person.	Nil	Done	Zaw/Tin/ Kaung
4	Emergency drill exercise was conducted regularly?	Yes		Conducting monthly Emergency response drill.	Nil	Done	Zaw/Tin/ Kaung
5	Regular inspection on clearance of emergency evacuation route, for emergency vehicle access?	Yes		Monthly inspection conducted by appointed person.	Nil	Done	Zaw/Tin/ Kaung
6	Emergency response team was trained to deal with emergency situation? - First Aid - Firefighting - Rescue	Yes		Plant Emergency Response team is trained to fight fire, practice basic first aid and search & rescue.	Nil	Done	Zaw/Tin/ Kaung
7	Adequate number of emergency response team in place?	Yes		Plant emergency response team is established in accordance with Emergency Response Plan.	Nil	Done	Zaw/Tin/ Kaung

Date: 28 February 2026

Location: Myingyan 225MW CCPP

Name of individual undertaking the monitoring: Tin Ko Ko (HSSE Officer), Kaung Zayar (HSSE Officer), Zaw Moe Aung (HSSE Manager), Kyaw Myo Htet (Security)

Chemical Spillage Controlled Emergency, Feb-2026








Regular Inspections for Emergency Preparedness Feb - 2026

Fire hydrant and hose inspection and testing

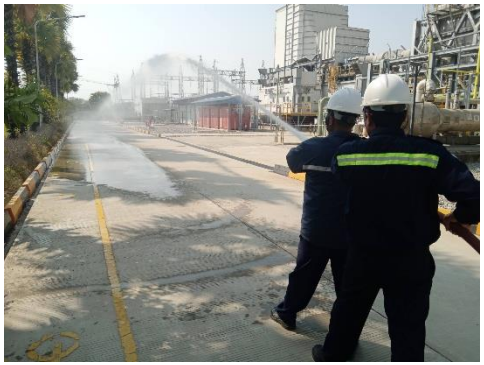

Eyewash shower station inspection and testing.



Checking and testing of inter-com system.



Sembcorp Myingyan Power Company Limited

ESMP Checklist for March 2026

Emergency Preparedness & Response Management Monitoring Checklist Form (Operational Phase)

No	Description	Yes	No	Details of Observation	Corrective Action to be Taken	Action taken date	Verified by
1	Emergency contact list displayed in prominent area, such as, notice board, resting shelters?	Yes		Displayed at offices notice boards, security guard house and canteen and updating regularly.	Nil	Done	Zaw/Tin/Thet
2	Emergency evacuation route is pasted on prominent location?	Yes		Posted in major buildings.	Nil	Done	Zaw/Tin/Thet
3	Regular inspection on emergency resources?	Yes		Monthly inspection is conducted by appointed person.	Nil	Done	Zaw/Tin/Thet
4	Emergency drill exercise was conducted regularly?	Yes		Conducting monthly Emergency response drill.	Nil	Done	Zaw/Tin/Thet
5	Regular inspection on clearance of emergency evacuation route, for emergency vehicle access?	Yes		Monthly inspection conducted by appointed person.	Nil	Done	Zaw/Tin/Thet
6	Emergency response team was trained to deal with emergency situation? - First Aid - Firefighting - Rescue	Yes		Plant Emergency Response team is trained to fight fire, practice basic first aid and search & rescue.	Nil	Done	Zaw/Tin/Thet
7	Adequate number of emergency response team in place?	Yes		Plant emergency response team is established in accordance with Emergency Response Plan.	Nil	Done	Zaw/Tin/Thet

Date: 30 March 2026

Location: Myingyan 225MW CCPP

Name of individual undertaking the monitoring: Tin Ko Ko (HSSE Officer), Kaung Zayar (HSSE Officer), Zaw Moe Aung (HSSE Manager), Kyaw Myo Htet (Security)

Carbon Dioxide CO_2 Leakage Controlled Emergency Response Drill, Table Talk Discussion
March 2026

Exercise description scenario



Details of Actual Exercise (localize) are as follow:

Date: 26/ March/ 2026


Time: 10:30 Am

Location: GT-2 CO_2 Container

Event: CO_2 Leakage

- On 26 March 2026 (Thursday) at 10:30 AM, CCR shift charge engineer notified CO_2 weight loss alarm activation & inform the field technician to check actual cylinder leakage in the CO_2 cylinder container at GT-2.
- The field technician check via gas meter through the ventilation hole & found that O_2 level is dropping inside the CO_2 container
- The leakage resulted in CO_2 gas release within the enclosed container, posing a risk of oxygen displacement.
- No injury occurred.
- The person confirmed "CO_2 leak", withdrew to a safe distance, and alerted nearby workers.

Response Flow Chart

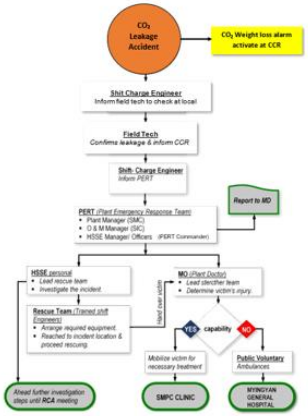

Regular Inspections for Emergency Preparedness, March 2026

Fire hydrant and hose inspection and testing



Fire Truck Inspection



Spike Barrier Inspection



Sembcorp Myingyan Power Co., Limited.

ESMP- Noise & Vibration Management Monitoring Checklist.
(Oct 2025 ~ Mar 2026)

Sembcorp Myingyan Power Company Limited
ESMP Checklist for October 2025

Noise and Vibration Management Monitoring Checklist Form (Operational Phase)

S/N	Description	Yes	No	Details of Observation / Location	Action to be Taken	Action taken date	Verified by
1	Are there operation & maintenance noise activities and area identified?	Yes		Noise sources situated in; ▪ Steam turbine building ▪ GT#1, HRSG #1 ▪ GT#2, HRSG #2	▪ Conduct training of noise protection. ▪ Issue ear protector	Done	Zaw/Tin/Thet
2	Are noisy parts of Machines enclosed?	Yes		Machines are installed in their enclosures.	Nil	Done	Zaw/Tin/Thet
3	Are Machines serviced and maintained regularly?	Yes		Nil	Nil	Done	Zaw/Tin/Thet
4	Are machines correctly mounted to avoid vibration and reduce noise levels?	Yes		Nil	Nil	Done	Zaw/Tin/Thet
5	Are sound absorbing materials used on site such as noise barrier?	Yes		Nil	Nil	Done	Zaw/Tin/Thet
6	Regular monitoring done for identified NSRs within 500m from the Plant boundary? (ESIA recommended quarterly	Yes		Will conduct quarterly monitoring by 3rd party surveyor in June 2025.	Nil	Ongoing	Zaw/Tin/Thet
7	Have there been any complaints from outside communities concerning noise through the Projects grievance mechanism?		No	Nil	Nil	Done	Zaw/Tin/Thet
8	Is the Plant Management discussed about noise issue in meeting, such as workforce training on noise protection and prevention?	Yes		Nil	Nil	Done	Zaw/Tin/Thet

Date / Time: 30 October 2025

Location: Designated points

Name of individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Thet Nyi Nyi Shwe (HSSE Officer), Zaw Moe Aung (HSSE Manager).

Sembcorp Myingyan Power Company Limited

ESMP Checklist for November 2025

Noise and Vibration Management Monitoring Checklist Form (Operational Phase)

S/N	Description	Yes	No	Details of Observation / Location	Action to be Taken	Action taken date	Verified by
1	Are there operation & maintenance noise activities and area identified?	Yes		Noise sources situated in. ▪ Steam turbine building ▪ GT#1, HRSG #1 ▪ GT#2, HRSG #2	▪ Conduct training of noise protection. ▪ Issue ear protector	Done	Zaw/Tin/Thet
2	Are noisy parts of Machines enclosed?	Yes		Machines are installed in their enclosures.	Nil	Done	Zaw/Tin/Thet
3	Are Machines serviced and maintained regularly?	Yes		Nil	Nil	Done	Zaw/Tin/Thet
4	Are machines correctly mounted to avoid vibration and reduce noise levels?	Yes		Nil	Nil	Done	Zaw/Tin/Thet
5	Are sound absorbing materials used on site such as noise barrier?	Yes		Nil	Nil	Done	Zaw/Tin/Thet
6	Regular monitoring done for identified NSRs within 500m from the Plant boundary? (ESIA recommended quarterly	Yes		Will conduct quarterly monitoring by 3rd party surveyor in June 2025.	Nil	Ongoing	Zaw/Tin/Thet
7	Have there been any complaints from outside communities concerning noise through the Projects grievance mechanism?		No	Nil	Nil	Done	Zaw/Tin/Thet
8	Is the Plant Management discussed about noise issue in meeting, such as workforce training on noise protection and prevention?	Yes		Nil	Nil	Done	Zaw/Tin/Thet

Date / Time: 30 November 2025

Location: Designated points

Name of individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Thet Nyi Nyi Shwe (HSSE Officer), Zaw Moe Aung (HSSE Manager).

Sembcorp Myingyan Power Company Limited

ESMP Checklist for December 2025

Noise and Vibration Management Monitoring Checklist Form (Operational Phase)

S/N	Description	Yes	No	Details of Observation / Location	Action to be Taken	Action taken date	Verified by
1	Are there operation & maintenance noise activities and area identified?	Yes		Noise sources situated in; ▪ Steam turbine building ▪ GT#1, HRSG #1 ▪ GT#2, HRSG #2	▪ Conduct training of noise protection. ▪ Issue ear protector	Done	Zaw/Tin/Thet
2	Are noisy parts of Machines enclosed?	Yes		Machines are installed in their enclosures.	Nil	Done	Zaw/Tin/Thet
3	Are Machines serviced and maintained regularly?	Yes		Nil	Nil	Done	Zaw/Tin/Thet
4	Are machines correctly mounted to avoid vibration and reduce noise levels?	Yes		Nil	Nil	Done	Zaw/Tin/Thet
5	Are sound absorbing materials used on site such as noise barrier?	Yes		Nil	Nil	Done	Zaw/Tin/Thet
6	Regular monitoring done for identified NSRs within 500m from the Plant boundary? (ESIA recommended quarterly	Yes		Conducted quarterly monitoring by 3rd party surveyor. Will be conducted again in September 2025.	Nil	Done	Zaw/Tin/Thet
7	Have there been any complaints from outside communities concerning noise through the Projects grievance mechanism?		No	Nil	Nil	Done	Zaw/Tin/Thet
8	Is the Plant Management discussed about noise issue in meeting, such as workforce training on noise protection and prevention?	Yes		Nil	Nil	Done	Zaw/Tin/Thet

Date / Time: 30 December 2025

Location: Designated points

Name of individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Thet Nyi Nyi Shwe (HSSE Officer), Zaw Moe Aung (HSSE Manager).

Sembcorp Myingyan Power Company Limited

ESMP Checklist for January 2026

Noise and Vibration Management Monitoring Checklist Form (Operational Phase)

S/N	Description	Yes	No	Details of Observation / Location	Action to be Taken	Action taken date	Verified by
1	Are there operation & maintenance noise activities and area identified?	Yes		Noise sources situated in; ▪ Steam turbine building ▪ GT#1, HRSG #1 ▪ GT#2, HRSG #2	▪ Conduct training of noise protection. ▪ Issue ear protector	Done	Zaw/Tin/ Kaung
2	Are noisy parts of Machines enclosed?	Yes		Machines are installed in their enclosures.	Nil	Done	Zaw/Tin/ Kaung
3	Are Machines serviced and maintained regularly?	Yes		Nil	Nil	Done	Zaw/Tin/ Kaung
4	Are machines correctly mounted to avoid vibration and reduce noise levels?	Yes		Nil	Nil	Done	Zaw/Tin/ Kaung
5	Are sound absorbing materials used on site such as noise barrier?	Yes		Nil	Nil	Done	Zaw/Tin/ Kaung
6	Regular monitoring done for identified NSRs within 500m from the Plant boundary? (ESIA recommended quarterly	Yes		Will conduct quarterly monitoring by 3rd party surveyor in September 2025.	Nil	Done	Zaw/Tin/ Kaung
7	Have there been any complaints from outside communities concerning noise through the Projects grievance mechanism?		No	Nil	Nil	Done	Zaw/Tin/ Kaung
8	Is the Plant Management discussed about noise issue in meeting, such as workforce training on noise protection and prevention?	Yes		Nil	Nil	Done	Zaw/Tin/ Kaung

Date / Time: 31 Jan 2026

Location: Designated points

Name of individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Kaung Zayar (HSSE Officer), Zaw Moe Aung (HSSE Manager).

Sembcorp Myingyan Power Company Limited

ESMP Checklist for Feb 2026

Noise and Vibration Management Monitoring Checklist Form (Operational Phase)

S/N	Description	Yes	No	Details of Observation / Location	Action to be Taken	Action taken date	Verified by
1	Are there operation & maintenance noise activities and area identified?	Yes		Noise sources situated in; ▪ Steam turbine building ▪ GT#1, HRSG #1 ▪ GT#2, HRSG #2	▪ Conduct training of noise protection. ▪ Issue ear protector	Done	Zaw/Tin/ Kaung
2	Are noisy parts of Machines enclosed?	Yes		Machines are installed in their enclosures.	Nil	Done	Zaw/Tin/ Kaung
3	Are Machines serviced and maintained regularly?	Yes		Nil	Nil	Done	Zaw/Tin/ Kaung
4	Are machines correctly mounted to avoid vibration and reduce noise levels?	Yes		Nil	Nil	Done	Zaw/Tin/ Kaung
5	Are sound absorbing materials used on site such as noise barrier?	Yes		Nil	Nil	Done	Zaw/Tin/ Kaung
6	Regular monitoring done for identified NSRs within 500m from the Plant boundary? (ESIA recommended quarterly	Yes		Will conduct quarterly monitoring by 3rd party surveyor in September 2025.	Nil	Done	Zaw/Tin/ Kaung
7	Have there been any complaints from outside communities concerning noise through the Projects grievance mechanism?		No	Nil	Nil	Done	Zaw/Tin/ Kaung
8	Is the Plant Management discussed about noise issue in meeting, such as workforce training on noise protection and prevention?	Yes		Nil	Nil	Done	Zaw/Tin/ Kaung

Date / Time: 28 February 2026

Location: Designated points

Name of individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Kaung Zayar (HSSE Officer), Zaw Moe Aung (HSSE Manager).

Sembcorp Myingyan Power Company Limited

ESMP Checklist for March 2026

Noise and Vibration Management Monitoring Checklist Form (Operational Phase)

S/N	Description	Yes	No	Details of Observation / Location	Action to be Taken	Action taken date	Verified by
1	Are there operation & maintenance noise activities and area identified?	Yes		Noise sources situated in; ▪ Steam turbine building ▪ GT#1, HRSG #1 ▪ GT#2, HRSG #2	▪ Conduct training of noise protection. ▪ Issue ear protector	Done	Zaw/Tin/ Kaung
2	Are noisy parts of Machines enclosed?	Yes		Machines are installed in their enclosures.	Nil	Done	Zaw/Tin/ Kaung
3	Are Machines serviced and maintained regularly?	Yes		Nil	Nil	Done	Zaw/Tin/ Kaung
4	Are machines correctly mounted to avoid vibration and reduce noise levels?	Yes		Nil	Nil	Done	Zaw/Tin/ Kaung
5	Are sound absorbing materials used on site such as noise barrier?	Yes		Nil	Nil	Done	Zaw/Tin/ Kaung
6	Regular monitoring done for identified NSRs within 500m from the Plant boundary? (ESIA recommended quarterly	Yes		Conducted quarterly monitoring by 3rd party surveyor, and results are well below NEQG guideline values. Will be conducted again in December 2025.	Nil	Done	Zaw/Tin/ Kaung
7	Have there been any complaints from outside communities concerning noise through the Projects grievance mechanism?		No	Nil	Nil	Done	Zaw/Tin/ Kaung
8	Is the Plant Management discussed about noise issue in meeting, such as workforce training on noise protection and prevention?	Yes		Nil	Nil	Done	Zaw/Tin/ Kaung

Date / Time: 30 March 2026
Location: Designated points
Name of individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Kaung Zayar(HSSE Officer), Zaw Moe Aung (HSSE Manager).

Sembcorp Myingyan Power Co., Limited.

ESMP- Occupational Health and Safety Control Measure Implementation & Monitoring Check List (Oct 2025 ~ Mar 2026)

Sembcorp Myingyan Power Company Limited

ESMP Checklist for October 2025

Workers Occupational Health and Safety Control measure implementation & monitoring checklist (Operational Phase)

No.	Description	Yes	No	Details of Observation / Location	Corrective Action to be Taken	Action taken date	Verified by
1	Is the HSE policy authorized by company top management and communicated to the persons working under the control of organization?	Yes		QHSE policy has signed by company top management and displayed in all the HSSE notice boards, all meeting rooms and attached in SIC training as well.	Nil	Done	Zaw/Tin/Thet
2	Are personnel working under the organization comply with safe working practices to prevent from OHS risk associated to the activities. Are Permit-To-Work system implemented by the Plant such as Hot-work, working at height, lifting operation, Excavation and Confined space work, etc.?	Yes		Implemented Permit to work system.	Nil	Done	Zaw/Tin/Thet
3	Are trainings and consultation program for workers who involved in high risk activities conducted by the O&M and Contractors?	Yes		Workers are trained for safe work procedures. Risk assessment conducted for all work activities. Toolbox talk conducted prior to commencing work activity. Conduct Emergency response awareness according to SIC.	Nil	Done	Zaw/Tin/Thet
4	Are HSSE meetings conducted accordingly, such as Daily HSE and O&M meeting, Tool box meeting, HSSE Committee meeting, etc.?	Yes		Conducting daily HSE and O&M meeting. Conducting daily Permit to Work Meeting. Monthly HSSE Committee meeting in first week of April 2025.	Nil	Done	Zaw/Tin/Thet
5	Are all the near-miss, incidents, accidents, and occupational diseases, dangerous occurrence at the project activity area, plant and workers camp investigated and reported?	Yes		Nil	Nil	Done	Zaw/Tin/Thet
6	In-house rules are implemented and monitoring for the compliances.	Yes		12 life-saving rules are implemented and displayed at strategic locations. Stop Data Pro platform is used to report unsafe condition and unsafe act and to take corrective actions.	Nil	Done	Zaw/Tin/Thet

7	Is HSE promotional activities for workforce implemented by Plant Management?	Yes		Incentive awards giving out for HSSE observation submission and Life Saving Rule safety quiz.	Nil	Done	Zaw/Tin/Thet
8	Is there implemented procedure on evaluation, selection and control of sub-contractor? Is the daily monitoring on labor and working condition conducted by contractor, especially, no child and forced labor will be employed by contractors?	Yes		Safe Working Procedure for Contractor Management and Contractor Requirement has been implemented.	Nil	Done	Zaw/Tin/Thet
9	Is there implemented HSE inspection program and documented?	Yes		Weekly management site-walk inspection conducted and documented accordingly.	Nil	Done	Zaw/Tin/Thet
10	Are equipment, electrical tools, machineries, lifting gears, and scaffold inspected by competent personnel?	Yes		Inspected by appointed inspector before task.	Nil	Done	Zaw/Tin/Thet
11	Are Method Statements, Risk Assessments & Safe Work Procedures complying with required work activities that will be potential harm to workforce?	Yes		PTW attached with MS and RA are required to be approved before tasks.	Nil	Done	Zaw/Tin/Thet
12	Is there any form of control on movement of hazardous substances such as chemicals? Any PPEs compliance on handling of such chemicals?	Yes		Hazardous substances are controlled by complying with safe handling and storage of chemical procedures. Workers are mandatory to comply with PPEs requirement as stated in SDS.	Nil	Done	Zaw/Tin/Thet
13	Are firefighting equipment's provided and inspected/tested regularly? Any damaged firefighting equipment replaced timely?	Yes		Inspecting monthly and damaged are replaced timely if any.	Nil	Done	Zaw/Tin/Thet
14	Pre-employment medical check and routine health screen conducted? Annual audiometric test conducted for the persons working under the organization?	Yes		Pre-employment medical check is carried out for all new hires. Annual audiometric is planned to be conducted in May 2025.	Nil	Done	Zaw/Tin/Thet

Date / Time: 30 October 2025

Location: Plant area

Role of Individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Thet Nyi Nyi Shwe (HSSE Officer) and Zaw Moe Aung (HSSE Manager).

Sembcorp Myingyan Power Company Limited

ESMP Checklist for November 2025

Workers Occupational Health and Safety Control measure implementation & monitoring checklist (Operational Phase)

No.	Description	Yes	No	Details of Observation / Location	Corrective Action to be Taken	Action taken date	Verified by
1	Is the HSE policy authorized by company top management and communicated to the persons working under the control of organization?	Yes		QHSE policy has signed by company top management and displayed in all the HSSE notice boards, all meeting rooms and attached in SIC training as well.	Nil	Done	Zaw/Tin/Thet
2	Are personnel working under the organization comply with safe working practices to prevent from OHS risk associated to the activities. Are Permit-To-Work system implemented by the Plant such as Hot-work, working at height, lifting operation, Excavation and Confined space work, etc.?	Yes		Implemented Permit to work system.	Nil	Done	Zaw/Tin/Thet
3	Are trainings and consultation program for workers who involved in high risk activities conducted by the O&M and Contractors?	Yes		Workers are trained for safe work procedures. Risk assessment conducted for all work activities. Toolbox talk conducted prior to commencing work activity. Conduct Emergency response awareness according to SIC.	Nil	Done	Zaw/Tin/Thet
4	Are HSSE meetings conducted accordingly, such as Daily HSE and O&M meeting, Tool box meeting, HSSE Committee meeting, etc.?	Yes		Conducting daily HSE and O&M meeting. Conducting daily Permit to Work Meeting. Monthly HSSE Committee meeting in first week of May 2025.	Nil	Done	Zaw/Tin/Thet
5	Are all the near-miss, incidents, accidents, and occupational diseases, dangerous occurrence at the project activity area, plant and workers camp investigated and reported?	Yes		Nil	Nil	Done	Zaw/Tin/Thet
6	In-house rules are implemented and monitoring for the compliances.	Yes		12 life-saving rules are implemented and displayed at strategic locations. Stop Data Pro platform is used to report unsafe condition and unsafe act and to take corrective actions.	Nil	Done	Zaw/Tin/Thet

7	Is HSE promotional activities for workforce implemented by Plant Management?	Yes		Incentive awards giving out for HSSE observation submission and Life Saving Rule safety quiz.	Nil	Done	Zaw/Tin/Thet
8	Is there implemented procedure on evaluation, selection and control of sub-contractor? Is the daily monitoring on labor and working condition conducted by contractor, especially, no child and forced labor will be employed by contractors?	Yes		Safe Working Procedure for Contractor Management and Contractor Requirement has been implemented.	Nil	Done	Zaw/Tin/Thet
9	Is there implemented HSE inspection program and documented?	Yes		Weekly management site-walk inspection conducted and documented accordingly.	Nil	Done	Zaw/Tin/Thet
10	Are equipment, electrical tools, machineries, lifting gears, and scaffold inspected by competent personnel?	Yes		Inspected by appointed inspector before task.	Nil	Done	Zaw/Tin/Thet
11	Are Method Statements, Risk Assessments & Safe Work Procedures complying with required work activities that will be potential harm to workforce?	Yes		PTW attached with MS and RA are required to be approved before tasks.	Nil	Done	Zaw/Tin/Thet
12	Is there any form of control on movement of hazardous substances such as chemicals? Any PPEs compliance on handling of such chemicals?	Yes		Hazardous substances are controlled by complying with safe handling and storage of chemical procedures. Workers are mandatory to comply with PPEs requirement as stated in SDS.	Nil	Done	Zaw/Tin/Thet
13	Are firefighting equipment's provided and inspected/tested regularly? Any damaged firefighting equipment replaced timely?	Yes		Inspecting monthly and damaged are replaced timely if any.	Nil	Done	Zaw/Tin/Thet
14	Pre-employment medical check and routine health screen conducted? Annual audiometric test conducted for the persons working under the organization?	Yes		Pre-employment medical check is carried out for all new hires. Annual audiometric has been conducted in May 2025.	Nil	Done	Zaw/Tin/Thet

Date / Time: 30 November 2025

Location: Plant area

Role of Individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Thet Nyi Nyi Shwe (HSSE Officer), Zaw Moe Aung (HSSE Manager).

Sembcorp Myingyan Power Company Limited

ESMP Checklist for December 2025

Workers Occupational Health and Safety Control measure implementation & monitoring checklist (Operational Phase)

No.	Description	Yes	No	Details of Observation / Location	Corrective Action to be Taken	Action taken date	Verified by
1	Is the HSE policy authorized by company top management and communicated to the persons working under the control of organization?	Yes		QHSE policy has signed by company top management and displayed in all the HSSE notice boards, all meeting rooms and attached in SIC training as well.	Nil	Done	Zaw/Tin/Thet
2	Are personnel working under the organization comply with safe working practices to prevent from OHS risk associated to the activities. Are Permit-To-Work system implemented by the Plant such as Hot-work, working at height, lifting operation, Excavation and Confined space work, etc.?	Yes		Implemented Permit to work system.	Nil	Done	Zaw/Tin/Thet
3	Are trainings and consultation program for workers who involved in high risk activities conducted by the O&M and Contractors?	Yes		Workers are trained for safe work procedures. Risk assessment conducted for all work activities. Toolbox talk conducted prior to commencing work activity. Conduct Emergency response awareness according to SIC.	Nil	Done	Zaw/Tin/Thet
4	Are HSSE meetings conducted accordingly, such as Daily HSE and O&M meeting, Tool box meeting, HSSE Committee meeting, etc.?	Yes		Conducting daily HSE and O&M meeting. Conducting daily Permit to Work Meeting. Monthly HSSE Committee meeting in first week of June 2025.	Nil	Done	Zaw/Tin/Thet
5	Are all the near-miss, incidents, accidents, and occupational diseases, dangerous occurrence at the project activity area, plant and workers camp investigated and reported?	Yes		Nil	Nil	Done	Zaw/Tin/Thet
6	In-house rules are implemented and monitoring for the compliances.	Yes		12 life-saving rules are implemented and displayed at strategic locations. Stop Data Pro platform is used to report unsafe condition and unsafe act and to take corrective actions.	Nil	Done	Zaw/Tin/Thet

7	Is HSE promotional activities for workforce implemented by Plant Management?	Yes		Incentive awards giving out for HSSE observation submission and Life Saving Rule safety quiz. DuPont (STOP observation)	Nil	Done	Zaw/Tin/Thet
8	Is there implemented procedure on evaluation, selection and control of sub-contractor? Is the daily monitoring on labor and working condition conducted by contractor, especially, no child and forced labor will be employed by contractors?	Yes		Safe Working Procedure for Contractor Management and Contractor Requirement has been implemented.	Nil	Done	Zaw/Tin/Thet
9	Is there implemented HSE inspection program and documented?	Yes		Weekly management site-walk inspection conducted and documented accordingly.	Nil	Done	Zaw/Tin/Thet
10	Are equipment, electrical tools, machineries, lifting gears, and scaffold inspected by competent personnel?	Yes		Inspected by appointed inspector before task.	Nil	Done	Zaw/Tin/Thet
11	Are Method Statements, Risk Assessments & Safe Work Procedures complying with required work activities that will be potential harm to workforce?	Yes		PTW attached with MS and RA are required to be approved before tasks.	Nil	Done	Zaw/Tin/Thet
12	Is there any form of control on movement of hazardous substances such as chemicals? Any PPEs compliance on handling of such chemicals?	Yes		Hazardous substances are controlled by complying with safe handling and storage of chemical procedures. Workers are mandatory to comply with PPEs requirement as stated in SDS.	Nil	Done	Zaw/Tin/Thet
13	Are firefighting equipment's provided and inspected/tested regularly? Any damaged firefighting equipment replaced timely?	Yes		Inspecting monthly and damaged are replaced timely if any.	Nil	Done	Zaw/Tin/Thet
14	Pre-employment medical check and routine health screen conducted? Annual audiometric test conducted for the persons working under the organization?	Yes		Pre-employment medical check is carried out for all new hires. Annual audiometric was conducted in May 2025.	Nil	Done	Zaw/Tin/Thet

Date / Time: 30 December 2025

Location: Plant area

Role of Individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Thet Nyi Nyi Shwe (HSSE Officer), Zaw Moe Aung (HSSE Manager).

Sembcorp Myingyan Power Company Limited

ESMP Checklist for January 2026

Workers Occupational Health and Safety Control measure implementation & monitoring checklist (Operational Phase)

No.	Description	Yes	No	Details of Observation / Location	Corrective Action to be Taken	Action taken date	Verified by
1	Is the HSE policy authorized by company top management and communicated to the persons working under the control of organization?	Yes		QHSE policy has signed by company top management and displayed in all the HSSE notice boards, all meeting rooms and attached in SIC training as well.	Nil	Done	Zaw/Tin/ Kaung
2	Are personnel working under the organization comply with safe working practices to prevent from OHS risk associated to the activities. Are Permit-To-Work system implemented by the Plant such as Hot-work, working at height, lifting operation, Excavation and Confined space work, etc.?	Yes		Implemented Permit to work system.	Nil	Done	Zaw/Tin/ Kaung
3	Are trainings and consultation program for workers who involved in high risk activities conducted by the O&M and Contractors?	Yes		Workers are trained for safe work procedures. Risk assessment conducted for all work activities. Toolbox talk conducted prior to commencing work activity. Conduct Emergency response awareness according to SIC.	Nil	Done	Zaw/Tin/ Kaung
4	Are HSSE meetings conducted accordingly, such as Daily HSE and O&M meeting, Tool box meeting, HSSE Committee meeting, etc.?	Yes		Conducting daily HSE and O&M meeting. Conducting daily Permit to Work Meeting. Monthly HSSE Committee meeting in first week of July 2025.	Nil	Done	Zaw/Tin/ Kaung
5	Are all the near-miss, incidents, accidents, and occupational diseases, dangerous occurrence at the project activity area, plant and workers camp investigated and reported?	Yes		Nil	Nil	Done	Zaw/Tin/ Kaung
6	In-house rules are implemented and monitoring for the compliances.	Yes		12 life-saving rules are implemented and displayed at strategic locations. Stop Data Pro platform is used to report unsafe condition and unsafe act and to take corrective actions.	Nil	Done	Zaw/Tin/ Kaung

7	Is HSE promotional activities for workforce implemented by Plant Management?	Yes		Incentive awards giving out for HSSE observation submission and Life Saving Rule safety quiz. DuPont (STOP observation)	Nil	Done	Zaw/Tin/ Kaung
8	Is there implemented procedure on evaluation, selection and control of sub-contractor? Is the daily monitoring on labor and working condition conducted by contractor, especially, no child and forced labor will be employed by contractors?	Yes		Safe Working Procedure for Contractor Management and Contractor Requirement has been implemented.	Nil	Done	Zaw/Tin/ Kaung
9	Is there implemented HSE inspection program and documented?	Yes		Weekly management site-walk inspection conducted and documented accordingly.	Nil	Done	Zaw/Tin/ Kaung
10	Are equipment, electrical tools, machineries, lifting gears, and scaffold inspected by competent personnel?	Yes		Inspected by appointed inspector before task.	Nil	Done	Zaw/Tin/ Kaung
11	Are Method Statements, Risk Assessments & Safe Work Procedures complying with required work activities that will be potential harm to workforce?	Yes		PTW attached with MS and RA are required to be approved before tasks.	Nil	Done	Zaw/Tin/ Kaung
12	Is there any form of control on movement of hazardous substances such as chemicals? Any PPEs compliance on handling of such chemicals?	Yes		Hazardous substances are controlled by complying with safe handling and storage of chemical procedures. Workers are mandatory to comply with PPEs requirement as stated in SDS.	Nil	Done	Zaw/Tin/ Kaung
13	Are firefighting equipment's provided and inspected/tested regularly? Any damaged firefighting equipment replaced timely?	Yes		Inspecting monthly and damaged are replaced timely if any.	Nil	Done	Zaw/Tin/ Kaung
14	Pre-employment medical check and routine health screen conducted? Annual audiometric test conducted for the persons working under the organization?	Yes		Pre-employment medical check is carried out for all new hires. Annual audiometric was conducted in May 2025.	Nil	Done	Zaw/Tin/ Kaung

Date/Time: 31 January 2026

Location: Plant area

Role of Individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Kaung Zayar (HSSE Officer), Zaw Moe Aung (HSSE Manager).

Sembcorp Myingyan Power Company Limited

ESMP Checklist for February 2026

Workers Occupational Health and Safety Control measure implementation & monitoring checklist (Operational Phase)

No.	Description	Yes	No	Details of Observation / Location	Corrective Action to be Taken	Action taken date	Verified by
1	Is the HSE policy authorized by company top management and communicated to the persons working under the control of organization?	Yes		QHSE policy has signed by company top management and displayed in all the HSSE notice boards, all meeting rooms and attached in SIC training as well.	Nil	Done	Zaw/Tin/ Kaung
2	Are personnel working under the organization comply with safe working practices to prevent from OHS risk associated to the activities. Are Permit-To-Work system implemented by the Plant such as Hot-work, working at height, lifting operation, Excavation and Confined space work, etc.?	Yes		Implemented Permit to work system.	Nil	Done	Zaw/Tin/ Kaung
3	Are trainings and consultation program for workers who involved in high risk activities conducted by the O&M and Contractors?	Yes		Workers are trained for safe work procedures. Risk assessment conducted for all work activities. Toolbox talk conducted prior to commencing work activity. Conduct Emergency response awareness according to SIC.	Nil	Done	Zaw/Tin/ Kaung
4	Are HSSE meetings conducted accordingly, such as Daily HSE and O&M meeting, Tool box meeting, HSSE Committee meeting, etc.?	Yes		Conducting daily HSE and O&M meeting. Conducting daily Permit to Work Meeting. Monthly HSSE Committee meeting in first week of August 2025.	Nil	Done	Zaw/Tin/ Kaung
5	Are all the near-miss, incidents, accidents, and occupational diseases, dangerous occurrence at the project activity area, plant and workers camp investigated and reported?	Yes		Nil	Nil	Done	Zaw/Tin/ Kaung
6	In-house rules are implemented and monitoring for the compliances.	Yes		12 life-saving rules are implemented and displayed at strategic locations. Stop Data Pro platform is used to report unsafe condition and unsafe act and to take corrective actions.	Nil	Done	Zaw/Tin/ Kaung

7	Is HSE promotional activities for workforce implemented by Plant Management?	Yes		Incentive awards giving out for HSSE observation submission and Life Saving Rule safety quiz. DuPont (STOP observation)	Nil	Done	Zaw/Tin/ Kaung
8	Is there implemented procedure on evaluation, selection and control of sub-contractor? Is the daily monitoring on labor and working condition conducted by contractor, especially, no child and forced labor will be employed by contractors?	Yes		Safe Working Procedure for Contractor Management and Contractor Requirement has been implemented.	Nil	Done	Zaw/Tin/ Kaung
9	Is there implemented HSE inspection program and documented?	Yes		Weekly management site-walk inspection conducted and documented accordingly.	Nil	Done	Zaw/Tin/ Kaung
10	Are equipment, electrical tools, machineries, lifting gears, and scaffold inspected by competent personnel?	Yes		Inspected by appointed inspector before task.	Nil	Done	Zaw/Tin/Thet
11	Are Method Statements, Risk Assessments & Safe Work Procedures complying with required work activities that will be potential harm to workforce?	Yes		PTW attached with MS and RA are required to be approved before tasks.	Nil	Done	Zaw/Tin/ Kaung
12	Is there any form of control on movement of hazardous substances such as chemicals? Any PPEs compliance on handling of such chemicals?	Yes		Hazardous substances are controlled by complying with safe handling and storage of chemical procedures. Workers are mandatory to comply with PPEs requirement as stated in SDS.	Nil	Done	Zaw/Tin/ Kaung
13	Are firefighting equipment's provided and inspected/tested regularly? Any damaged firefighting equipment replaced timely?	Yes		Inspecting monthly and damaged are replaced timely if any.	Nil	Done	Zaw/Tin/ Kaung
14	Pre-employment medical check and routine health screen conducted? Annual audiometric test conducted for the persons working under the organization?	Yes		Pre-employment medical check is carried out for all new hires. Annual audiometric was conducted in May 2025	Nil	Done	Zaw/Tin/ Kaung

Date/Time: 28 February2026

Location: Plant area

Role of Individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Kaung Zayar (HSSE Officer), Zaw Moe Aung (HSSE Manager).

Sembcorp Myingyan Power Company Limited

ESMP Checklist for March 2026

Workers Occupational Health and Safety Control measure implementation & monitoring checklist (Operational Phase)

No.	Description	Yes	No	Details of Observation / Location	Corrective Action to be Taken	Action taken date	Verified by
1	Is the HSE policy authorized by company top management and communicated to the persons working under the control of organization?	Yes		QHSE policy has signed by company top management and displayed in all the HSSE notice boards, all meeting rooms and attached in SIC training as well.	Nil	Done	Zaw/Tin/ Kaung
2	Are personnel working under the organization comply with safe working practices to prevent from OHS risk associated to the activities. Are Permit-To-Work system implemented by the Plant such as Hot-work, working at height, lifting operation, Excavation and Confined space work, etc.?	Yes		Implemented Permit to work system.	Nil	Done	Zaw/Tin/ Kaung
3	Are trainings and consultation program for workers who involved in high risk activities conducted by the O&M and Contractors?	Yes		Workers are trained for safe work procedures. Risk assessment conducted for all work activities. Toolbox talk conducted prior to commencing work activity. Conduct Emergency response awareness according to SIC.	Nil	Done	Zaw/Tin/ Kaung
4	Are HSSE meetings conducted accordingly, such as Daily HSE and O&M meeting, Tool box meeting, HSSE Committee meeting, etc.?	Yes		Conducting daily HSE and O&M meeting. Conducting daily Permit to Work Meeting. Monthly HSSE Committee meeting in first week of September 2025.	Nil	Done	Zaw/Tin/ Kaung
5	Are all the near-miss, incidents, accidents, and occupational diseases, dangerous occurrence at the project activity area, plant and workers camp investigated and reported?	Yes		Nil	Nil	Done	Zaw/Tin/ Kaung
6	In-house rules are implemented and monitoring for the compliances.	Yes		12 life-saving rules are implemented and displayed at strategic locations. Stop Data Pro platform is used to report unsafe condition and unsafe act and to take corrective actions.	Nil	Done	Zaw/Tin/ Kaung

7	Is HSE promotional activities for workforce implemented by Plant Management?	Yes		Incentive awards giving out for HSSE observation submission and Life Saving Rule safety quiz. DuPont (STOP observation)	Nil	Done	Zaw/Tin/ Kaung
8	Is there implemented procedure on evaluation, selection and control of sub-contractor? Is the daily monitoring on labor and working condition conducted by contractor, especially, no child and forced labor will be employed by contractors?	Yes		Safe Working Procedure for Contractor Management and Contractor Requirement has been implemented.	Nil	Done	Zaw/Tin/ Kaung
9	Is there implemented HSE inspection program and documented?	Yes		Weekly management site-walk inspection conducted and documented accordingly.	Nil	Done	Zaw/Tin/ Kaung
10	Are equipment, electrical tools, machineries, lifting gears, and scaffold inspected by competent personnel?	Yes		Inspected by appointed inspector before task.	Nil	Done	Zaw/Tin/ Kaung
11	Are Method Statements, Risk Assessments & Safe Work Procedures complying with required work activities that will be potential harm to workforce?	Yes		PTW attached with MS and RA are required to be approved before tasks.	Nil	Done	Zaw/Tin/ Kaung
12	Is there any form of control on movement of hazardous substances such as chemicals? Any PPEs compliance on handling of such chemicals?	Yes		Hazardous substances are controlled by complying with safe handling and storage of chemical procedures. Workers are mandatory to comply with PPEs requirement as stated in SDS.	Nil	Done	Zaw/Tin/ Kaung
13	Are firefighting equipment's provided and inspected/tested regularly? Any damaged firefighting equipment replaced timely?	Yes		Inspecting monthly and damaged are replaced timely if any.	Nil	Done	Zaw/Tin/ Kaung
14	Pre-employment medical check and routine health screen conducted? Annual audiometric test conducted for the persons working under the organization?	Yes		Pre-employment medical check is carried out for all new hires. Annual audiometric was conducted in May 2025	Nil	Done	Zaw/Tin/ Kaung

Date/Time: 30 March 2026

Location: Plant area

Role of Individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Kaung Zayar (HSSE Officer), Zaw Moe Aung (HSSE Manager).

Sembcorp Myingyan Power Co., Limited.

ESMP- Surface Water Management Monitoring Check List
(Oct 2025 ~ Mar 2026)

Sembcorp Myingyan Power Company Limited
ESMP Checklist for October 2025

Surface Water Management Monitoring Checklist Form (Operational Phase)

S/N	Description	Yes	No	Details of Observation	Action to be Taken	Action taken date	Verified by
1	Treated by oil/water separators before discharge to central monitoring basin (CMB)	Yes		Oil/Water separator is functioning according to design.	Nil	Done	Zaw/Tin/Thet
2	Implement adequate sanitary facilities for onsite personnel.	Yes		Provided sufficient facility.	Nil	Done	Zaw/Tin/Thet
3	Liquid effluents arising from operations will be treated to the applicable IFC guideline prior to discharge. The sewage from the entire plant area will be collected and treated in a sewage treatment plant (STP). No untreated sewage will be directly discharged into the Ayeyarwady River, or disposed of on land, for the duration of the project life cycle.	Yes		STP is available at site.	Nil	Done	Zaw/Tin/Thet
4	Wastewater collected from canteen kitchens, including that from basins, sinks and floor drains, should be discharged into sanitary sewers via grease traps. The sanitary sewer should then be treated prior to discharge or reuse as greywater.	Yes		All basins including pantry room are all routed to sewage treatment plant.	Nil	Done	Zaw/Tin/Thet
5	Conduct monitoring of wastewater discharge point at Ayeyarwady River (Seik Nyan Pumping Station) frequency of once every quarterly.	Yes		Quarterly Water Quality Monitoring has been conducted by 3rd Party Lab. Will be conducted in June 2025 as per planned schedule.	Nil	Ongoing	Zaw/Tin/Thet
6	Implement discharge system shutdown in event that discharge temperature of effluent exceeds standard.	Yes		Discharge valve is controlled by automated system and will not be opened if the effluent exceeds standard.	Nil	Done	Zaw/Tin/Thet
7	Implement Awareness program to workforce? (i.e. ESMP Awareness Training to Staff)	Yes		ESMP Awareness Training to Staff is planned to conduct in October 2025.	Nil	Done	Zaw/Tin/Thet
8	Store and handle all hazardous substances in accordance with their SDS and readily accessible for reference.	Yes		SDS for all chemicals are displayed at local sites and stored as digital copies for reference.	Nil	Done	Zaw/Tin/Thet

Date / Time: 30 October 2025

Location: Operation area

Role of Individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Thet Nyi Nyi Shwe (HSSE Officer) and Zaw Moe Aung (HSSE Manager)

Sembcorp Myingyan Power Company Limited

ESMP Checklist for November 2025

Surface Water Management Monitoring Checklist Form (Operational Phase)

S/N	Description	Yes	No	Details of Observation	Action to be Taken	Action taken date	Verified by
1	Treated by oil/water separators before discharge to central monitoring basin (CMB)	Yes		Oil/Water separator is functioning according to design.	Nil	Done	Zaw/Tin/Thet
2	Implement adequate sanitary facilities for onsite personnel.	Yes		Provided sufficient facility.	Nil	Done	Zaw/Tin/Thet
3	Liquid effluents arising from operations will be treated to the applicable IFC guideline prior to discharge. The sewage from the entire plant area will be collected and treated in a sewage treatment plant (STP). No untreated sewage will be directly discharged into the Ayeyarwady River, or disposed of on land, for the duration of the project life cycle.	Yes		STP is available at site.	Nil	Done	Zaw/Tin/Thet
4	Wastewater collected from canteen kitchens, including that from basins, sinks and floor drains, should be discharged into sanitary sewers via grease traps. The sanitary sewer should then be treated prior to discharge or reuse as greywater.	Yes		All basins including pantry room are all routed to sewage treatment plant.	Nil	Done	Zaw/Tin/Thet
5	Conduct monitoring of wastewater discharge point at Ayeyarwady River (Seik Nyan Pumping Station) frequency of once every quarterly.	Yes		Quarterly Water Quality Monitoring has been conducted by 3rd Party Lab. Will be conducted in June 2025 as per planned schedule.	Nil	Ongoing	Zaw/Tin/Thet
6	Implement discharge system shutdown in event that discharge temperature of effluent exceeds standard.	Yes		Discharge valve is controlled by automated system and will not be opened if the effluent exceeds standard.	Nil	Done	Zaw/Tin/Thet
7	Implement Awareness program to workforce? (i.e. ESMP Awareness Training to Staff)	Yes		ESMP Awareness Training to Staff is planned to conduct in October 2025.	Nil	Done	Zaw/Tin/Thet
8	Store and handle all hazardous substances in accordance with their SDS and readily accessible for reference.	Yes		SDS for all chemicals are displayed at local sites and stored as digital copies for reference.	Nil	Done	Zaw/Tin/Thet

Date / Time: 30 November 2025

Location: Operation area

Role of Individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Thet Nyi Nyi Shwe (HSSE Officer) and Zaw Moe Aung (HSSE Manager)

Sembcorp Myingyan Power Company Limited

ESMP Checklist for December 2025

Surface Water Management Monitoring Checklist Form (Operational Phase)

S/N	Description	Yes	No	Details of Observation	Action to be Taken	Action taken date	Verified by
1	Treated by oil/water separators before discharge to central monitoring basin (CMB)	Yes		Oil/Water separator is functioning according to design.	Nil	Done	Zaw/Tin/Thet
2	Implement adequate sanitary facilities for onsite personnel.	Yes		Provided sufficient facility.	Nil	Done	Zaw/Tin/Thet
3	Liquid effluents arising from operations will be treated to the applicable IFC guideline prior to discharge. The sewage from the entire plant area will be collected and treated in a sewage treatment plant (STP). No untreated sewage will be directly discharged into the Ayeyarwady River, or disposed of on land, for the duration of the project life cycle.	Yes		STP is available at site.	Nil	Done	Zaw/Tin/Thet
4	Wastewater collected from canteen kitchens, including that from basins, sinks and floor drains, should be discharged into sanitary sewers via grease traps. The sanitary sewer should then be treated prior to discharge or reuse as greywater.	Yes		All basins including pantry room are all routed to sewage treatment plant.	Nil	Done	Zaw/Tin/Thet
5	Conduct monitoring of wastewater discharge point at Ayeyarwady River (Seik Nyan Pumping Station) frequency of once every quarterly.	Yes		Quarterly Water Quality Monitoring has been conducted by 3rd Party Lab in June. Will be conducted in September 2025 as per planned schedule.	Nil	Ongoing	Zaw/Tin/Thet
6	Implement discharge system shutdown in event that discharge temperature of effluent exceeds standard.	Yes		Discharge valve is controlled by automated system and will not be opened if the effluent exceeds standard.	Nil	Done	Zaw/Tin/Thet
7	Implement Awareness program to workforce? (i.e. ESMP Awareness Training to Staff)	Yes		ESMP Awareness Training to Staff is planned to conduct in October 2025.	Nil	Done	Zaw/Tin/Thet
8	Store and handle all hazardous substances in accordance with their SDS and readily accessible for reference.	Yes		SDS for all chemicals are displayed at local sites and stored as digital copies for reference.	Nil	Done	Zaw/Tin/Thet

Date / Time: 30 December 2025

Location: Operation area

Role of Individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Kaung Zayar (HSSE Officer) and Zaw Moe Aung (HSSE Manager)

Sembcorp Myingyan Power Company Limited

ESMP Checklist for January 2026

Surface Water Management Monitoring Checklist Form (Operational Phase)

S/N	Description	Yes	No	Details of Observation	Action to be Taken	Action taken date	Verified by
1	Treated by oil/water separators before discharge to central monitoring basin (CMB)	Yes		Oil/Water separator is functioning according to design.	Nil	Done	Zaw/Tin/Kaung
2	Implement adequate sanitary facilities for onsite personnel.	Yes		Provided sufficient facility.	Nil	Done	Zaw/Tin/ Kaung
3	Liquid effluents arising from operations will be treated to the applicable IFC guideline prior to discharge. The sewage from the entire plant area will be collected and treated in a sewage treatment plant (STP). No untreated sewage will be directly discharged into the Ayeyarwady River, or disposed of on land, for the duration of the project life cycle.	Yes		STP is available at site.	Nil	Done	Zaw/Tin/ Kaung
4	Wastewater collected from canteen kitchens, including that from basins, sinks and floor drains, should be discharged into sanitary sewers via grease traps. The sanitary sewer should then be treated prior to discharge or reuse as greywater.	Yes		All basins including pantry room are all routed to sewage treatment plant.	Nil	Done	Zaw/Tin/ Kaung
5	Conduct monitoring of wastewater discharge point at Ayeyarwady River (Seik Nyan Pumping Station) frequency of once every quarterly.	Yes		Quarterly Water Quality Monitoring was conducted by 3rd Party Lab in June. Will be conducted in September 2025 as per planned schedule.	Nil	Ongoing	Zaw/Tin/ Kaung
6	Implement discharge system shutdown in event that discharge temperature of effluent exceeds standard.	Yes		Discharge valve is controlled by automated system and will not be opened if the effluent exceeds standard.	Nil	Done	Zaw/Tin/ Kaung
7	Implement Awareness program to workforce? (i.e. ESMP Awareness Training to Staff)	Yes		ESMP Awareness Training to Staff is planned to conduct in October 2025.	Nil	Done	Zaw/Tin/ Kaung
8	Store and handle all hazardous substances in accordance with their SDS and readily accessible for reference.	Yes		SDS for all chemicals are displayed at local sites and stored as digital copies for reference.	Nil	Done	Zaw/Tin/ Kaung

Date / Time: 31 January 2026

Location: Operation area

Role of Individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Kaung Zayar (HSSE Officer) and Zaw Moe Aung (HSSE Manager)

Sembcorp Myingyan Power Company Limited

ESMP Checklist for February 2026

Surface Water Management Monitoring Checklist Form (Operational Phase)

S/N	Description	Yes	No	Details of Observation	Action to be Taken	Action taken date	Verified by
1	Treated by oil/water separators before discharge to central monitoring basin (CMB)	Yes		Oil/Water separator is functioning according to design.	Nil	Done	Zaw/Tin/ Kaung
2	Implement adequate sanitary facilities for onsite personnel.	Yes		Provided sufficient facility.	Nil	Done	Zaw/Tin/ Kaung
3	Liquid effluents arising from operations will be treated to the applicable IFC guideline prior to discharge. The sewage from the entire plant area will be collected and treated in a sewage treatment plant (STP). No untreated sewage will be directly discharged into the Ayeyarwady River, or disposed of on land, for the duration of the project life cycle.	Yes		STP is available at site.	Nil	Done	Zaw/Tin/ Kaung
4	Wastewater collected from canteen kitchens, including that from basins, sinks and floor drains, should be discharged into sanitary sewers via grease traps. The sanitary sewer should then be treated prior to discharge or reuse as greywater.	Yes		All basins including pantry room are all routed to sewage treatment plant.	Nil	Done	Zaw/Tin/ Kaung
5	Conduct monitoring of wastewater discharge point at Ayeyarwady River (Seik Nyan Pumping Station) frequency of once every quarterly.	Yes		Quarterly Water Quality Monitoring was conducted by 3rd Party Lab in June. Will be conducted in September 2025 as per planned schedule.	Nil	Ongoing	Zaw/Tin/ Kaung
6	Implement discharge system shutdown in event that discharge temperature of effluent exceeds standard.	Yes		Discharge valve is controlled by automated system and will not be opened if the effluent exceeds standard.	Nil	Done	Zaw/Tin/ Kaung
7	Implement Awareness program to workforce? (i.e. ESMP Awareness Training to Staff)	Yes		ESMP Awareness Training to Staff is planned to conduct in October 2025.	Nil	Done	Zaw/Tin/ Kaung
8	Store and handle all hazardous substances in accordance with their SDS and readily accessible for reference.	Yes		SDS for all chemicals are displayed at local sites and stored as digital copies for reference.	Nil	Done	Zaw/Tin/ Kaung

Date / Time: 28 February2025

Location: Operation area

Role of Individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Kaung Zayar (HSSE Officer) and Zaw Moe Aung (HSSE Manager)

Sembcorp Myingyan Power Company Limited

ESMP Checklist for March 2026

Surface Water Management Monitoring Checklist Form (Operational Phase)

S/N	Description	Yes	No	Details of Observation	Action to be Taken	Action taken date	Verified by
1	Treated by oil/water separators before discharge to central monitoring basin (CMB)	Yes		Oil/Water separator is functioning according to design.	Nil	Done	Zaw/Tin/ Kaung
2	Implement adequate sanitary facilities for onsite personnel.	Yes		Provided sufficient facility.	Nil	Done	Zaw/Tin/ Kaung
3	Liquid effluents arising from operations will be treated to the applicable IFC guideline prior to discharge. The sewage from the entire plant area will be collected and treated in a sewage treatment plant (STP). No untreated sewage will be directly discharged into the Ayeyarwady River, or disposed of on land, for the duration of the project life cycle.	Yes		STP is available at site.	Nil	Done	Zaw/Tin/ Kaung
4	Wastewater collected from canteen kitchens, including that from basins, sinks and floor drains, should be discharged into sanitary sewers via grease traps. The sanitary sewer should then be treated prior to discharge or reuse as greywater.	Yes		All basins including pantry room are all routed to sewage treatment plant.	Nil	Done	Zaw/Tin/ Kaung
5	Conduct monitoring of wastewater discharge point at Ayeyarwady River (Seik Nyan Pumping Station) frequency of once every quarterly.	Yes		Quarterly Water Quality Monitoring was conducted by 3rd Party Lab in September. Will be conducted in December 2025 as per planned schedule.	Nil	Ongoing	Zaw/Tin/ Kaung
6	Implement discharge system shutdown in event that discharge temperature of effluent exceeds standard.	Yes		Discharge valve is controlled by automated system and will not be opened if the effluent exceeds standard.	Nil	Done	Zaw/Tin/ Kaung
7	Implement Awareness program to workforce? (i.e. ESMP Awareness Training to Staff)	Yes		ESMP Awareness Training to Staff is planned to conduct in October 2025.	Nil	Done	Zaw/Tin/ Kaung
8	Store and handle all hazardous substances in accordance with their SDS and readily accessible for reference.	Yes		SDS for all chemicals are displayed at local sites and stored as digital copies for reference.	Nil	Done	Zaw/Tin/ Kaung

Date / Time: 30 March 2025

Location: Operation area

Role of Individual Undertaking Monitoring: Tin Ko Ko (HSSE Officer), Kaung Zayar (HSSE Officer) and Zaw Moe Aung (HSSE Manager)

Sembcorp Myingyan Power Co., Limited.

ESMP- Waste (Hazardous/ Non-Hazardous) Management Monitoring Check List (Oct 2025 ~ Mar 2026)

ESMP Checklist for October 2025

Waste (Hazardous and Non-Hazardous) Management Monitoring Checklist Form (Operational Phase)

S/No	Description	Yes	No	Details of Observation / Location	Action to be Taken	Action Taken date	Verified by
1	What kinds of waste are generated are identified (by waste category)?	Yes		Hazardous and non-hazardous wastes are generated and segregated.	Nil	Done	Zaw/Tin/Thet
2	Are waste data records managed in accordance with the requirements?	Yes		Waste disposal data are recorded.	Nil	Done	Zaw/Tin/Thet
3	Is the waste stored in a way that does not adversely affect human health and the environment?	Yes		Stored in accordance with Hazardous and non-hazardous waste management procedure.	Nil	Done	Zaw/Tin/Thet
4	Is the waste storage site in accordance with environmental requirements?	Yes		Stored in covered waste bin and designated storage area.	Nil	Done	Zaw/Tin/Thet
5	Are hazardous wastes stored in accordance with the requirements?	Yes		Stored in designated area in accordance with Hazardous and non-hazardous waste management procedure.	Nil	Done	Zaw/Tin/Thet
6	Is the packaging Junked/ labelled with information on the origin of materials used?	Yes		Wastes containers are Junked/labelled with information of the origin of materials used.	Nil	Done	Zaw/Tin/Thet
7	Are waste clean-up measures being undertaken on regular basis?	Yes		Regular mass housekeeping conducted on every Friday. Cleaners are assigned at locations and undertaking proper clean-up of wastes with the schedule planned.	Nil	Done	Zaw/Tin/Thet
8	Are workers being trained on the requirements mentioned in this plan in accordance with the Workers Training Plan?	Yes		ESMP Training will be conducted to all staffs in October 2025.	Nil	Ongoing	Zaw/Tin/Thet

Date / Time: 30 October 2025

Location: Operation area

Role of Individual Undertaking Monitoring: HSSE and Operation Team

Sembcorp Myingyan Power Company Limited

ESMP Checklist for November 2025

Waste (Hazardous and Non-Hazardous) Management Monitoring Checklist Form (Operational Phase)

S/No	Description	Yes	No	Details of Observation / Location	Action to be Taken	Action Taken date	Verified by
1	What kinds of waste are generated are identified (by waste category)?	Yes		Hazardous and non-hazardous wastes are generated and segregated.	Nil	Done	Zaw/Tin/Thet
2	Are waste data records managed in accordance with the requirements?	Yes		Waste disposal data are recorded.	Nil	Done	Zaw/Tin/Thet
3	Is the waste stored in a way that does not adversely affect human health and the environment?	Yes		Stored in accordance with Hazardous and non-hazardous waste management procedure.	Nil	Done	Zaw/Tin/Thet
4	Is the waste storage site in accordance with environmental requirements?	Yes		Stored in covered waste bin and designated storage area.	Nil	Done	Zaw/Tin/Thet
5	Are hazardous wastes stored in accordance with the requirements?	Yes		Stored in designated area in accordance with Hazardous and non-hazardous waste management procedure.	Nil	Done	Zaw/Tin/Thet
6	Is the packaging Junked/ labelled with information on the origin of materials used?	Yes		Wastes containers are Junked/labelled with information of the origin of materials used.	Nil	Done	Zaw/Tin/Thet
7	Are waste clean-up measures being undertaken on regular basis?	Yes		Regular mass housekeeping conducted on every Friday. Cleaners are assigned at locations and undertaking proper clean-up of wastes with the schedule planned.	Nil	Done	Zaw/Tin/Thet
8	Are workers being trained on the requirements mentioned in this plan in accordance with the Workers Training Plan?	Yes		ESMP Training will be conducted to all staffs in October 2025.	Nil	Ongoing	Zaw/Tin/Thet

Date / Time: 30 November 2025

Location: Operation area

Role of Individual Undertaking Monitoring: HSSE and Operation Team

Sembcorp Myingyan Power Company Limited

ESMP Checklist for December 2025

Waste (Hazardous and Non-Hazardous) Management Monitoring Checklist Form (Operational Phase)

S/No	Description	Yes	No	Details of Observation / Location	Action to be Taken	Action Taken date	Verified by
1	What kinds of waste are generated are identified (by waste category)?	Yes		Hazardous and non-hazardous wastes are generated and segregated.	Nil	Done	Zaw/Tin/Thet
2	Are waste data records managed in accordance with the requirements?	Yes		Waste disposal data are recorded.	Nil	Done	Zaw/Tin/Thet
3	Is the waste stored in a way that does not adversely affect human health and the environment?	Yes		Stored in accordance with Hazardous and non-hazardous waste management procedure.	Nil	Done	Zaw/Tin/Thet
4	Is the waste storage site in accordance with environmental requirements?	Yes		Stored in covered waste bin and designated storage area.	Nil	Done	Zaw/Tin/Thet
5	Are hazardous wastes stored in accordance with the requirements?	Yes		Stored in designated area in accordance with Hazardous and non-hazardous waste management procedure.	Nil	Done	Zaw/Tin/Thet
6	Is the packaging Junked/ labelled with information on the origin of materials used?	Yes		Wastes containers are Junked/labelled with information of the origin of materials used.	Nil	Done	Zaw/Tin/Thet
7	Are waste clean-up measures being undertaken on regular basis?	Yes		Regular mass housekeeping conducted on every Friday. Cleaners are assigned at locations and undertaking proper clean-up of wastes with the schedule planned.	Nil	Done	Zaw/Tin/Thet
8	Are workers being trained on the requirements mentioned in this plan in accordance with the Workers Training Plan?	Yes		ESMP Training will be conducted to all staffs in October 2025.	Nil	Ongoing	Zaw/Tin/Thet

Date / Time: 30 December 2025

Location: Operation area

Role of Individual Undertaking Monitoring: HSSE and Operation Team

Sembcorp Myingyan Power Company Limited

ESMP Checklist for January 2026

Waste (Hazardous and Non-Hazardous) Management Monitoring Checklist Form (Operational Phase)

S/No	Description	Yes	No	Details of Observation / Location	Action to be Taken	Action Taken date	Verified by
1	What kinds of waste are generated are identified (by waste category)?	Yes		Hazardous and non-hazardous wastes are generated and segregated.	Nil	Done	Zaw/Tin/ Kaung
2	Are waste data records managed in accordance with the requirements?	Yes		Waste disposal data are recorded.	Nil	Done	Zaw/Tin/ Kaung
3	Is the waste stored in a way that does not adversely affect human health and the environment?	Yes		Stored in accordance with Hazardous and non-hazardous waste management procedure.	Nil	Done	Zaw/Tin/ Kaung
4	Is the waste storage site in accordance with environmental requirements?	Yes		Stored in covered waste bin and designated storage area.	Nil	Done	Zaw/Tin/ Kaung
5	Are hazardous wastes stored in accordance with the requirements?	Yes		Stored in designated area in accordance with Hazardous and non-hazardous waste management procedure.	Nil	Done	Zaw/Tin/ Kaung
6	Is the packaging Junked/ labelled with information on the origin of materials used?	Yes		Wastes containers are Junked/labelled with information of the origin of materials used.	Nil	Done	Zaw/Tin/ Kaung
7	Are waste clean-up measures being undertaken on regular basis?	Yes		Regular mass housekeeping conducted on every Friday. Cleaners are assigned at locations and undertaking proper clean-up of wastes with the schedule planned.	Nil	Done	Zaw/Tin/ Kaung
8	Are workers being trained on the requirements mentioned in this plan in accordance with the Workers Training Plan?	Yes		ESMP Training will be conducted to all staffs in October 2025.	Nil	Ongoing	Zaw/Tin/ Kaung

Date / Time: 31 January 2026

Location: Operation area

Role of Individual Undertaking Monitoring: HSSE and Operation Team

Sembcorp Myingyan Power Company Limited

ESMP Checklist for February 2026

Waste (Hazardous and Non-Hazardous) Management Monitoring Checklist Form (Operational Phase)

S/No	Description	Yes	No	Details of Observation / Location	Action to be Taken	Action Taken date	Verified by
1	What kinds of waste are generated are identified (by waste category)?	Yes		Hazardous and non-hazardous wastes are generated and segregated.	Nil	Done	Zaw/Tin/ Kaung
2	Are waste data records managed in accordance with the requirements?	Yes		Waste disposal data are recorded.	Nil	Done	Zaw/Tin/ Kaung
3	Is the waste stored in a way that does not adversely affect human health and the environment?	Yes		Stored in accordance with Hazardous and non-hazardous waste management procedure.	Nil	Done	Zaw/Tin/ Kaung
4	Is the waste storage site in accordance with environmental requirements?	Yes		Stored in covered waste bin and designated storage area.	Nil	Done	Zaw/Tin/ Kaung
5	Are hazardous wastes stored in accordance with the requirements?	Yes		Stored in designated area in accordance with Hazardous and non-hazardous waste management procedure.	Nil	Done	Zaw/Tin/ Kaung
6	Is the packaging Junked/ labelled with information on the origin of materials used?	Yes		Wastes containers are Junked/labelled with information of the origin of materials used.	Nil	Done	Zaw/Tin/ Kaung
7	Are waste clean-up measures being undertaken on regular basis?	Yes		Regular mass housekeeping conducted on every Friday. Cleaners are assigned at locations and undertaking proper clean-up of wastes with the schedule planned.	Nil	Done	Zaw/Tin/ Kaung
8	Are workers being trained on the requirements mentioned in this plan in accordance with the Workers Training Plan?	Yes		ESMP Training will be conducted to all staffs in October 2025.	Nil	Ongoing	Zaw/Tin/ Kaung

Date / Time: 28 February 2026

Location: Operation area

Role of Individual Undertaking Monitoring: HSSE and Operation Team

Sembcorp Myingyan Power Company Limited

ESMP Checklist for March 2026

Waste (Hazardous and Non-Hazardous) Management Monitoring Checklist Form (Operational Phase)

S/No	Description	Yes	No	Details of Observation / Location	Action to be Taken	Action Taken date	Verified by
1	What kinds of waste are generated are identified (by waste category)?	Yes		Hazardous and non-hazardous wastes are generated and segregated.	Nil	Done	Zaw/Tin/ Kaung
2	Are waste data records managed in accordance with the requirements?	Yes		Waste disposal data are recorded.	Nil	Done	Zaw/Tin/ Kaung
3	Is the waste stored in a way that does not adversely affect human health and the environment?	Yes		Stored in accordance with Hazardous and non-hazardous waste management procedure.	Nil	Done	Zaw/Tin/ Kaung
4	Is the waste storage site in accordance with environmental requirements?	Yes		Stored in covered waste bin and designated storage area.	Nil	Done	Zaw/Tin/ Kaung
5	Are hazardous wastes stored in accordance with the requirements?	Yes		Stored in designated area in accordance with Hazardous and non-hazardous waste management procedure.	Nil	Done	Zaw/Tin/ Kaung
6	Is the packaging Junked/ labelled with information on the origin of materials used?	Yes		Wastes containers are Junked/labelled with information of the origin of materials used.	Nil	Done	Zaw/Tin/ Kaung
7	Are waste clean-up measures being undertaken on regular basis?	Yes		Regular mass housekeeping conducted on every Friday. Cleaners are assigned at locations and undertaking proper clean-up of wastes with the schedule planned.	Nil	Done	Zaw/Tin/ Kaung
8	Are workers being trained on the requirements mentioned in this plan in accordance with the Workers Training Plan?	Yes		ESMP Training will be conducted to all staffs in October 2025.	Nil	Ongoing	Zaw/Tin/ Kaung

Date / Time: 30 March 2026

Location: Operation area

Role of Individual Undertaking Monitoring: HSSE and Operation Team

Sembcorp Myingyan Power Co., Limited.

CSR activities report (October 2025 to March 2026)

Sembcorp Myingyan Power Company Limited

CSR Activity (October 2025 to March 2026)

No.	Date of Handover to Beneficiary	Beneficiary	Activity	Details
1	14-Oct-25	Hnan Village School, Taung Thar Township	Hnan Village School Brick Wall	Brick Wall (130ft x 6ft)
2	14-Oct-25	Phet Taw Village School, Taung Thar Township	Phet Taw Village School Brick Wall	Brick Wall (130ft x 6ft)
3	17 Oct 2025, 21 Oct 2025, 22 Oct 2025	1. Sarkhaar Village 2. Hnan Village 3. Theim Village 4. Gyoke Pin Village 5. Hta Naung Tai Village 6. Aye Village 7. Ma Yoe Kone Village 8. Tha Pyay Thar Village 9. Sate Nyan Village 10. Ka Lain Chone Village 11. Kyun U Village (Myingyan and Taung Thar Community)	Contribution Empty Clean Drums to Community	200 lit 400 pcs 25 kg 700 pcs
4	3 Months, 1st September 2025 – 28th November 2025	Hta Naung Tai Village	Basic Tailoring & Designer Training Class (Hta Naung Tai)	12 Pax (Ladies from Hta Naung Tai Village)
5	9-Dec-25	Kyun U Village School, Myingyan Township	Kyun U Village School Brick Wall	Brick Wall Fence (96ft x 6ft)
6	9-Dec-25	Sate Nyan Village School, Myingyan Township	School Toilet and Septic Tank	School Toilet (10ft x 5ft x 7ft) and Septic Tank (8ft x 5ft x 8ft)
7	24-Dec-25	Government Technical Institute Myingyan (GTI Myingyan)	Clean Energy Support to GTI Myingyan	6kW Solar System (Solar Panel, Battery, Inverter, Lightning and Earthing System)
8	27, 28 Feb 2026	1. Sarkhaar Village 2. Hnan Village 3. Phet Taw Village 4. Nyaung Kan 5. Theim Village 6. Gyoke Pin Village 7. Hta Naung Tai Village 8. Aye Village 9. Ma Yoe Kone Village 10. Tha Pyay Thar Village 11. Sate Nyan Village 12. Ka Lain Chone Village 13. Kyun U Village (Myingyan and Taung Thar Community)	Water Treatment Filter Refill and replacement service	PP 5 UM 20” 112 Pcs Chemical replacement and Installation Service

© Sembcorp Industries

Sembcorp Myingyan Power Company Limited

CSR Activity (October 2025 to March 2026)

1. Hnan Village School Brick Wall



2. Phet Taw Village School Brick Wall



© Sembcorp Industries

Sembcorp Myingyan Power Company Limited

CSR Activity (October 2025 to March 2026)

3. Contribution Empty Clean Drums to Community



4. Basic Tailoring & Designer Training Class (Hta Naung Tai)



© Sembcorp Industries

Sembcorp Myingyan Power Company Limited

CSR Activity (October 2025 to March 2026)

5. Kyun U Village School Brick Wall



6. School Toilet and Septic Tank



© Sembcorp Industries

Sembcorp Myingyan Power Company Limited

CSR Activity (October 2025 to March 2026)

7. Clean Energy Support to GTI Myingyan



8. Water Treatment Filter Refill and replacement service



© Sembcorp Industries